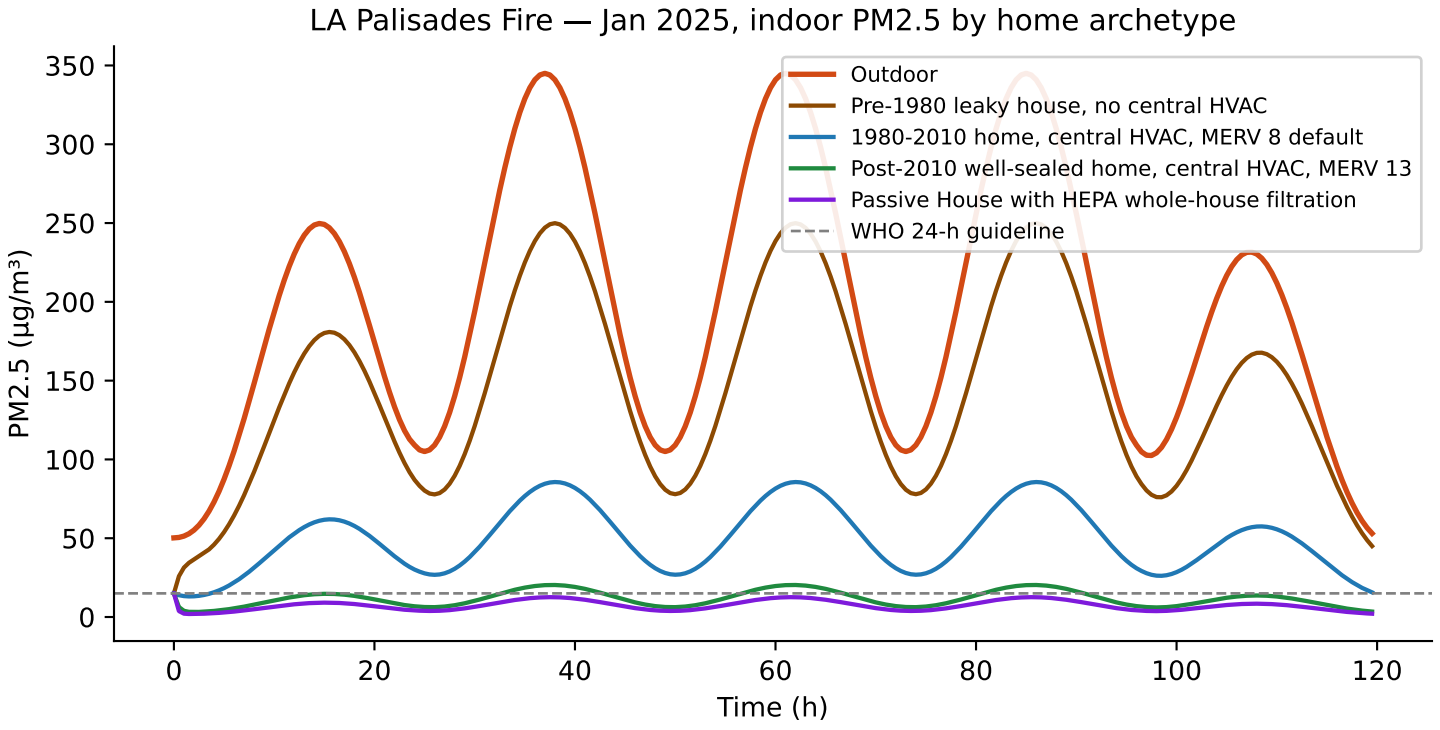
LA Palisades Fire — Jan 2025, indoor PM2.5 by home archetype
Outdoor
Pre-1980 leaky house, no central HVAC
1980-2010 home, central HVAC, MERV 8 default
Post-2010 well-sealed home, central HVAC, MERV 13
Passive House with HEPA whole-house filtration
WHO 24-h guideline
PM2.5 (µg/m³)
Time (h)
0
50
100
150
200
250
300
350
0
20
40
60
80
100
120