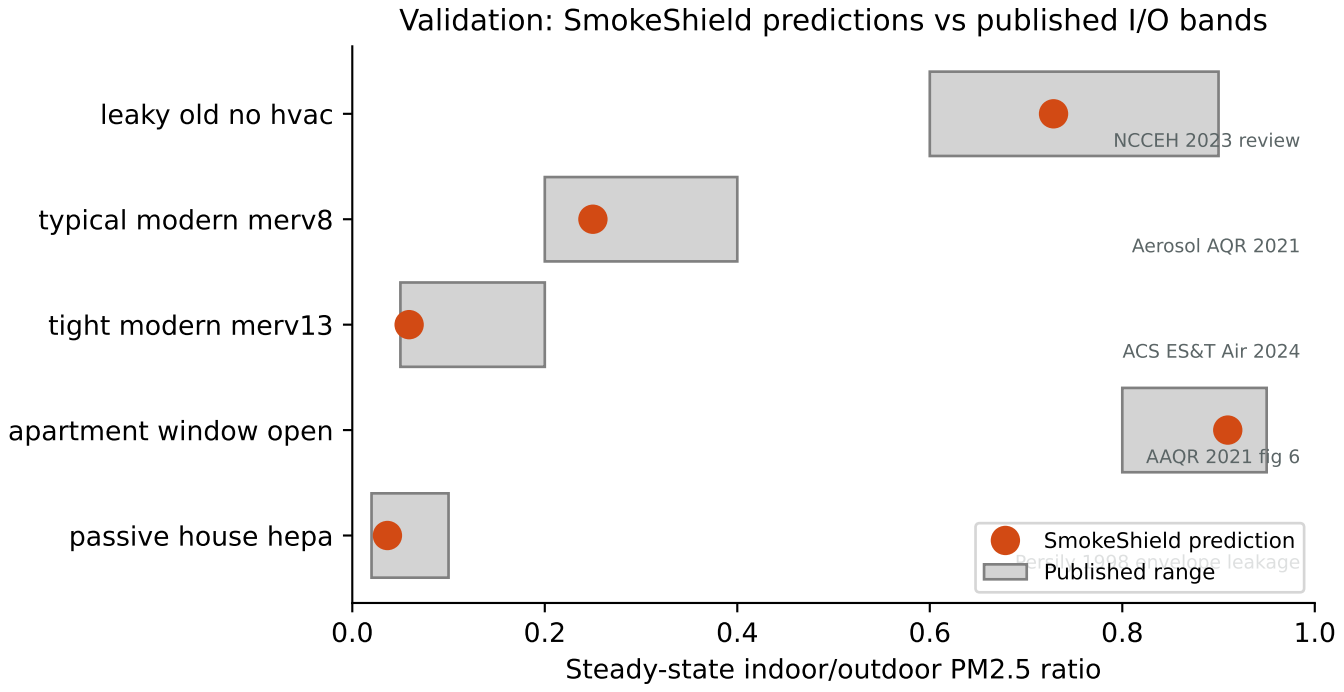
Validation: SmokeShield predictions vs published I/O bands
leaky old no hvac
typical modern merv8
tight modern merv13
apartment window open
passive house hepa
NCCEH 2023 review
Aerosol AQR 2021
ACS ES&T Air 2024
AAQR 2021 fig 6
SmokeShield prediction
Published range
0.0
0.2
0.4
0.6
0.8
1.0
Steady-state indoor/outdoor PM2.5 ratio