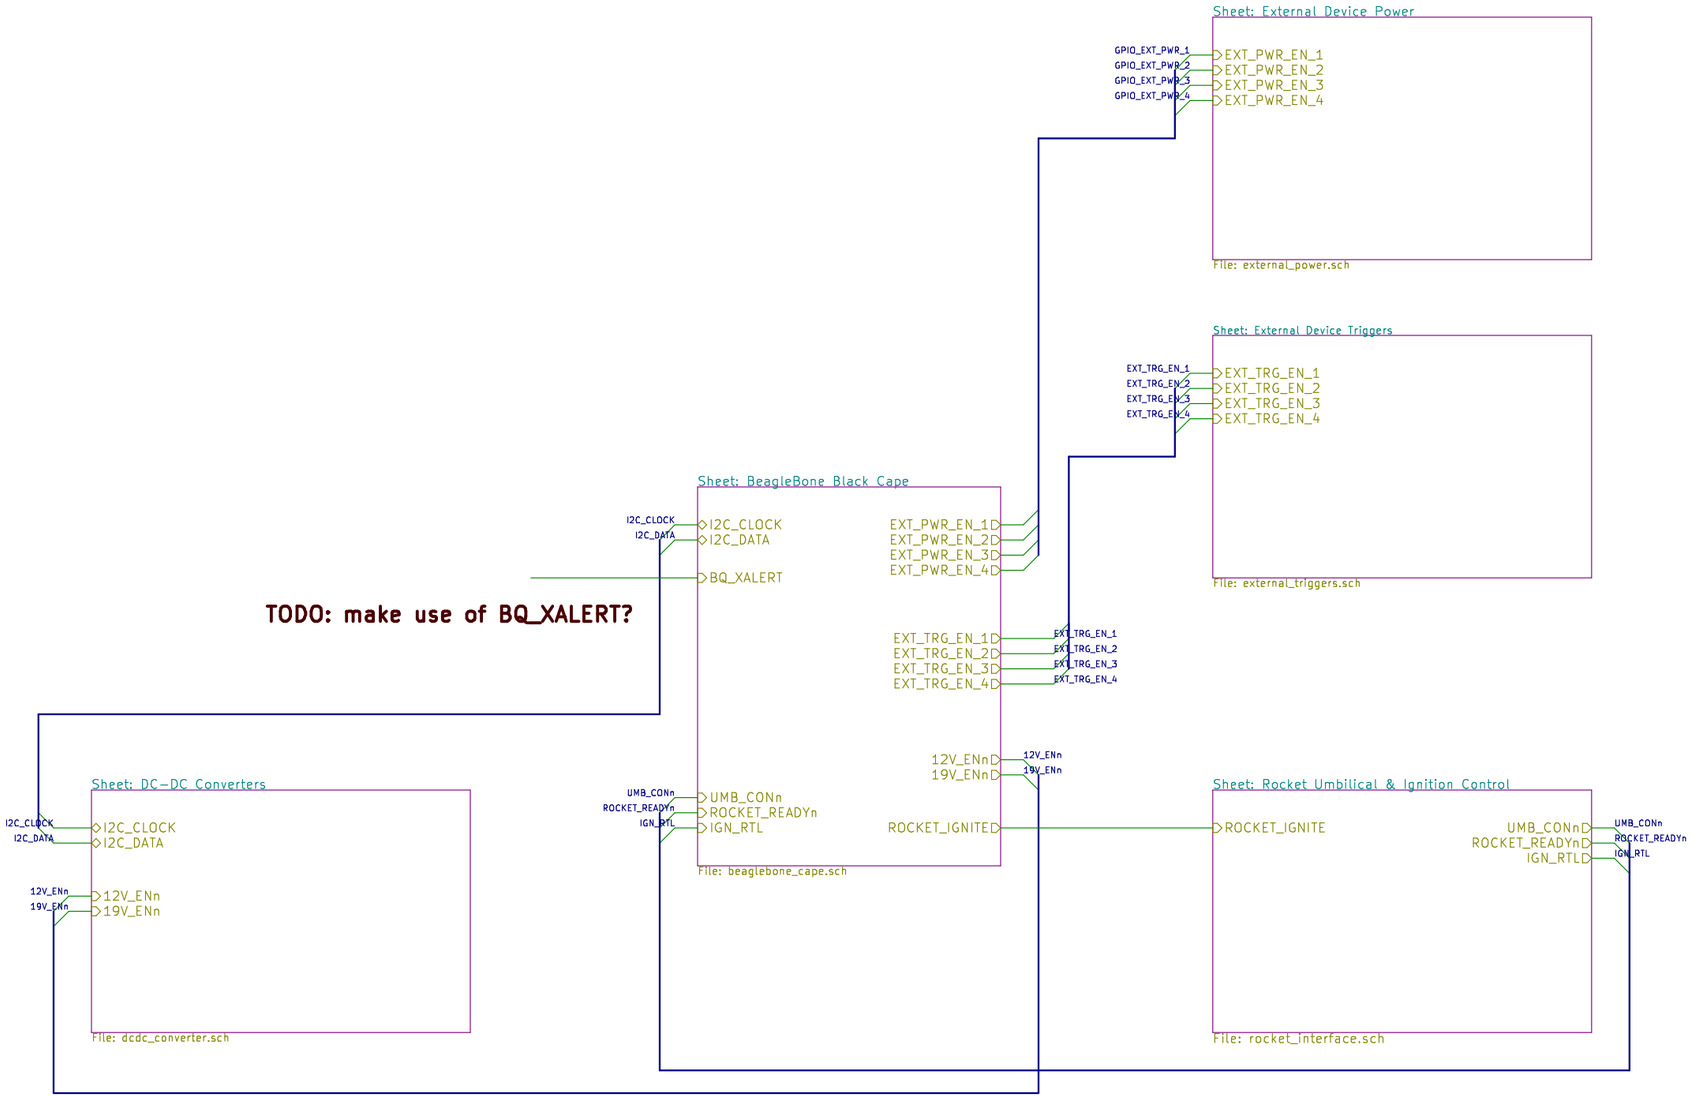

Portland State Aerospace Society <http://psas.pdx.edu/>

Sheet: /
File: LTC3.sch

Title: Launch Tower Computer 3 (LTC3)

Size: B	Date: 2016-09-03	**Rev: A**
KiCad E.D.A. kicad 4.0.2+dfsg1-stable		Id: 1/6

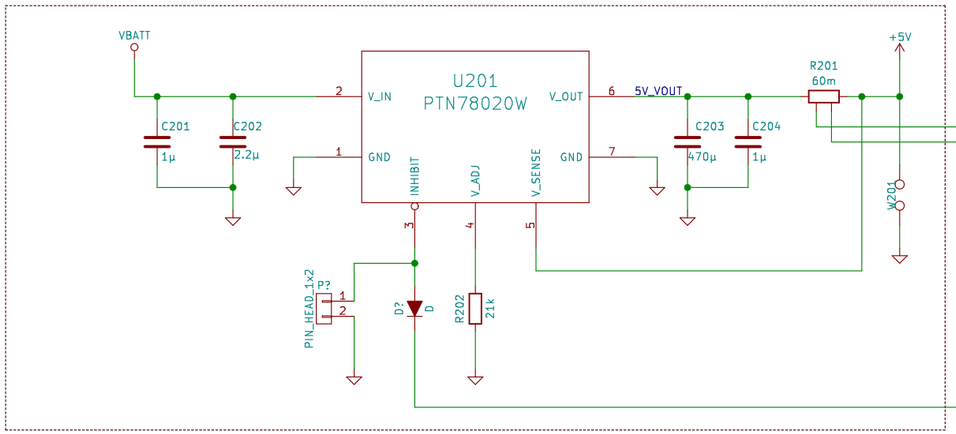

+5V DC Supply

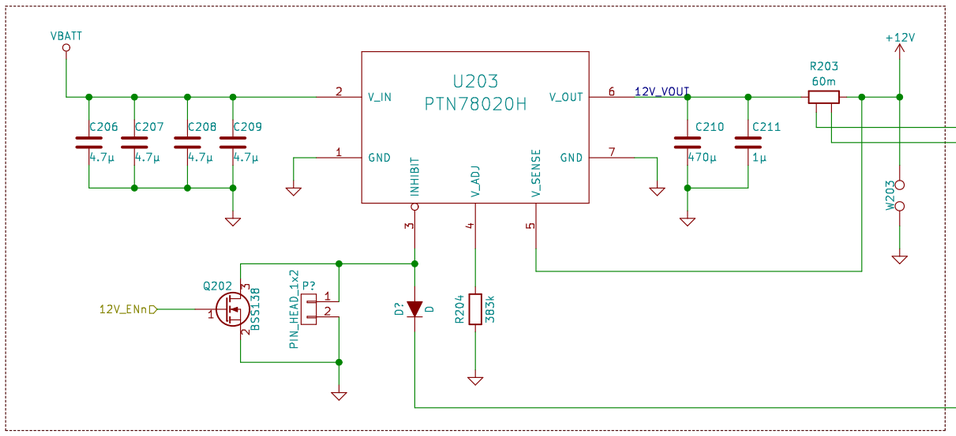

+12V DC Supply

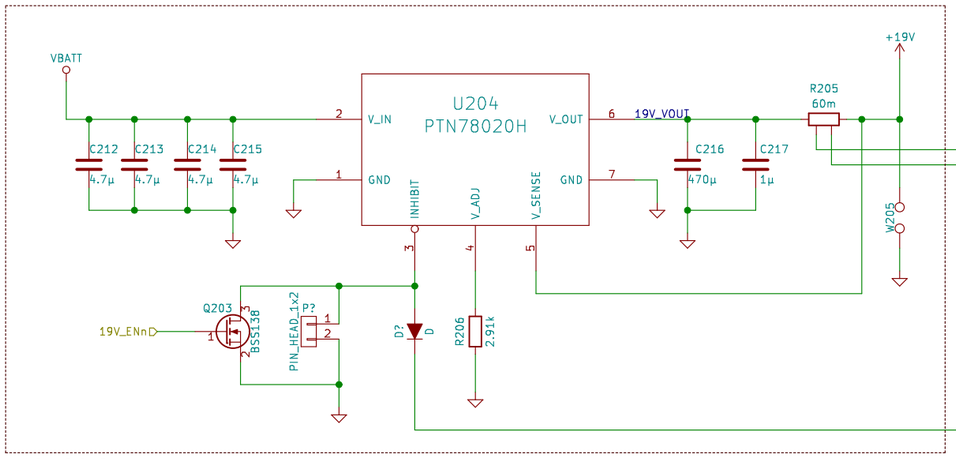

+19V DC Supply

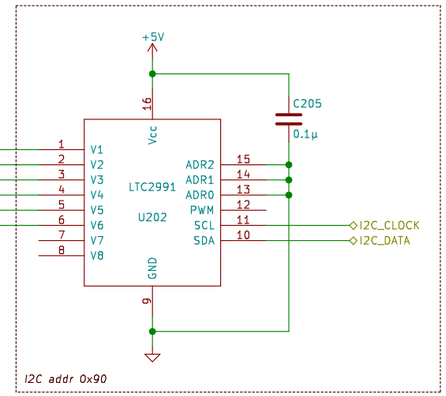

Voltage, Current, & Temp Sense

Current Sense Resistors
full-scale voltage = 0.300 V
R_sense_max = 0.300/Imax
5 A = 60mΩ



Power In



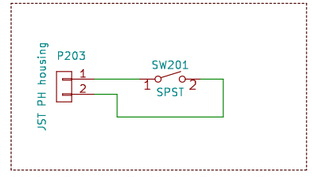

Main Power Switch, Front Panel

NOTES
1. V_sense should connect as close as possible to the largest load on the given power rail.
2. Place Rset resistors as close to package pins as possible.
3. Ceramic (Cin) capacitors should be located within 0.5 in of the input pins.
4. We may need heat sinks on the converters. The datasheet indicates a range of 2W to 5W of power dissipation given our specs.
5. Pay attention to the datasheet's recommendations regarding capacitor selection.

Portland State Aerospace Society <http://psas.pdx.edu/>		
Sheet: /DC-DC Converters/		
File: dcdc_converter.sch		
Title: LTC3 DC-DC Converters		
Size: B	Date: 2016-09-03	Rev: A
KiCad E.D.A. kicad 4.0.2+dfsg1-stable		Id: 2/6

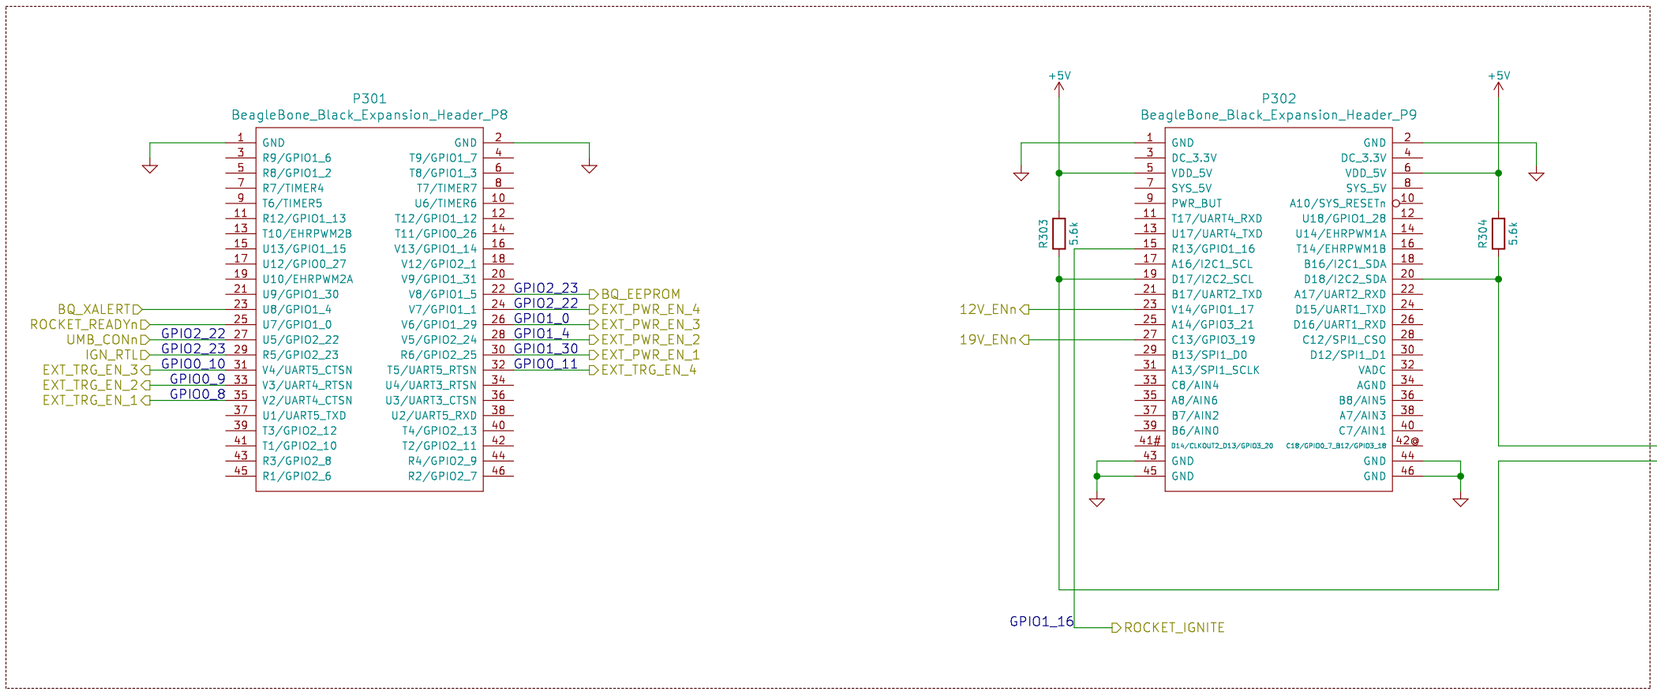

BeagleBone Expansion Headers

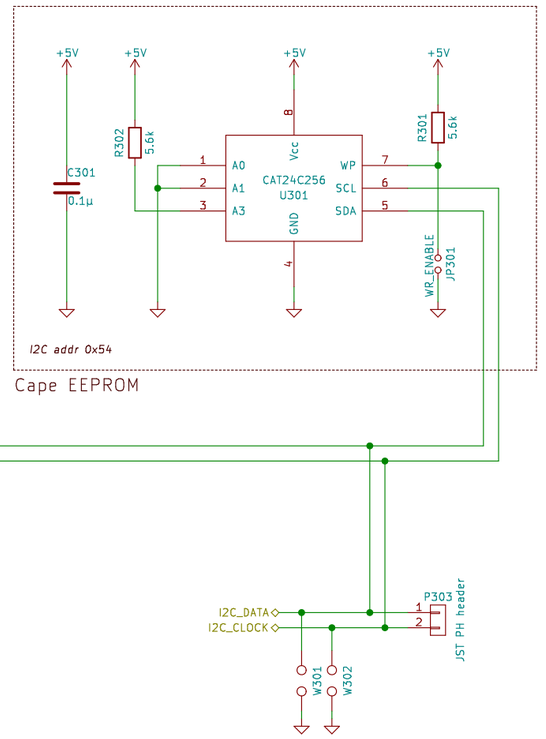

Cape EEPROM

I2C Devices

ADDR	Part	Type	Location
0x10	U203	BQ77PL900	B/PM
0x54	U501	EEPROM	BBB
0x90	U402	LTC2991	DC-DC
0x98	U203	LTC2990	Power In
0x9A	U301	LTC2990	B/PM

NOTES:
* Do NOT change ROCKET_IGNITE, pin default reset state is High-Z w/ pulldown resistor. Other pins can be configured in EEPROM at boot time.
* All I2C devices on LTC3 are slaves. The BBB is the only master so the LTC will not need arbitration.

Portland State Aerospace Society <http://psas.pdx.edu/>

Sheet: /BeagleBone Black Cape/
File: beaglebone_cape.sch

Title: LTC3 BeagleBone Black Cape Interface

Size: B	Date: 2016-09-03	**Rev: A**
KiCad E.D.A. kicad 4.0.2+dfsg1-stable		Id: 3/6

Circuit keeps ignition battery pack disconnected until
flight computer has asserted ROCKET_READY and
19 VDC rail (shore power) has been shut off.

Input Logic

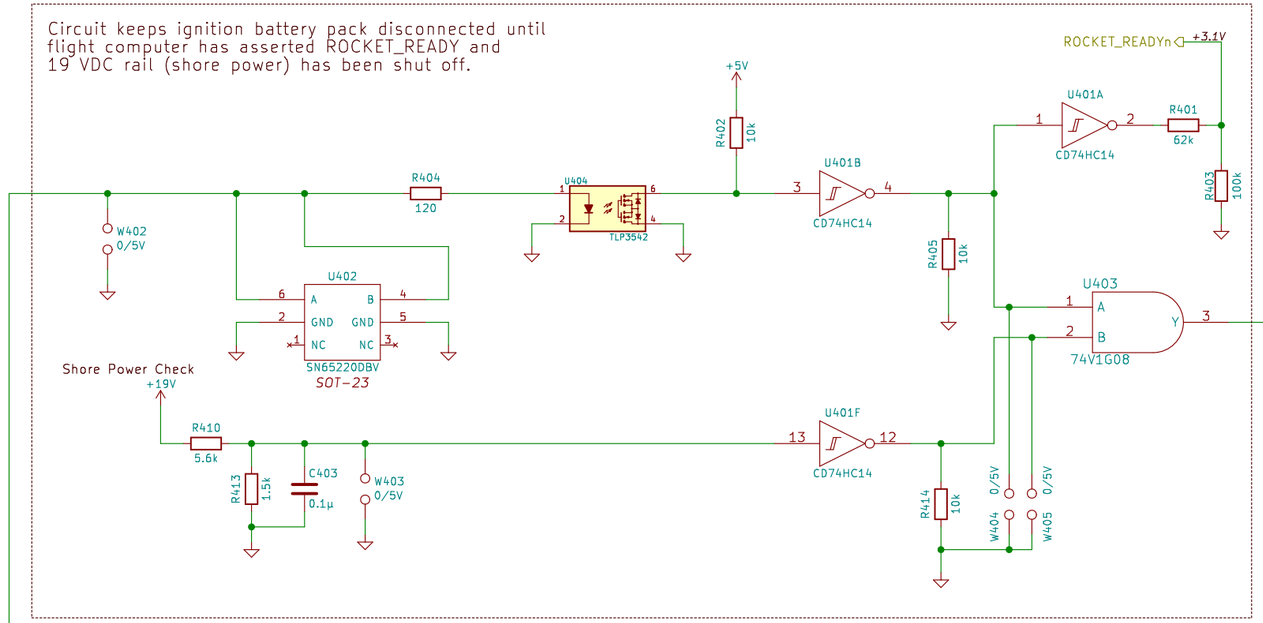

Delay (5s)

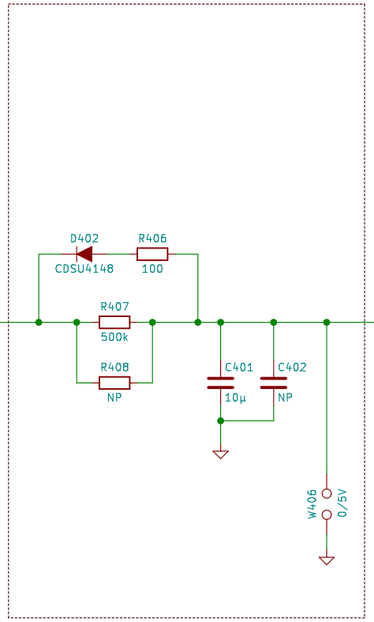

Ignition Battery Relay

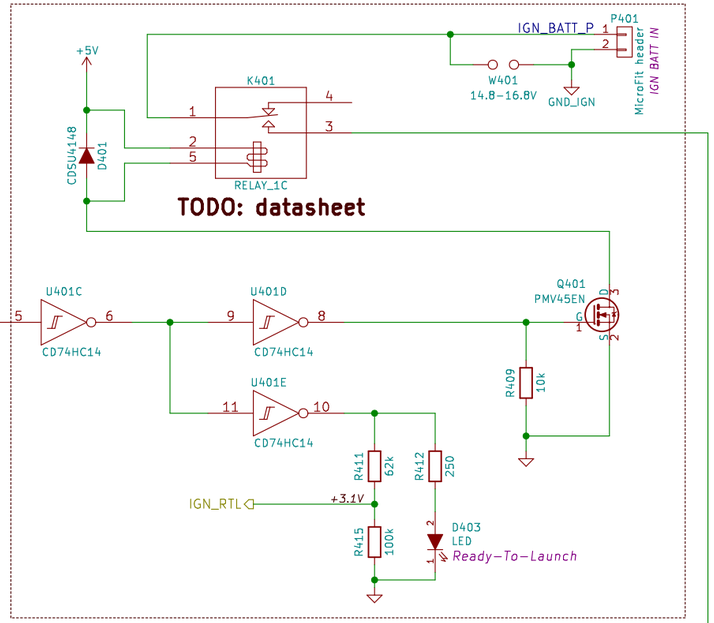

Rocket Umbilical

Rocket-to-BeagleBone Ethernet

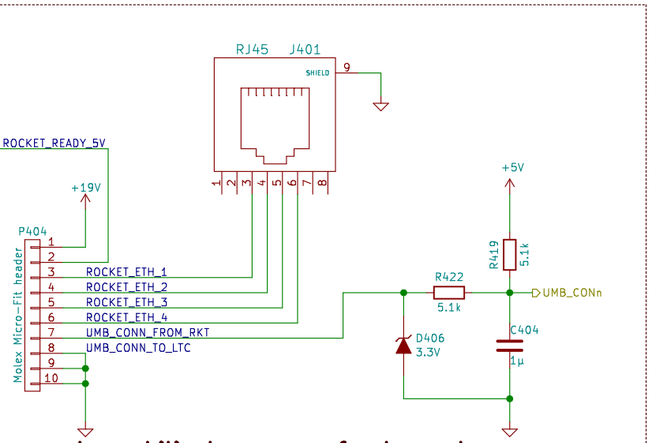

TODO: conn. to umbilical conn. on front panel

VCC for CD74HC14



Bypass Capacitors (one per IC VCC)



BAKERCON Hazard Gauge

(super-bright LEDs, exterior panel)

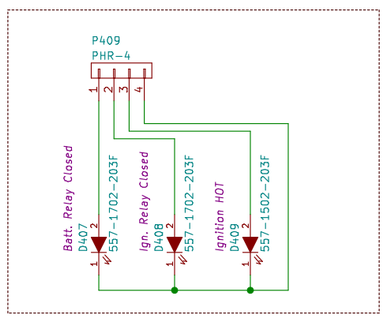

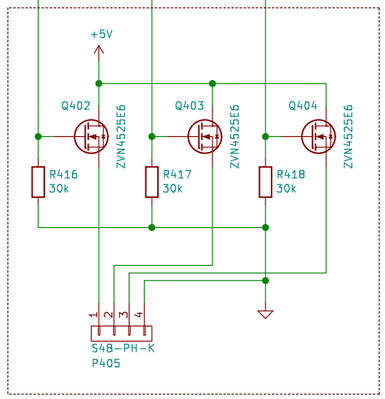

Rocket Ignition Relay

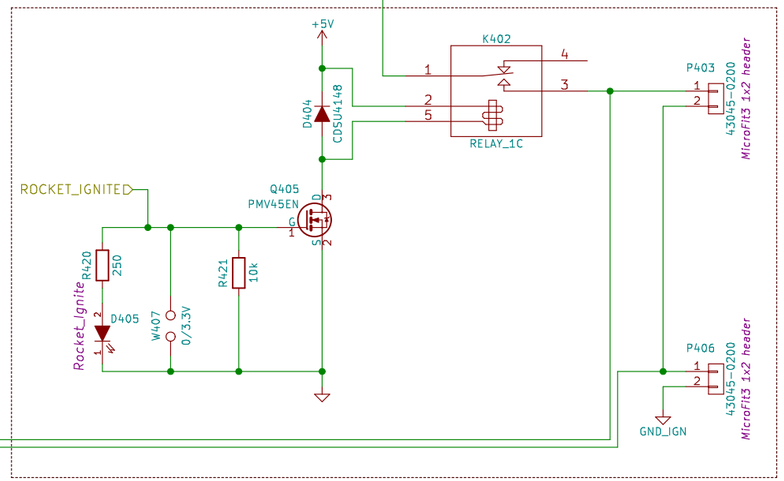

Breaker, Arm Switch, Shorting Bar, & Ignition Connector

(front panel)

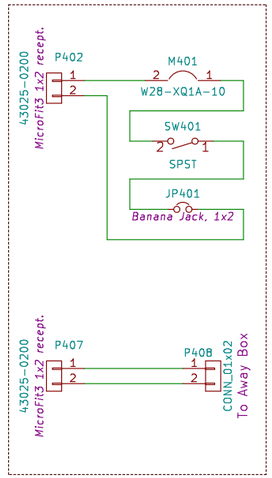

TODO: find out if Dialight 557 LED indicators require current-limiting resistor

Portland State Aerospace Society <http://psas.pdx.edu/>

Sheet: /Rocket Umbilical & Ignition Control/
File: rocket_interface.sch

Title: LTC3 Rocket Umbilical & Ignition Control

Size: B	Date: 2016-09-03	Rev: A
KiCad E.D.A. kicad 4.0.2+dfsg1-stable		Id: 4/6

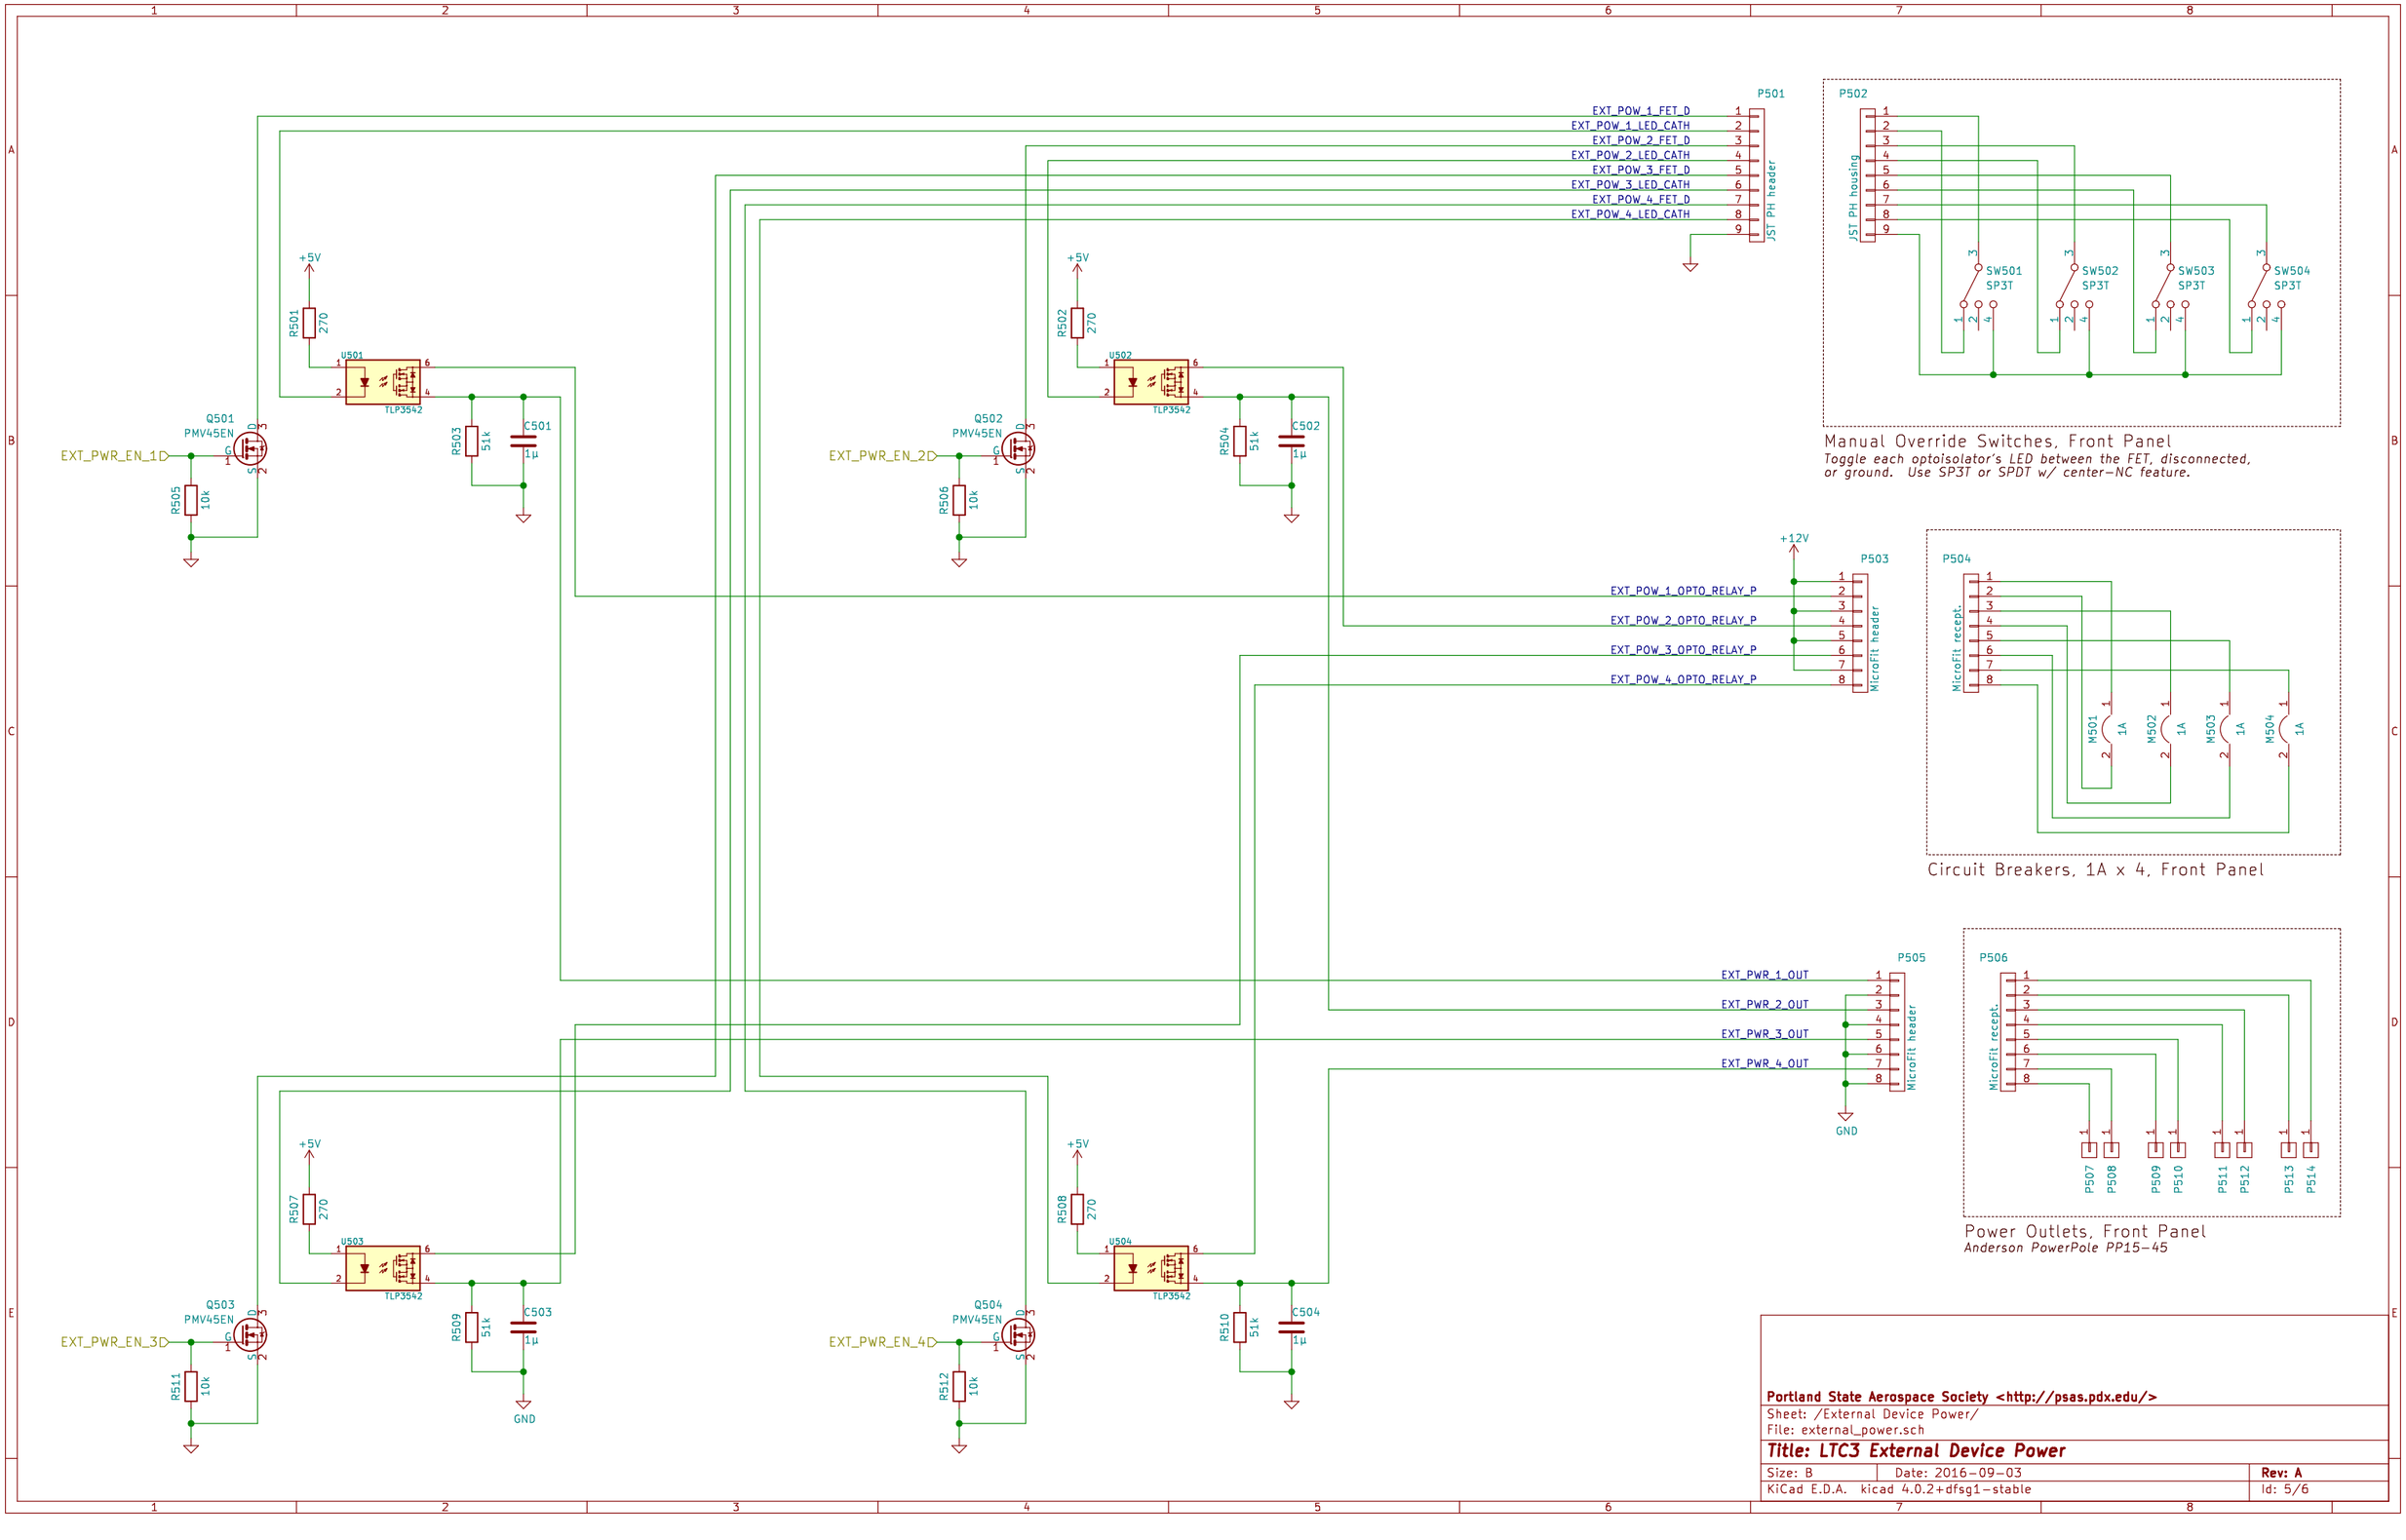

Portland State Aerospace Society <http://psas.pdx.edu/>

Sheet: /External Device Power/
File: external_power.sch

Title: LTC3 External Device Power

Size: B	Date: 2016-09-03	**Rev: A**
KiCad E.D.A. kicad 4.0.2+dfsg1-stable		Id: 5/6

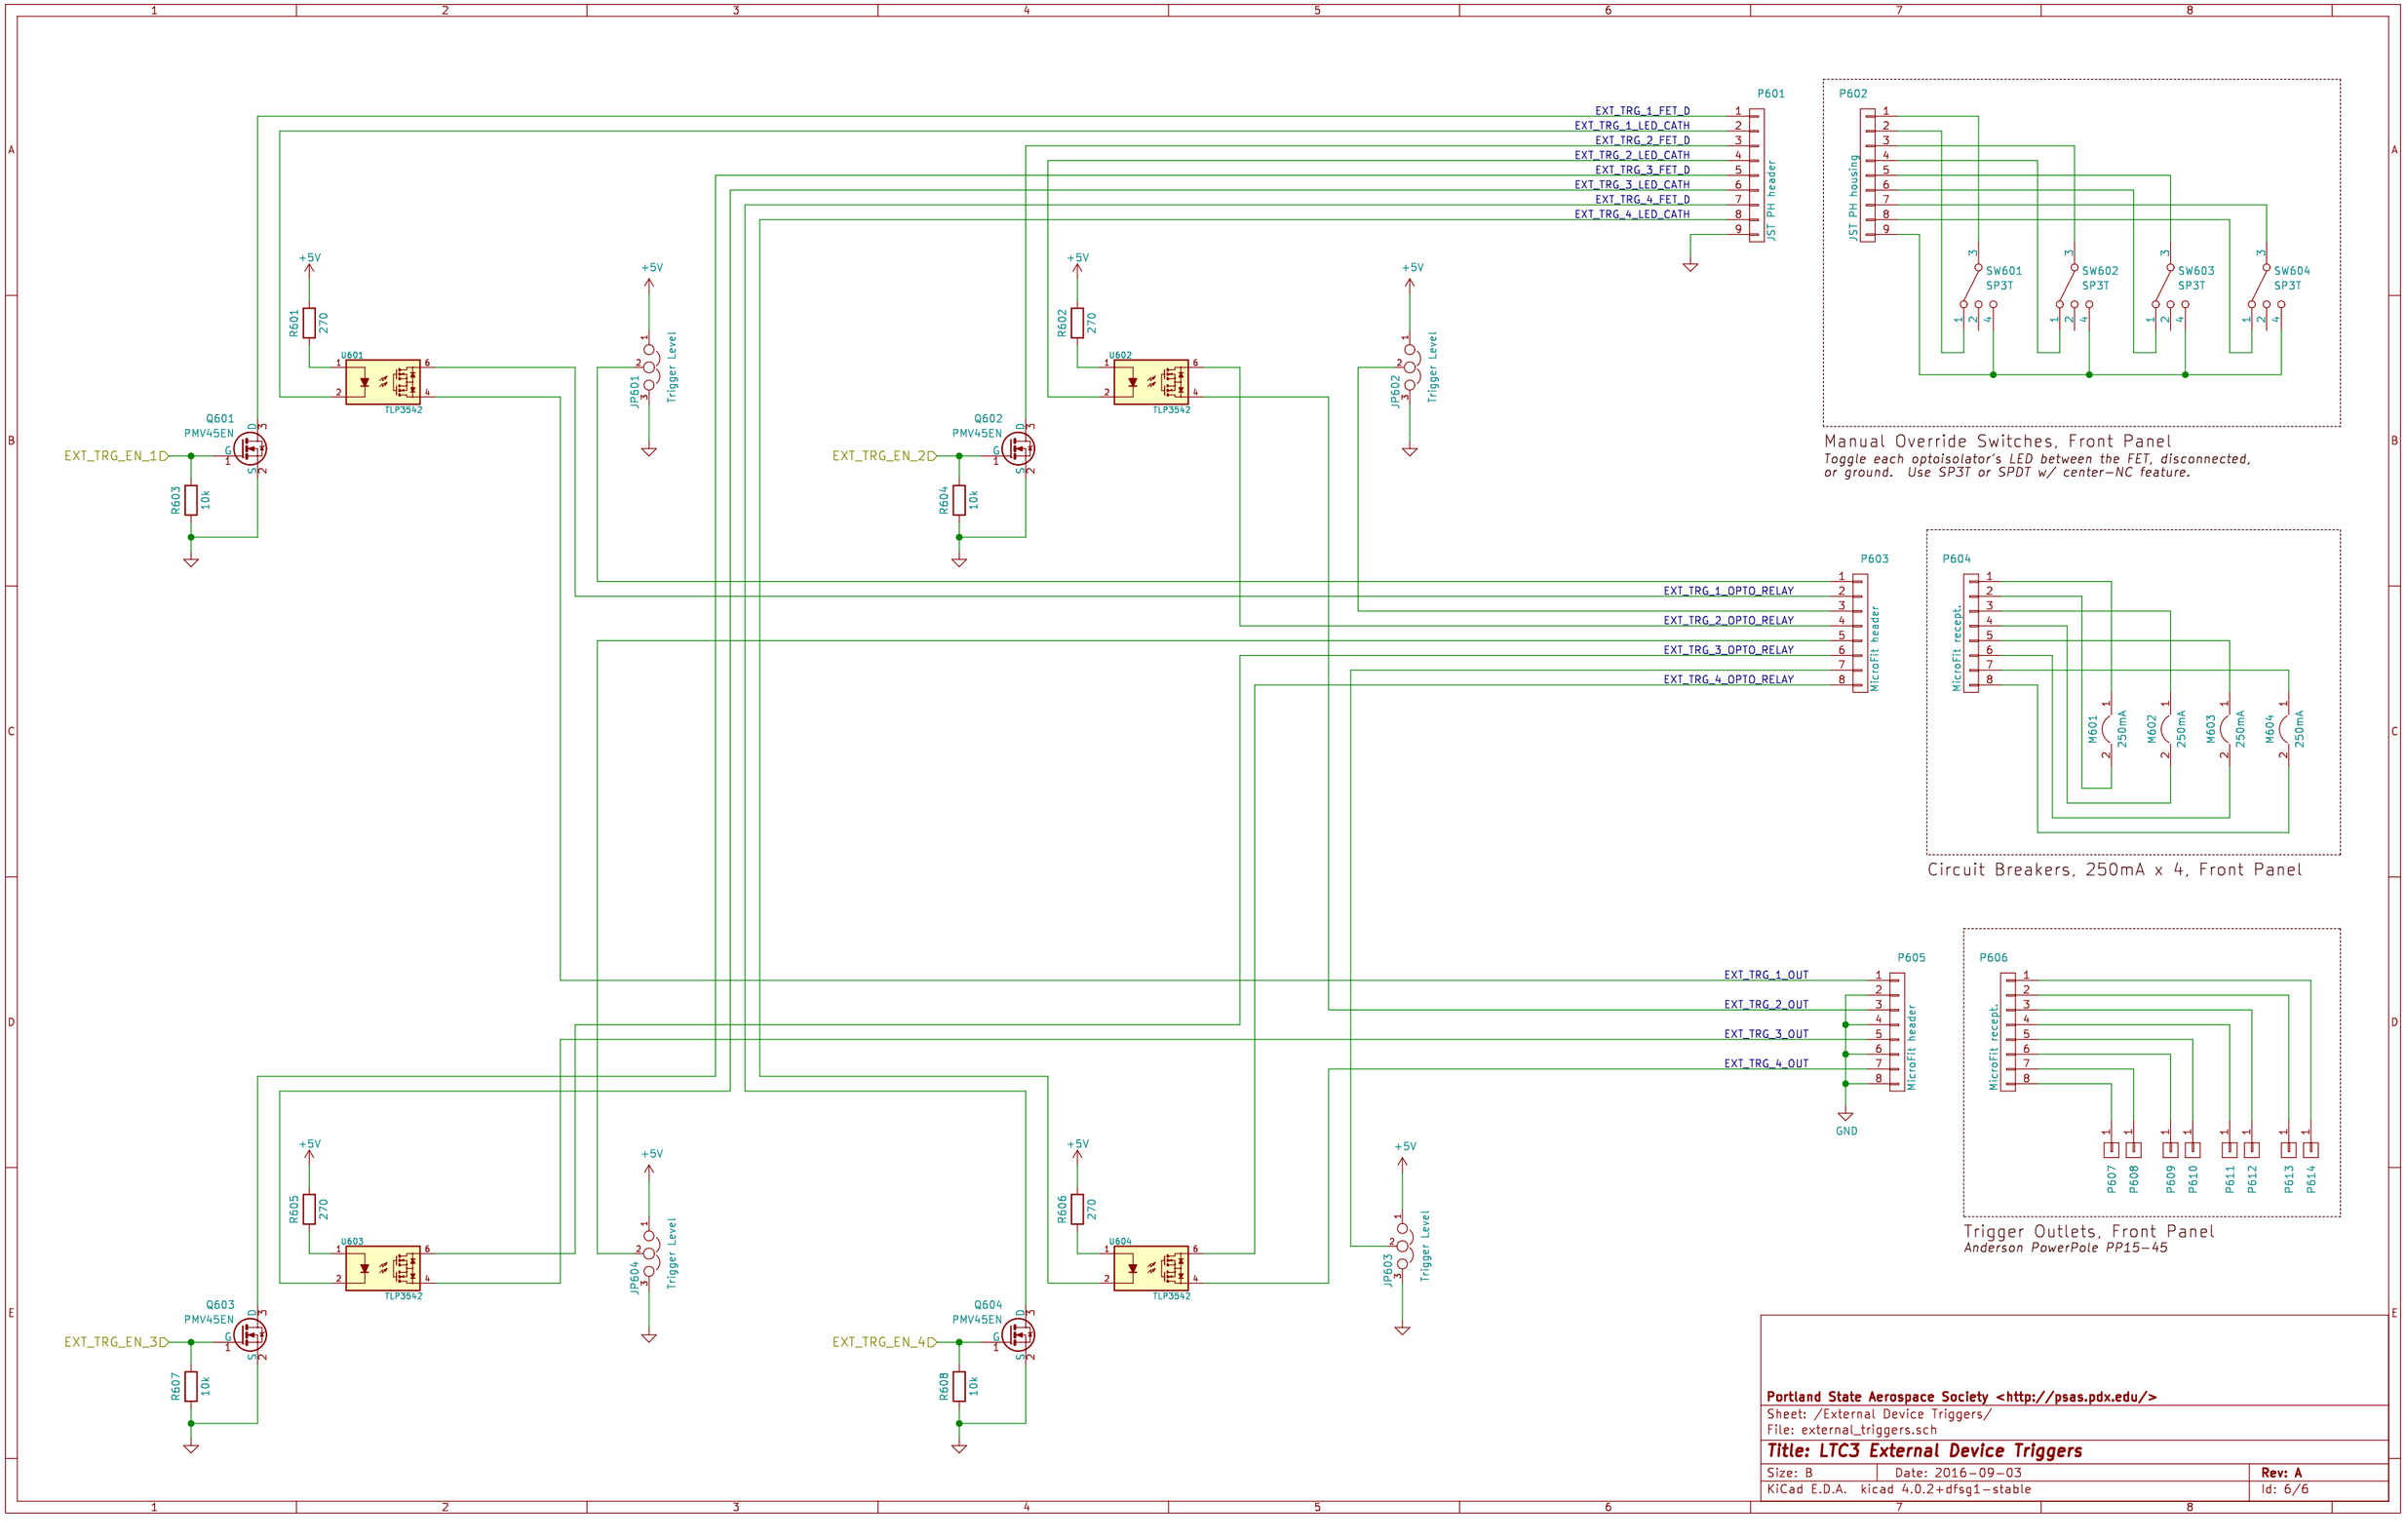
P601
EXT_TRG_1_FET_D
EXT_TRG_1_LED_CATH
EXT_TRG_2_FET_D
EXT_TRG_2_LED_CATH
EXT_TRG_3_FET_D
EXT_TRG_3_LED_CATH
EXT_TRG_4_FET_D
EXT_TRG_4_LED_CATH
JST PH header
P602
JST PH housing
SW601 SP3T
SW602 SP3T
SW603 SP3T
SW604 SP3T
Manual Override Switches, Front Panel
Toggle each optoisolator's LED between the FET, disconnected, or ground. Use SP3T or SPDT w/ center-NC feature.
+5V
R601 270
U601
TLP3542
JP601
Trigger Level
Q601
PMV45EN
EXT_TRG_EN_1
R603 10k
R602 270
U602
JP602
Q602
EXT_TRG_EN_2
R604 10k
P603
EXT_TRG_1_OPTO_RELAY
EXT_TRG_2_OPTO_RELAY
EXT_TRG_3_OPTO_RELAY
EXT_TRG_4_OPTO_RELAY
MicroFit header
P604
MicroFit receptacle
M601 250mA
M602 250mA
M603 250mA
M604 250mA
Circuit Breakers, 250mA x 4, Front Panel
P605
EXT_TRG_1_OUT
EXT_TRG_2_OUT
EXT_TRG_3_OUT
EXT_TRG_4_OUT
GND
P606
P607 P608 P609 P610 P611 P612 P613 P614
Trigger Outlets, Front Panel
Anderson PowerPole PP15-45
R605 270
U603
JP604
Q603
EXT_TRG_EN_3
R607 10k
R606 270
U604
JP603
Q604
EXT_TRG_EN_4
R608 10k
Portland State Aerospace Society <http://psas.pdx.edu/>
Sheet: /External Device Triggers/
File: external_triggers.sch
Title: LTC3 External Device Triggers
Size: B
Date: 2016-09-03
Rev: A
KiCad E.D.A. kicad 4.0.2+dfsg1-stable
Id: 6/6