


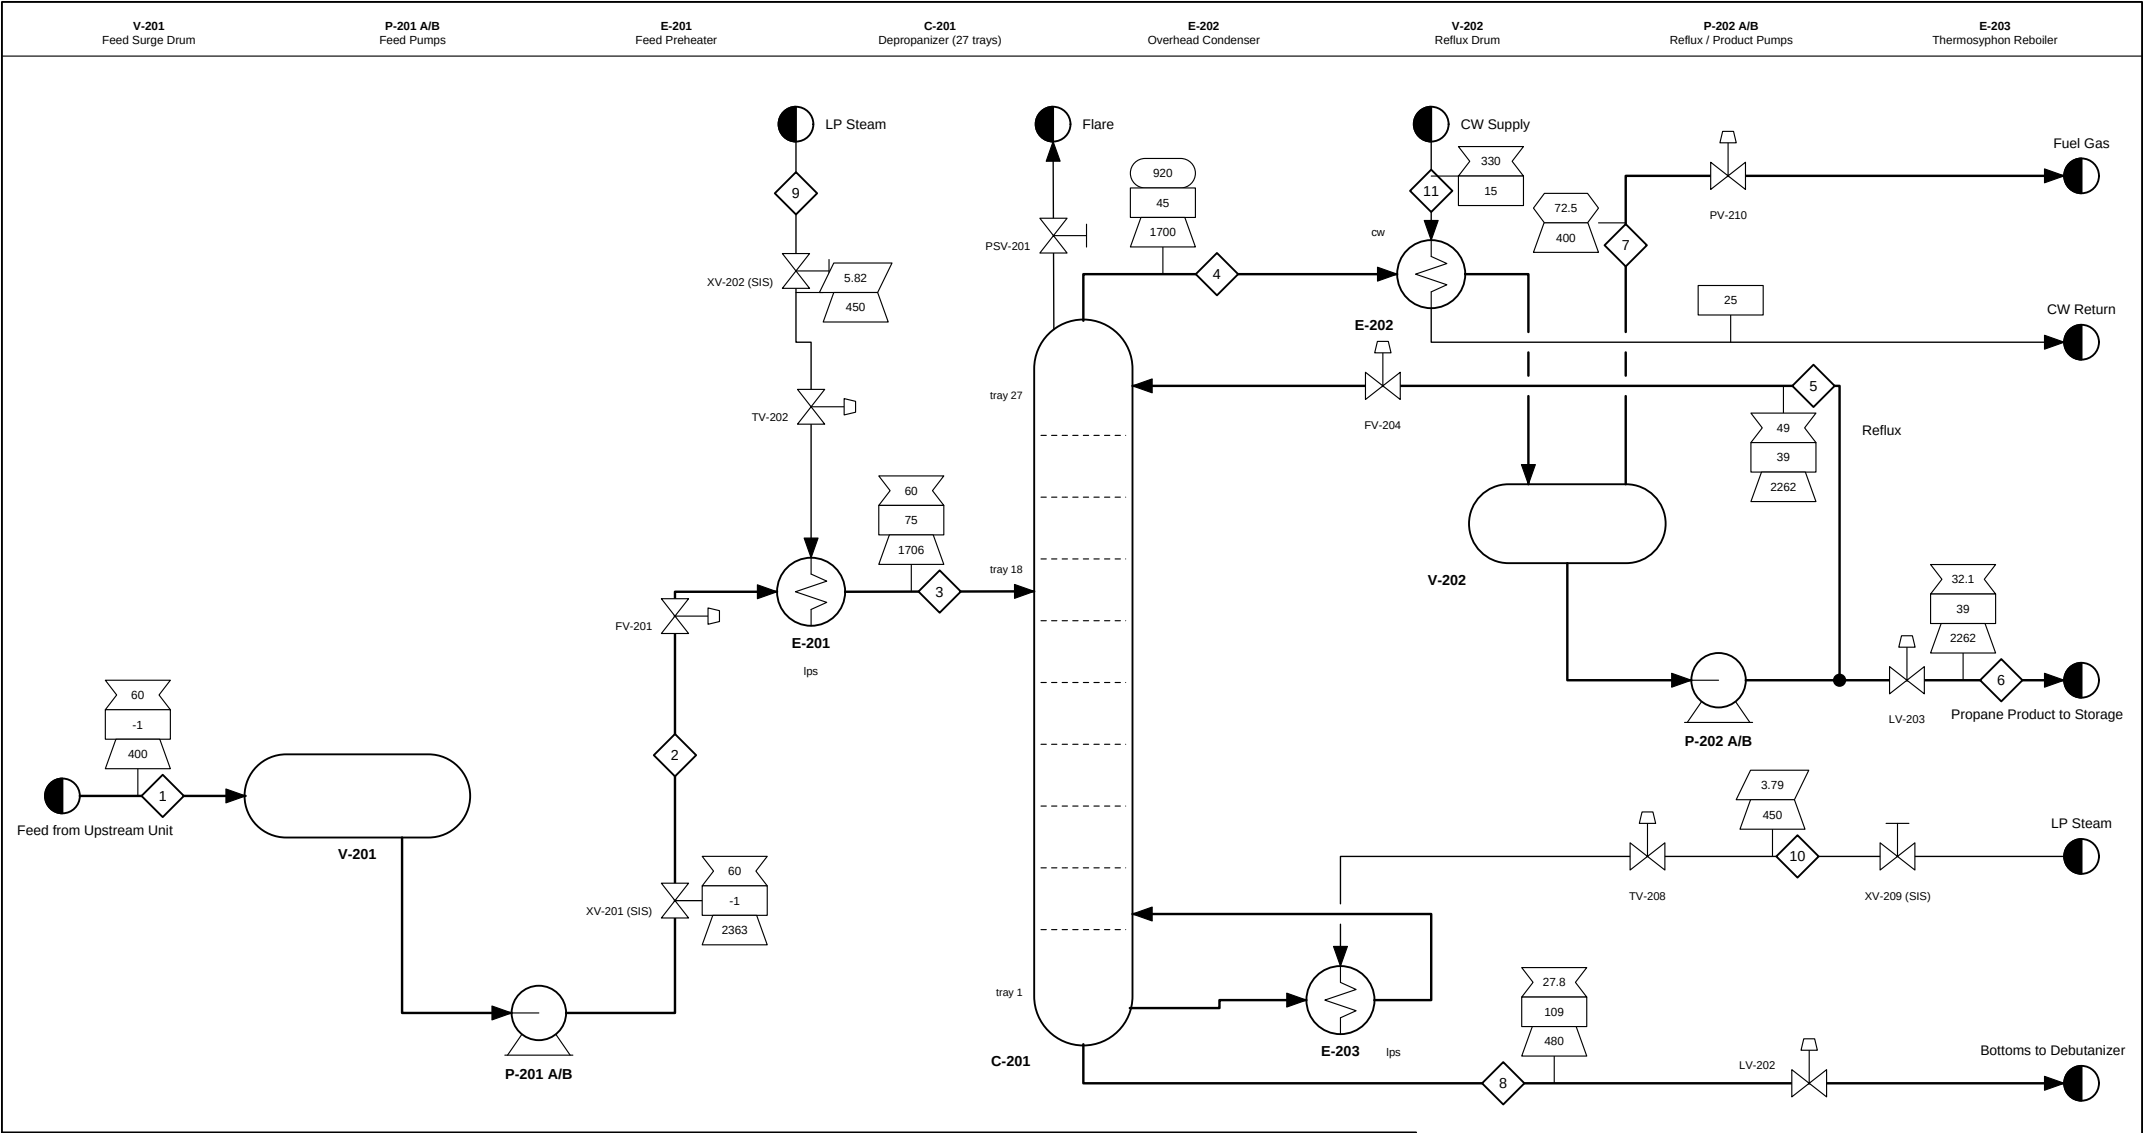

NOTES

1. Liquid flows m3/h; vapour kmol/h; vent Nm3/h; steam t/h; °C; kPa g. Design point of the simulator model.

2. Pseudo-binary feed: C3 and lighter / C4 and heavier. Trays numbered from the bottom; feed on tray 18.

3. XV-201/202/209: SIS shut-off valves. PSV-201 set 1.80 MPa g to flare. Steam condensate returns not shown.

LEGEND

Liquid Flow (m3/h)

Process Line

Line Crossing

Molar Flow (kmol/h)

Utility Line

Vessel / Drum

Gas Flow (Nm3/h)

Block Valve

Centrifugal Pump

Steam Flow (t/h)

Control Valve

Heat Exchanger

Temperature (°C)

Process Input / Output

Distillation Column

Pressure (kPa g)

Stream Number

DEPROPANIZER COLUMN VER 1 - OPERATOR TRAINING SIMULATOR			
PROCESS FLOW DIAGRAM			
DEPROPANIZER C-201 - FEED DRUM, COLUMN, CONDENSER AND REBOILER			
DRAWING No. DC-PFD-200	REV. 0	SIZE A4	SHEET 1 OF 1
DRAWN Apinan Soottitantawat	CHECKED	SCALE NTS	DATE 2026-09-29