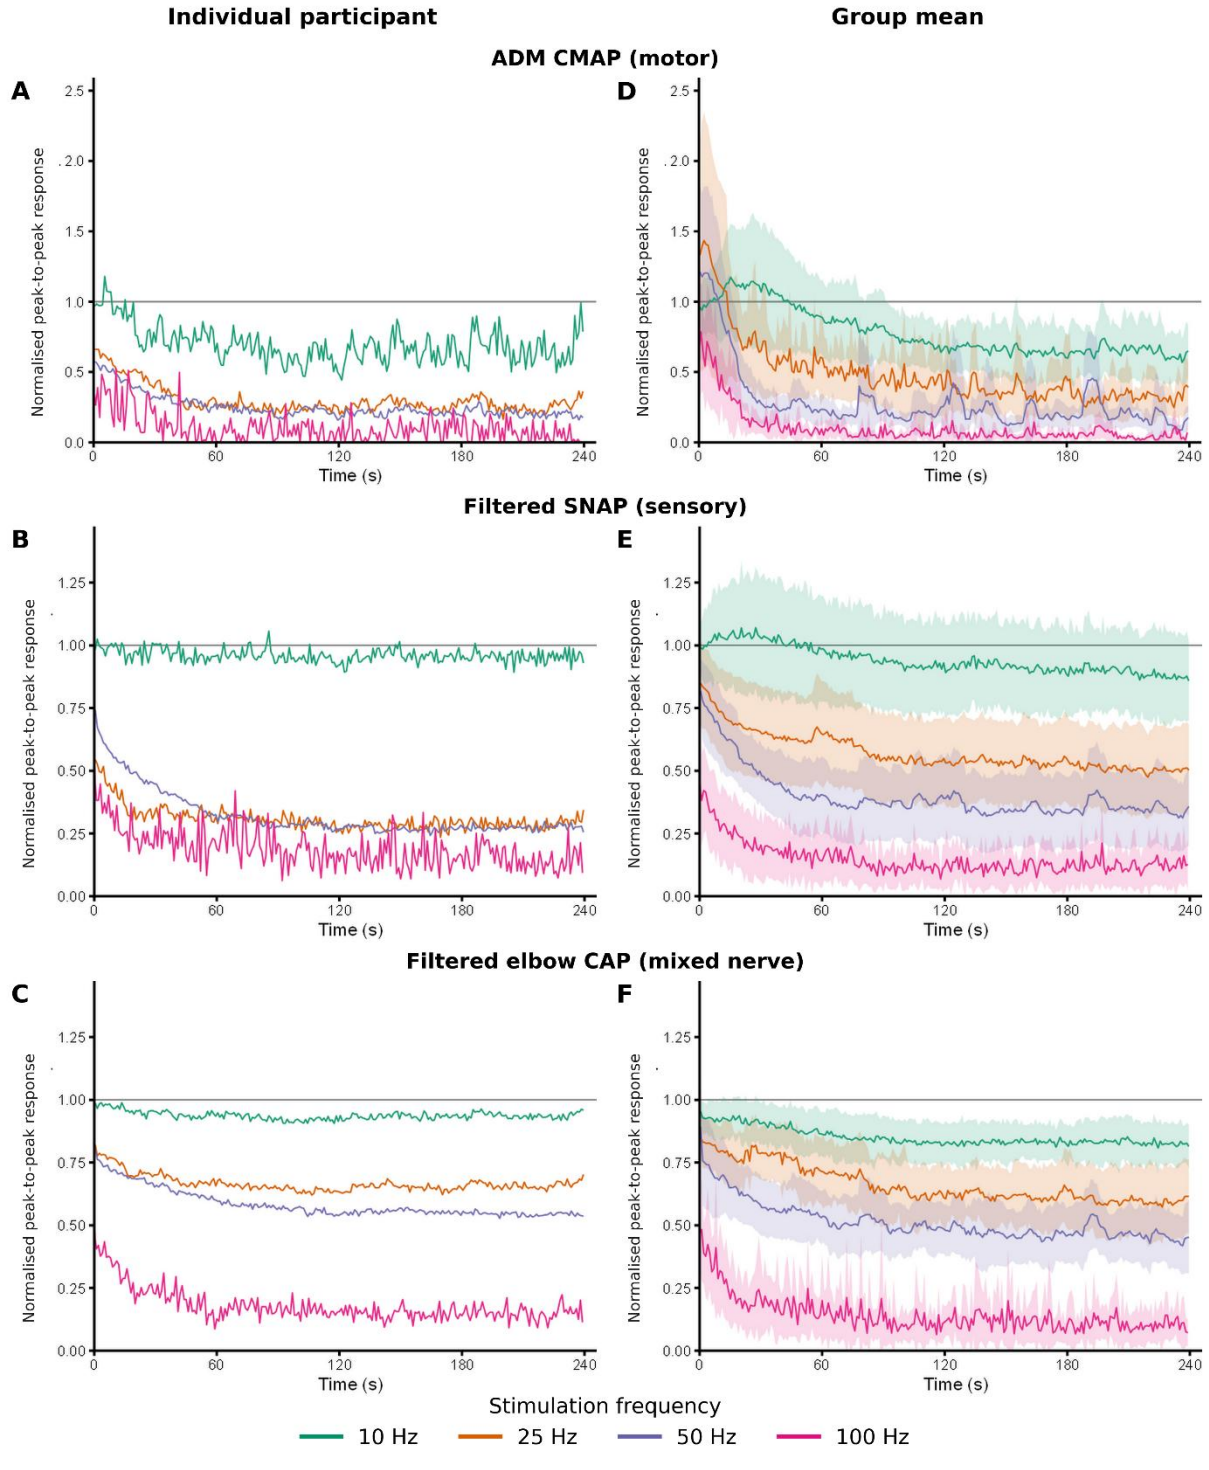

Individual participant
Group mean
ADM CMAP (motor)
A
D
Filtered SNAP (sensory)
B
E
Filtered elbow CAP (mixed nerve)
C
F
Normalised peak-to-peak response
Time (s)
Stimulation frequency
10 Hz
25 Hz
50 Hz
100 Hz