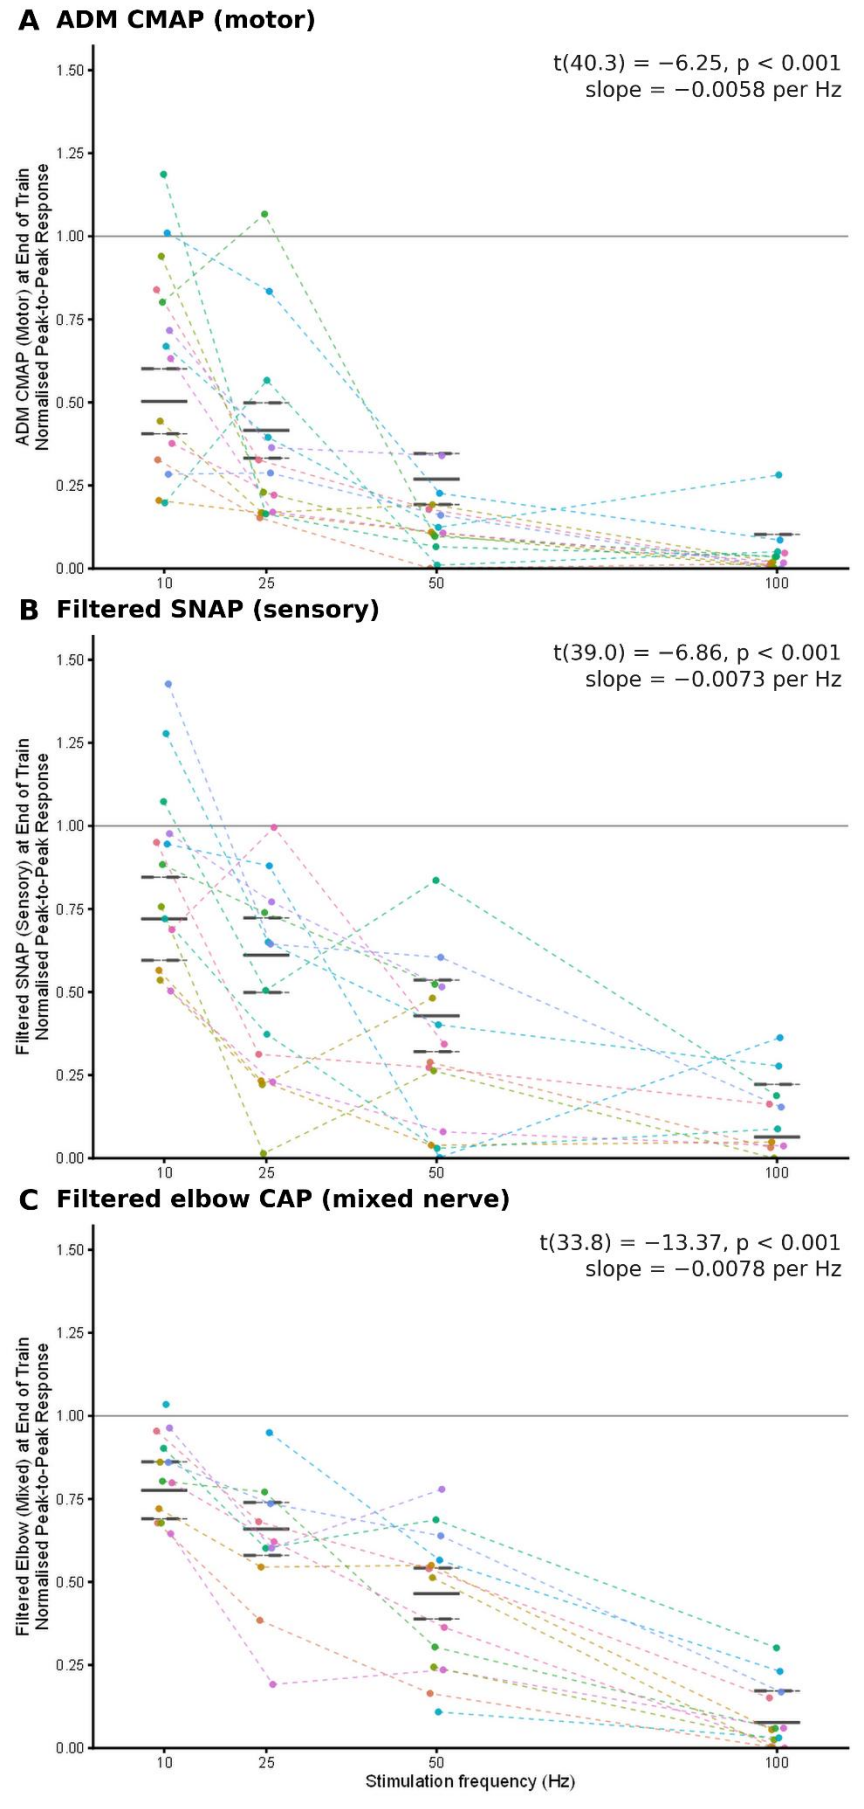

A ADM CMAP (motor)
t(40.3) = −6.25, p < 0.001
slope = −0.0058 per Hz
ADM CMAP (Motor) at End of Train
Normalised Peak-to-Peak Response
B Filtered SNAP (sensory)
t(39.0) = −6.86, p < 0.001
slope = −0.0073 per Hz
Filtered SNAP (Sensory) at End of Train
Normalised Peak-to-Peak Response
C Filtered elbow CAP (mixed nerve)
t(33.8) = −13.37, p < 0.001
slope = −0.0078 per Hz
Filtered Elbow (Mixed) at End of Train
Normalised Peak-to-Peak Response
0.00
0.25
0.50
0.75
1.00
1.25
1.50
10
25
50
100
Stimulation frequency (Hz)