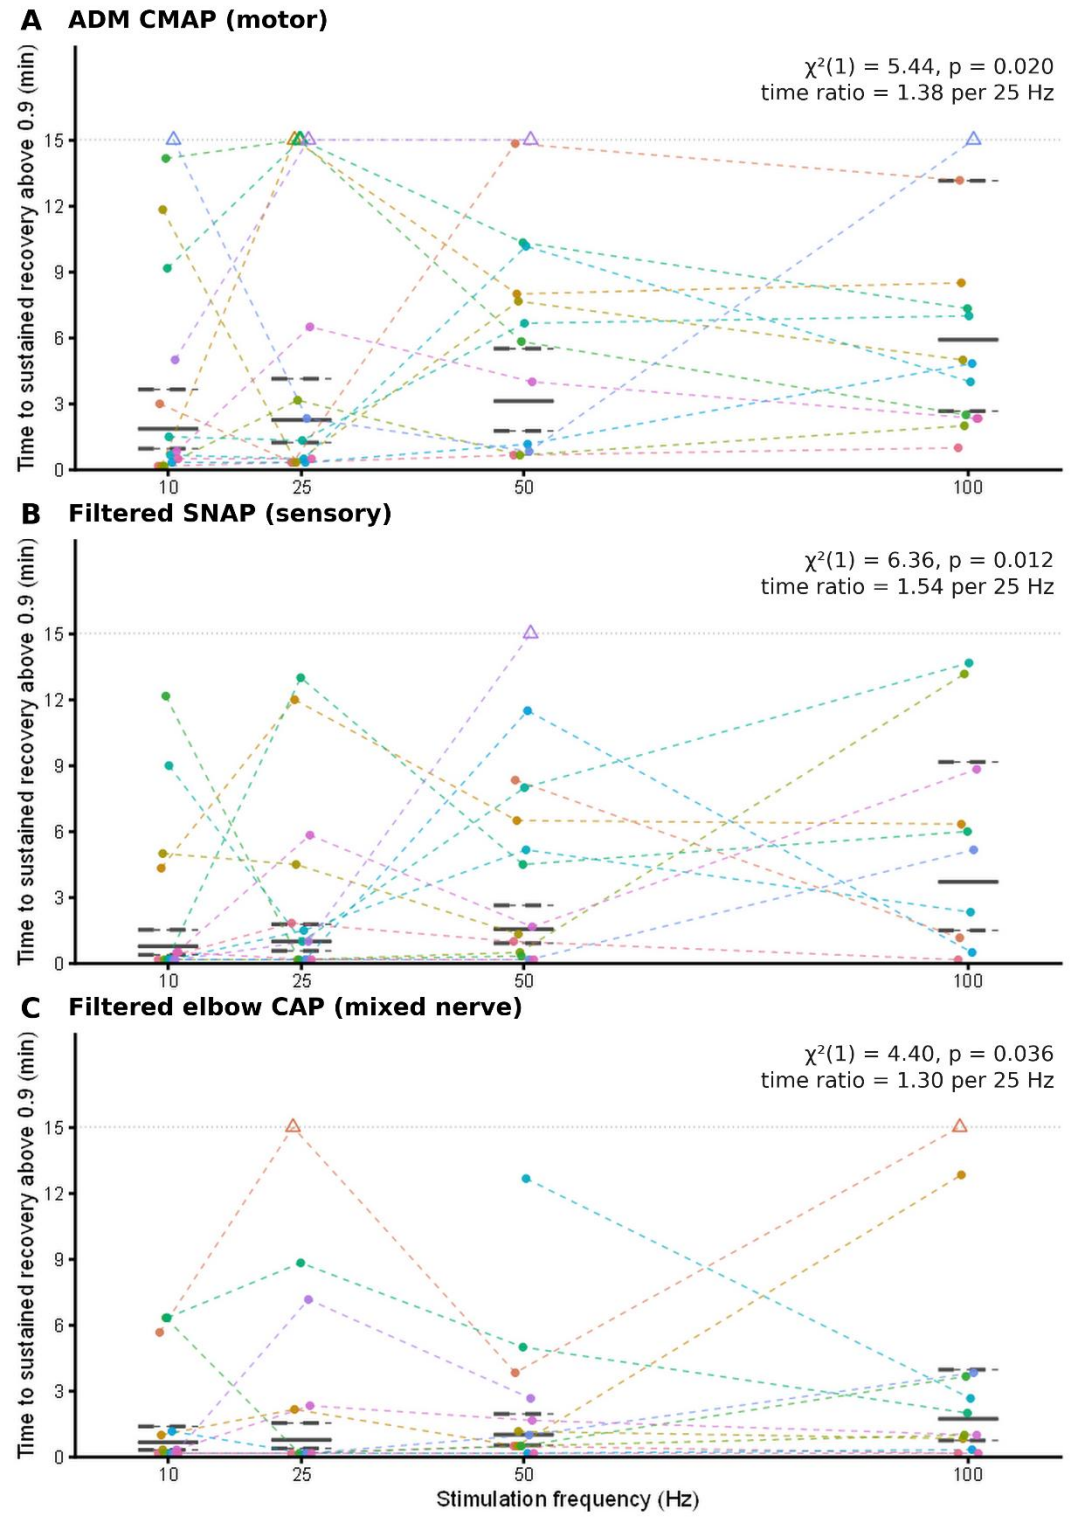

A
ADM CMAP (motor)
χ²(1) = 5.44, p = 0.020
time ratio = 1.38 per 25 Hz
Time to sustained recovery above 0.9 (min)
B
Filtered SNAP (sensory)
χ²(1) = 6.36, p = 0.012
time ratio = 1.54 per 25 Hz
Time to sustained recovery above 0.9 (min)
C
Filtered elbow CAP (mixed nerve)
χ²(1) = 4.40, p = 0.036
time ratio = 1.30 per 25 Hz
Time to sustained recovery above 0.9 (min)
0
3
6
9
12
15
10
25
50
100
Stimulation frequency (Hz)