



Faculty of Engineering
Cairo University
Civil Department

NOTES:

- THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.
 - ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.
- #### GENERAL NOTES:
- THIS BUILDING CONSISTS OF ONE BASEMENT, THREE OFFICE FLOORS AND FIFTEEN TYPICAL FLOORS.
 - THE CHARACTERISTIC STRENGTH FOR R.C. (R_{cd}) IS 300 KG/CM².
 - THE CEMENT CONTENT FOR REINFORCED CONCRETE IS 350 KG/M³.
 - THE CEMENT CONTENT FOR PLAIN CONCRETE IS 250 KG/M³.
 - ORDINARY PORTLAND CEMENT IS USED IN ALL CONCRETE ELEMENTS.
 - THE GRADE OF THE REINFORCING STEEL IS: (36/52) FOR ALL DAIMETRES GREATER THAN 8MM. (24/37) FOR ALL DAIMETRES EQUAL TO 8MM.

COLUMNS NOTES:

- MINIMUM DOWEL LENGTH IS 60 ϕ OR 1.00 M 'WHICH IS BIGGER.
- STIRRUPS ARE 6 ϕ 8/M AND INCREASED TO 10 ϕ 8/M IN BOTH ENDS OF COLUMN FOR 1.00 M HEIGHT.
- DEVELOPED LENGTH FOR STEEL BARS INSIDE FOUNDATION IS 60 ϕ , EXTEND INSIDE COLUMNS.
- COLUMNS STIRRUPS SHOULD BE EXTENDED ALONG BEAMS DEPTH.
- CONCRETE COVER FOR COLUMNS AND WALLS IS 2.5 CM.

PROJECT NAME :


High Rise Building

By :

Anas Akram Saeed

DRAWING TITLE :


1) Columns and Shear Walls

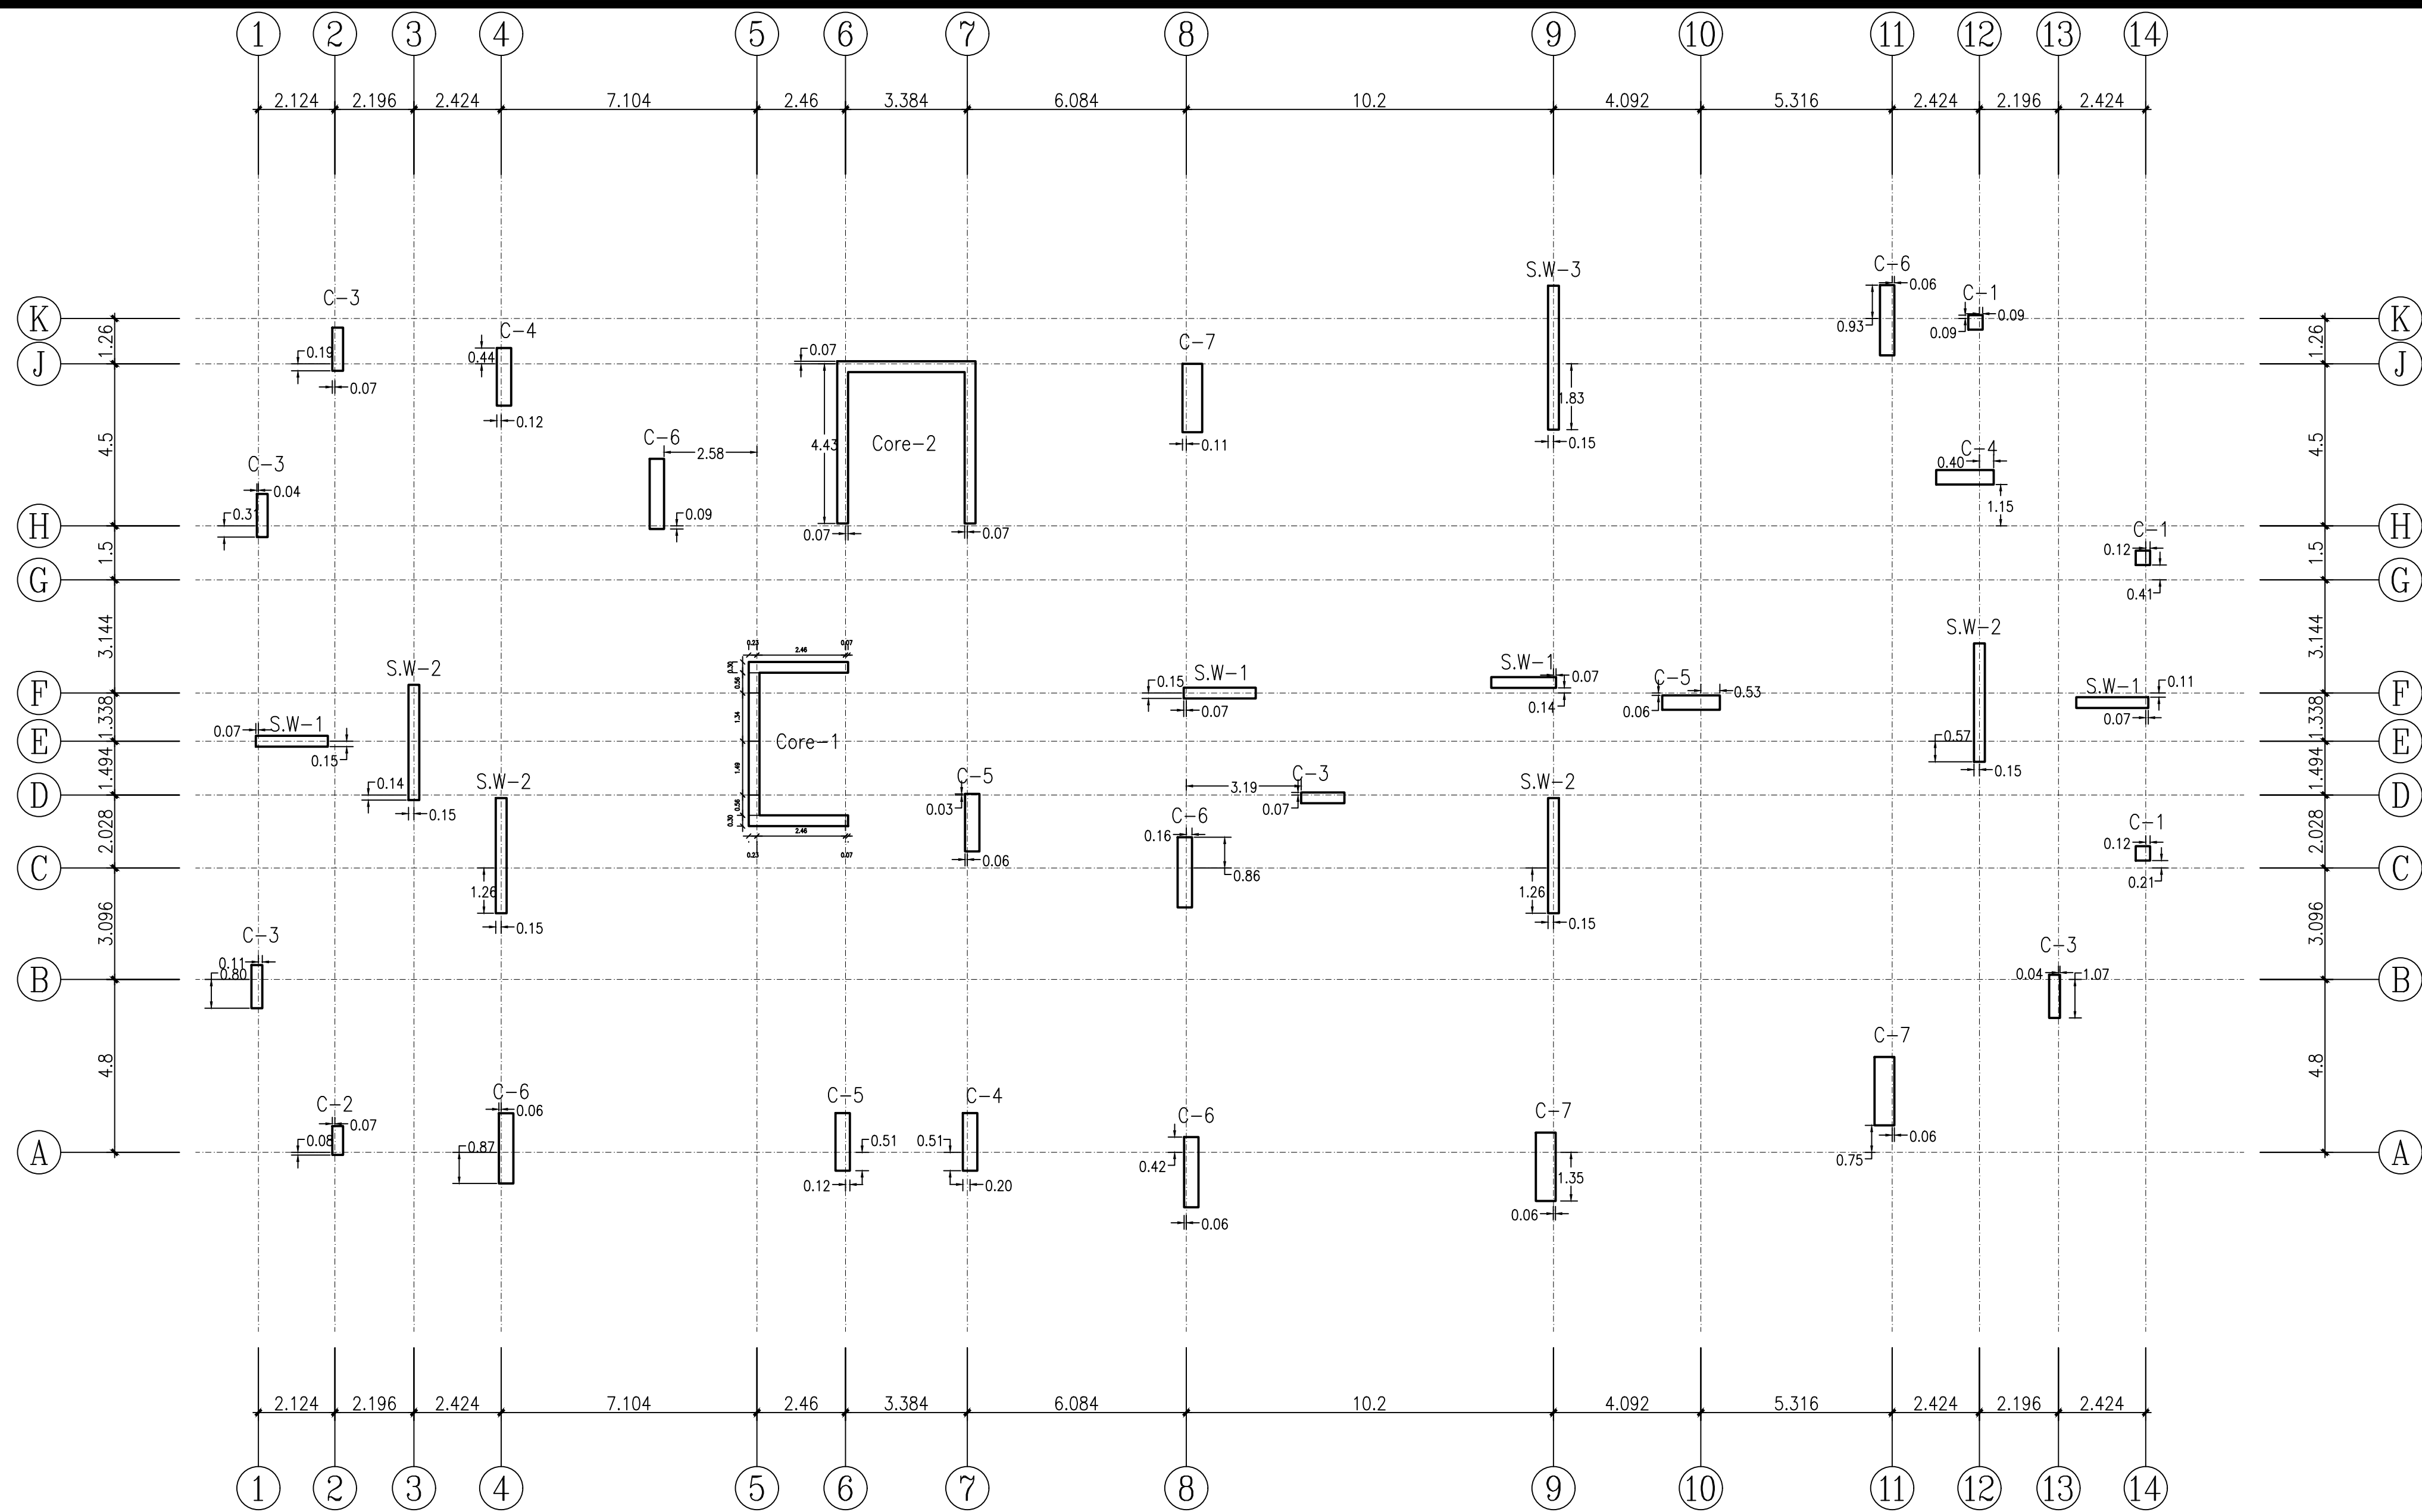


COLUMNS TABLE

SECTIONS


	C-1	C-2	C-3	C-4	C-5	C-6	C-7
b x t	40X40	30 X 80	30 X 120	40 X 140	40 X 160	40 X 195	55 X 190
As	8 ϕ 16	12 ϕ 16	18 ϕ 16	18 ϕ 20	22 ϕ 20	20 ϕ 20	22 ϕ 25
Astr	6 ϕ 8/m	6 ϕ 8/m	6 ϕ 8/m	7 ϕ 8/m	7 ϕ 8/m	7 ϕ 8/m	7 ϕ 8/m
Typical Section							
Stirrups							

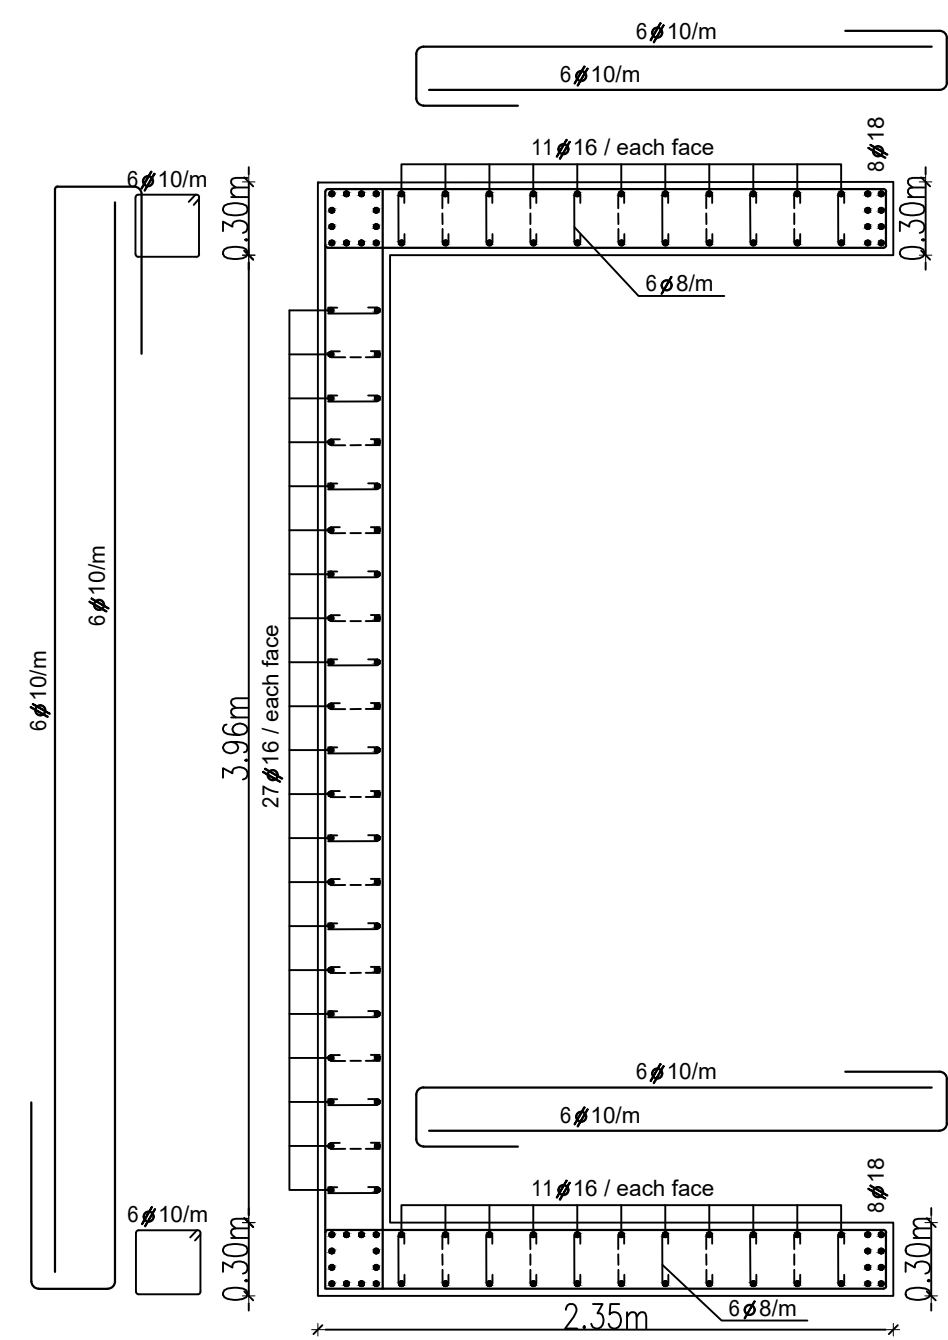


CORE-1

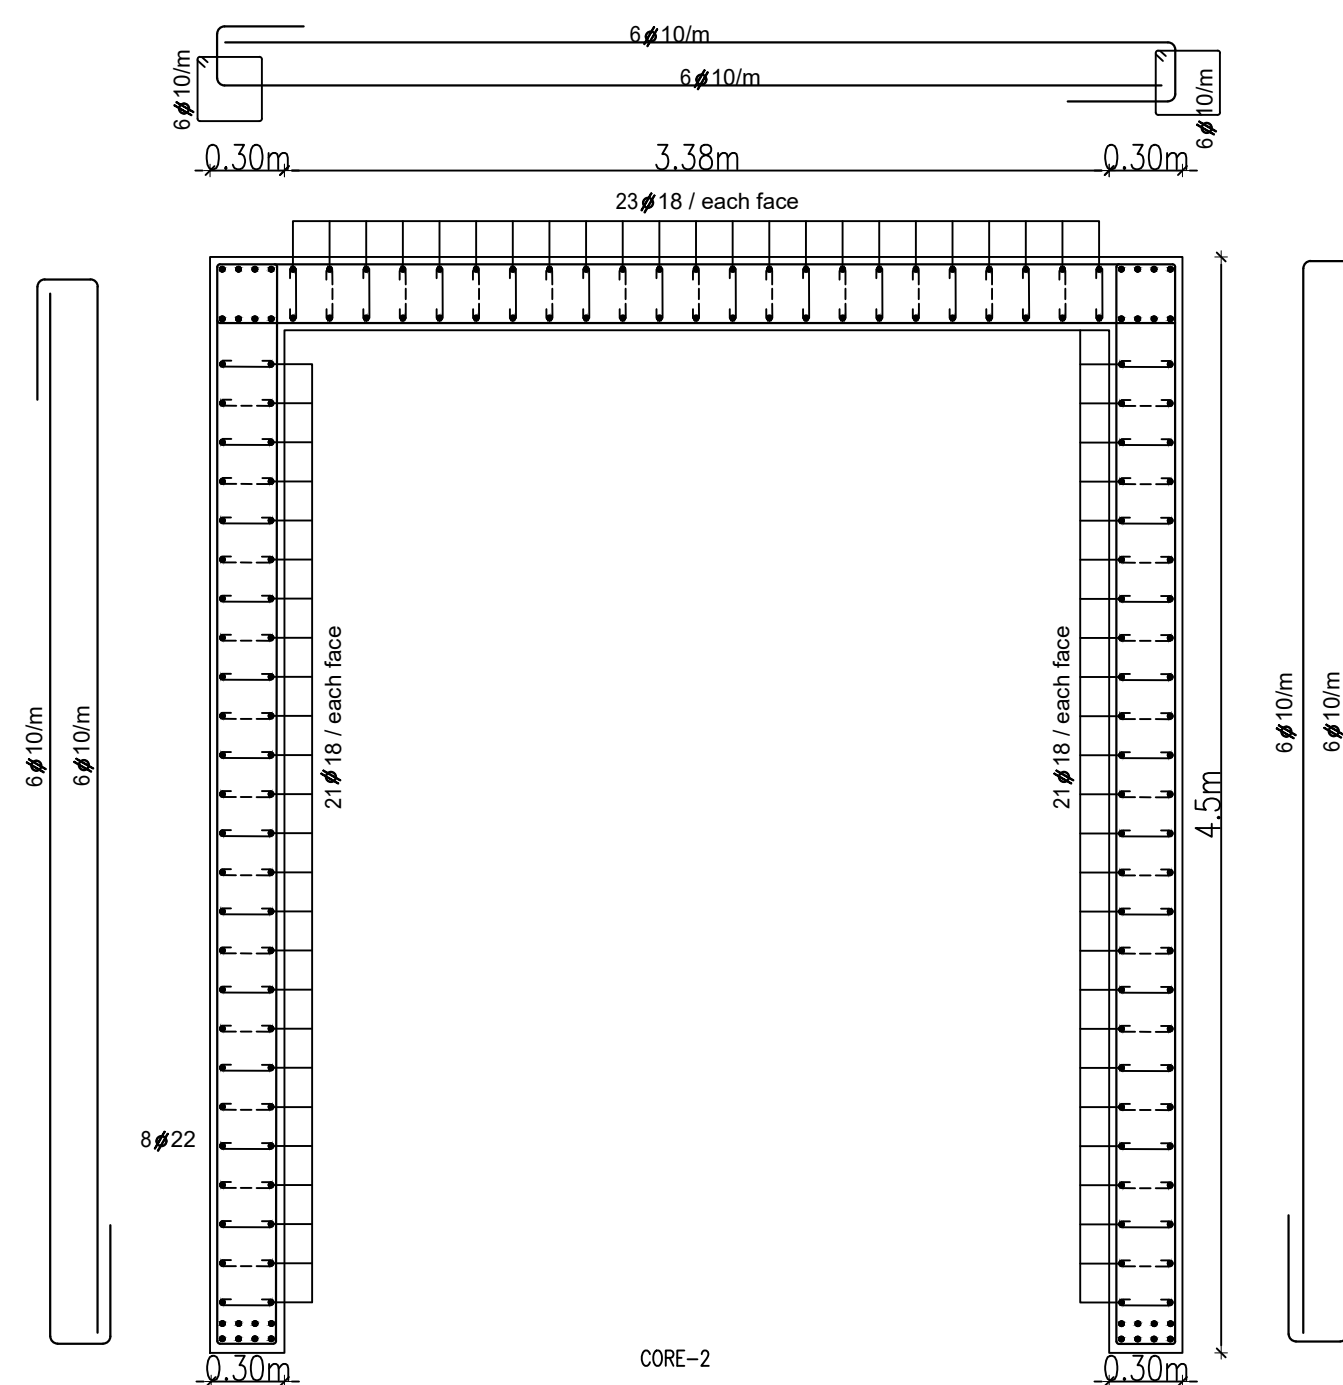


CORE-2

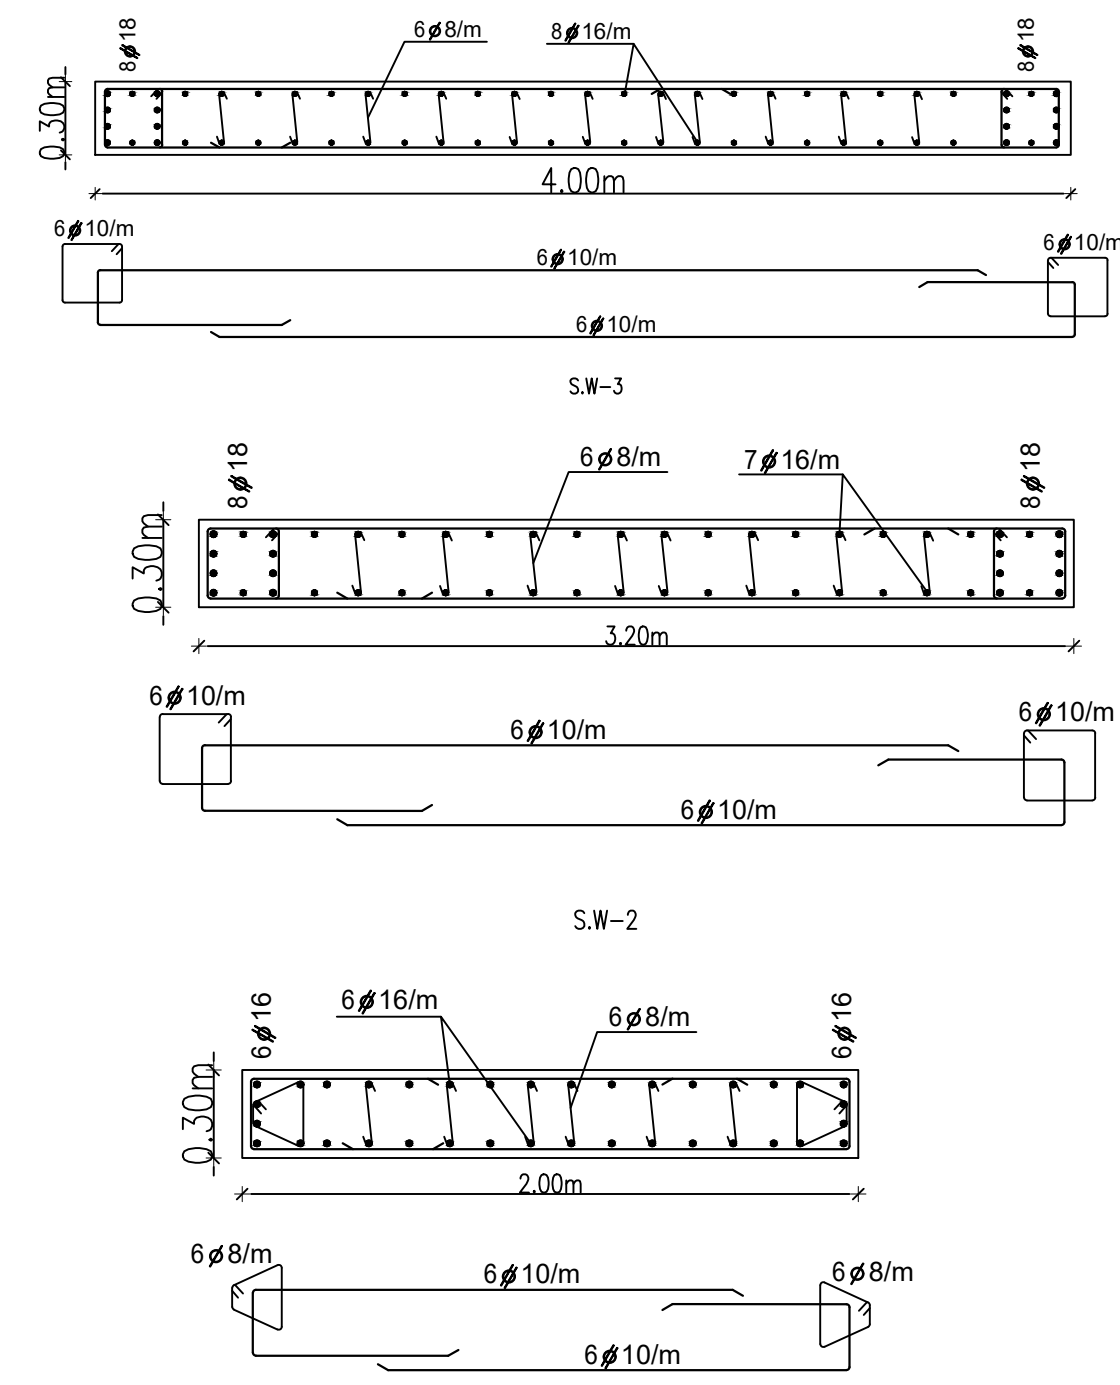

S.W.-1

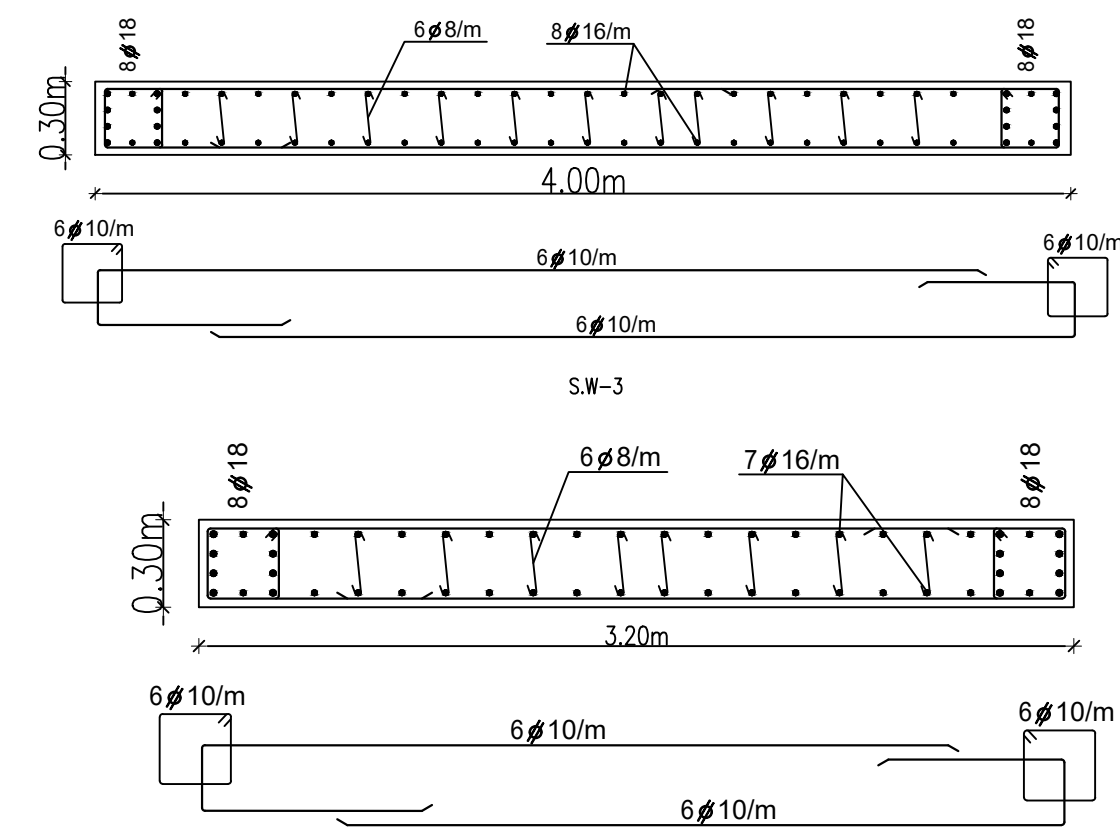

S.W.-2

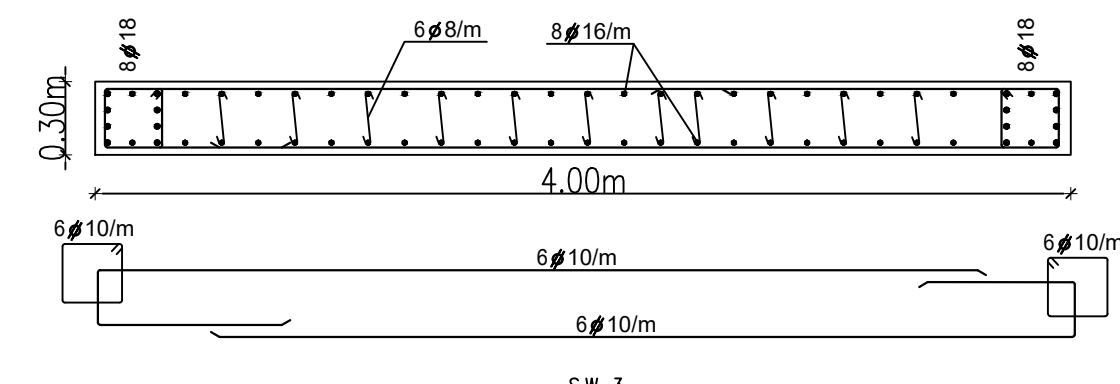

S.W.-3



- o THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.

- o ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.

GENERAL NOTES:

- 1) THIS BUILDING CONSISTS OF ONE BASEMENT
TWO OFFICE FLOORS AND TEN
TYPICAL FLOORS.
- 2) THE CHARACTERISTIC STRENGTH FOR R.C.
(F_{cu}) IS 300 KG/CM².
- 3) THE CEMENT CONTENT FOR REINFORCED
CONCRETE IS 350 KG/M³.
- 4) THE CEMENT CONTENT FOR PLAIN
CONCRETE IS 250 KG/M³.
- 5) ORDINARY PORTLAND CEMENT IS USED IN
ALL CONCRETE ELEMENTS.
- 6) THE GRADE OF THE REINFORCING STEEL IS:
(42/52) FOR ALL DAIMETRES GREATER
THAN 8MM.

FOUNDATION NOTES:

- 1) FOUNDATION LEVEL IS (-4.35).
- 2) FOUNDATIONS ARE DESIGNED FOR SOIL BEARING CAPACITY OF 2.00 KG/CM².
- 3) DEVELOPED LENGTH FOR STEEL BARS INSIDE FOUNDATION IS 60 ϕ .
- 4) RAFT IS 1.5 M RC RESTED ON 0.2 M PC.

PROJECT NAME

High Rise Buliding

By :

Anas Akram Saeed

DRAWING TITLE

2) BASEMENT ROOF RFT



Faculty of Engineering
Cairo University
Civil Department

NOTES:

- THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.
- ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.

GENERAL NOTES:

- THIS BUILDING CONSISTS OF ONE BASEMENT, TWO OFFICE FLOORS AND TEN TYPICAL FLOORS.
- THE CHARACTERISTIC STRENGTH FOR R.C. (F_{cu}) IS 350 KG/CM^2 .
- THE CEMENT CONTENT FOR REINFORCED CONCRETE IS 350 KG/M^3 .
- THE CEMENT CONTENT FOR PLAIN CONCRETE IS 250 KG/M^3 .
- ORDINARY PORTLAND CEMENT IS USED IN ALL CONCRETE ELEMENTS.
- THE GRADE OF THE REINFORCING STEEL IS: (42/52) FOR ALL DAIMETRES GREATER THAN 8MM.

SLABS NOTES:

- EQUAL TO 70CM MUST BE PROVIDED WITH $10\#12$ SPACED AT 300 MM FOR EACH SIDE.
- FOR CONTINUOUS SLABS, UPPER RFT BARS MUST BE EXTENDED TO $1/4$ OF THE GREATER SPAN.
- DEVELOPED LENGTH (LD)= 60ϕ IN TENSION AND (LD)= 40ϕ IN COMPRESSION.
- $2\phi10$ SHRINKAGE BARS IS PROVIDED FOR $DEPTH \geq 70\text{cm}$.
- REINFORCEMENT MUST BE PLACED ACCORDING TO EGYPTIAN CODE.
- CONCRETE COVER IS 2.0 CM

PROJECT NAME :




High Rise Building

By :

Anas Akram Saeed

DRAWING TITLE :

3) BASEMENT ROOF RFT

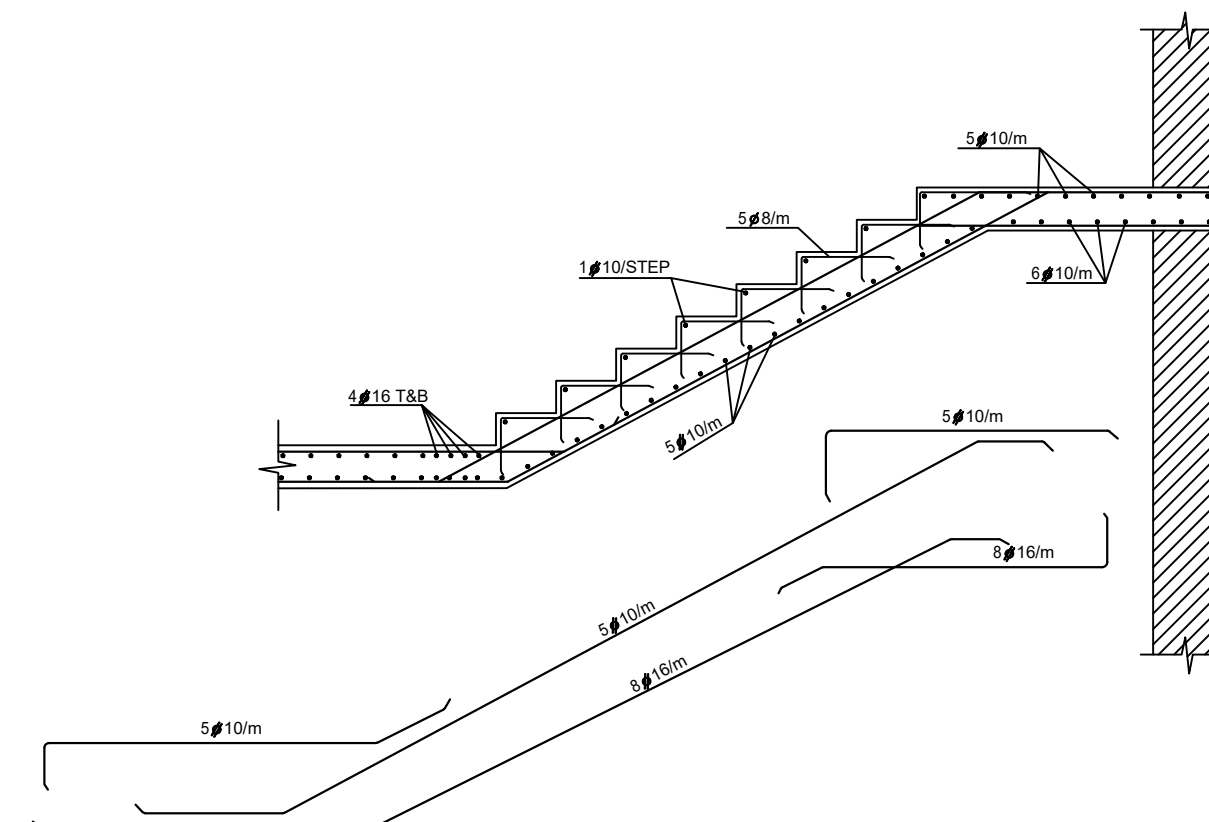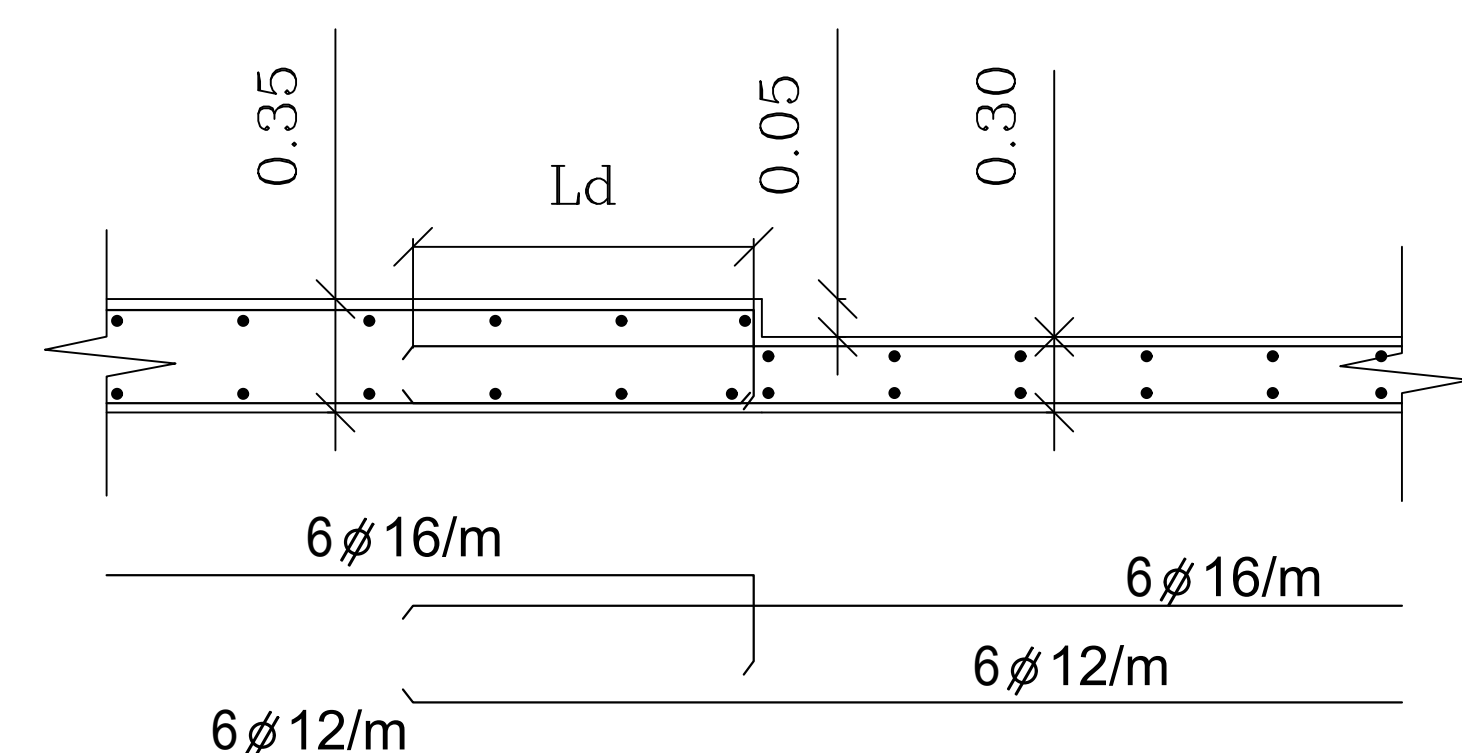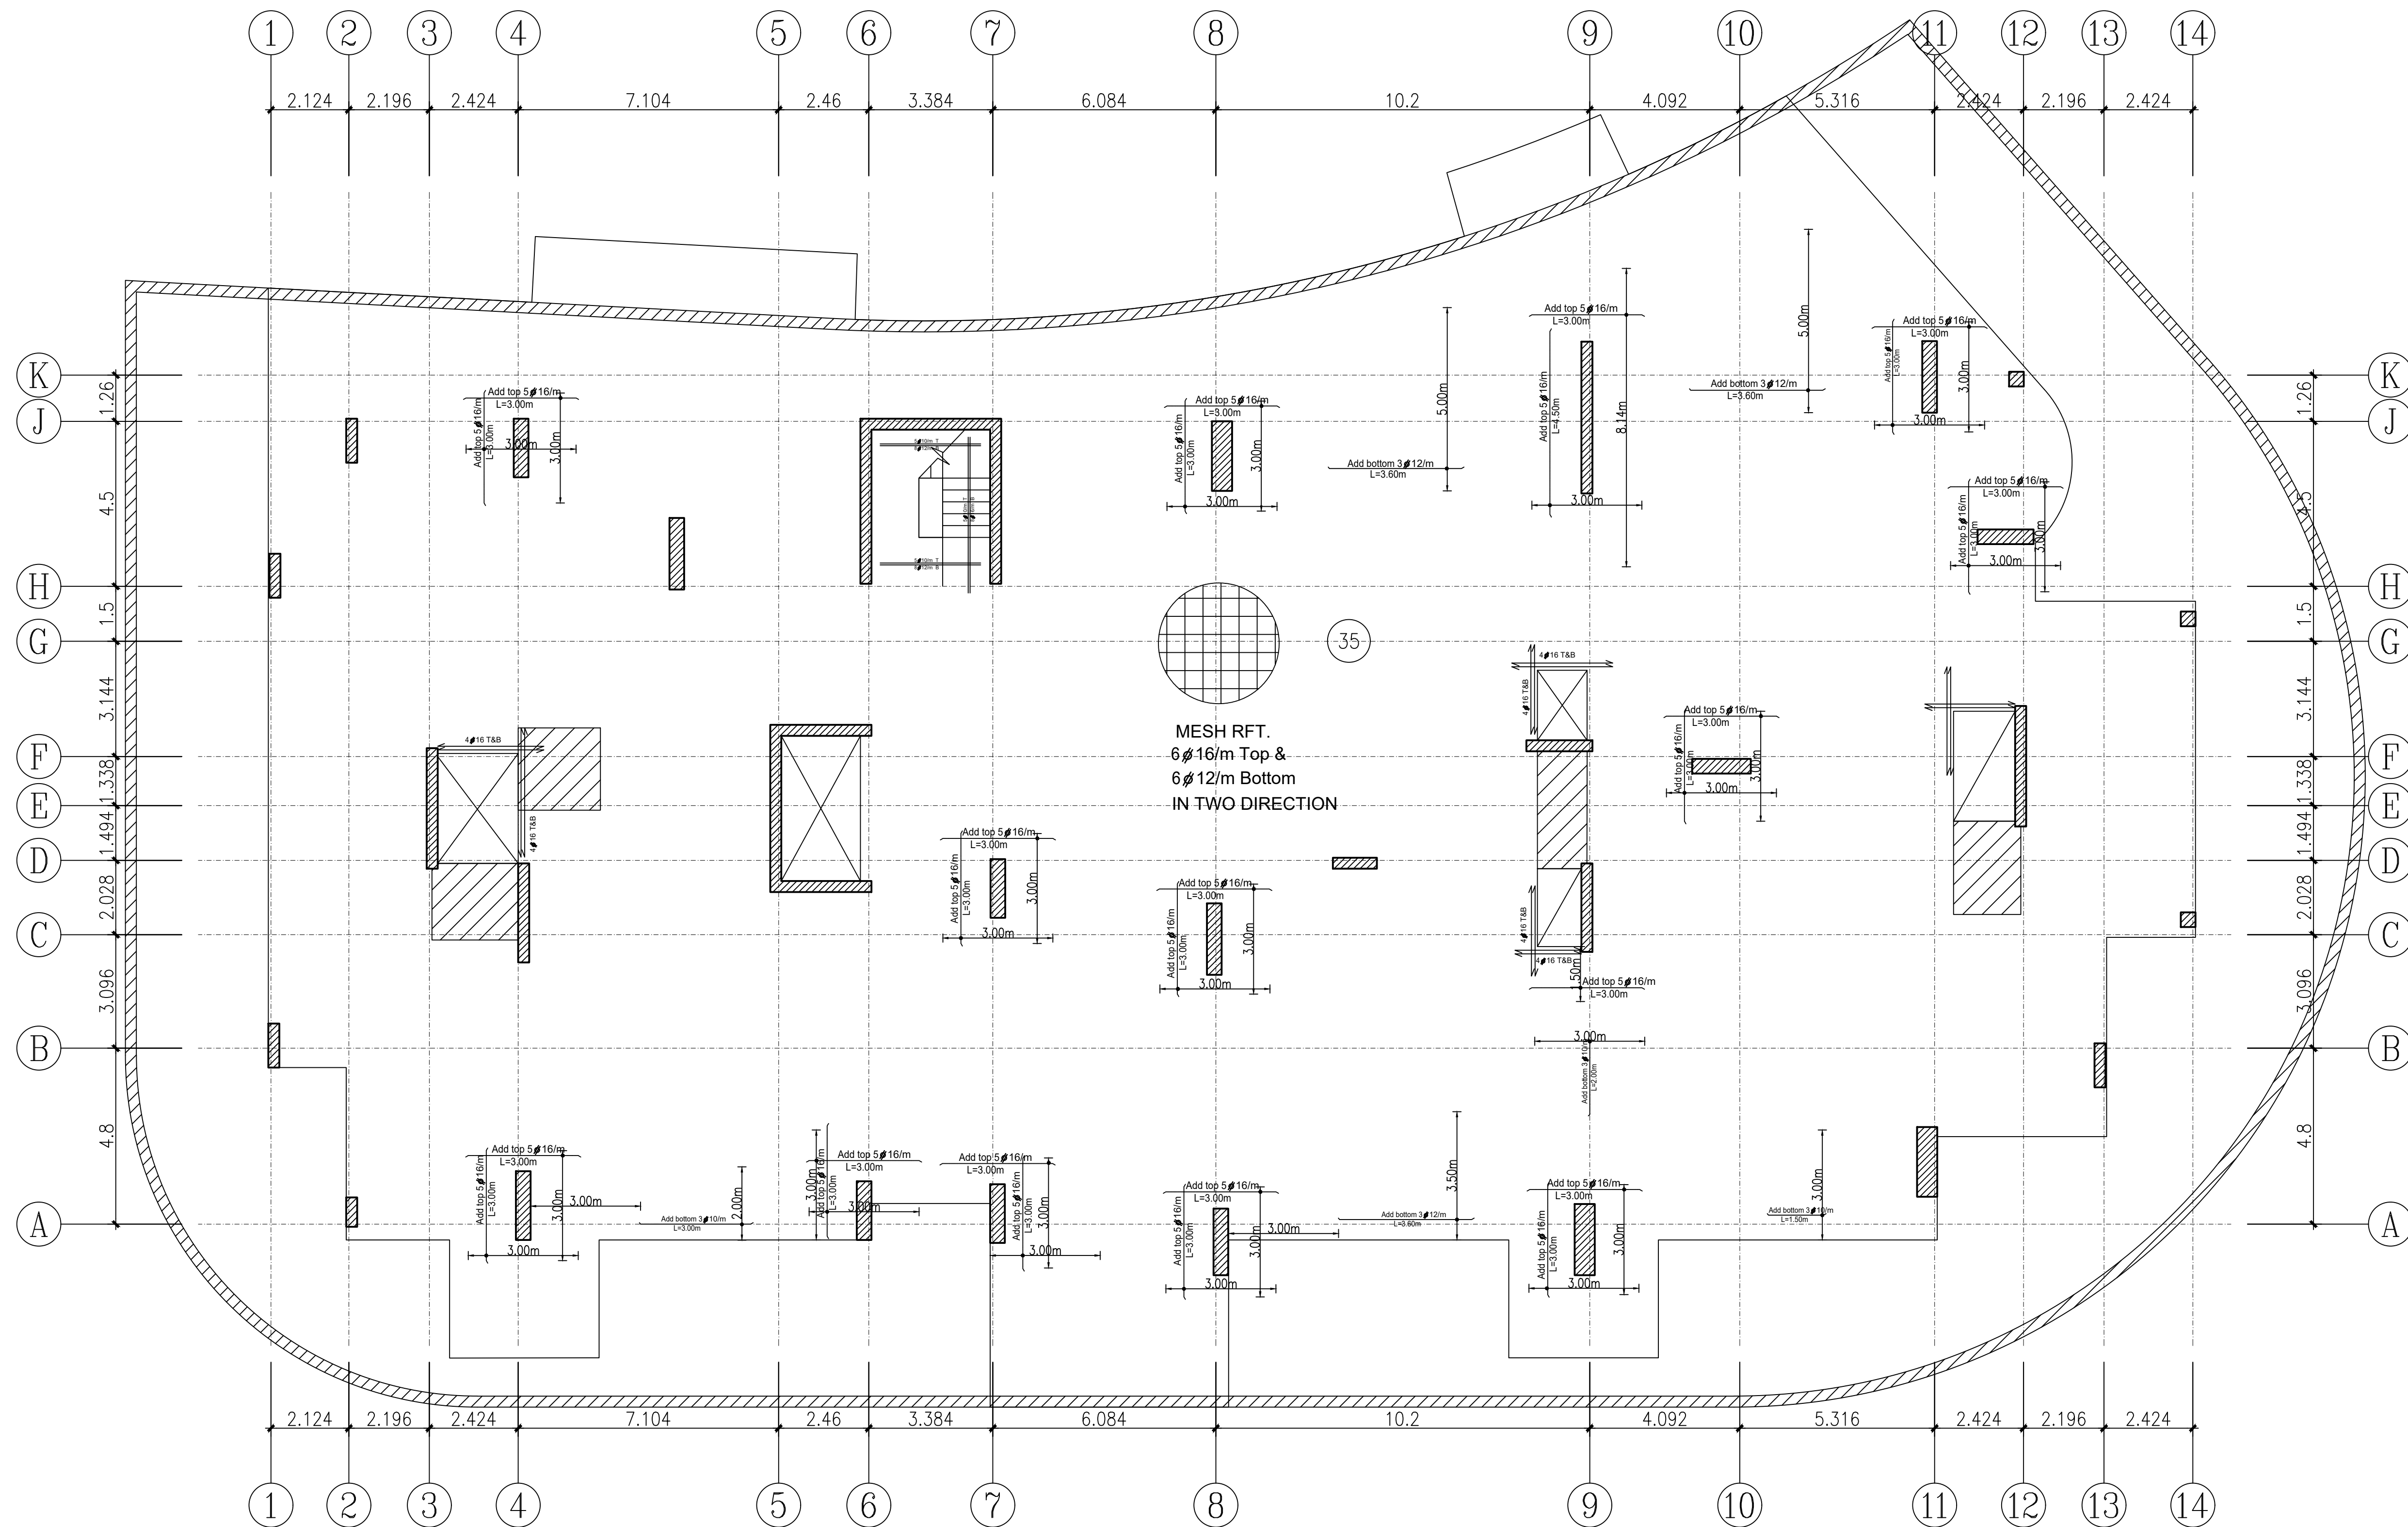



Faculty of Engineering
Cairo University
Civil Department

NOTES:

- THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.
- ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.

GENERAL NOTES:

- THIS BUILDING CONSISTS OF ONE BASEMENT, TWO OFFICE FLOORS AND TEN TYPICAL FLOORS.
- THE CHARACTERISTIC STRENGTH FOR R.C. (F_{cu}) IS 350 KG/CM^2 .
- THE CEMENT CONTENT FOR REINFORCED CONCRETE IS 350 KG/M^3 .
- THE CEMENT CONTENT FOR PLAIN CONCRETE IS 250 KG/M^3 .
- ORDINARY PORTLAND CEMENT IS USED IN ALL CONCRETE ELEMENTS.
- THE GRADE OF THE REINFORCING STEEL IS: (42/52) FOR ALL DAIMETRES GREATER THAN 8MM.

SLABS NOTES:

- EQUAL TO 70CM MUST BE PROVIDED WITH $1\phi 12$ SPACED AT 300 MM FOR EACH SIDE.
- FOR CONTINUOUS SLABS, UPPER RFT BARS MUST BE EXTENDED TO $1/4$ OF THE GREATER SPAN.
- DEVELOPED LENGTH (LD)= 60ϕ IN TENSION AND (LD)= 40ϕ IN COMPRESSION.
- $2\phi 10$ SHRINKAGE BARS IS PROVIDED FOR DEPTH $\geq 70\text{cm}$.
- REINFORCEMENT MUST BE PLACED ACCORDING TO EGYPTIAN CODE.
- CONCRETE COVER IS 2.0 CM

PROJECT NAME:



High Rise Building

By:

Anas Akram Saeed

DRAWING TITLE:

3) GROUND ROOF RFT

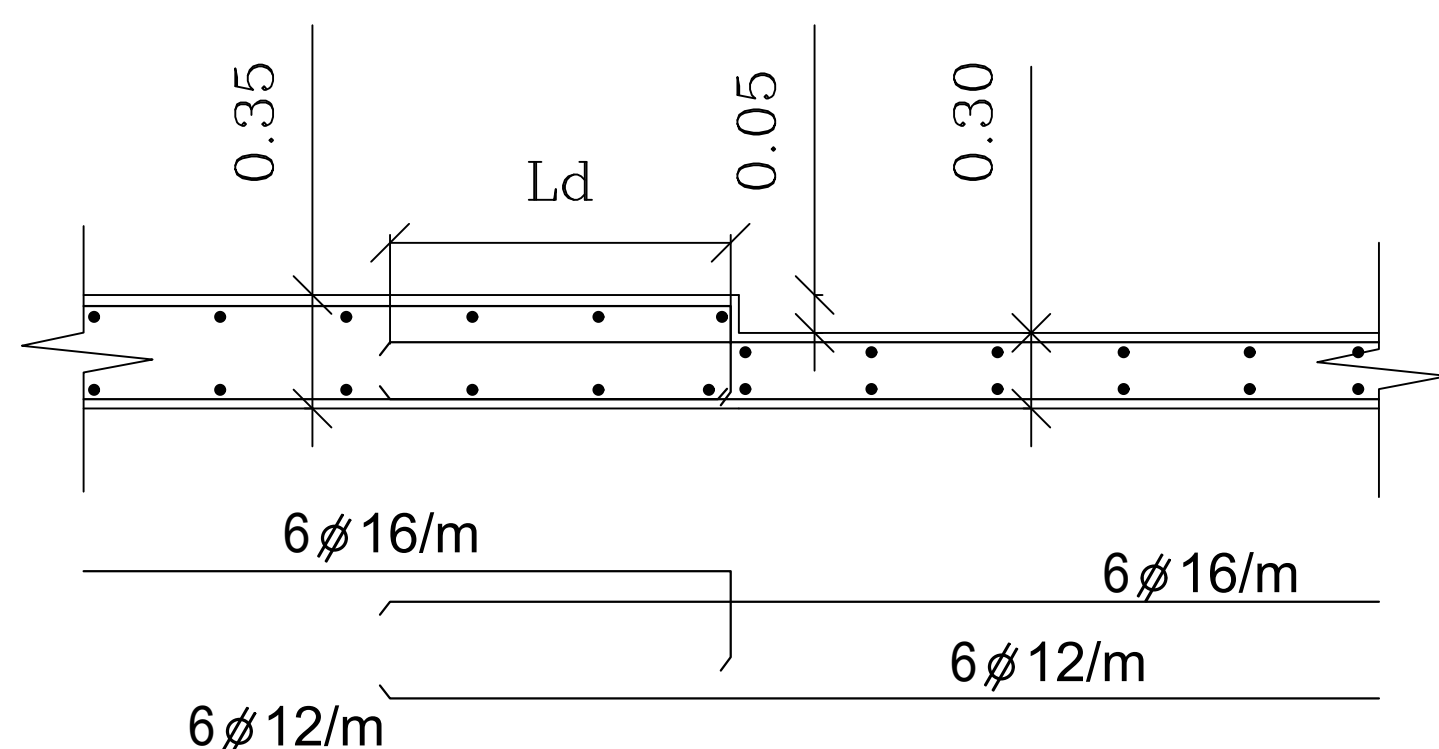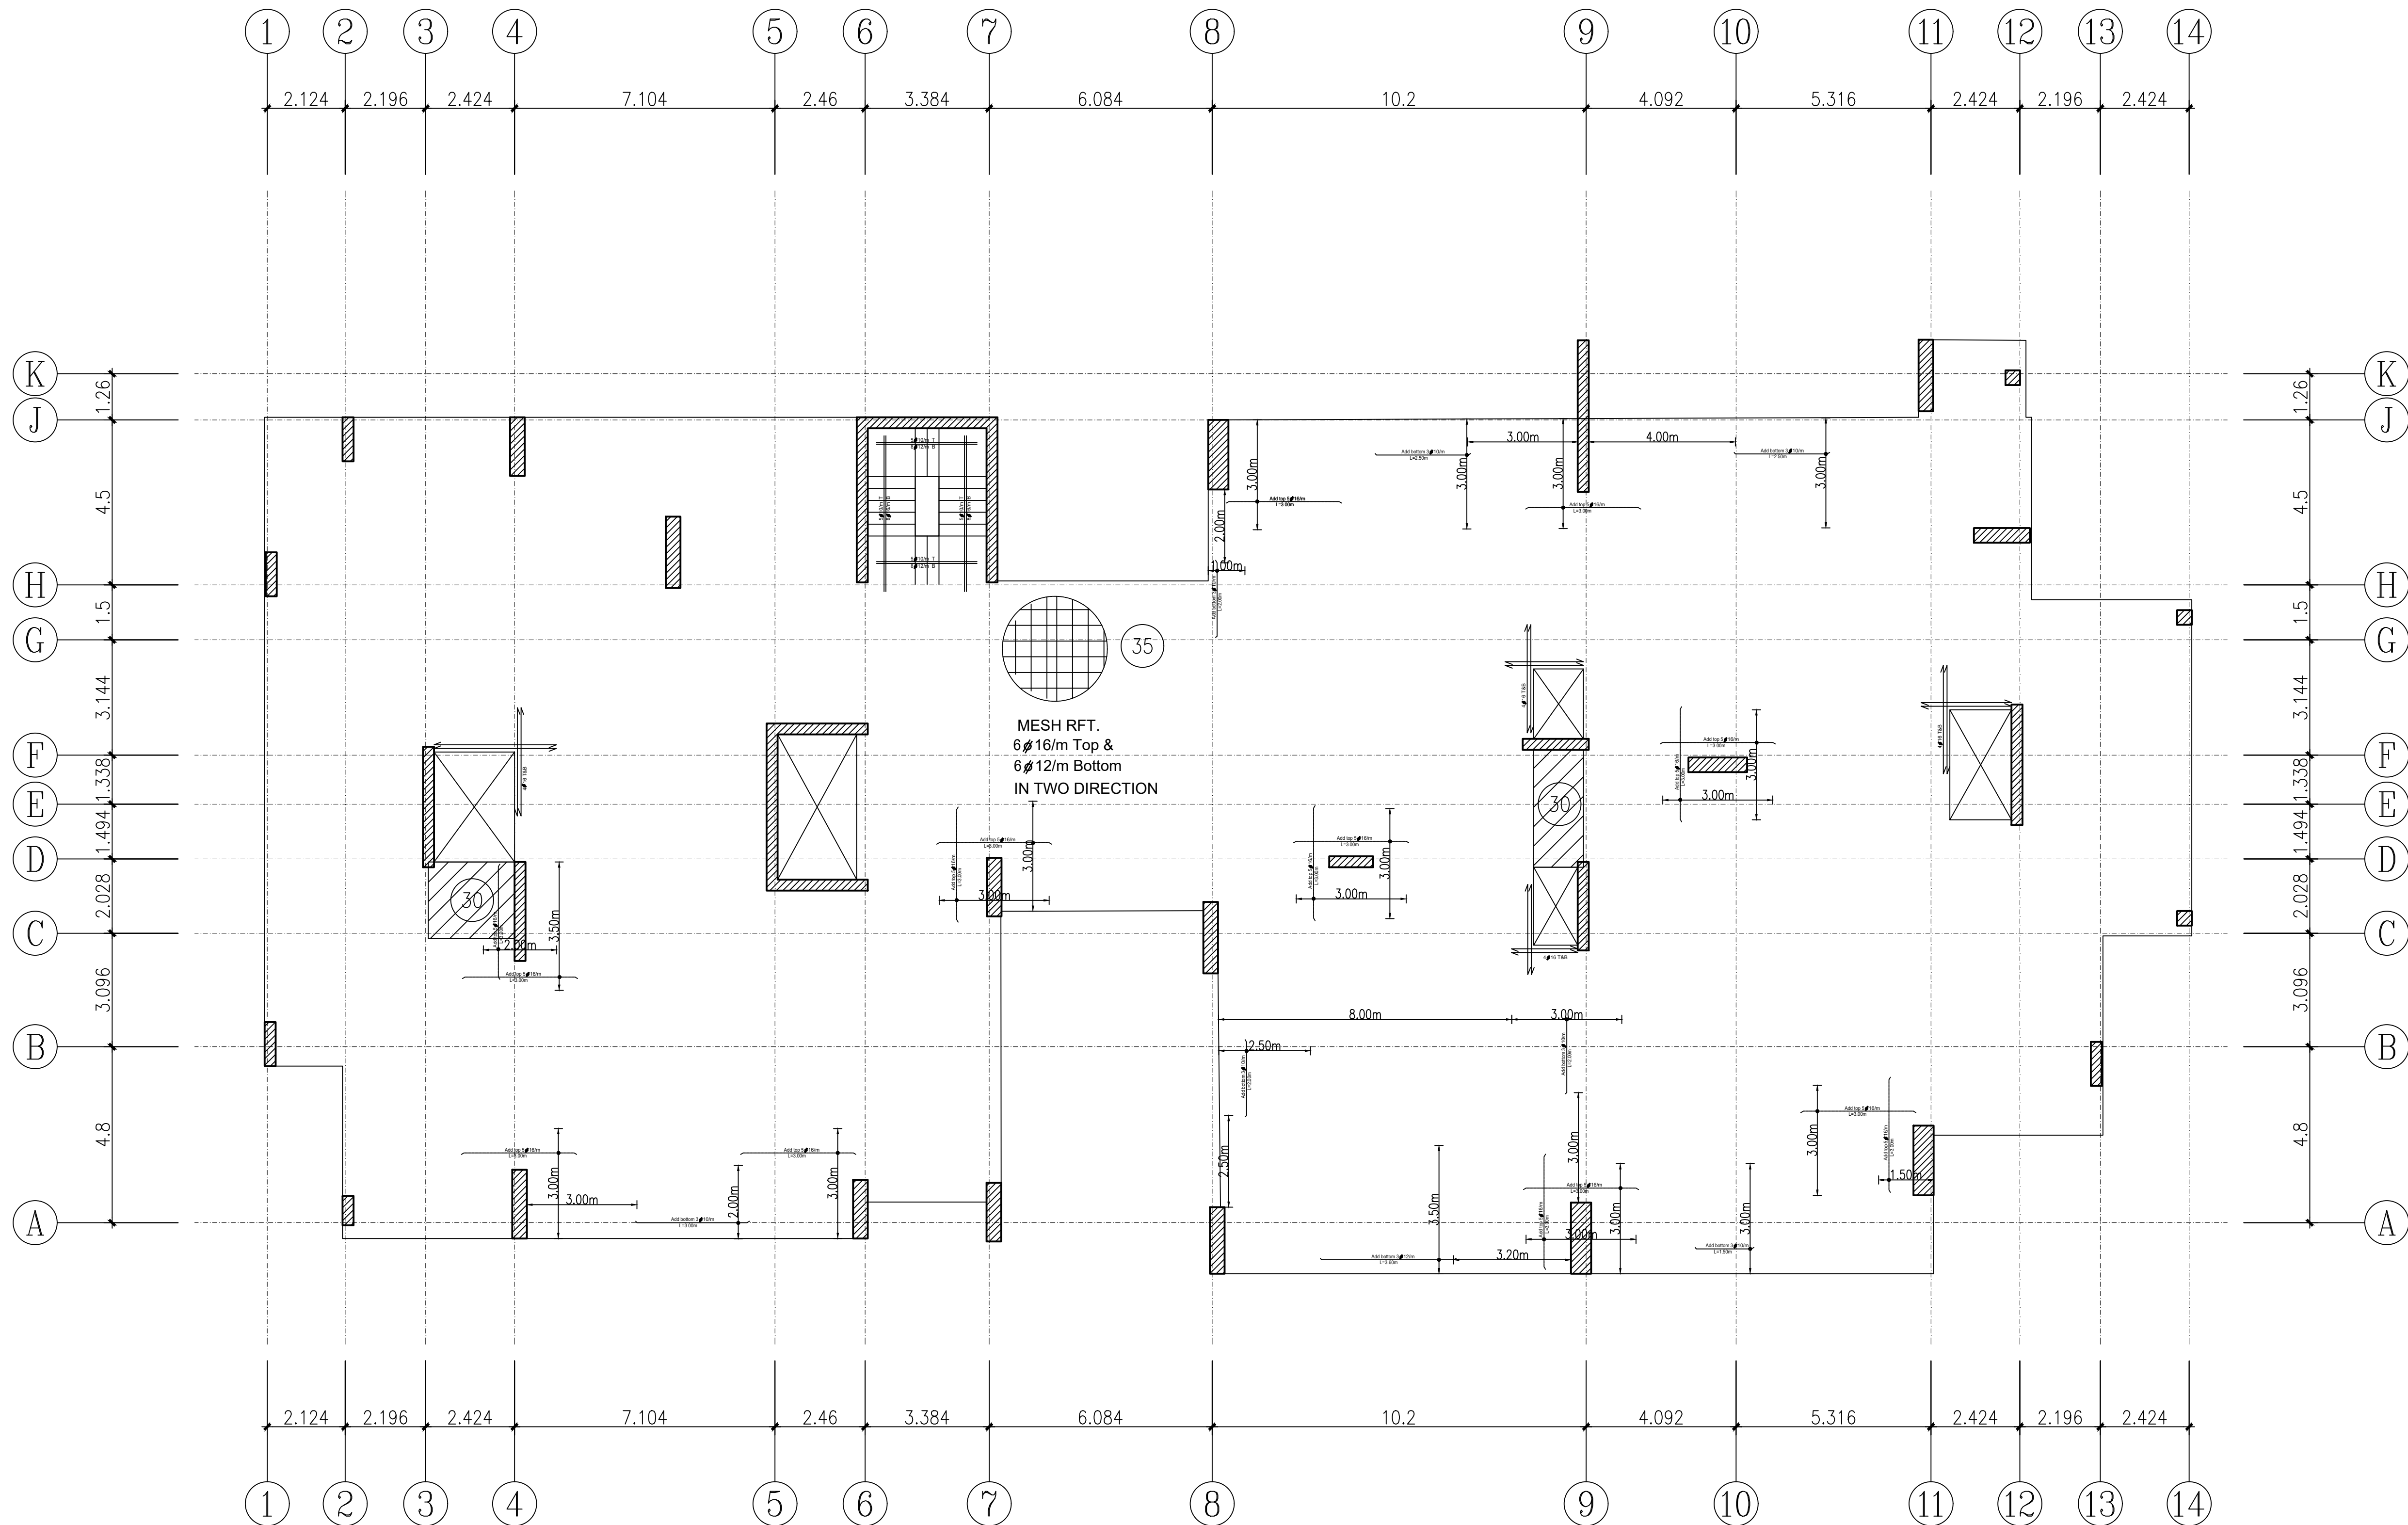



Faculty of Engineering
Cairo University
Civil Department

NOTES:

- THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.
 - ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.
- #### GENERAL NOTES:
- THIS BUILDING CONSISTS OF ONE BASEMENT, TWO OFFICE FLOORS AND TEN TYPICAL FLOORS.
 - THE CHARACTERISTIC STRENGTH FOR R.C. (F_{cu}) IS 350 KG/CM^2 .
 - THE CEMENT CONTENT FOR REINFORCED CONCRETE IS 350 KG/M^3 .
 - THE CEMENT CONTENT FOR PLAIN CONCRETE IS 250 KG/M^3 .
 - ORDINARY PORTLAND CEMENT IS USED IN ALL CONCRETE ELEMENTS.
 - THE GRADE OF THE REINFORCING STEEL IS: (42/52) FOR ALL DAIMETRES GREATER THAN 8MM.

SLABS NOTES:

- EQUAL TO 70CM MUST BE PROVIDED WITH 1012 SPACED AT 300 MM FOR EACH SIDE.
- FOR CONTINUOUS SLABS, UPPER RFT BARS MUST BE EXTENDED TO $1/4$ OF THE GREATER SPAN.
- DEVELOPED LENGTH (LD)= 60ϕ IN TENSION AND (LD)= 40ϕ IN COMPRESSION.
- $2\phi 10$ SHRINKAGE BARS IS PROVIDED FOR DEPTH $\geq 70\text{cm}$.
- REINFORCEMENT MUST BE PLACED ACCORDING TO EGYPTIAN CODE.
- CONCRETE COVER IS 2.0 CM

PROJECT NAME :



High Rise Building

By :

Anas Akram Saeed

DRAWING TITLE :

4) TYPICAL ROOF RFT

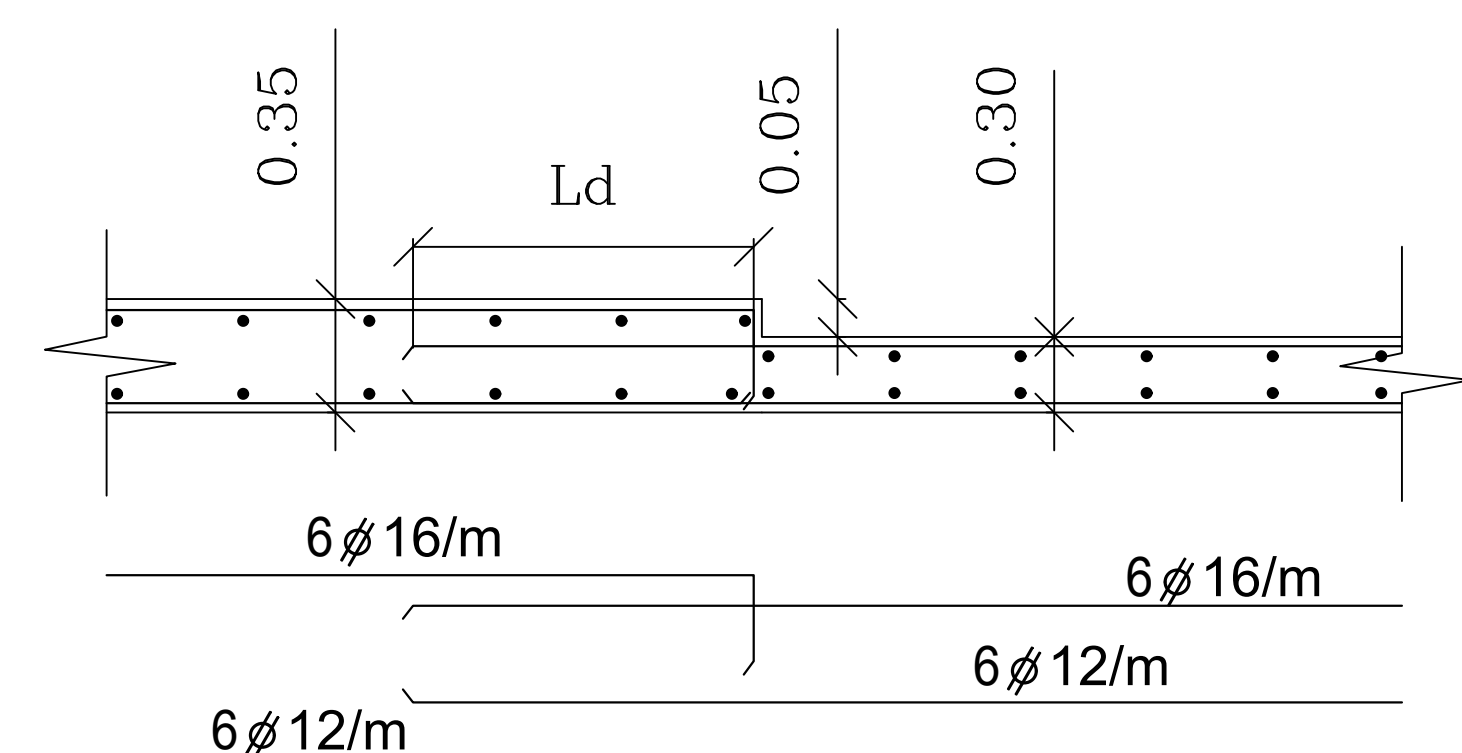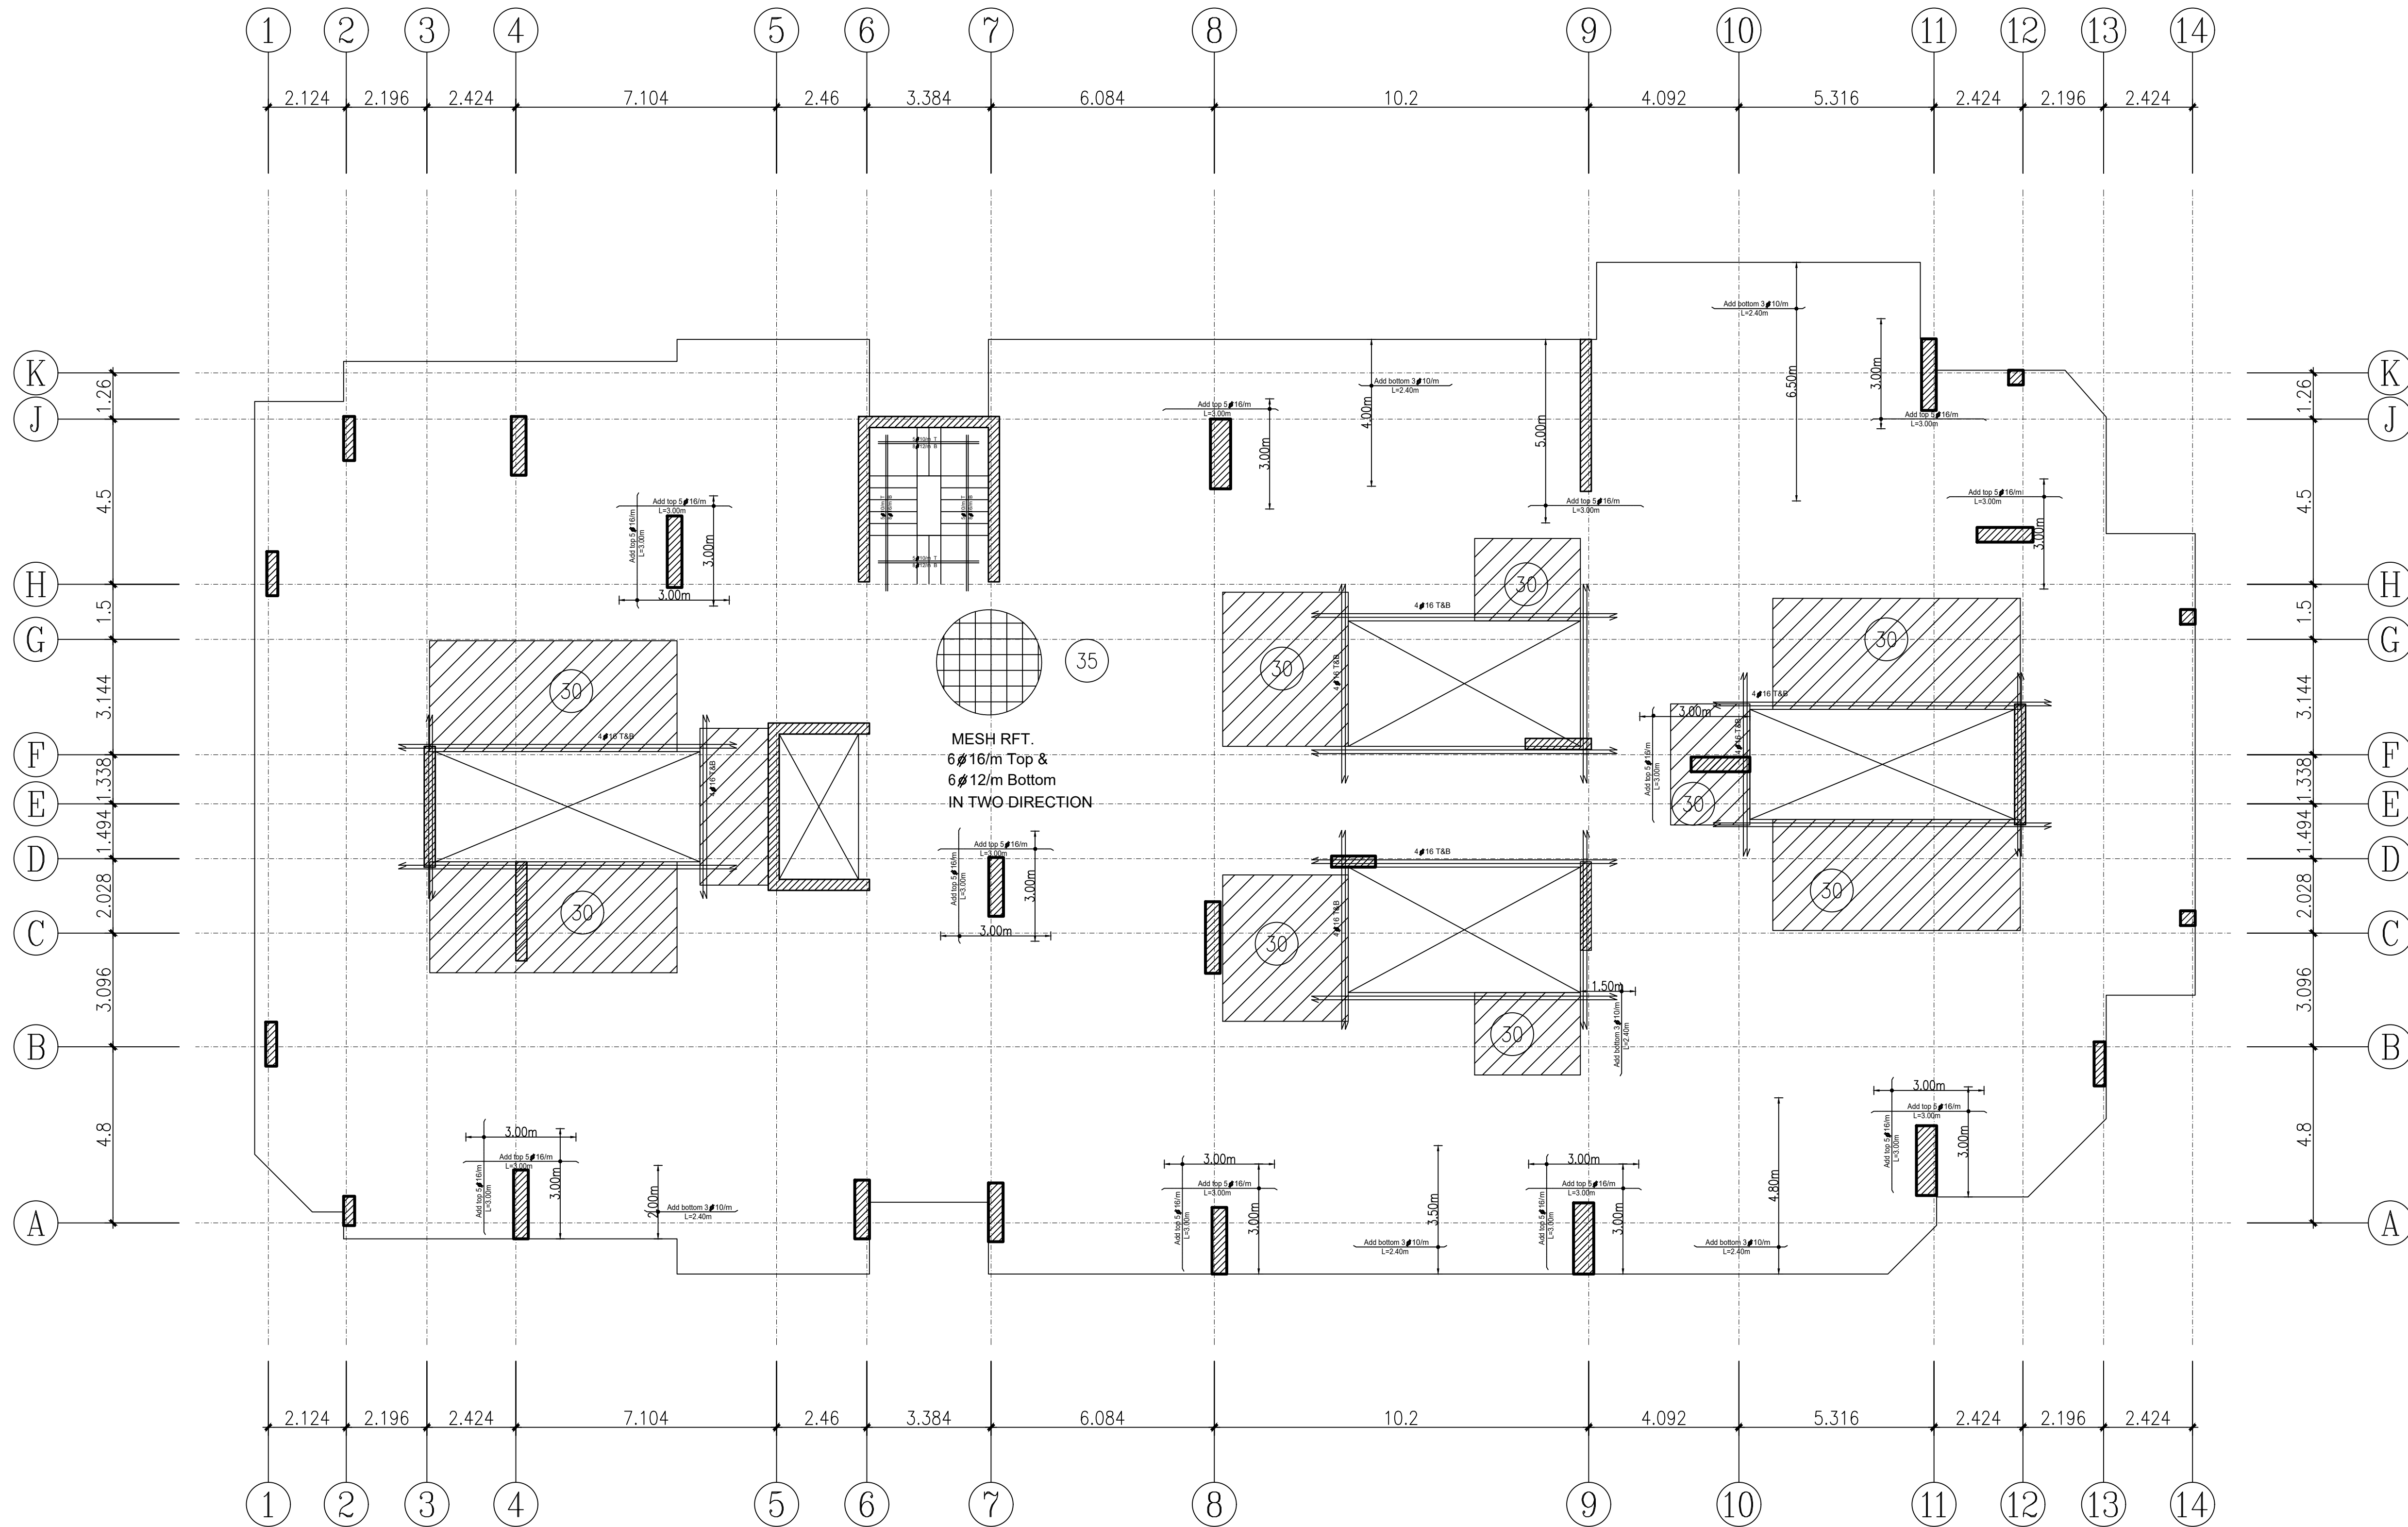



Faculty of Engineering
Cairo University
Civil Department

NOTES:

- o THE CONTRACTOR MUST CHECK ALL ARCHITECTURAL, STRUCTURAL AND ELECTROMECHANICAL DRAWINGS BEFORE CONSTRUCTION.
- o ALL DIMENSIONS ARE IN METERS AND MUST BE VERIFIED ON SITE AND APPROVED BY THE ENGINEER.

GENERAL NOTES:

- 1) THIS BUILDING CONSISTS OF ONE BASEMENT, TWO OFFICE FLOORS AND TEN TYPICAL FLOORS.
- 2) THE CHARACTERISTIC STRENGTH FOR R.C. (F_{cu}) IS 350 KG/CM².
- 3) THE CEMENT CONTENT FOR REINFORCED CONCRETE IS 350 KG/M³.
- 4) THE CEMENT CONTENT FOR PLAIN CONCRETE IS 250 KG/M³.
- 5) ORDINARY PORTLAND CEMENT IS USED IN ALL CONCRETE ELEMENTS.
- 6) THE GRADE OF THE REINFORCING STEEL IS: (42/52) FOR ALL DAIMETRES GREATER THAN 8MM.

SLABS NOTES:

- 1) EQUAL TO 70CM MUST BE PROVIDED WITH 1012 SPACED AT 300 MM FOR EACH SIDE.
- 2) FOR CONTINUOUS SLABS, UPPER RFT BARS MUST BE EXTENDED TO 1/4 OF THE GREATER SPAN.
- 3) DEVELOPED LENGTH (LD)= 60 ϕ IN TENSION AND (LD)= 40 ϕ IN COMPRESSION.
- 4) 2 ϕ 10 SHRINKAGE BARS IS PROVIDED FOR DEPTH $\geq$ 70cm.
- 5) REINFORCEMENT MUST BE PLACED ACCORDING TO EGYPTIAN CODE.
- 6) CONCRETE COVER IS 2.0 CM

PROJECT NAME :

High Rise Building

By :

Anas Akram Saeed

DRAWING TITLE :

5) ROOF SLAB RFT

