



Faculty of Engineering  
Cairo University  
Civil Department

Notes:

- Verify all dimensions and axes with the architectural drawings before starting execution.
- The net foundation level must not be less than what is found in the soil report.
- The compressive strength of concrete for reinforced concrete after 28 days should not be less than 350 kg/cm<sup>2</sup>
- The concrete mix for reinforced concrete must achieve the required strength, and the cement content should not be less than 350 kg/m<sup>2</sup>
- The compressive strength of concrete for plain concrete after 28 days should not be less than 250 kg/cm<sup>2</sup>
- The concrete mix for plain concrete must achieve the required strength, and the cement content should not be less than 250 kg/m<sup>2</sup>
- The yield strength should not be less than 4200 kg/cm<sup>2</sup> and the percentage of elongation should not be less than 10%.
- The concrete cover for main reinforcement bars should not be less than 2.5 cm, except where otherwise specified.
- The diameter of stirrups should not be less than 8 mm, unless otherwise specified.
- It is strictly prohibited to use waste, debris, or any foreign materials in the concrete mix.
- All necessary tests must be performed before and during the execution, as well as water tightness tests for tanks.
- The contractor must carry out all required site tests and preparatory works before pouring concrete.
- All additives used must be approved by the supervising engineer.
- Water stops must be installed at construction joints when specified.

PROJECT NAME :


Tank Unit

By :

Anas Akram Saeed

DRAWING TITLE :





Concrete Dimensions

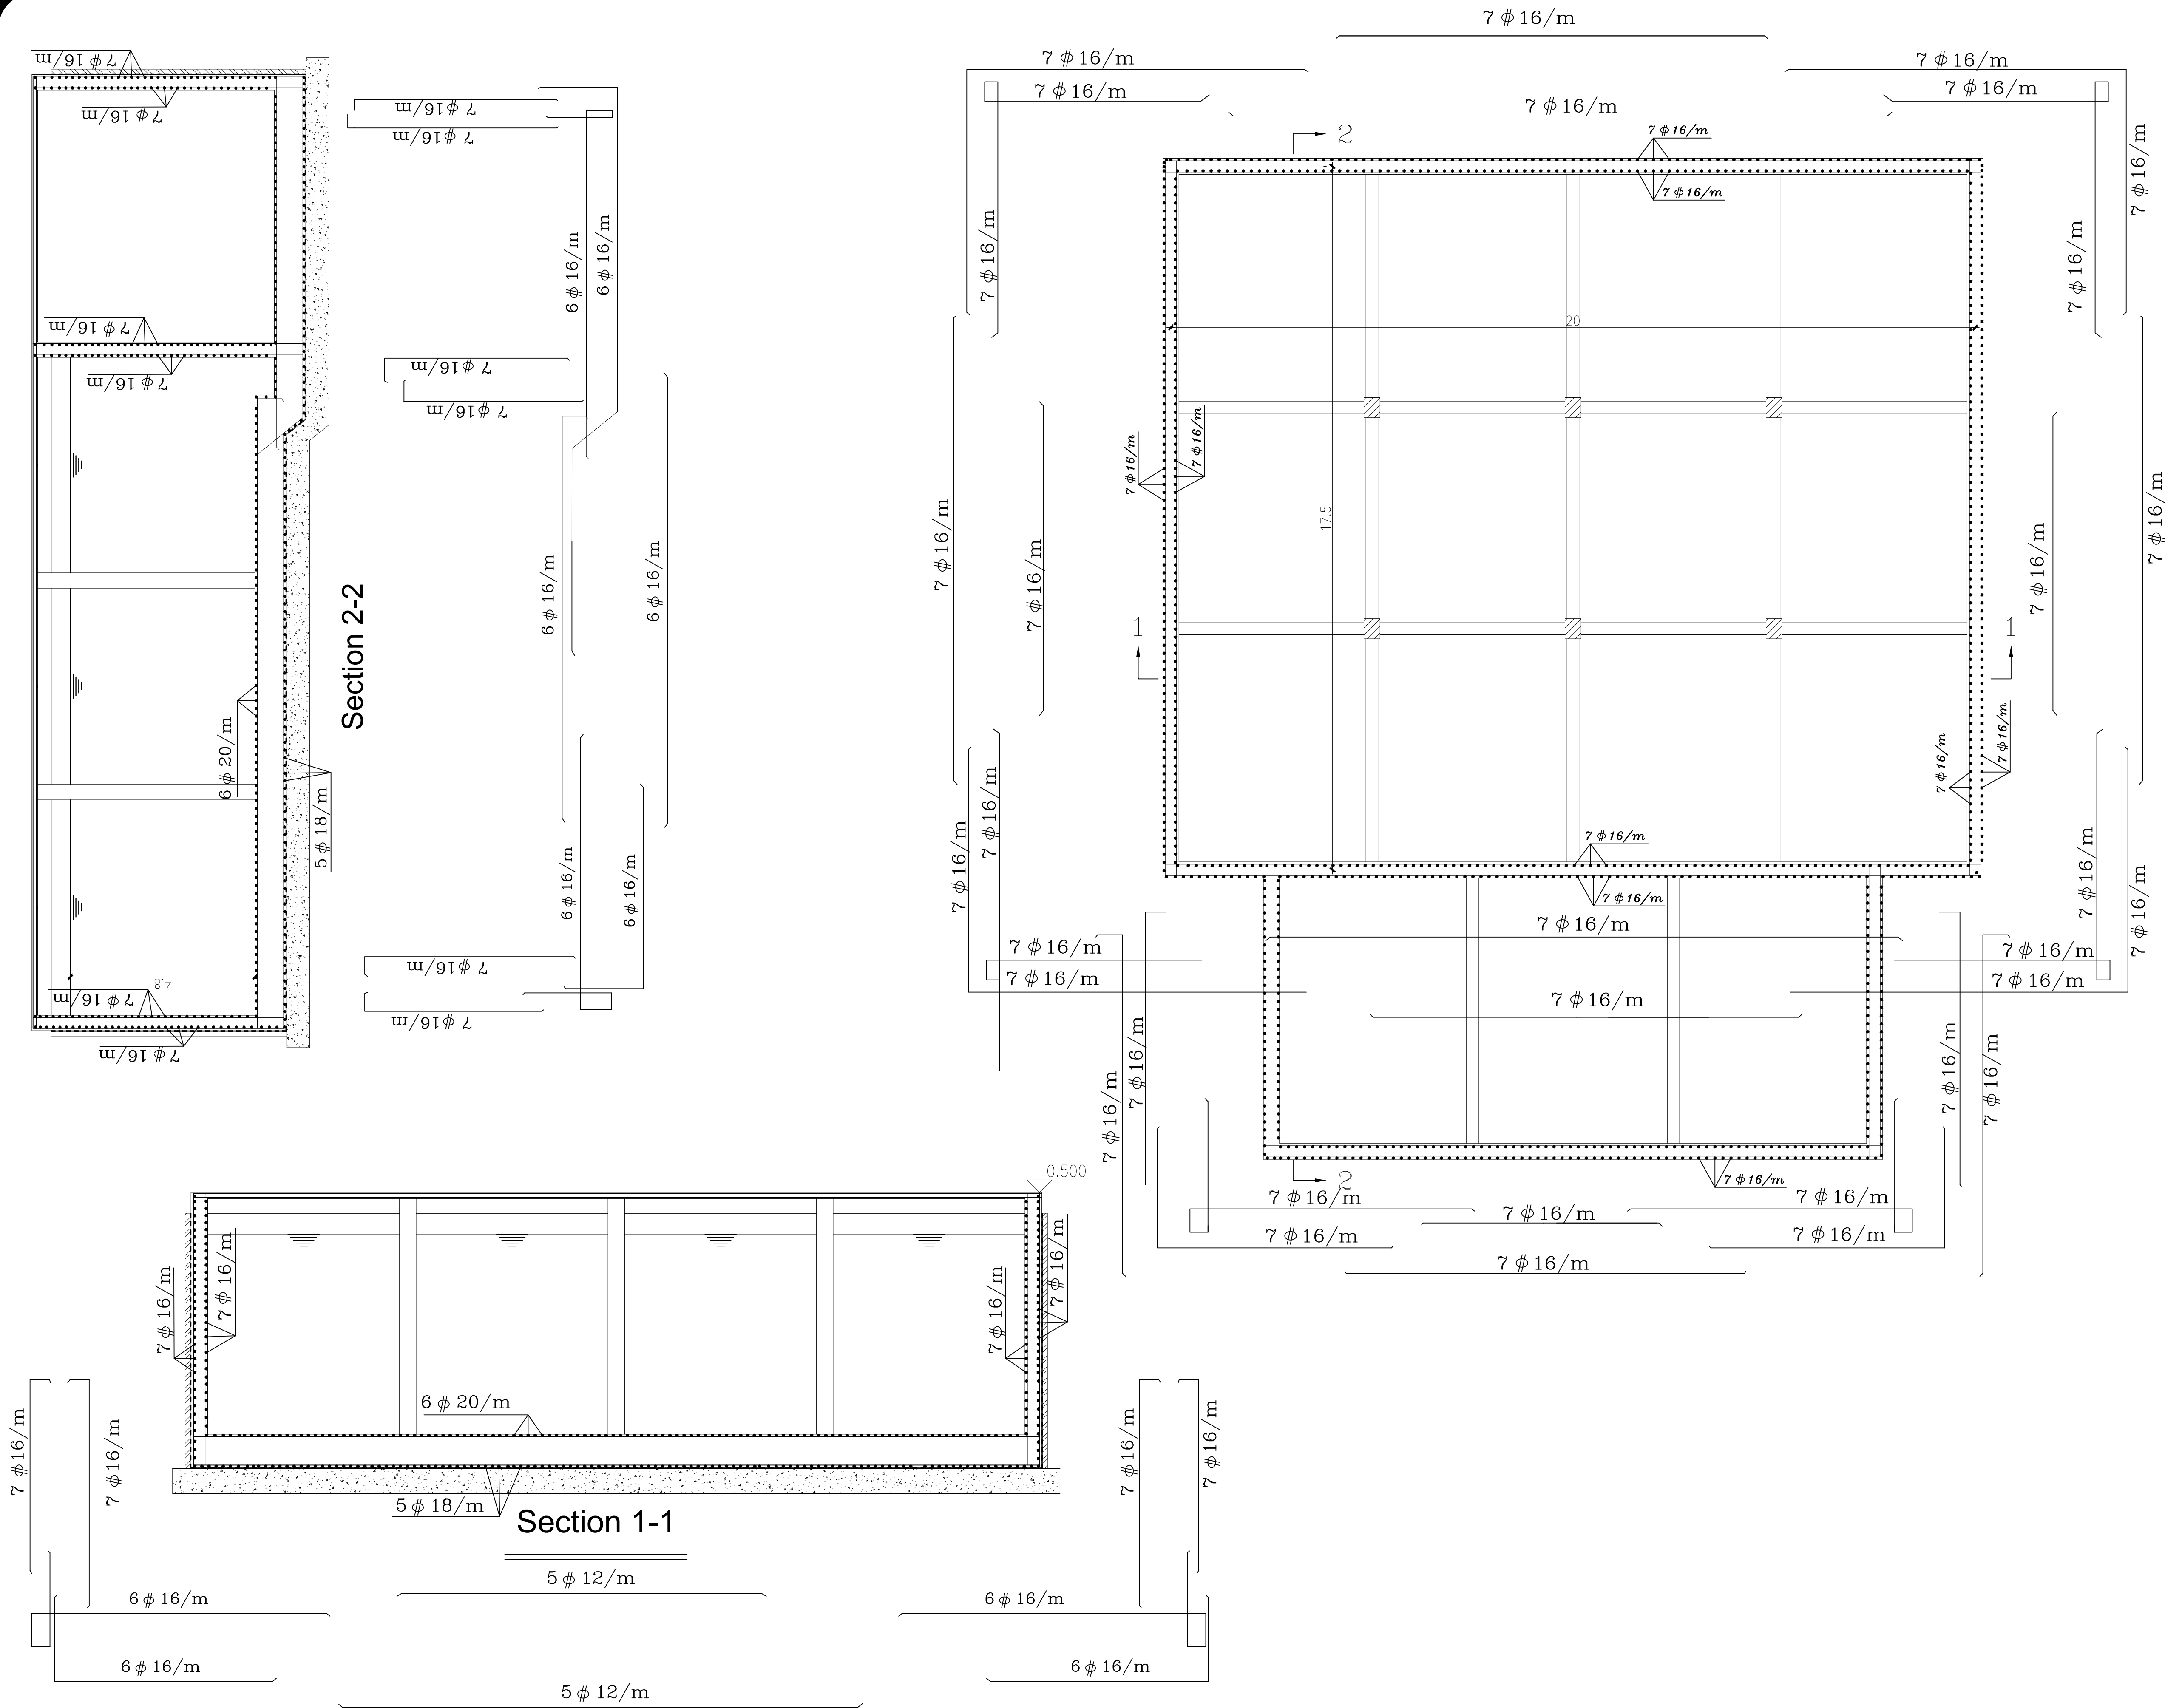



Beam Table

| Beam | Bottom Rft. | Top Rft. |        | Stirrups |
|------|-------------|----------|--------|----------|
|      |             | support  | Hanger |          |
| B1   | 3Ø16        | 4Ø16     | 2Ø12   | 5 Ø 10/m |
| B2   | 3Ø16        | 4Ø16     | 2Ø12   | 5 Ø 10/m |
| B3   | 3Ø16        | 3Ø16     | 2Ø12   | 5 Ø 10/m |
| B4   | 3Ø16        | 3Ø16     | 2Ø12   | 5 Ø 10/m |
| B5   | 4Ø16        | 7Ø16     | 2Ø12   | 5 Ø 10/m |
| B6   | 4Ø16        | 7Ø16     | 2Ø12   | 5 Ø 10/m |

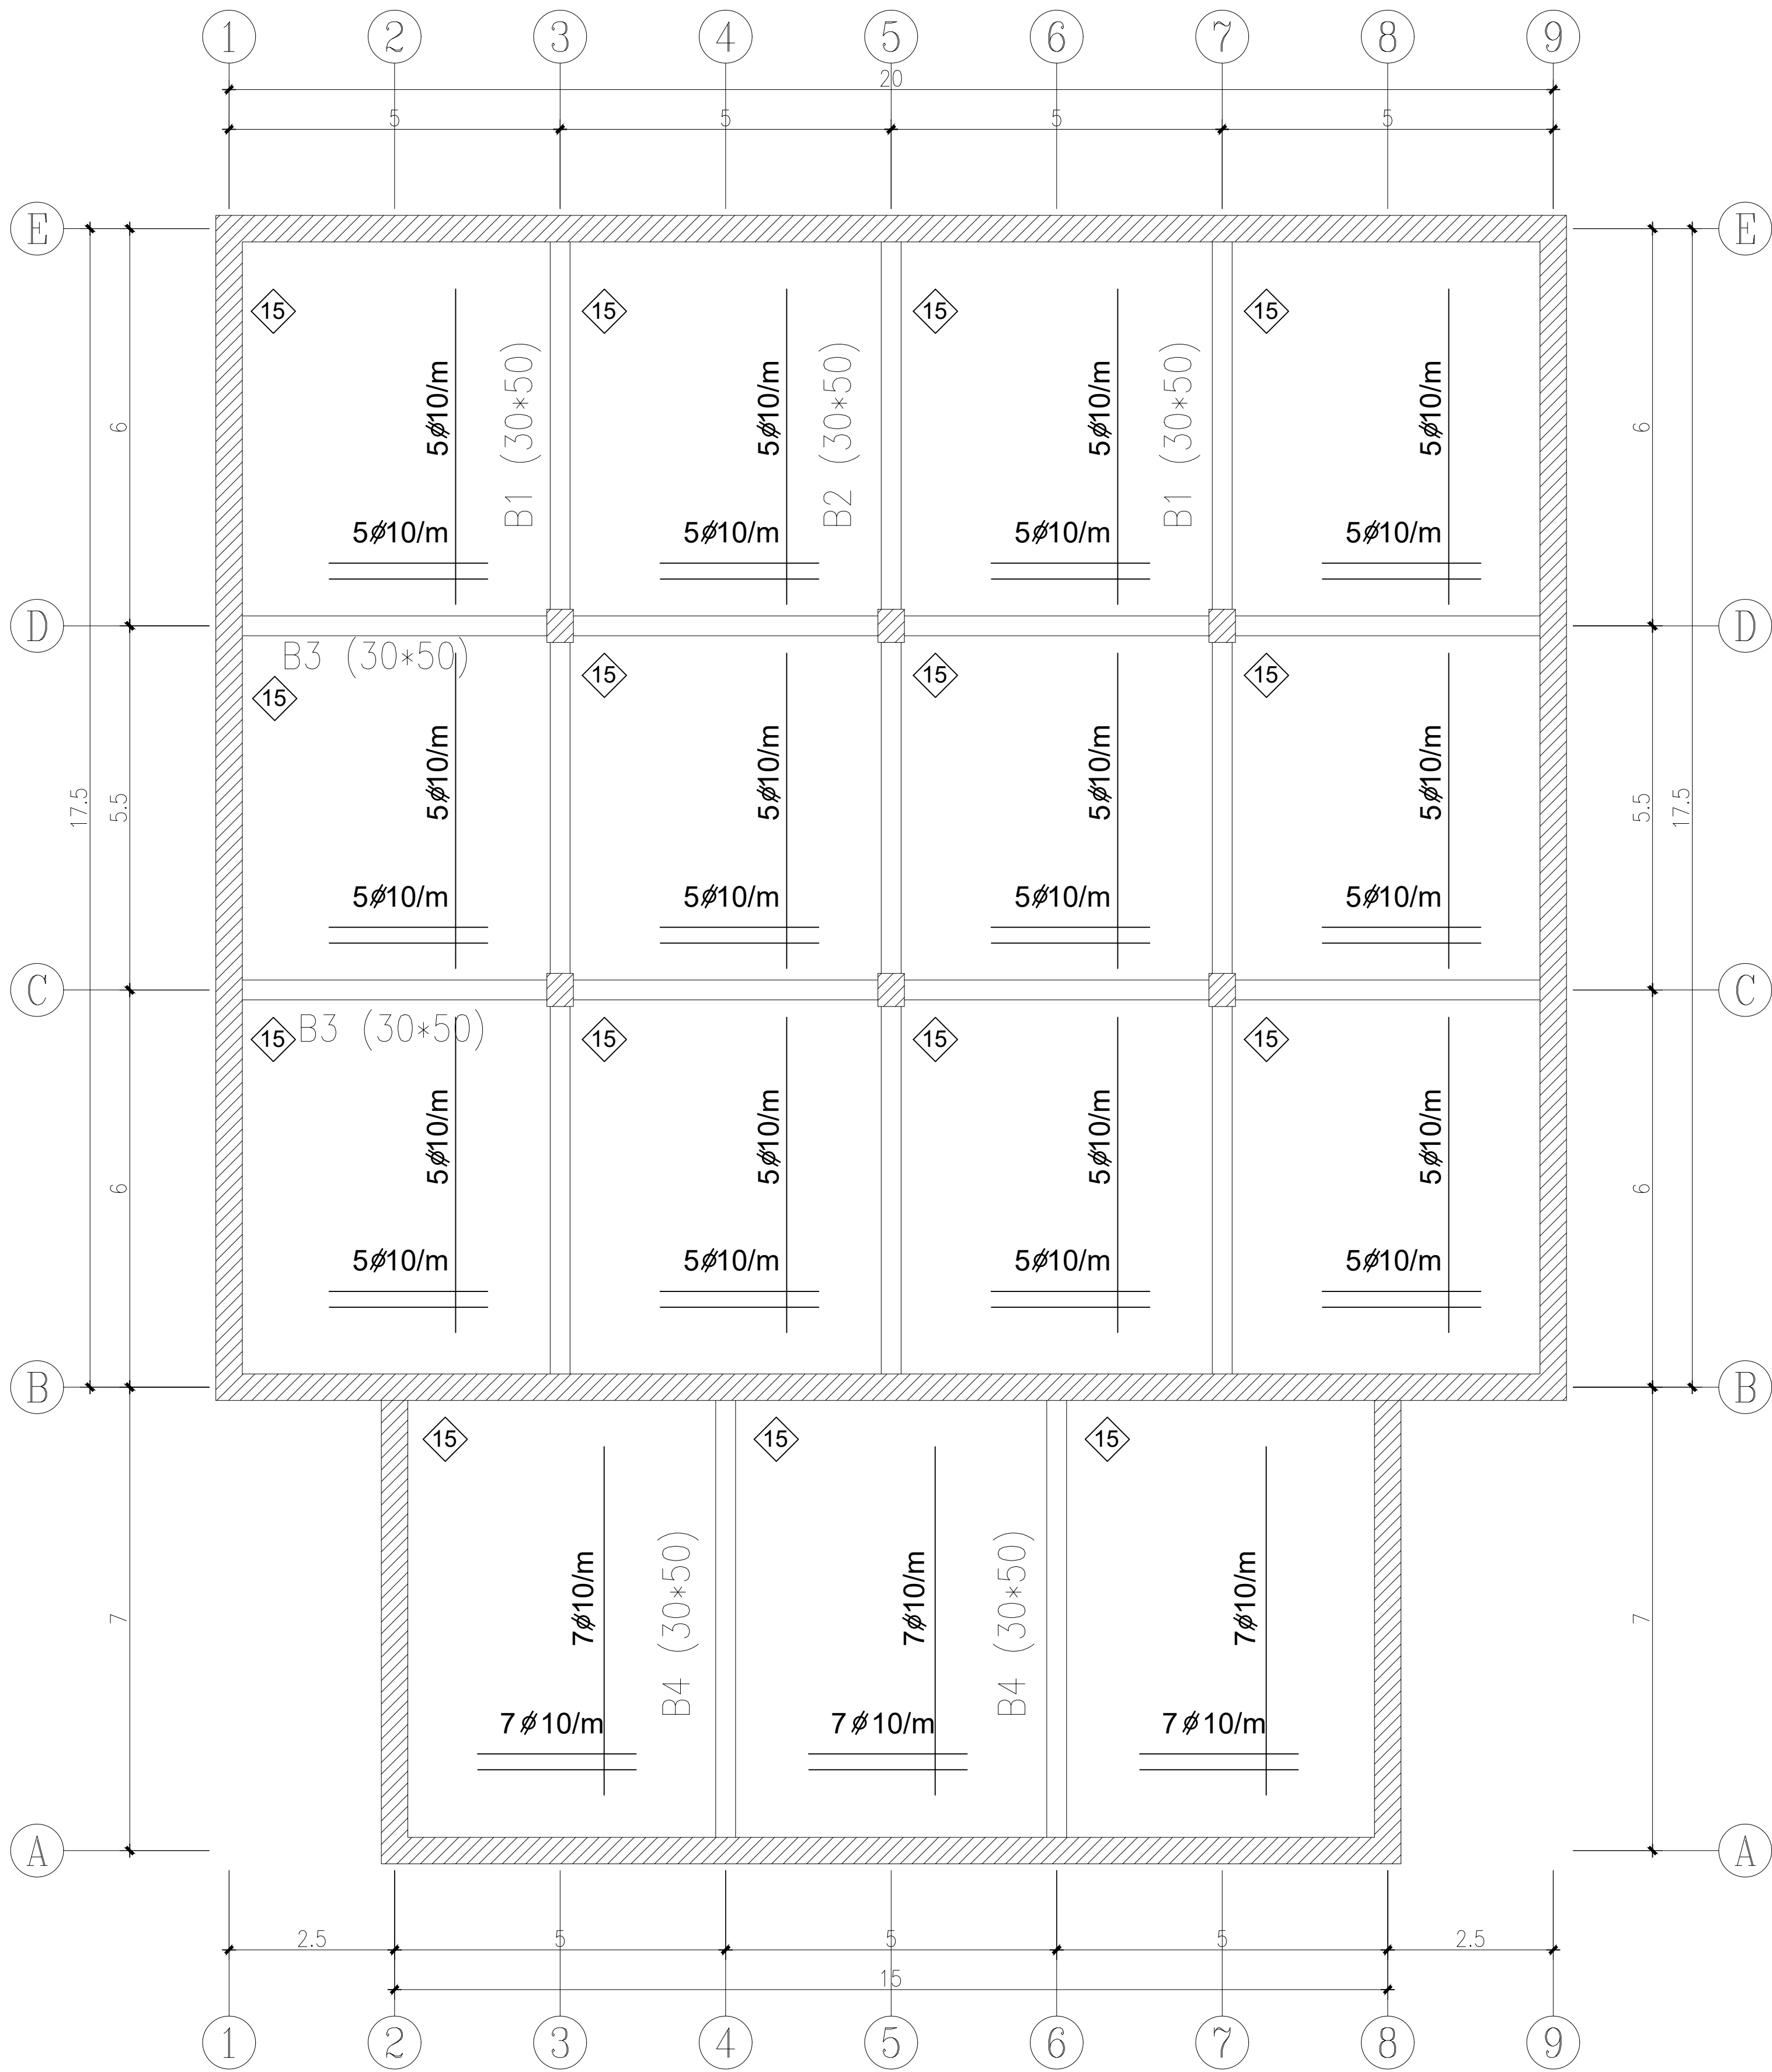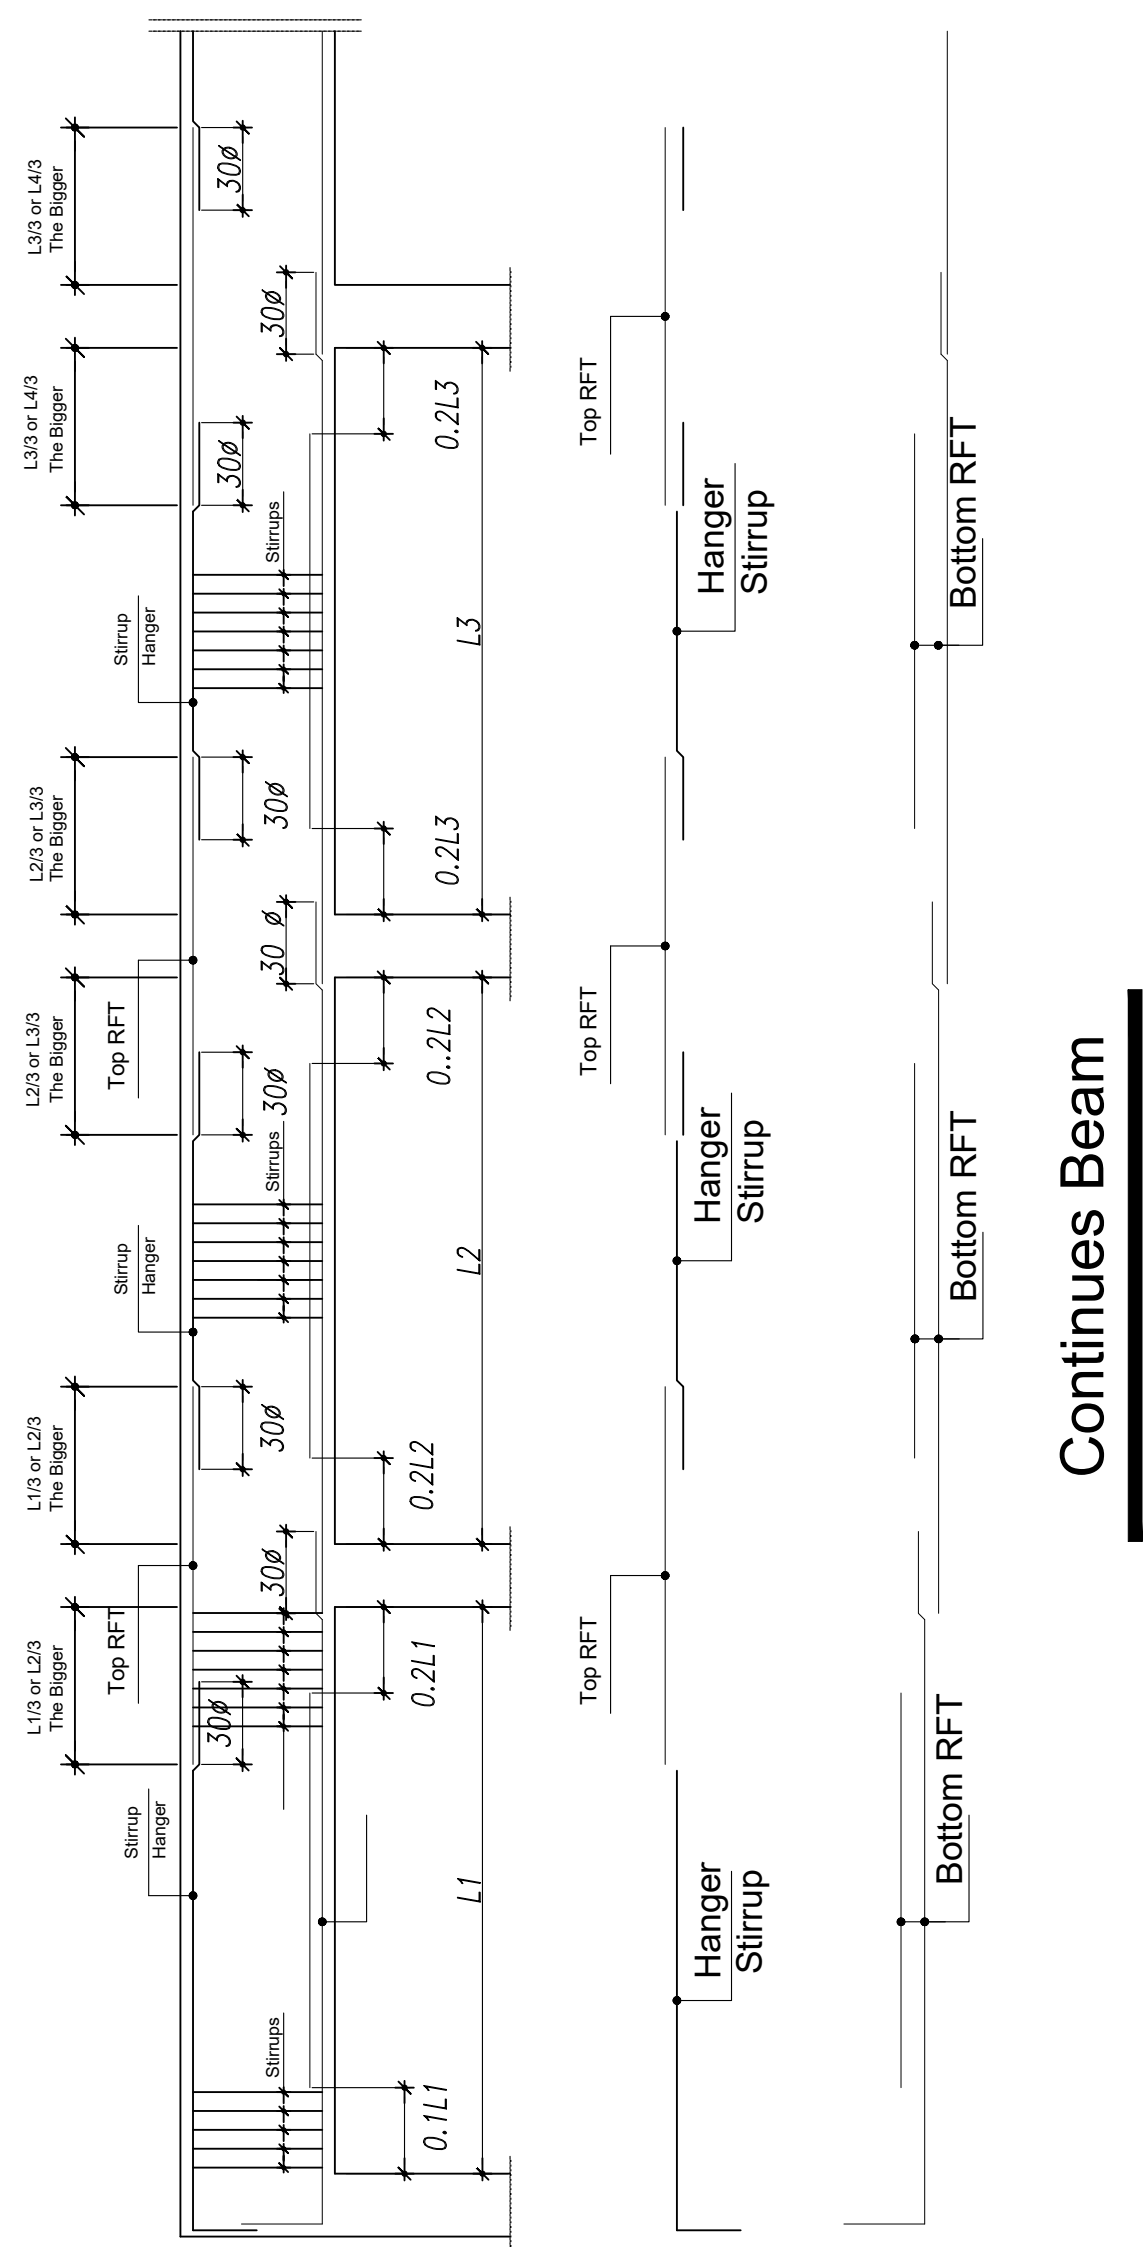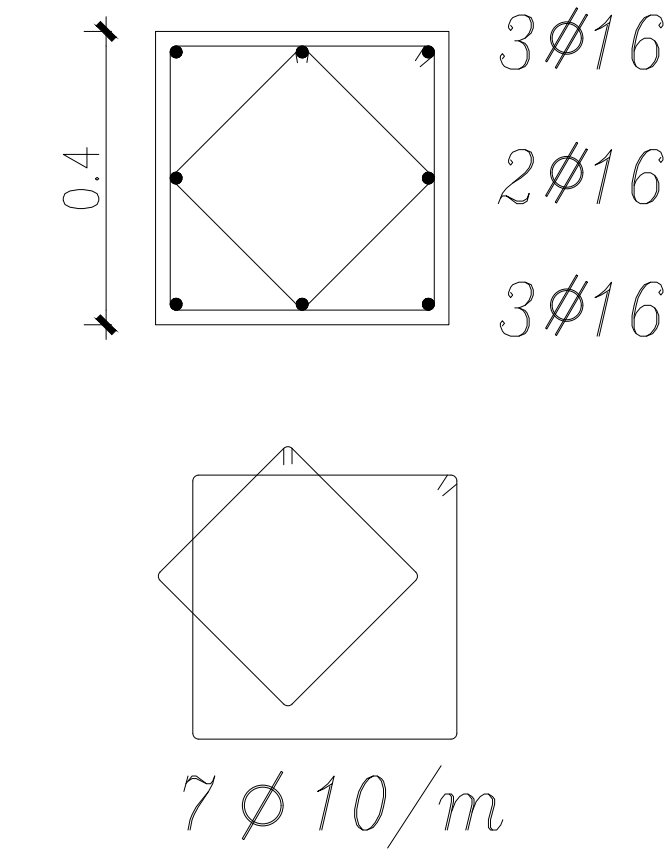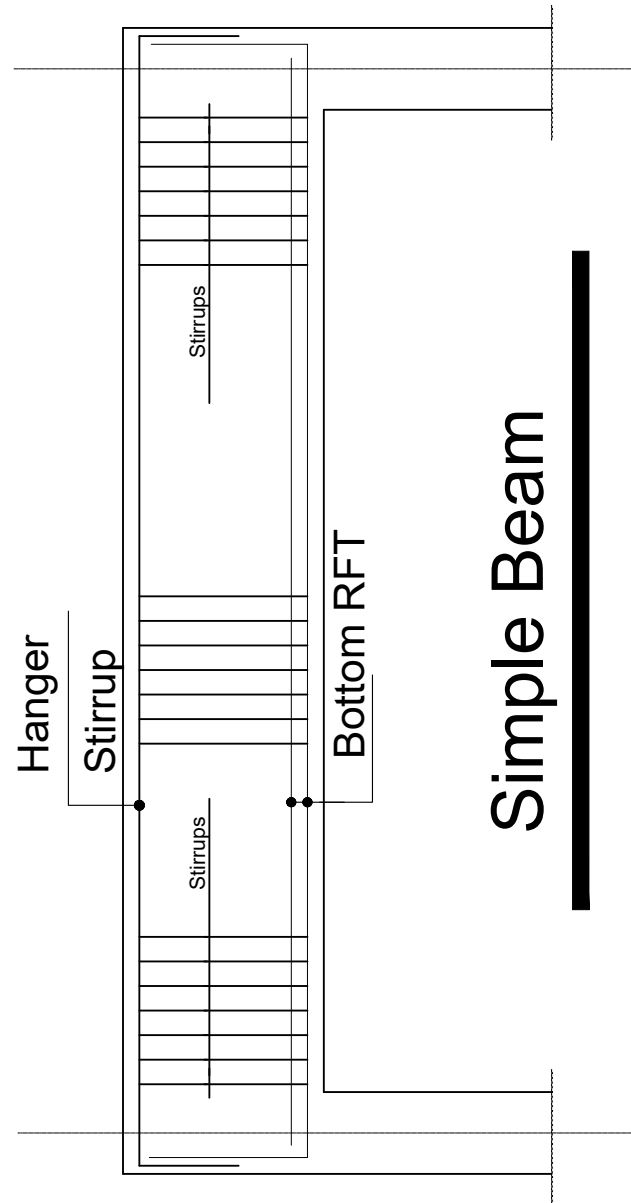

Faculty of Engineering  
Cairo University  
Civil Department


- Notes:
- Verify all dimensions and axes with the architectural drawings before starting execution.
  - The net foundation level must not be less than what is found in the soil report.
  - The compressive strength of concrete for reinforced concrete after 28 days should not be less than 350 kg/cm2
  - The concrete mix for reinforced concrete must achieve the required strength, and the cement content should not be less than 350 kg/m2
  - The compressive strength of concrete for plain concrete after 28 days should not be less than 250 kg/cm2
  - The concrete mix for plain concrete must achieve the required strength, and the cement content should not be less than 250 kg/m2
  - The yield strength should not be less than 4200 kg/cm2 and the percentage of elongation should not be less than 10%.
  - The concrete cover for main reinforcement bars should not be less than 2.5 cm, except where otherwise specified.
  - The diameter of stirrups should not be less than 8 mm, unless otherwise specified.
  - It is strictly prohibited to use waste, debris, or any foreign materials in the concrete mix.
  - All necessary tests must be performed before and during the execution, as well as water tightness tests for tanks.
  - The contractor must carry out all required site tests and preparatory works before pouring concrete.
  - All additives used must be approved by the supervising engineer.
  - Water stops must be installed at construction joints when specified.

PROJECT NAME :  
Tank Unit


By :  
Anas Akram Saeed

DRAWING TITLE :  
ROOF RFT



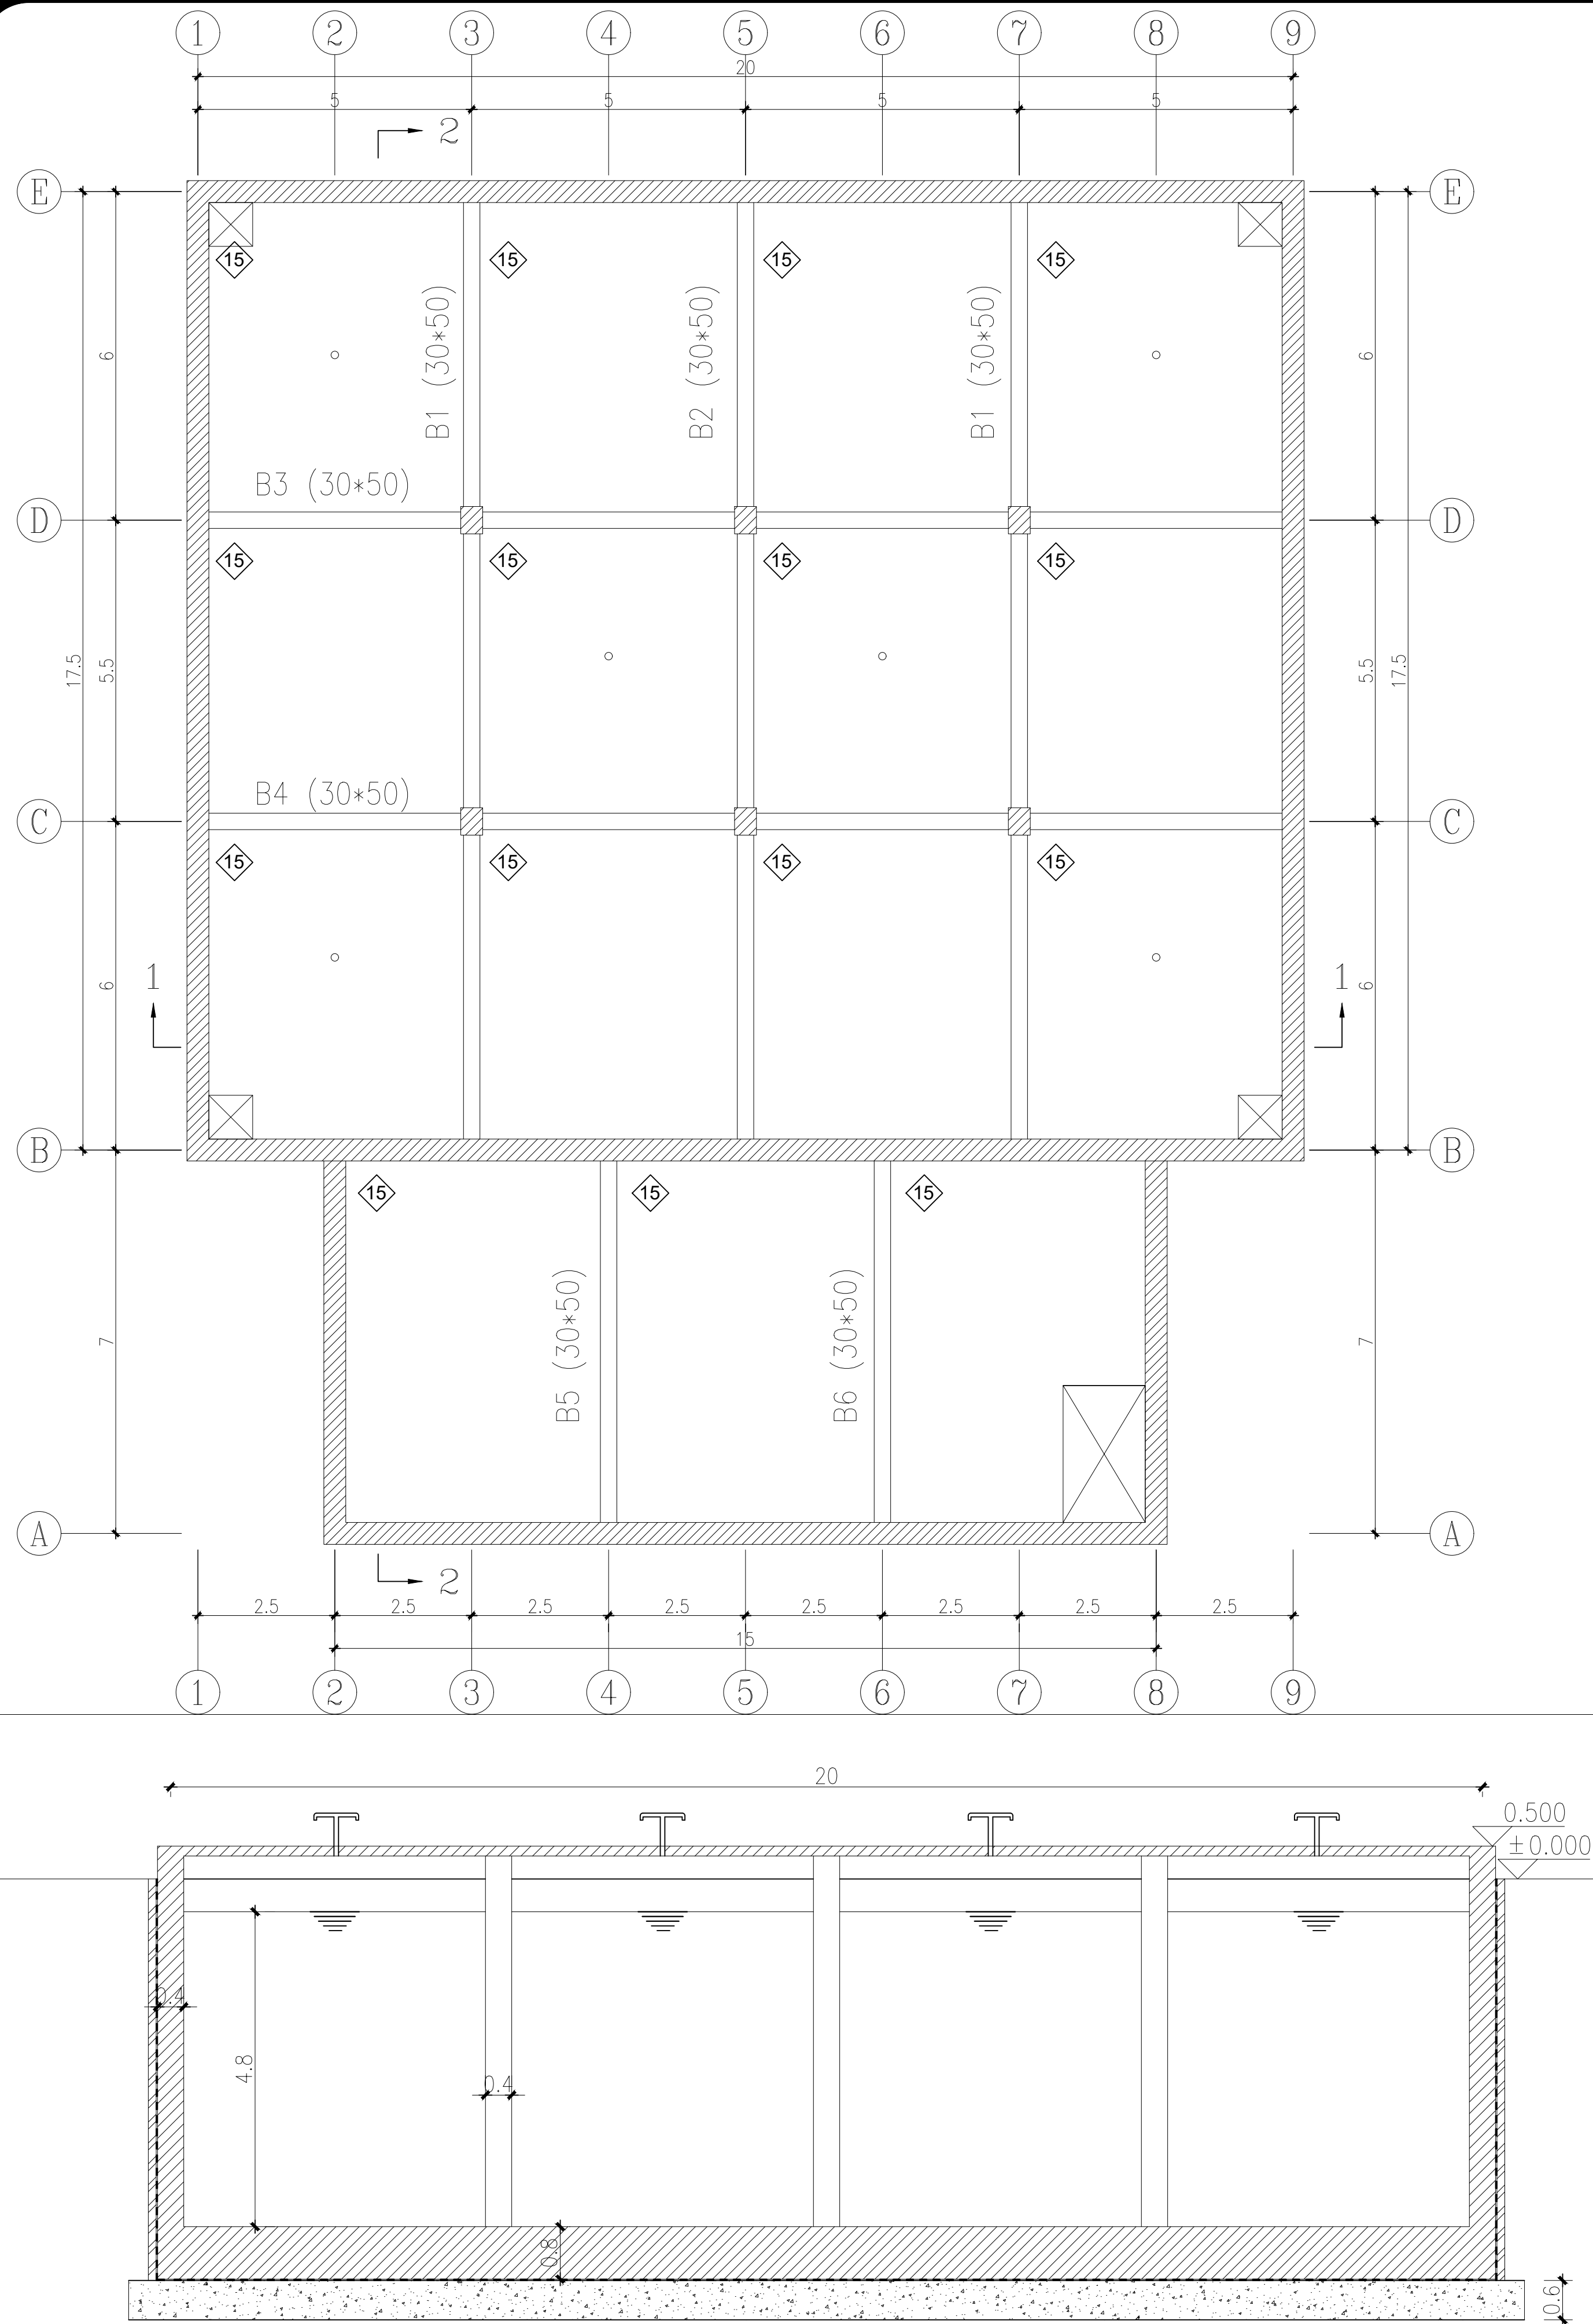

Section 1-1

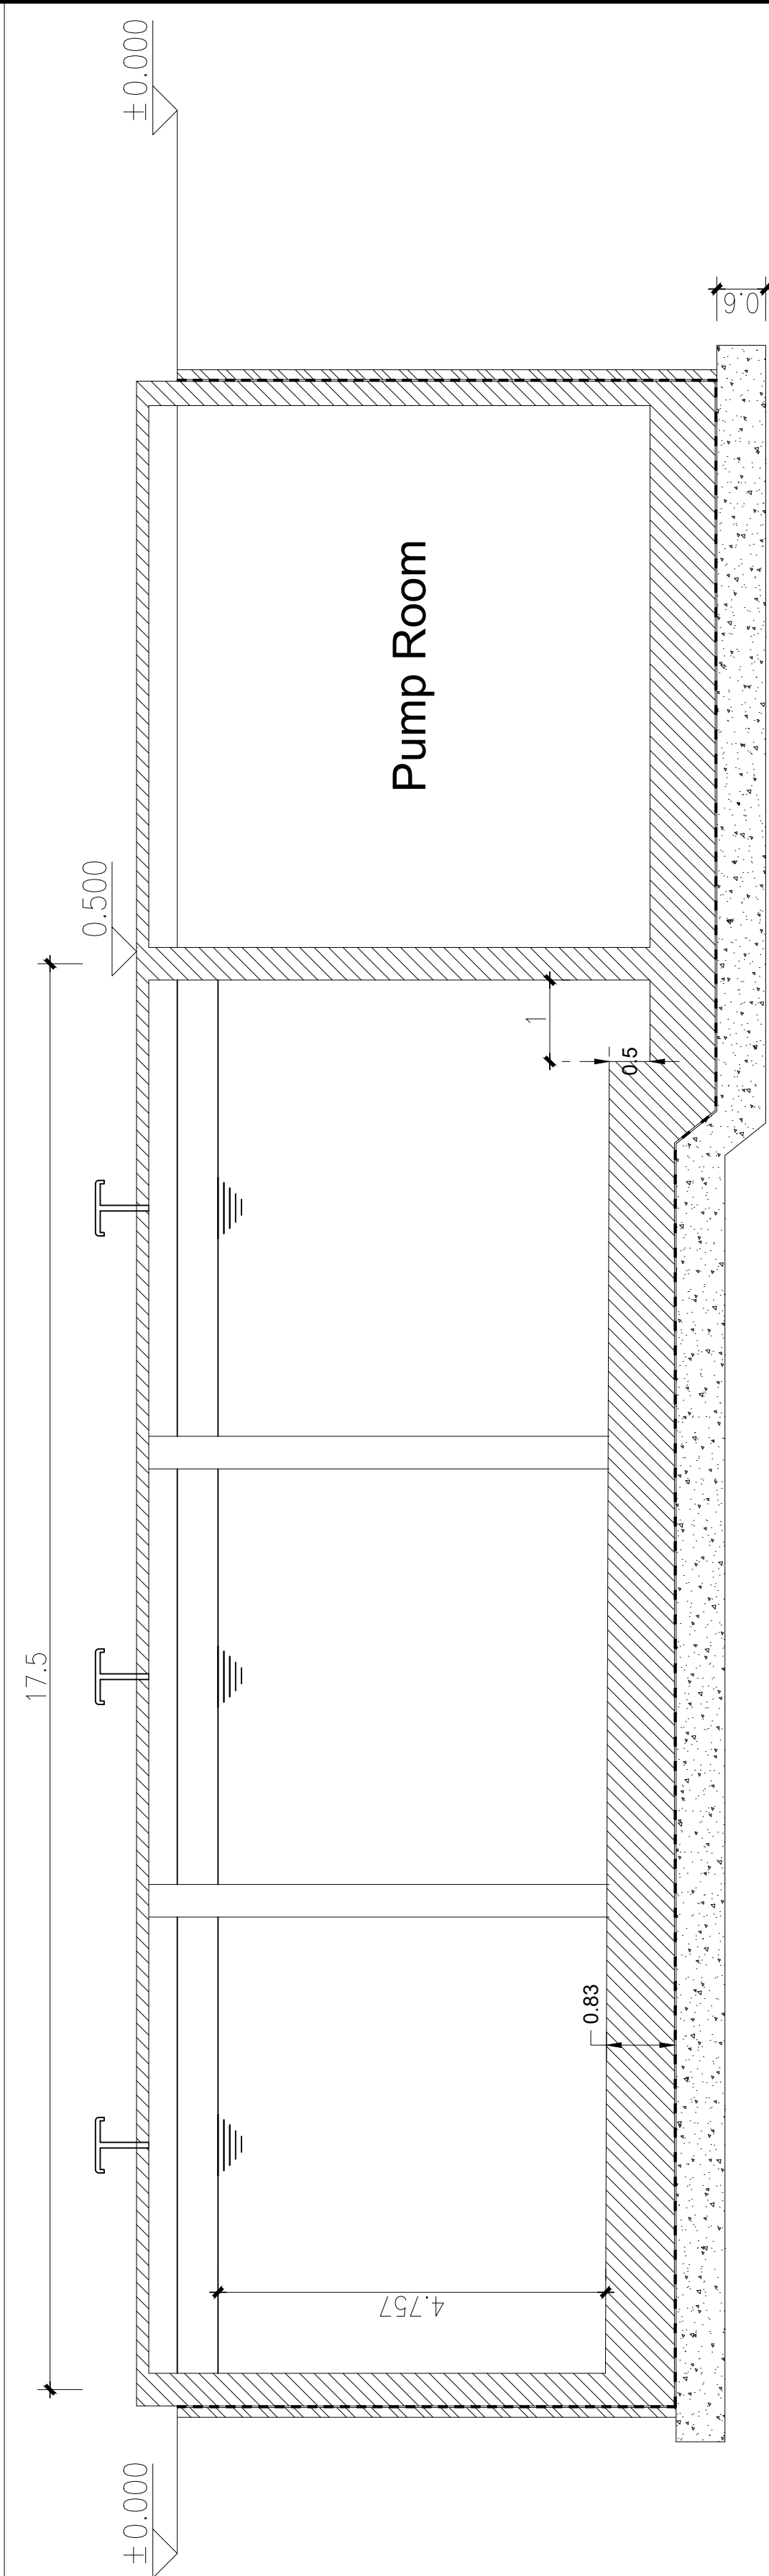

Section 2-2



Faculty of Engineering  
Cairo University  
Civil Department

Notes:

- Verify all dimensions and axes with the architectural drawings before starting execution.
- The net foundation level must not be less than what is found in the soil report.
- The compressive strength of concrete for reinforced concrete after 28 days should not be less than 350 kg/cm<sup>2</sup>.
- The concrete mix for reinforced concrete must achieve the required strength, and the cement content should not be less than 350 kg/m<sup>2</sup>.
- The compressive strength of concrete for plain concrete after 28 days should not be less than 250 kg/cm<sup>2</sup>.
- The concrete mix for plain concrete must achieve the required strength, and the cement content should not be less than 250 kg/m<sup>2</sup>.
- The yield strength should not be less than 4200 kg/cm<sup>2</sup> and the percentage of elongation should not be less than 10%.
- The concrete cover for main reinforcement bars should not be less than 2.5 cm, except where otherwise specified.
- The diameter of stirrups should not be less than 8 mm, unless otherwise specified.
- It is strictly prohibited to use waste, debris, or any foreign materials in the concrete mix.
- All necessary tests must be performed before and during the execution, as well as water tightness tests for tanks.
- The contractor must carry out all required site tests and preparatory works before pouring concrete.
- All additives used must be approved by the supervising engineer.
- Water stops must be installed at construction joints when specified.

PROJECT NAME :

Tank Unit

By :

Anas Akram Saeed

DRAWING TITLE :

Concrete Dimensions