



EC μS	North Bore	East Bore	South Bore	Lake Water	Inlet Drain
2/04/2025	631	-.--	956	974	714
14/05/2025	647	4170	866	1046	818
18/06/2025	678	4310	870	1039	527
12/08/2025	716	4400	841	980	960
17/10/2025	807	4495	831	930	979


pH	North Bore	East Bore	South Bore	Lake Water	Inlet Drain
2/04/2025	7.98	-.--	7.83	9.11	8.22
14/05/2025	7.76	7.63	7.94	8.71	7.78
18/06/2025	7.83	7.96	7.78	8.60	8.27
12/08/2025	7.85	7.46	7.76	8.80	8.29
17/10/2025	7.70	7.81	8.18	8.72	8.78


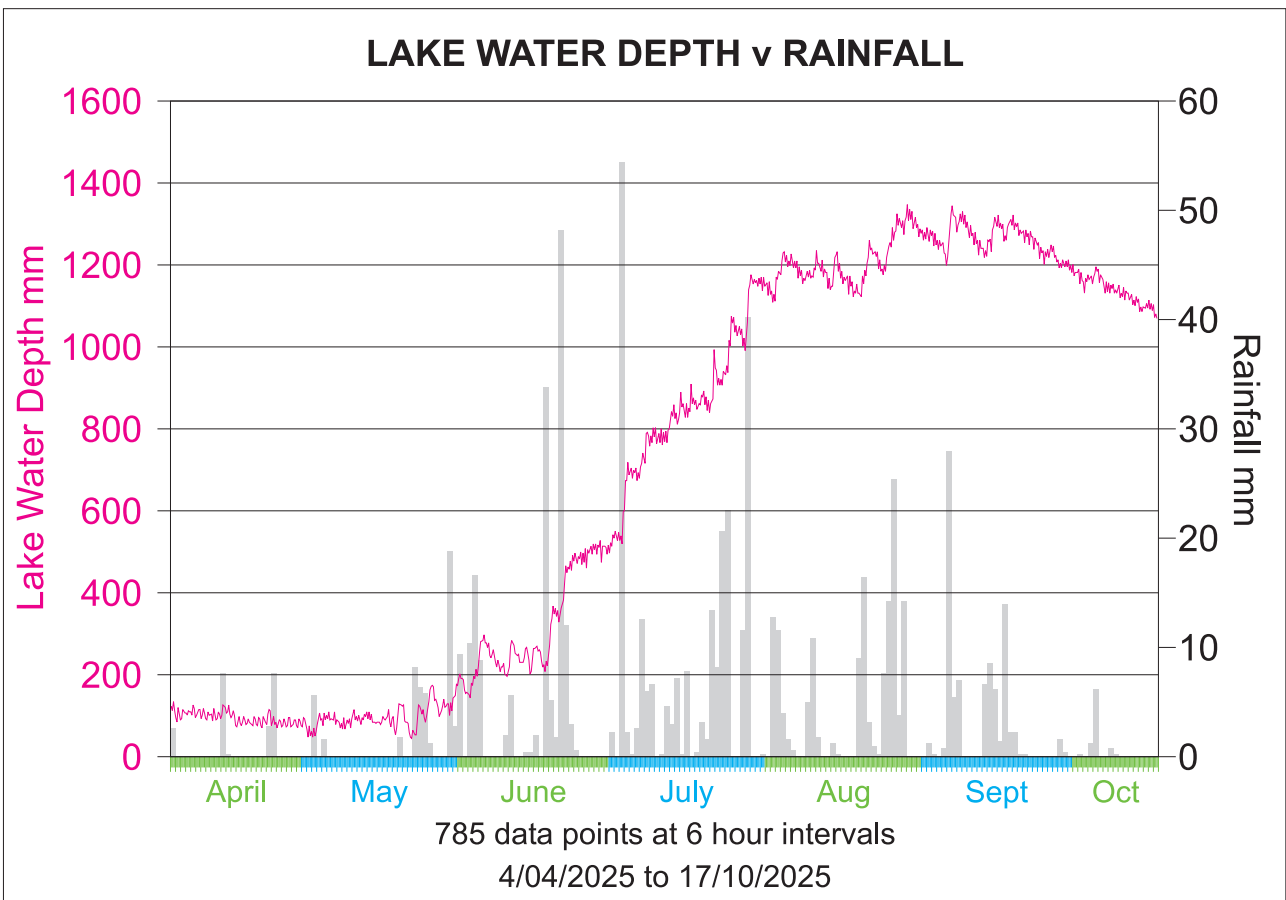




LAKE WATER EC v DEPTH

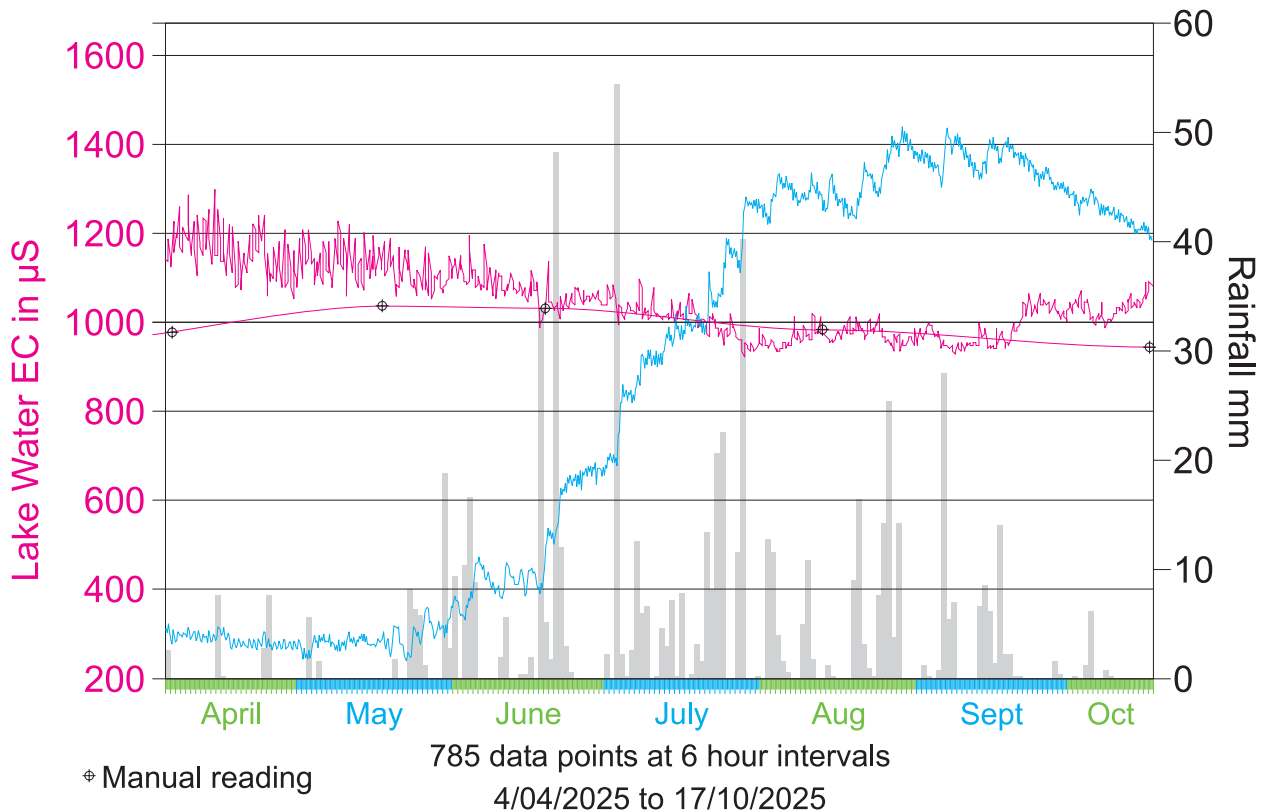

LAKE WATER EC v RAINFALL

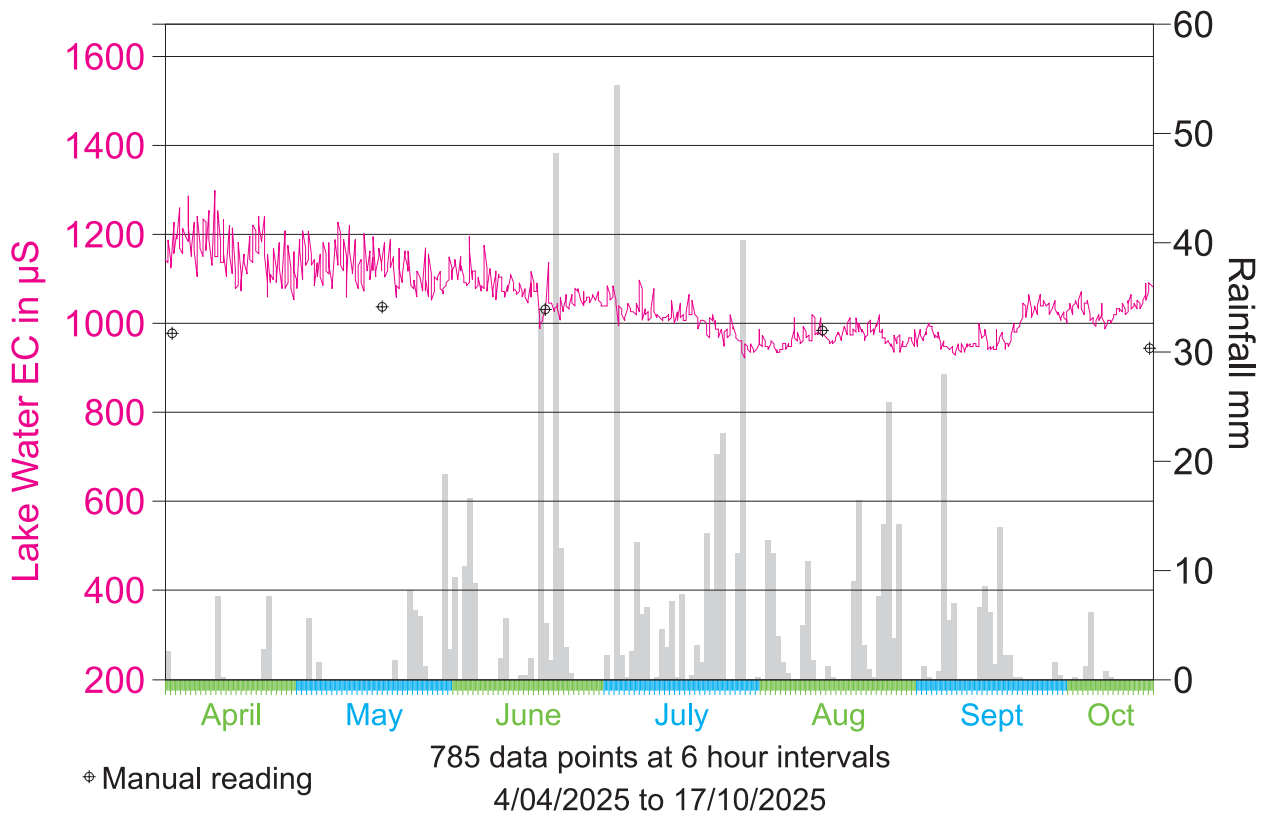

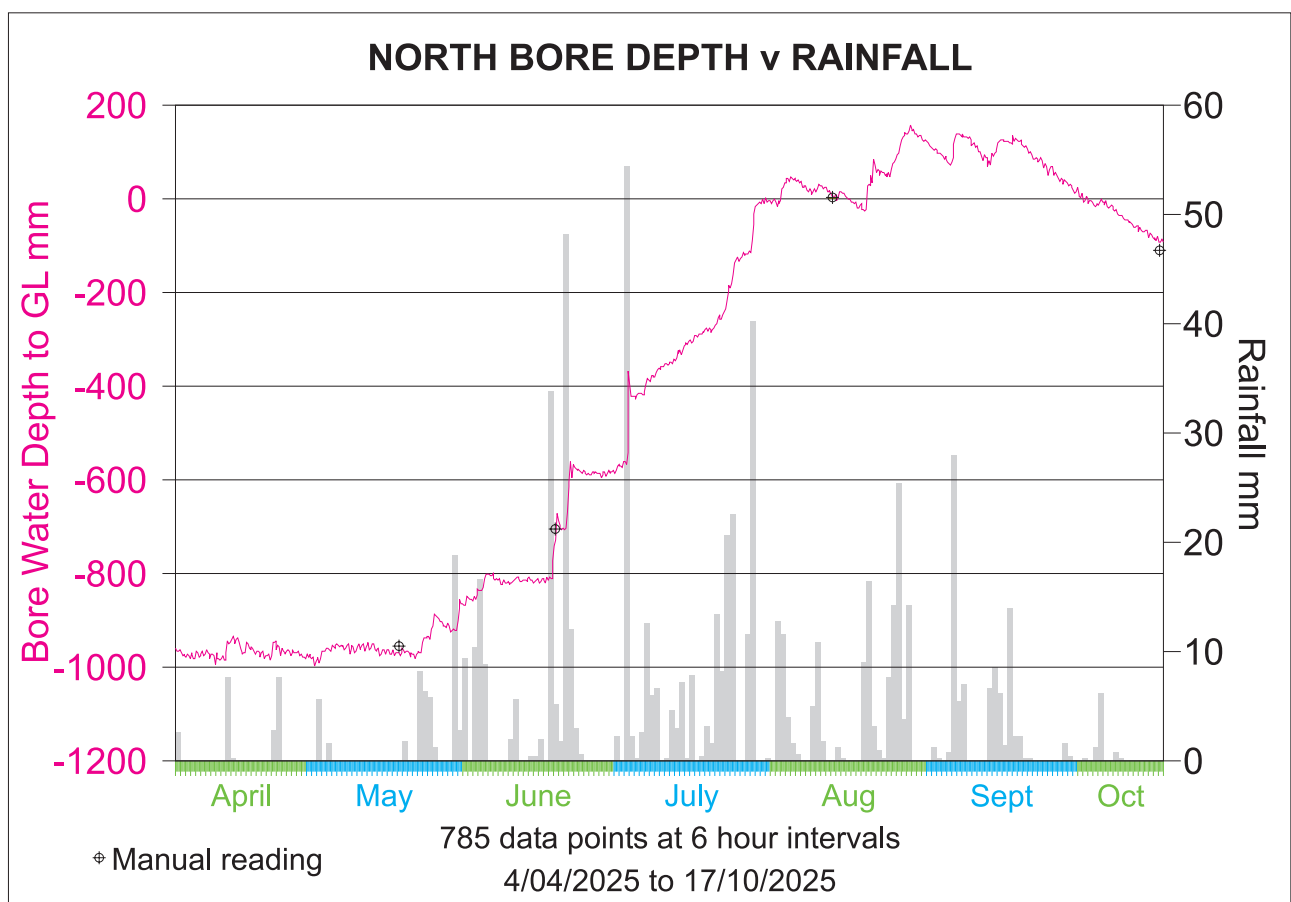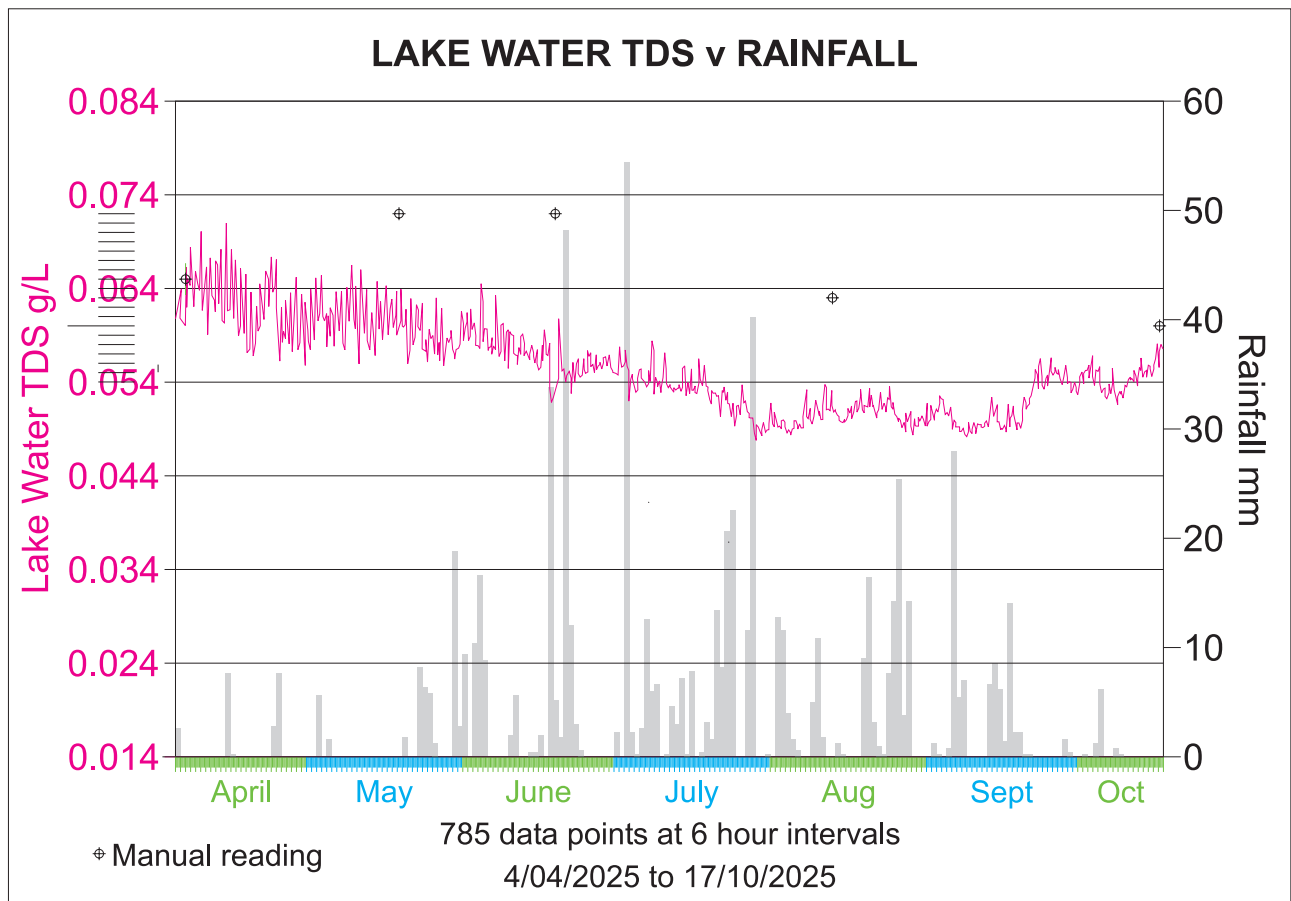

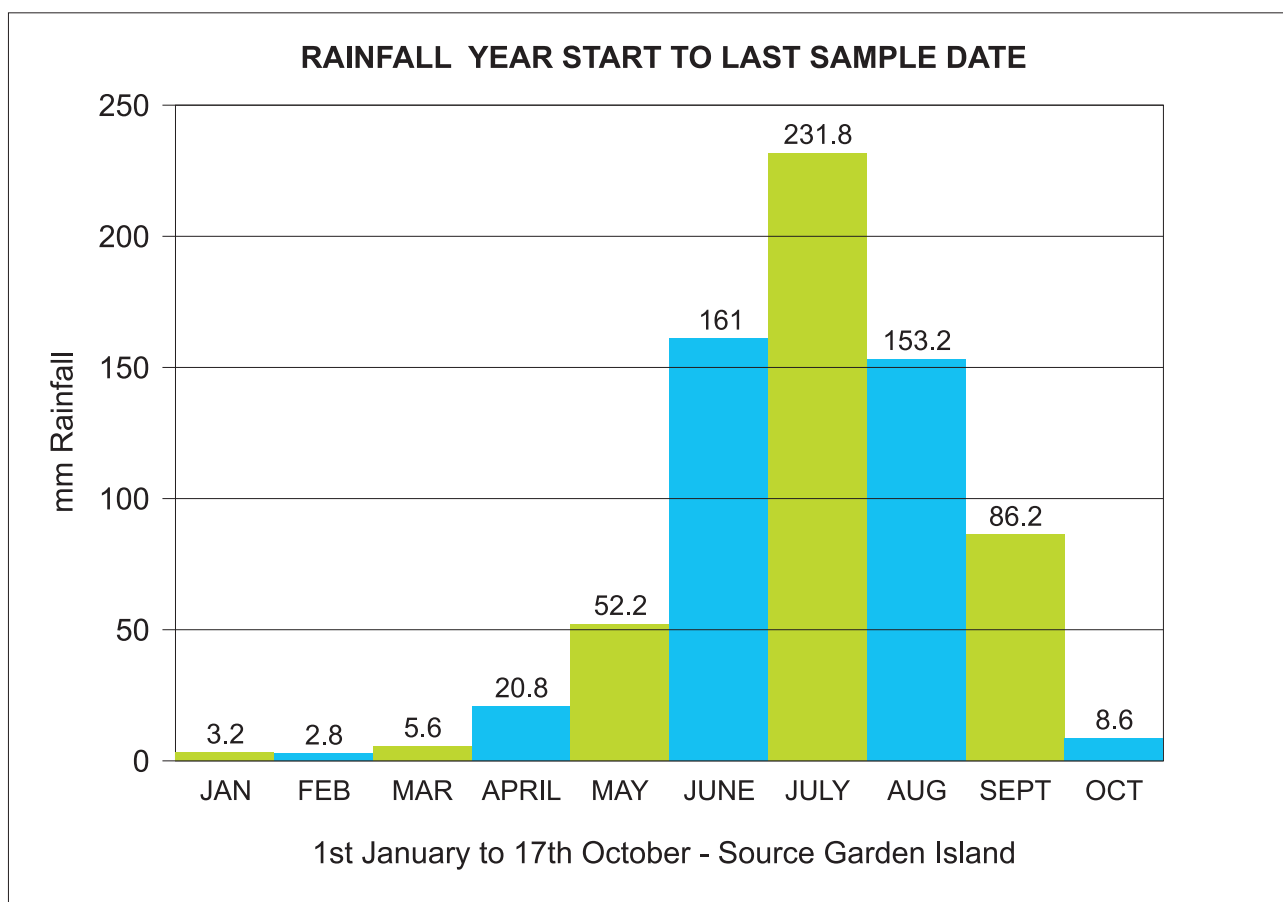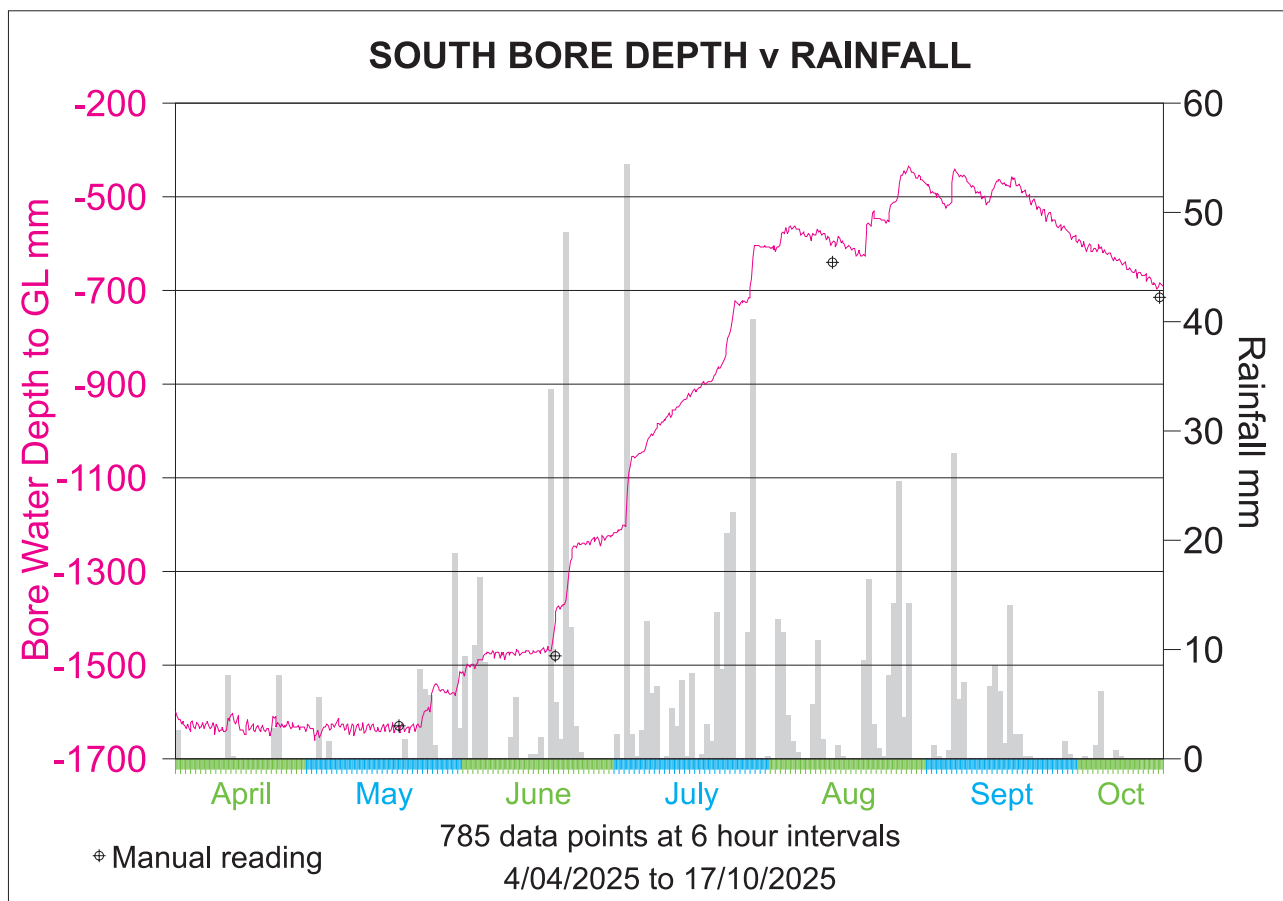

TDS from manual EC for all sites

