Bringing compute to the heat

ARCHEGON CAPITAL

A zero-start proof of geothermal-powered AI compute in Australia and/or New Zealand.

Draft for discussion · not an offer · not a priced round

Not a priced round | **AU and/or NZ** | **PoC · zero-start**

archegon.com

The right physics, the wrong economics

Why a century of proven physics has produced so little capacity.

Geothermal is the only renewable that matches a 24/7 AI load — available around the clock and carbon-free; firm supply to an islanded load still needs N-1 redundancy and backup (slide 17). **It has never scaled because the geology had to be found, not built.**

Heat, water and permeable rock had to coincide naturally, and that coincidence is a rounding error in global generation. Fervo's claim is that it can be engineered instead of located.

World geothermal at year-end 2025

17,173 MW

VERIFIED · fervo-egs-tech-56 · ThinkGeoEnergy YE2025. The geographic constraint Fervo claims to engineer around.

Fervo made permeability a manufacturing problem

Four moves that make permeability a design choice rather than a site accident.

01 Horizontal laterals

Sawtooth 7: 7,500 ft / 2,286 m through the hot zone. Rock contacted per well becomes a design choice, not a luck draw.

02 Multi-stage frac

The lateral is isolated and stimulated in sequence. Permeability is engineered in. It aims to remove the geographic constraint; unproven in Cooper Basin geology, where Habanero's permeability was one sub-horizontal thrust fault.

03 DAS / DTS fibre


Distributed acoustic and temperature sensing along the whole lateral. Reservoir management becomes measurement, which is what makes a learning curve possible.

04 Doublet

Injector and producer as a closed circulation loop into an ORC binary plant. Fluid is recirculated; some is lost to the formation, so make-up water is needed.

Cape Station cut well cost from US$9.4m to US$4.8m

US$/ft and days, eight wells. Source reports a 35% learning rate vs 18% planned; the cost endpoints alone imply ~20% per doubling.

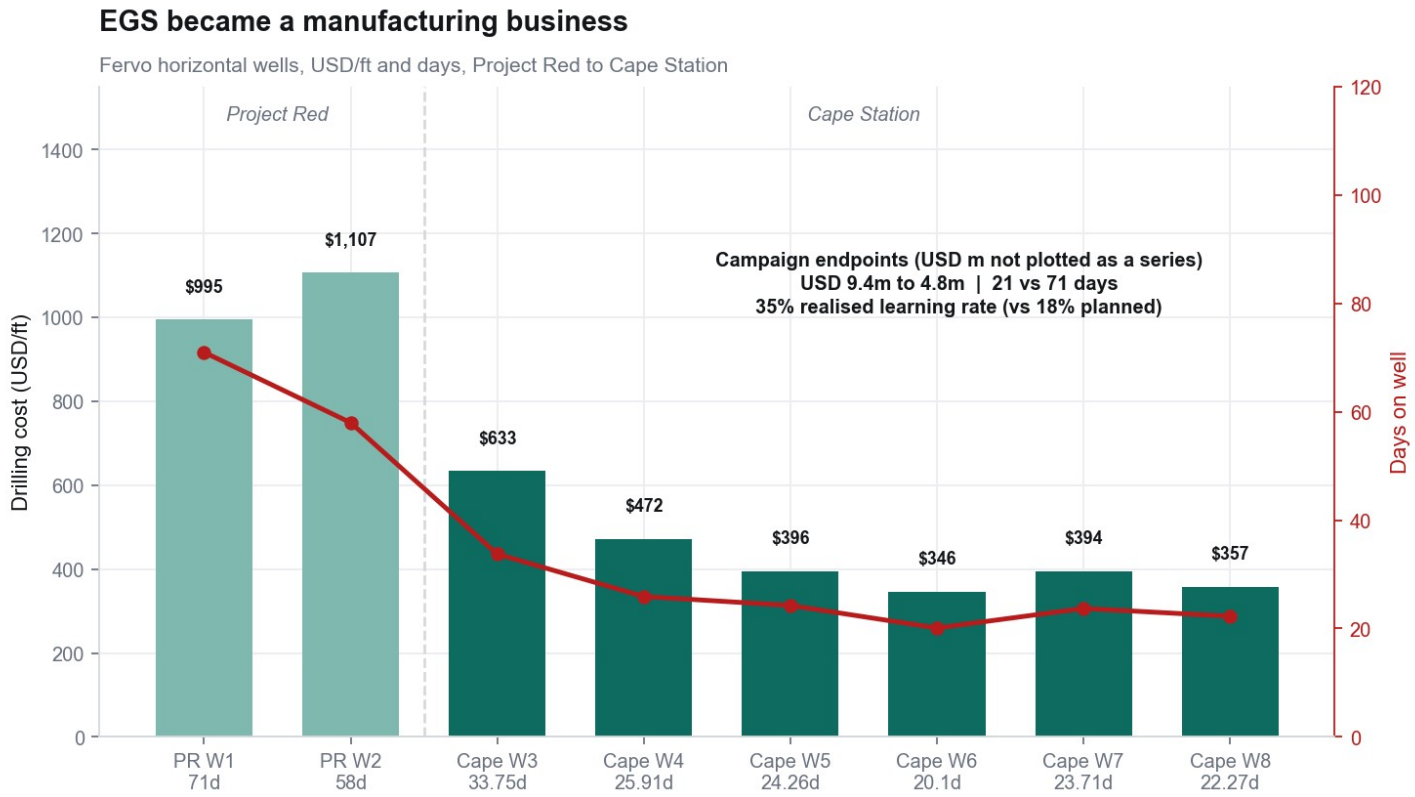

Sources: facts/geothermal-capex.json geothermal-capex-02 (NREL/El-Sadi Table 1: USD/ft and days for eight wells, VERIFIED); geothermal-capex-01 (campaign endpoints USD 9.4m to 4.8m, VERIFIED); geothermal-capex-03 (35% realised vs 18% planned learning rate, VERIFIED); geothermal-capex-04 (21 vs 71 days, VERIFIED). No USD-million intermediates are plotted.


US$9.4m → US$4.8m over eight wells is three doublings, ~20% per doubling of well count (geothermal-capex-01). The 35% vs 18% is the source's own metric (geothermal-capex-03), not well cost. Our model uses none of this; the only Cooper Basin record ran the other way (A$11.40m → A$50.85m, slide 7).

Underwrite 1.4 MWe net sustained, not 3.5 MWe peak

Peak is not the number a diligence team will underwrite.


Model the sustained figure, not the headline

Project Red, 614 days of continuous operation

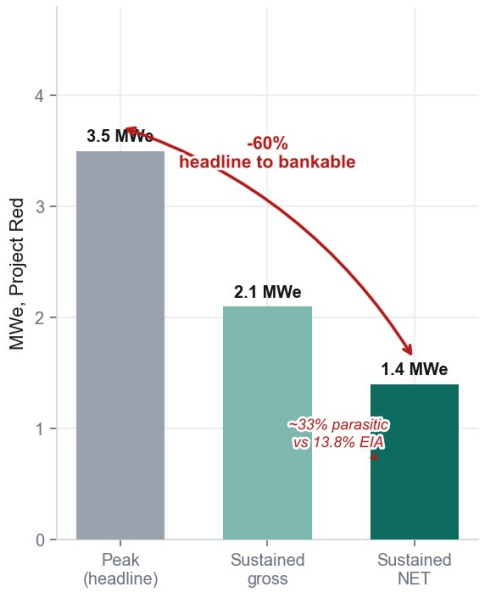

The most contested number in the sector

Net MWe per producer - an 8x disagreement (solid = low end, pale = stated range)

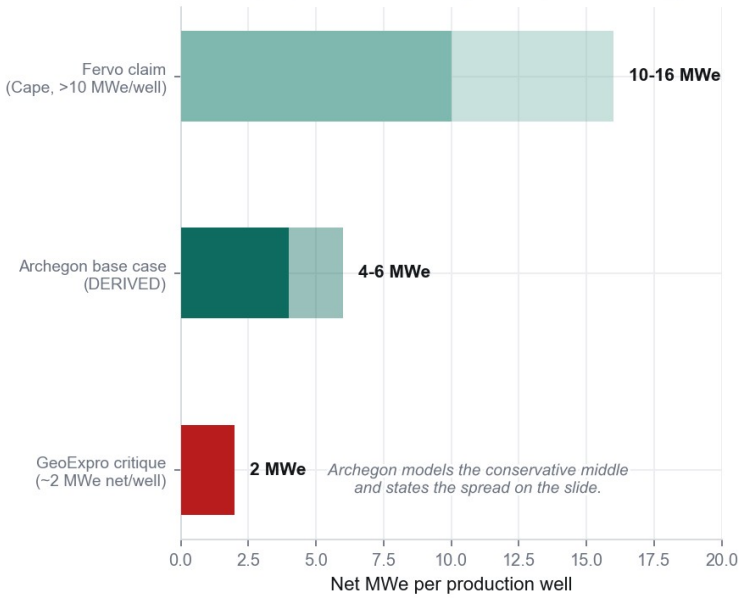

Sources: facts/fervo-egs-tech.json (Project Red 614-day sustained vs peak, 98.4% uptime, zero workovers, VERIFIED); facts/geothermal-capex.json (EIA 13.8% parasitic benchmark; GeoExpro critique: 50-60 wells for 100 MW net). Archegon 4-6 MWe = DERIVED, not sourced.

Project Red, step by step

3.5 MWe peak (calculated, not metered)


→ 2.1 MW gross sustained (614+ days)

− 0.7 MW parasitic (pumping) = 1.4 MW net

Our BASE 5 MWe net per producer is an ASSUMPTION 3.6× this. Habanero's best sustained loop (19 kg/s) ≈ 1.0–1.5 MWe net. Flow basis: slide 16. Decline analogue: Soultz (ORC since 2008).

Habanero cost 2.4× Fervo's first-project estimate

One currency, model FX 0.7122. Each Fervo figure is on its own basis: overnight, all-in expected, target. Not one curve.

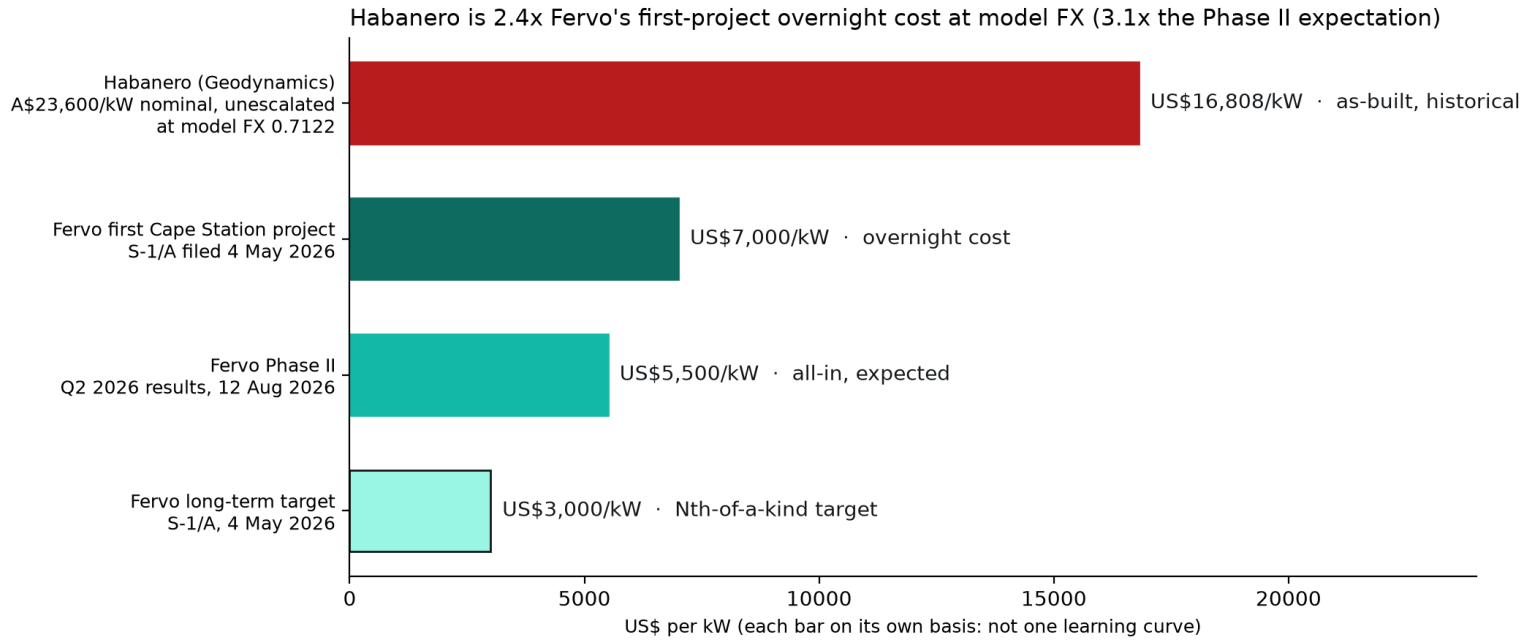

33 MW net, operating

Cape Station GeoBlock 1 reached commercial operation on 30 Sep 2026, selling under its PPA.

7,000 · 5,500 · 3,000


US$/kW: overnight, first project (S-1/A, 4 May 2026) · Phase II all-in expected (12 Aug 2026) · long-term target. Company guidance, not as-built.


2.4× US$

Habanero A$23,600/kW → US$16,808/kW at 0.7122 (nominal, unescalated).

Habanero failed on market access and on flow

Geodynamics wells A$11.40m → A$50.85m. Co-location fixes the first failure; Fervo toolkit is the claim on the second.

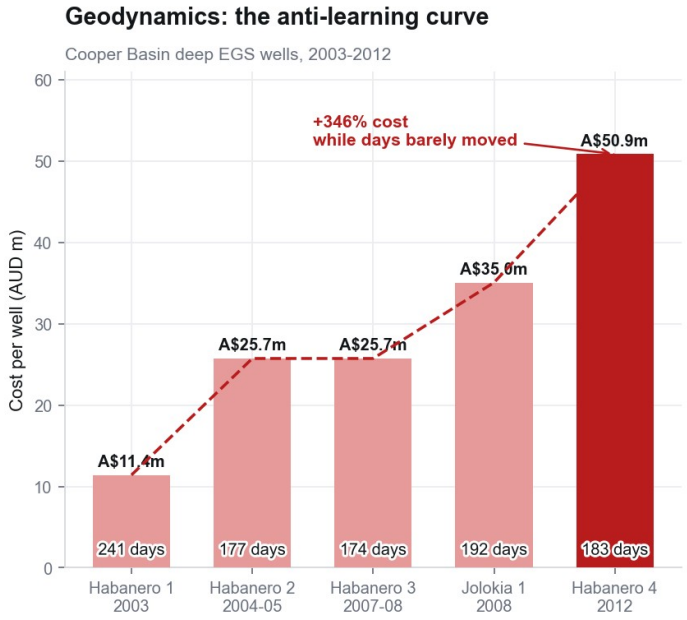

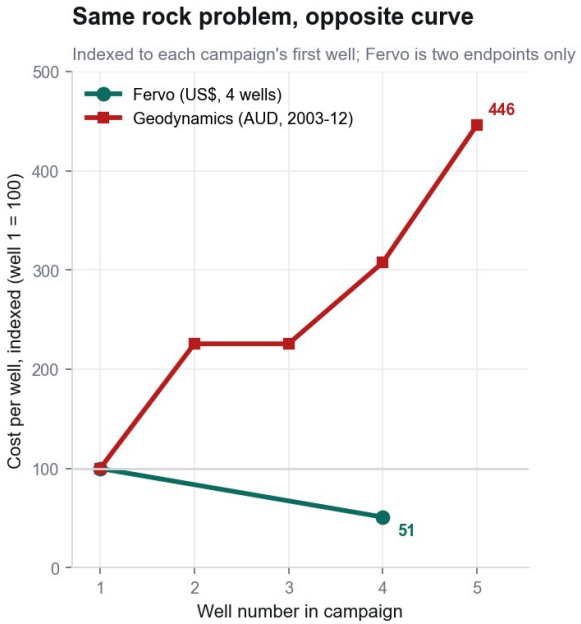

Sources: facts/geothermal-capex.json geothermal-capex-29 (Geodynamics well costs, VERIFIED - the only AU deep-EGS cost record), geothermal-capex-30 (AUD16.5m/well redesign estimate, never tested); geothermal-capex-01 (Fervo USD 9.4m to 4.8m over 4 wells, VERIFIED - two-point index, no interpolated intermediates). Currencies not converted - the comparison is of curve SHAPE, not absolute level.

Market access

Lost the co-located heat customer; transmission uneconomic. Co-location of the AI load is the claim on this half.

Flow / cost

Reservoir and well-cost performance were also disappointing. The Fervo toolkit is the claim on this half — a claim, not a result.

Australia drills. New Zealand contracts.


AU = Cooper Basin hot dry rock. NZ = already-producing TVZ. Do not blend.



Basis: facts/geothermal-capex.json -29..-36 (Habanero record); facts/nz-route.json -01..-25 (TVZ production, operators, deal structures); facts/vc-poc.json -24 (NZ commissioning record; Mercury pipeline = 5 TWh options, 1 TWh entering feasibility, first generation targeted 2030).

NZ is an option, not a switch

Pipeline is real and slow. First generation targeted 2030. Attributes are not electrons.

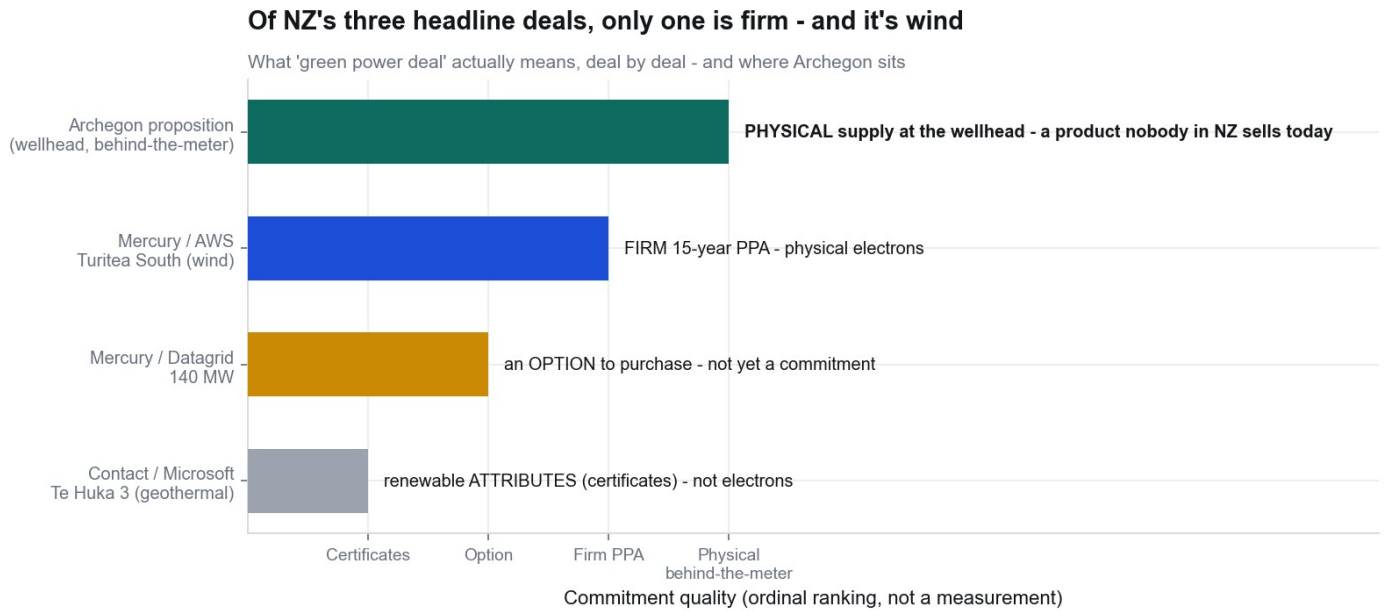

Sources: facts/nz-route.json -21 (firm/attributes/option distinction, VERIFIED), -22 (Mercury 12% equity in Datagrid NZ$53m), -10 (Contact/Microsoft Te Huka 3 = certificates, per Contact's own release). Archegon row is the PROPOSITION, not an executed deal. X-axis is ordinal.

Mercury (NZX 472609)

Up to 5 TWh options

2.5 TWh active development

1 TWh Ngā Tamariki + Rotokawa entering feasibility

NZ$75m appraisal drilling

First generation 2030

Contact–Microsoft is attributes, not physical supply.

Any NZ plan that needs geothermal electrons before 2030 must source them from existing stations, not this pipeline. Physical, behind-the-meter, wellhead supply is a product nobody in New Zealand is currently selling.

Legals are on the critical path, unpriced

Clocks are scenario branches. Zeros in the model are RATE_MISSING — unpriced, not cheap.

Australia

Federal RTN: 6-month s35 floor.

Separate s32 4-month expedited-procedure branch. Do not schedule 4 months as the negotiated minimum.

Unresolved whether a geothermal licence is an NTA “right to mine”. The 6-month clock is not an established geothermal default until counsel answers that.

Conjunctive ILUA is the load-bearing route.

New Zealand

Iwi partnership, not freehold.

Fast-track exists. Archegon is not on Schedule 2 — referral is discretionary, and it adds time.


There is no published cost for concluding the AU native title instrument. NZ grid + fibre are likewise unpriced.

Model land + legals = A$0 · RATE_MISSING

Ships at zero and is labelled unpriced. Resolving land, AU/NZ legals, and NZ grid+fibre can only move the floor up. It is not a free input.

Energy is ~7% of TCO for a GPU owner, not for a landlord

Modelled 1 GW stack (compute-economics-03, DERIVED) assumes the operator owns the GPUs. Under COLO the tenant does.

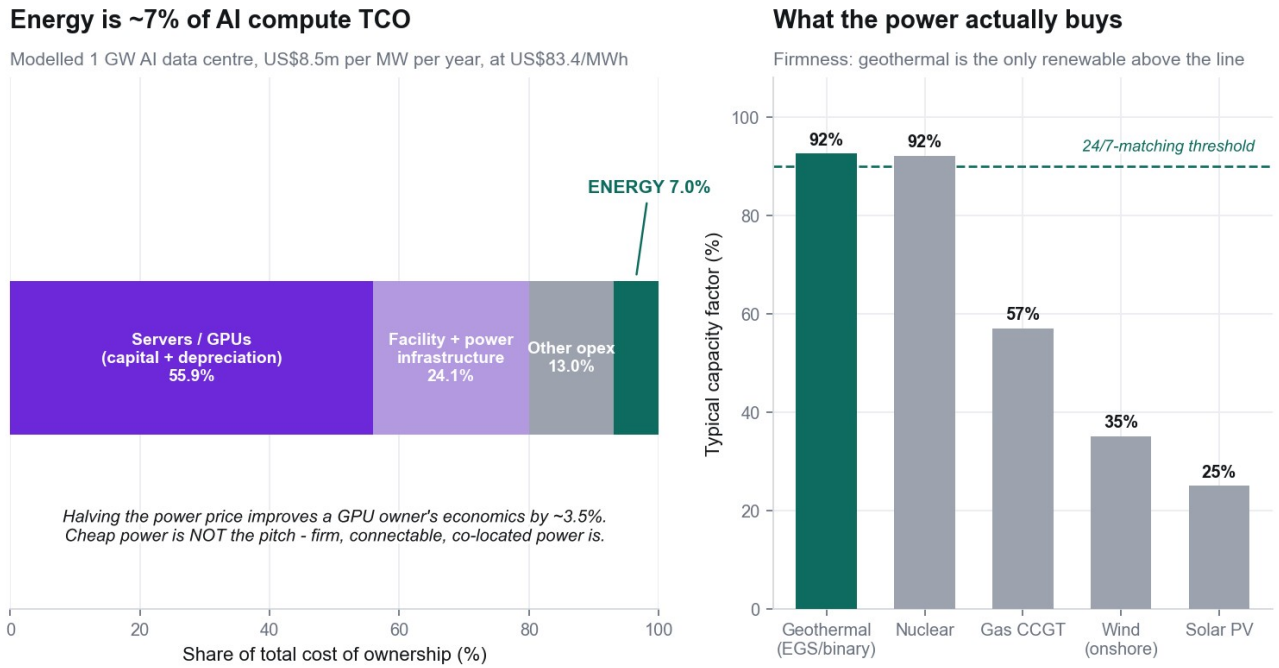


Sources: facts/compute-economics.json -03 (energy 7.0% of TCO, DERIVED from Epoch AI 1 GW model, US$8.5m/MW/yr TCO), -01 (US$37.9m/MW all-in, servers 55.9%); facts/geothermal-capex.json -26 (geothermal 90-95%+ capacity factor, VERIFIED). Other capacity factors: EIA typical ranges, INDICATIVE - shown for shape, not for modelling.

Under COLO our costs are the shell and the power system, and the power system costs ~98% of colo revenue at 8% (slide 18). A premium for firm, carbon-free power is unproven until tenant LOIs price it.

AU: compute is the biggest block; wells carry the risk

Model at current settings: Route AU, COLO, BASE/BASE, LIQUID, remote ON, 5.0 MW IT, PUE 1.25, 25% contingency, 90% CF.

AU floor A$301.2m | **NZ floor A$127.2m** | **Zeros = RATE_MISSING**

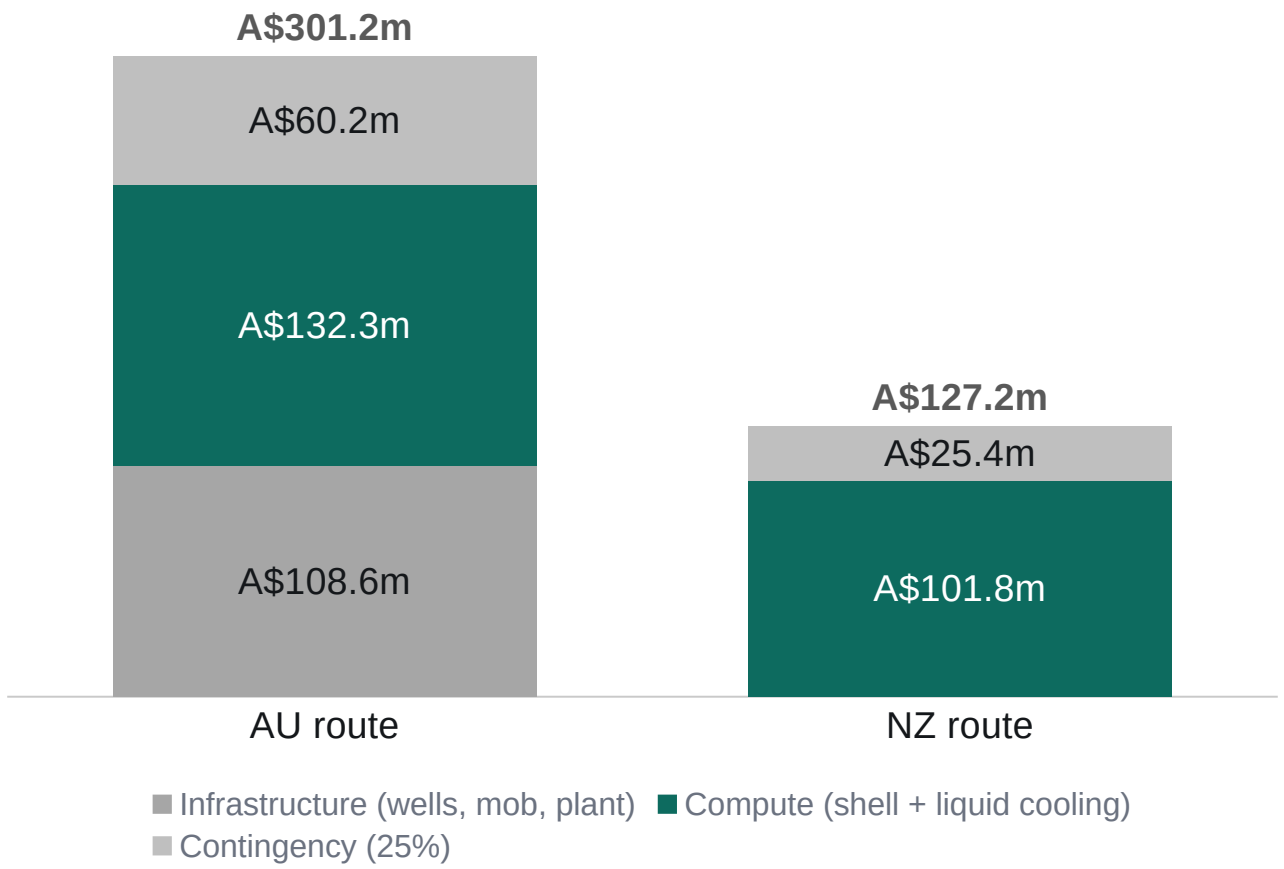

AU · DERIVED / FLOOR

Wells: 2 producers + 2 injectors = 4

Net nameplate: 6.94 MW (5 × 1.25 PUE ÷ 0.90 CF) · 6.25 MW average, not firm

Well ratings are NET (parasitic inside). Compute A$132.3m = 55% of pre-contingency capex; wells + mob 29%.

Infra (wells+mob+plant): A$108.6m

Compute (shell+liquid, remote on): A$132.3m

Land / legals: A$0 RATE_MISSING

NZ · FLOOR


Compute: A$101.8m + A$25.4m contingency = A$127.2m (NZ$157.3m)

Infra / land / legals: A$0 RATE_MISSING

COLO tenant pays IT fit-out.

The derived raise is a floor, and it is not repaid

AU capex + A$6.0m 24-month runway. Grants sit beside the raise, never netted.

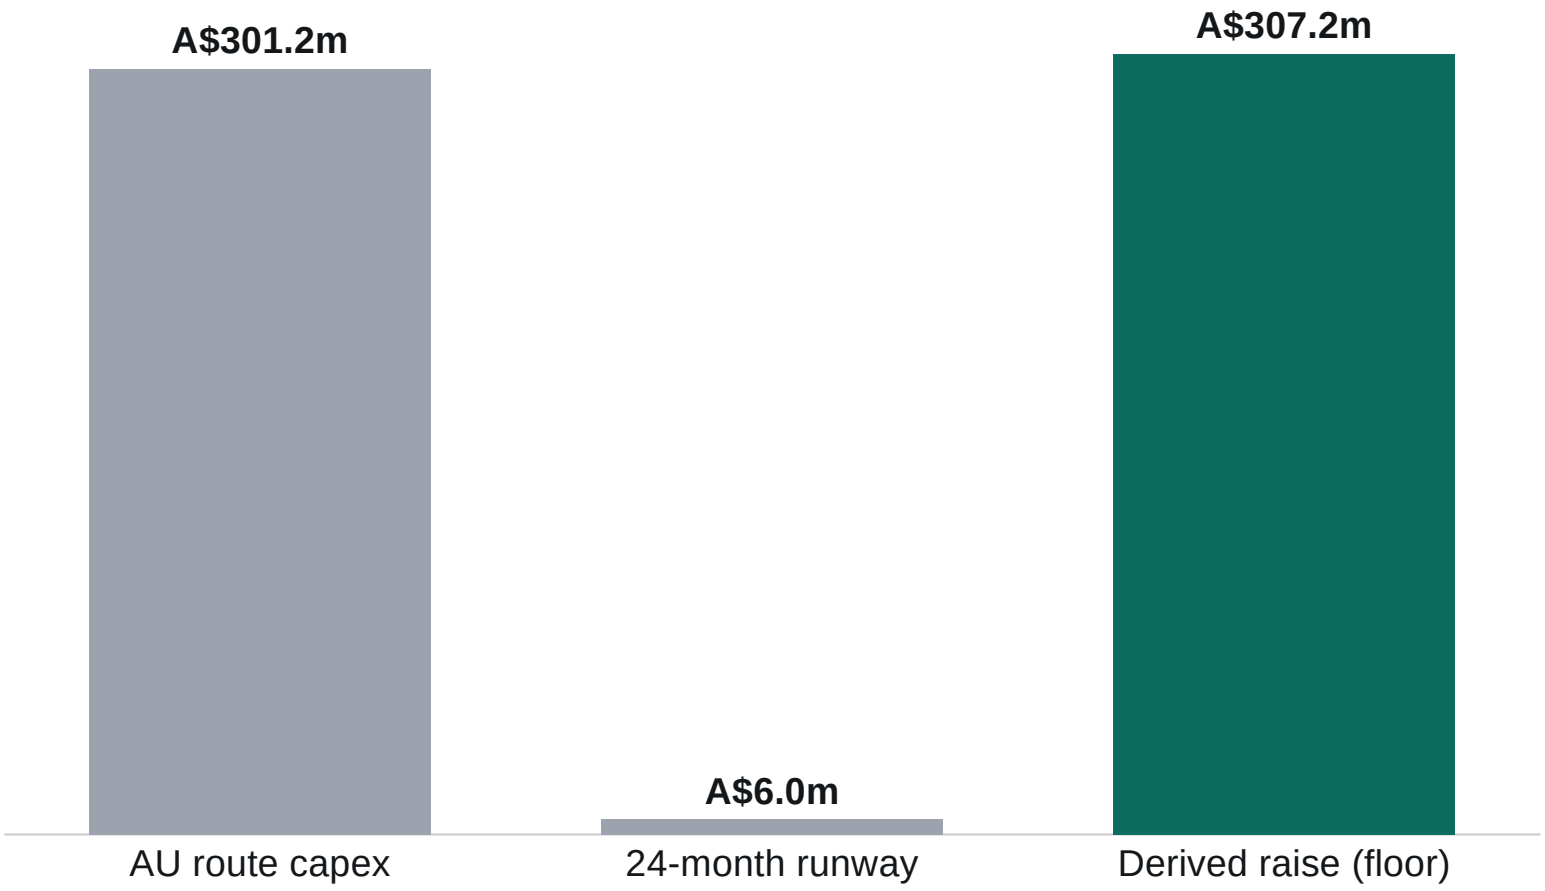

AU derived raise

A$348.5m

US$248.2m

FLOOR · includes A$6.0m runway


Converted at model FX 0.7122 (geothermal-capex-71) — the rate all workbook money uses.

Offsets, not cash in hand

ARENA Launchpad / NZ RIF named as offsets. No grant dollar is treated as in-hand. Contribution A$10.1m/yr = 2.9% of the raise; 25 years of it (A$251.6m) does not repay A$348.5m.

COLO covers opex; it does not repay the raise

No power-only fallback on the islanded AU route (A$0 without a grid tie). ANCHOR comps are ~400 MW hyperscale leases: reference only. BAREMETAL unpriced.

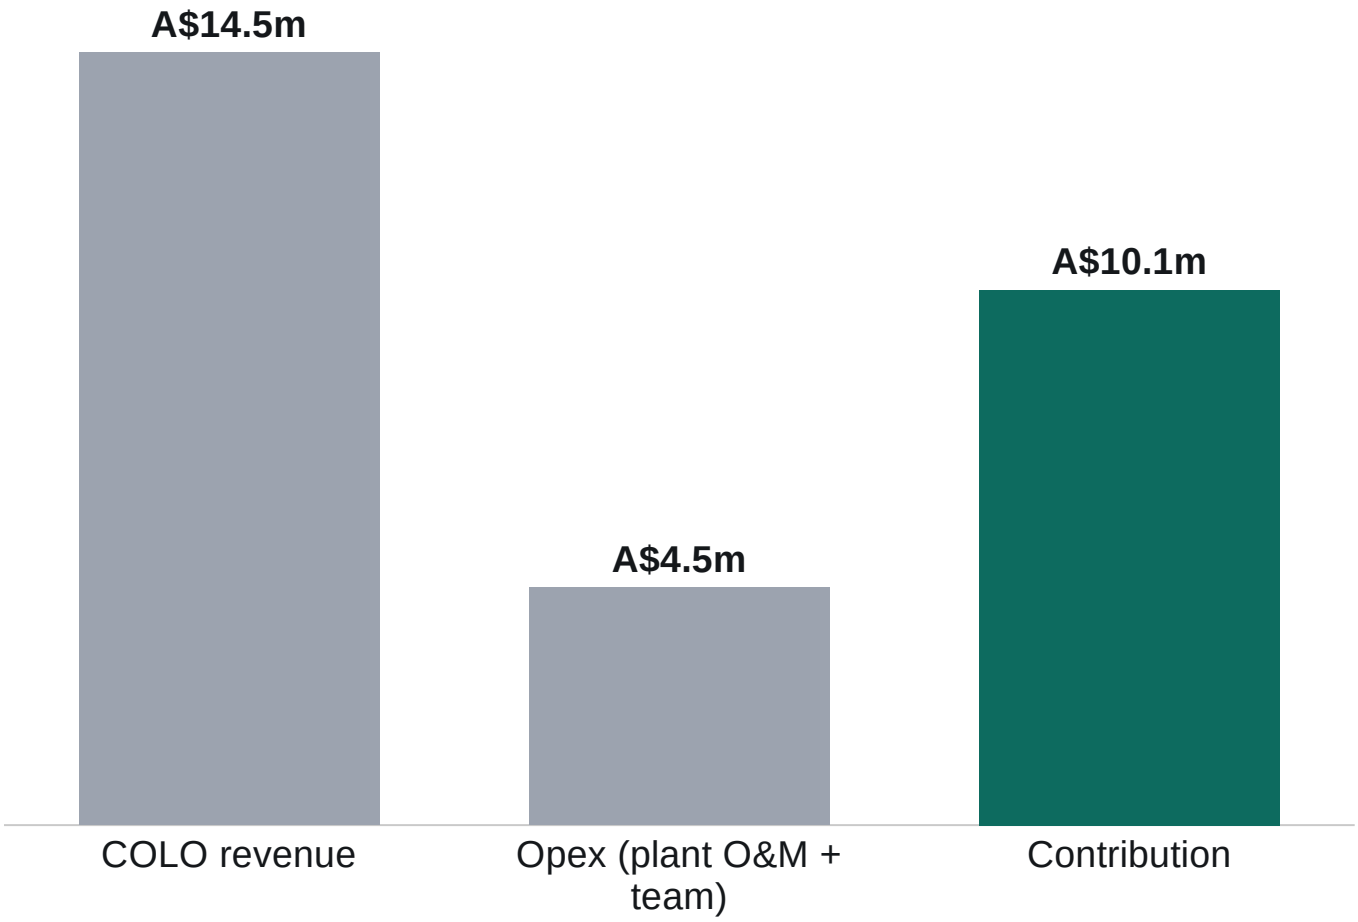

COLO

A$14.5m/yr

ANCHOR

A$16.6m/yr

BAREMETAL

unpriced · A$0

COLO contribution

A$10.1m/yr

before debt service · opex A$4.5m/yr

One meaning per word: net, gross, average, firm

v3 fixes the net/gross mix-up. Every MWe-per-producer figure is NET at the plant fence.

Term	Definition	Reference case (5 MW IT)
Gross	Generator-terminal output, before the plant's own load	not modelled directly
Parasitic	Injection pumps, ORC feed pumps, condenser fans, services	EIA 13.8% · EGS stress ~29% (GeoExpro-derived)
Net	Gross − parasitic = delivered to the site board	6.94 MW nameplate
Average	Net nameplate × 0.90 capacity factor (annual energy)	6.25 MW = facility load
Firm	Guaranteed every hour with one element out (N-1)	5.0 MW today (one producer out), no backup
Facility / IT	IT × PUE 1.25 (ASSUMPTION) / power to racks	6.25 MW / 5.0 MW in four 1.25 MW modules

v2 labelled HIGH (13 MWe) "gross" and LOW/BASE "net", and called the 6.25 MW average "firm". Both are corrected in the model, deck, diagrams and site.

What flow does 5 MWe net per producer need?

Screening calc (exergy × 40–50% utilisation × (1 − 13.8–29% parasitic)). Not a reservoir forecast.

Production temp	Flow for 5 MWe net	Reference
169 °C	104–158 kg/s	Fervo Project Red
200 °C	74–112 kg/s	Habanero earlier trial (~200 degC)
215 °C	64–97 kg/s	Habanero 4 wellhead, 2013
220 °C	61–93 kg/s	
240 °C	52–79 kg/s	

Measured flow	Source	Net MWe @215 °C
19 kg/s	Habanero best sustained closed loop	1.0–1.5
39 kg/s	Habanero 4 open flow	2.0–3.0
36 kg/s	Fervo Red sustained average	1.9–2.8
63 kg/s	Fervo Red peak	3.2–4.9
107 kg/s	Fervo Cape 30-day max, Sep 2024	5.5–8.3

Habanero's best sustained loop (19 kg/s) supports ~1.0–1.5 MWe net. BASE needs 3.4–5.4× that. At 1.4 MWe/producer the reference needs 10 wells and A$431.0m; at 2 MWe, 8 wells and A$389.7m; doublet vs triplet adds 50% more wells.
NEEDS SITE DATA: a reservoir engineer's sustainable rate, temperature and injectivity; Habanero tracer/injectivity data; ORC vendor curve.

Average power is not firm power

Islanded, the 10% of hours a 0.90 capacity factor leaves uncovered are outages unless something else is on site.

Item	Value
Average net at fence	6.25 MW
Firm with one producer out (N-1)	5.0 MW → 4.0 MW IT → 3 whole modules
Hours not covered at 90% CF	876 h/yr (5,475 MWh)
Diesel to cover them (illustrative)	~1.42 million litres/yr; price unpriced
N-1 on producers (3rd doublet)	+A$41.25m → raise A$389.7m
BESS, standby gen, black start	Public proxy (GenCost 2025-26): ~A$23.7m incl. contingency; not in the raise
Hot day (40 °C+), air-cooled ORC	Derate RATE_MISSING; at an illustrative 20% loss 3 modules stay lit, 2 with one producer out (Firm-Power D31:D34 corrected 13 Oct)
Wells 20% low	8 MWe still covers 6.94 MW: no change. Supply falls only below 3.47 MWe/producer (31% low)

Base case has zero margin: four modules draw 6.25 MW against 6.25 MW average. Module 4 is sold as interruptible unless backup is bought.

Two businesses: price the power as power

PowerCo (wells + ORC) sells to DCCo (the hall) at a transfer price = its levelised cost. WACC is an ASSUMPTION.

PowerCo levelised cost	A$/MWh	Capital + O&M, A$m/yr
Low (6%, 25 yrs)	280	15.3
BASE (Rates wacc_base) (8%, 25 yrs)	330	18.1
High (10%, 25 yrs)	383	21.0
Stress check (10%, 20 yrs)	407	22.3
At Habanero 4 actual well cost (8%)	553	
SA wholesale (reference)	88	

DCCo (the hall)	A$m/yr
Colo revenue	14.53
Power at transfer price (8%)	−18.05
DC opex (RATE_MISSING)	0.00
DCCo before team	-3.52
Consolidated contribution (capital uncharged)	10.06
Power-only fallback, islanded AU	0.00
…if a grid tie existed (unpriced) at SA wholesale	4.82

The power system costs ~124% of colo revenue at 8%. With free power the hall yields 8.8% on its own build cost. A 10% contribution yield on the raise needs ~US$467/kW/month (2.4× the benchmark).

On our own numbers, NZ beats AU

AU-first must be argued as an option on a reservoir, not implied by slide order.

	Australia (drill)	New Zealand (contract)
Raise, A$	A$348.5m	A$133.2m
Revenue (colo), A$/yr	A$14.5m	A$14.5m
Energy / plant cost, A$/yr	A$1.5m	A$4.6m
Contribution, A$/yr	A$10.1m	A$6.9m
Contribution / raise	2.9%	5.2%
Drilling risk carried	Yes (4 wells)	None
What Archegon owns	A reservoir (option value)	A contract

NZ power is priced off ONE week of spot (NZ$105/MWh, 17–23 May 2026). NZ stays ahead unless contracted power exceeds ~NZ$174/MWh. Needs: an indicative 15–20 yr PPA quote, checked against ASX NZ futures.

Reservoir first: a gated plan with pass/fail tests

Each gate is its own decision. No hall until the reservoir passes.

Gate	Buys	Capital (model rates)	Pass if
Gate 0 - SEED (US$10m)	Tranched seed: engineers/viability, lawyers/government, DC procurement, financing, itemised runway, buffer; Tranche 3 pre-buys Gate 1 long-lead items. See Seed tab.	A$4.2m–A$14.0m (public proxy)	Signed reservoir-engineer case for flow, temperature, injectivity; AFE in 2027 A$; principal named; LOI with price and energy terms
Gate 1a - appraisal well (option)	One deep well: temperature, stress, image logs, injectivity. Cheaper than a doublet.	A$31.6m	Temperature >= target; stress regime and fracture orientation compatible with the lateral design
Gate 1 - RESERVOIR TEST	One doublet + 90-180 day circulation test. No plant, no hall.	A$69.2m	v4: incl. stimulation of both wells; less seed Tranche 3 pre-buys; grossed up for the 6% success fee so the test is fully funded.
Gate 2 - first whole module	Plant sized to MEASURED flow + one 1.25 MW module, signed tenant	A$105.7m	Metered net power; PUE; tenant paying; N-1 design costed
Gate 3 - 5 MW reference	Scale to 4 modules	A$348.5m	Gate 2 performance holds; firm-power cover priced

Rent the hall, or sell compute?

Selling GPU-hours earns far more per MW, but needs ~A$287m of GPUs per 5 MW and carries GPU price risk. Inputs are PUBLIC PROXIES.

5 MW reference	Total capital	Revenue yr 1	EBITDA yr 1	EBITDA ÷ capital	25-yr IRR
AU rent (colo)	A$348.5m	A$14.5m	A$10.1m	2.9%	-2.4%
AU sell compute, prices fall ~25%/yr	A$645.0m	A$132.7m	A$87.8m	13.6%	never repays
AU sell compute, flat prices	A$645.0m	A$132.7m	A$87.8m	13.6%	4.1%
NZ sell compute, flat prices	A$421.2m	A$132.7m	A$85.9m	20.4%	8.5%
AU downside: 47% util, remote −20%	A$645.0m	A$71.3m	A$26.3m	4.1%	never repays


Inputs (PUBLIC PROXY): 8-GPU B200 server ~US$450k, 14.3 kW (Mercatus 2026; NVIDIA); network/storage +30%; maintenance 10%/yr; ops 5 FTE per 512 GPUs at US$275k (GPUaaS.com TCO, Jun 2026). Price US$5.52/GPU-h = 1-yr reserved, derived from the B200 on-demand median US$6.99 less 21% (gpueconomy.com, 12 Oct 2026; AI Industry Reviews, Sep 2026). Utilisation 70%. GPUs replaced every 5 years.
Downside is real: if B200 prices follow the H100 path (−25%/yr), the fleet never repays. With flat prices: AU 4.1%, NZ 8.5%.
Connectivity (PUBLIC PROXY, Connectivity tab): figures include fibre Innamincka–Moomba, ~79 km at A$125k/km = A$9.9m plus A$1.3m/yr. One satellite terminal (~50 Mbps) cannot carry the cluster. Bonded satellite: 385 terminals and ~A$26m/yr of priority data for a 10 Gbps training load (AU flat return becomes negative). It cannot carry ~280 Gbps of inference: one cell is licensed for ~20 Gbps. A future 10 Gbps gateway costs ~A$12.6m/yr (Connectivity row 50). Moomba access is unconfirmed; the Lyndhurst fallback is ~A$55m.

US$10m seed: sources, uses and staged release

US$10m = A$14.04m at the model FX (0.7122 US$/A$). Rates are PUBLIC PROXIES or labelled ASSUMPTIONS (Seed tab). Illustrative, not an offer.

US$10m seed: sources and uses (A$m)

A$ at the model FX of 0.7122 US$ per A$. Released in tranches against gates. Illustrative, not an offer.

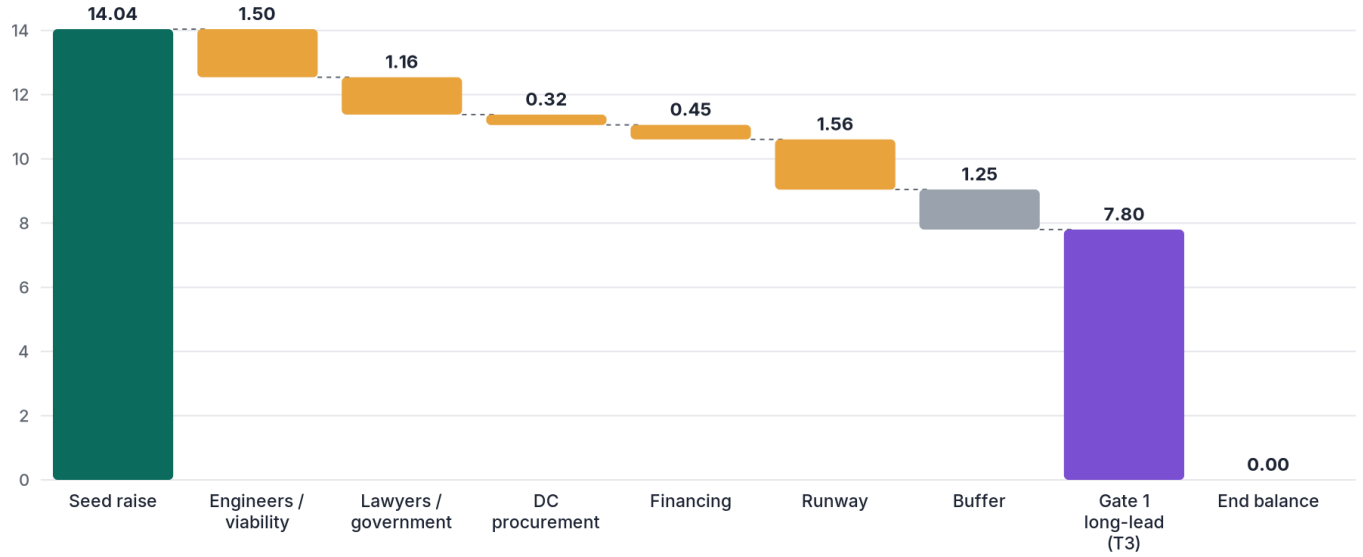

Staged release **T1** A$1.87m **T2** A$3.13m **T3** A$7.80m **Board** A$1.25m

T1 at close · T2 after G1 resource + G4 priced LOI · T3 after G2, G3, G5 and G6 · Board: buffer against overruns.
Purple: Gate 1 long-lead items (seismic baseline, water bore, casing, wellheads, rig slot) that cut the Gate 1 round 1:1.

Tranche	Released when	A$m	US$m
T1	At close	1.87	1.33
T2	G1 resource case and G4 priced LOI both pass	3.13	2.23
T3	G2 cost, G3 tenure/licence, G5 connectivity pass and G6 Gate 1 lead soft-circled	7.80	5.55
Board	Board release against overruns	1.25	0.89
Total		14.04	10.00

G4 kill test (10% hurdle, ASSUMPTION): a priced LOI must clear colo US$509/kW/month (benchmark US$172.5) or compute US$6.66/GPU-h flat (base US$5.52).
Gate 1 round: A$69.23m incl. stimulation, net of T3 long-lead items, grossed up for a 6% success fee (A$4.15m).

Runway is itemised (team, travel, office, insurance, data purchase) on the Seed tab, not a plug. T3 pre-buys Gate 1 long-lead items (seismic baseline, water bore, casing, wellheads, rig slot) and cuts the Gate 1 round 1:1.

EGS short-seller claims: how our gates test each

Allegations by a short seller (Morpheus Research, 6 Oct 2026), disputed by Fervo. We treat them as risks to test, not as facts.

Risk raised	What is claimed / known	Gate 1 limit (GO / NO-GO)
Thermal decline	Project Red: stable 500+ days, then -2.5 degF (1.4 °C) in 100 days, ~5 °C/yr if extrapolated. Fervo: expected for tight pilot spacing.	GO: forecast <= 1.0 °C/yr from tracer test + calibrated model; NO-GO >= 5 °C/yr. 12-month circulation record before Gate 2.
Fluid loss	Alleged ~30% vs <1% claimed. History: Fenton Hill 7%, Rosemanowes ~20%, Habanero 2013 ~0%.	GO <= 1%; NO-GO > 5%
Induced seismicity	Alleged 58+ Yellow events at Cape. Fervo cites a positive independent protocol review (Aug 2026).	Traffic light agreed with the SA regulator; receptor-based Red set below Habanero ML 3.7
Flow / output	Cape 24 h flow fell 97 to 93 kg/s; analysts estimate 4.8 MW net vs 8-10 MW claimed.	GO >= 5 MWe net per producer; NO-GO < 3.47; pumping <= 10% of gross
Disclosure	Alleged altered data (incl. a hidden ~90 °F drop at Project Red). Fervo has not yet answered point by point (checked 19 Oct 2026). An independent blog (Tidal Wave Technologies, 16 Oct; not Fervo) says the drop is a monthly average of shut-in readings in March 2024, but concedes a real cooling event that Fervo did not explain.	Test data verified by an independent engineer within 60 days; raw time series, with shut-ins flagged, published to investors
Eavor Geretsried (closed loop, Germany)	First power late 2025, then only 0.5-2.0 MWe gross and almost nothing delivered to the grid. Both rigs withdrawn (16 Oct 2026) and Loop 2 on hold while a firm heat offtake is renegotiated (ThinkGeoEnergy).	Modules are energised one at a time against measured output (Gate 2 sizes the plant to measured flow); no hall build before the offtake price is priced (G4)

Fluid make-up (Water tab): 1% loss = 36 ML/yr; 30% = 1,094 ML/yr and 8 bores (A$300k each, PUBLIC PROXY). Licensed supply, not price, is the constraint. Sources: Morpheus Research (6 Oct); Tidal Wave Technologies blog (16 Oct); ThinkGeoEnergy (16 Oct).

Decline: the well margin absorbs up to ~1 °C/yr

Wells deliver 3.06 MW more than the plant can use. Each 1% fall in temperature costs ~2.7% of net power (exergy). Decline tab.

Decline case	°C/yr	First dark yr	Lit yr 25	Compute flat	Colo net cash
SELECTED (headline)	0.83	none in 25 yrs	4	4.1% / A$403m	A$-97m
EGS target 0.65 °C/yr	0.65	none in 25 yrs	4	4.1% / A$403m	A$-97m
Conventional wells 0.83 °C/yr	0.83	none in 25 yrs	4	4.1% / A$403m	A$-97m
Intermediate 2.0 °C/yr (ASSUMPTION)	2.00	14	2	2.3% / A$172m	A$-155m
Project Red reading 5.0 °C/yr (disputed)	5.00	7	0	never repays / A$-285m	A$-304m
EGS base case 6.45 °C/yr	6.45	5	0	never repays / A$-328m	A$-344m
Stress 10 °C/yr (ASSUMPTION)	10.00	4	0	never repays / A$-490m	A$-380m

Decline	(a) Extra doublets up front	(b) Make-up doublets on trend	(c) Fewer modules
Intermediate 2.0 °C/yr	+A$123.8m: 2.5% / A$279m	+A$66.9m: 3.5% / A$336m	saves A$226m: 0.6% / A$33m
Project Red reading 5.0 °C/yr	not feasible	+A$267.5m: 1.5% / A$135m	saves A$452m: never repays / A$-337m
EGS base case 6.45 °C/yr	not feasible	+A$468.1m: never repays / A$-65m	saves A$452m: never repays / A$-337m
Stress 10 °C/yr	not feasible	+A$869.4m: never repays / A$-467m	saves A$452m: never repays / A$-337m

Headroom (Headroom tab): AU compute, flat prices, 25-yr IRR / net cash. Make-up doublets drilled on a monitored trend win up to 6.45 °C/yr; at 10 °C/yr building fewer modules loses least. Stimulation (A$8.25m/well) is now in the raise.

Full programme cost and a grid-connected comparator

What the 5 MW reference really costs with N-1, firm cover and fees, and what the same hall earns on a metro grid.

Item	A$m
Headline raise	348.5
N-1 producers	61.9
N-1 plant	15.4
Transformer and switchgear N-1	0 (RATE_MISSING)
Firm cover	23.7
Success fee on the Gate 1 round	4.2
Seed (US$10m)	14.0
FULL PROGRAMME, A$	467.6
Extra capital over the headline raise, A$	119.2

Case	Capital	IRR	Net cash
Metro colo	A$134m	never repays	A$-81m
Metro compute, flat prices	A$421m	6.9%	A$461m
Metro compute, falling prices	A$421m	never repays	A$-843m
AU full programme, Colo		never repays	
AU full programme, Compute flat		2.5%	
AU full programme, Compute falling		never repays	

Metro grid at A$171.9/MWh delivered (Metro-Grid tab; SAPN HV tariffs + wholesale, PUBLIC PROXY), 15-month connection lead time. On our own numbers a metro hall selling compute beats the geothermal route; the geothermal case rests on power scarcity, not cost.

What we cannot promise

Parked CONTESTED class. Estimates stay estimates. Retractions stay retracted.

GPU-hour rates

Parked CONTESTED. BAREMETAL revenue is A$0 because the rates are unpriced, not because the product earns nothing.

NZ generation-share figures

Several NZ generation-share numbers are parked CONTESTED. They are not on this deck and not in the model.

Remote-site loading handbook

Parked CONTESTED. Remote-site loading is a Control toggle, not a verified handbook figure on this slide.

Fervo US$/kW: 7,000 → 5,500 → 3,000

Overnight first-project cost (S-1/A filed 4 May 2026), Phase II all-in expectation (12 Aug 2026), long-term target. GeoBlock 1 runs at 33 MW net; no as-built US$/kW disclosed.

Mercury capacity invitation

Mercury has no 600 MW invitation. Disclosed pipeline is TWh options on a 2030 clock.

Crusoe 4.9 GW

Contracted capacity, not revenue. Pipeline is not contract.

Ask / next 90 days

Qualify the investor first. No priced round on this slide.

A US$10m seed buys the viability work; the next round is a reservoir test.

Seed: resource case, well AFE, named principal, tenure and native title, water licence, priced LOI, financing advisers (Seed tab). Gate 1: one doublet + 90–180 day circulation test, A$69.2m incl. stimulation and fee, net of seed long-lead items. No hall until the reservoir passes.

01

Named geothermal principal

Someone who has drilled or operated hot rock, not a slide.

02

Generator term sheet

Physical offtake or wellhead co-location — not certificates.

03

ARENA Launchpad application

Non-dilutive parallel path. Named as an application, not as cash.

04

Iwi / GEL path scoping

NZ partnership and AU tenure are critical-path, unpriced work.

Not a priced round

Seed milestones, not a valuation

archegon.com