


FB_AlarmsHandling [FB5]


FB_AlarmsHandling Properties							
General							
Name	FB_AlarmsHandling	Number	5	Type	FB	Language	LAD
Numbering	Manual						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
Input									
Output									
InOut									
▼ Static									
LiveHeartbeat_PLC_0	Bool	false	Non-retain	True	True	True	False		
LiveHeartbeat_PLC_2	Bool	false	Non-retain	True	True	True	False		
Edge_Heartbeat_PLC_0	Bool	false	Non-retain	True	True	True	False		
Edge_Heartbeat_PLC_2	Bool	false	Non-retain	True	True	True	False		
▼ TOF_Heartbeat_PLC_0	TOF_TIME		Non-retain	True	True	True	False		
PT	Time	T#0ms	Non-retain	True	True	True	False		
ET	Time	T#0ms	Non-retain	True	False	True	False		
IN	Bool	false	Non-retain	True	True	True	False		
Q	Bool	false	Non-retain	True	False	True	False		
▼ TOF_Heartbeat_PLC_2	TOF_TIME		Non-retain	True	True	True	True		
PT	Time	T#0ms	Non-retain	True	True	True	False		
ET	Time	T#0ms	Non-retain	True	False	True	False		
IN	Bool	false	Non-retain	True	True	True	False		
Q	Bool	false	Non-retain	True	False	True	False		
Temp									
Constant									


Network 1: Confirmacion de condiciones para establecer el "AutoRun"

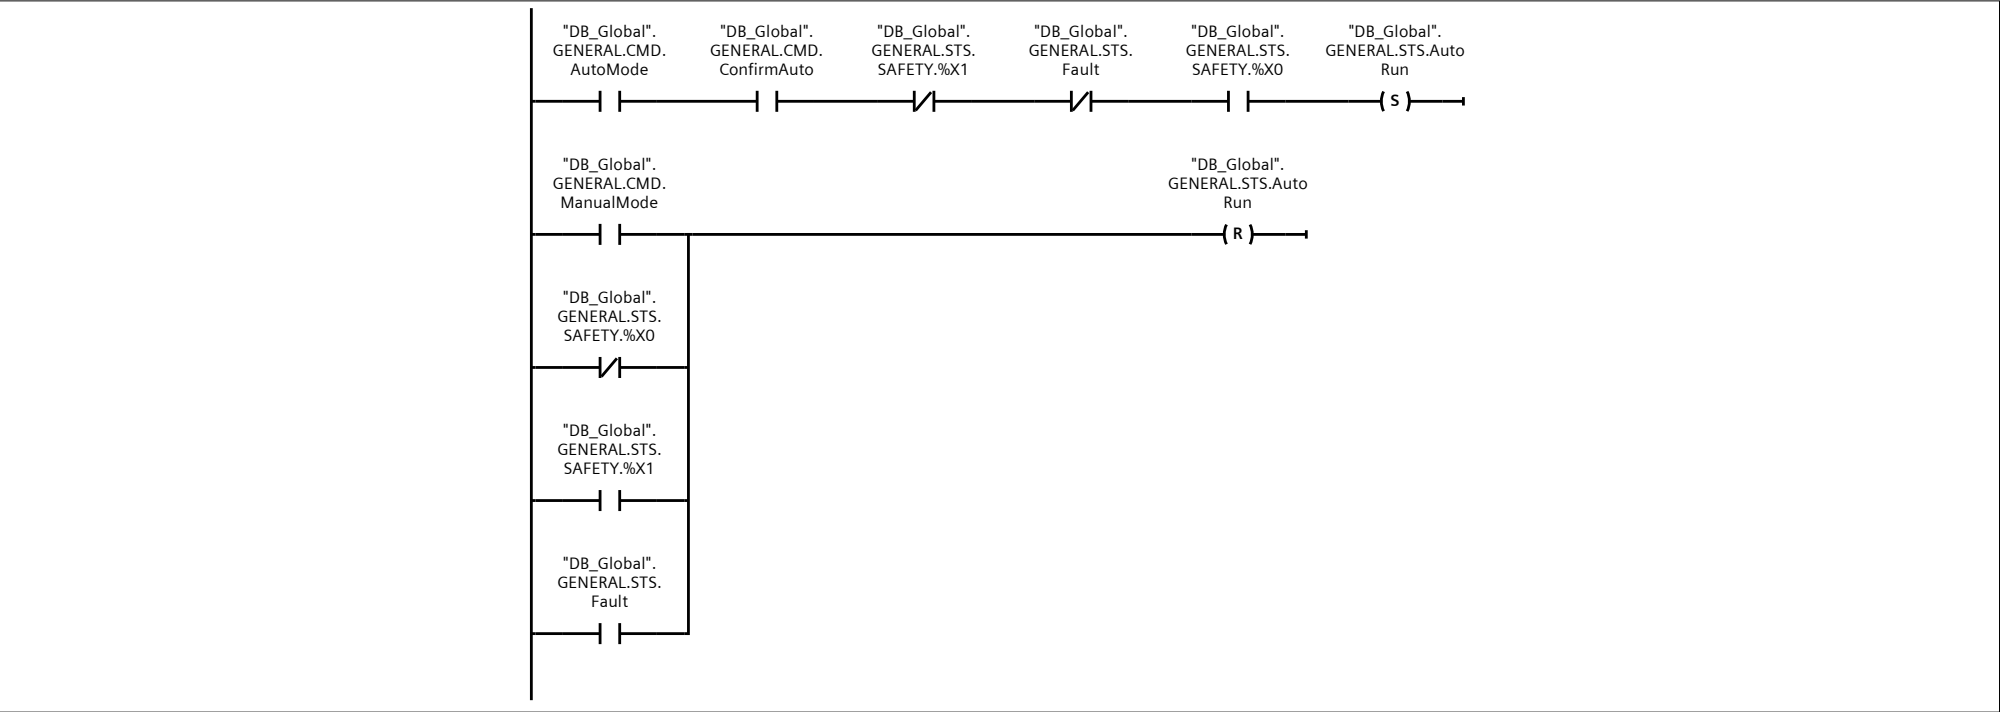


Network 2: Heartbit verificacion

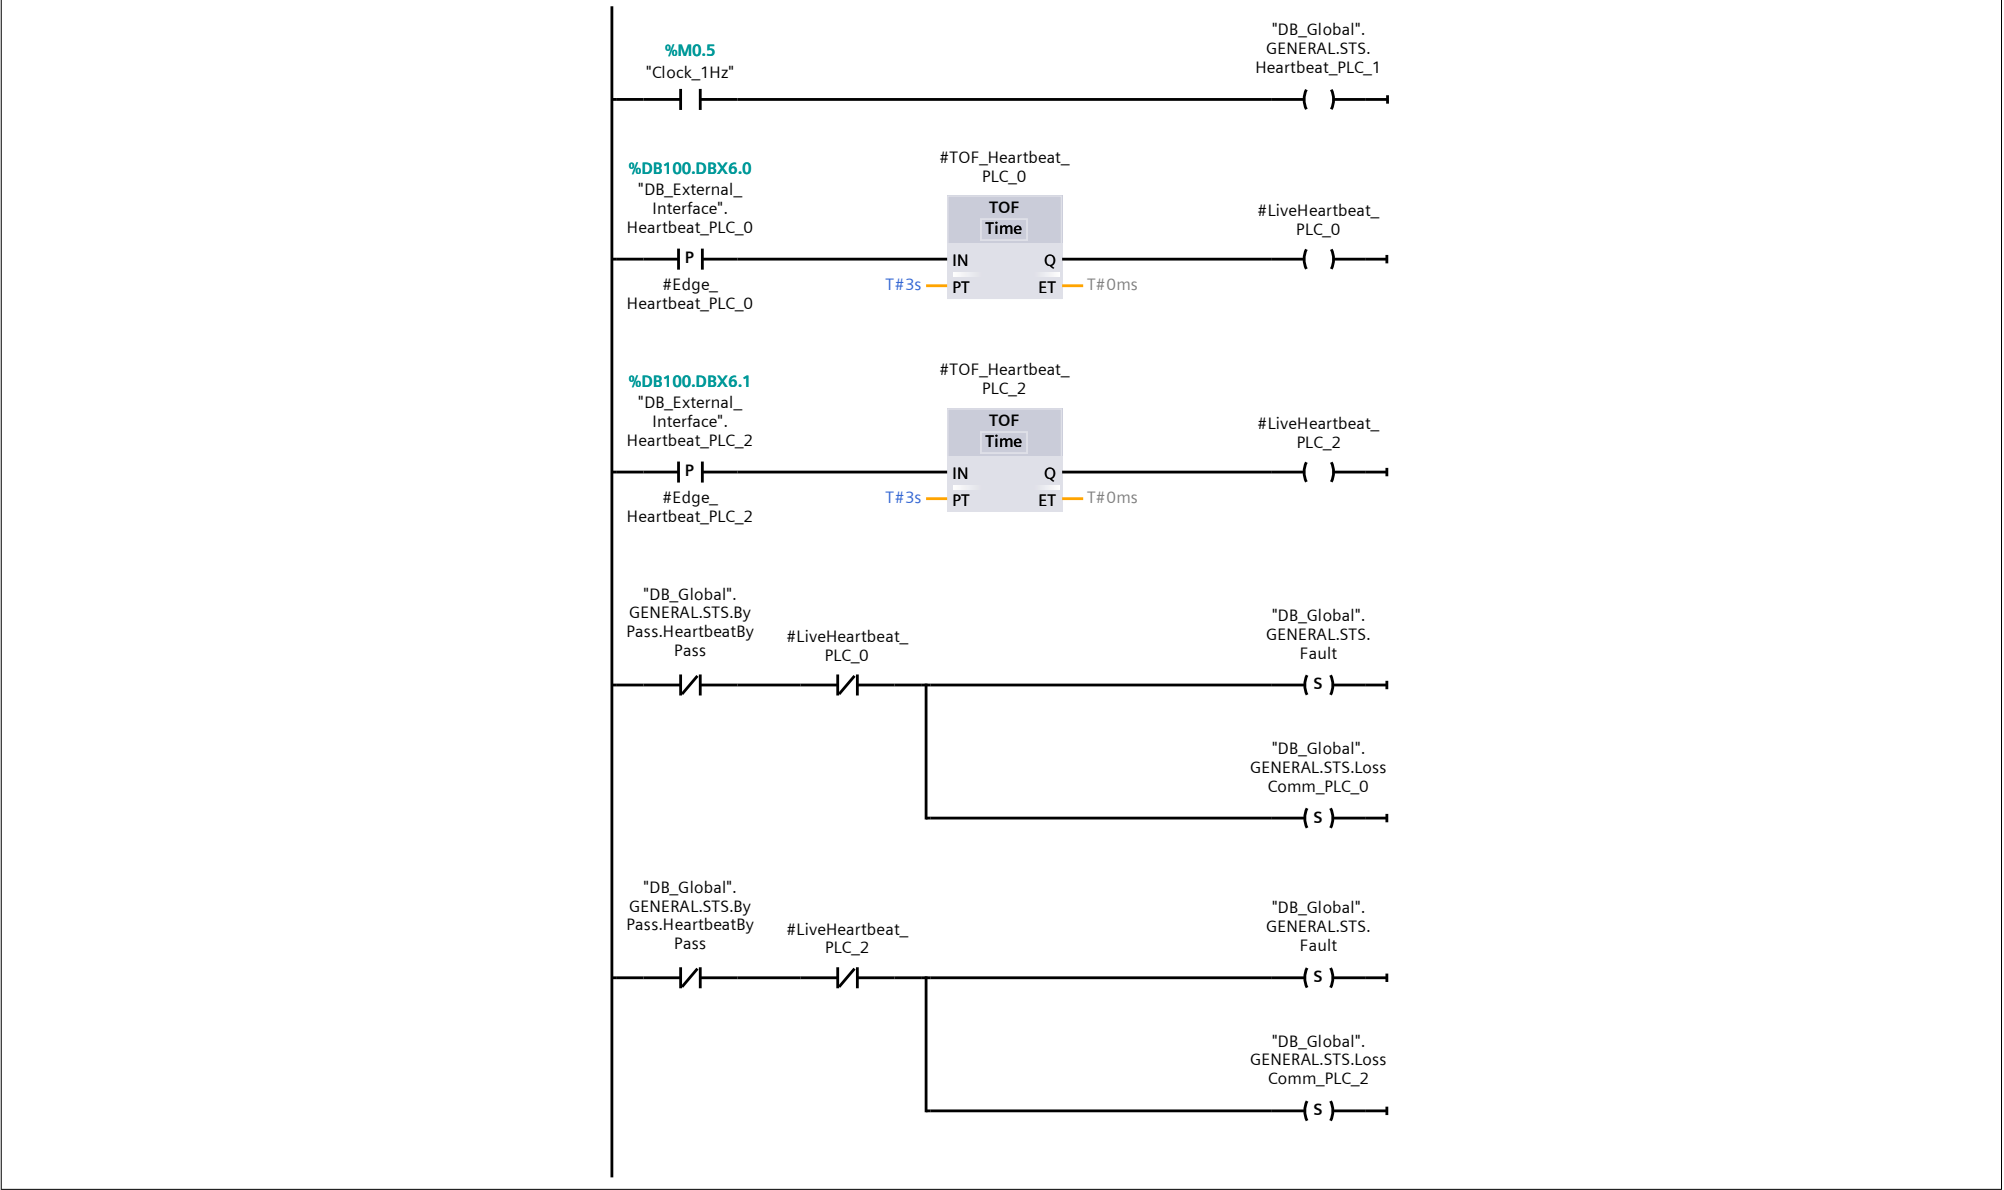

Network 3: Verificacion de fault en RB precedentes y proximas

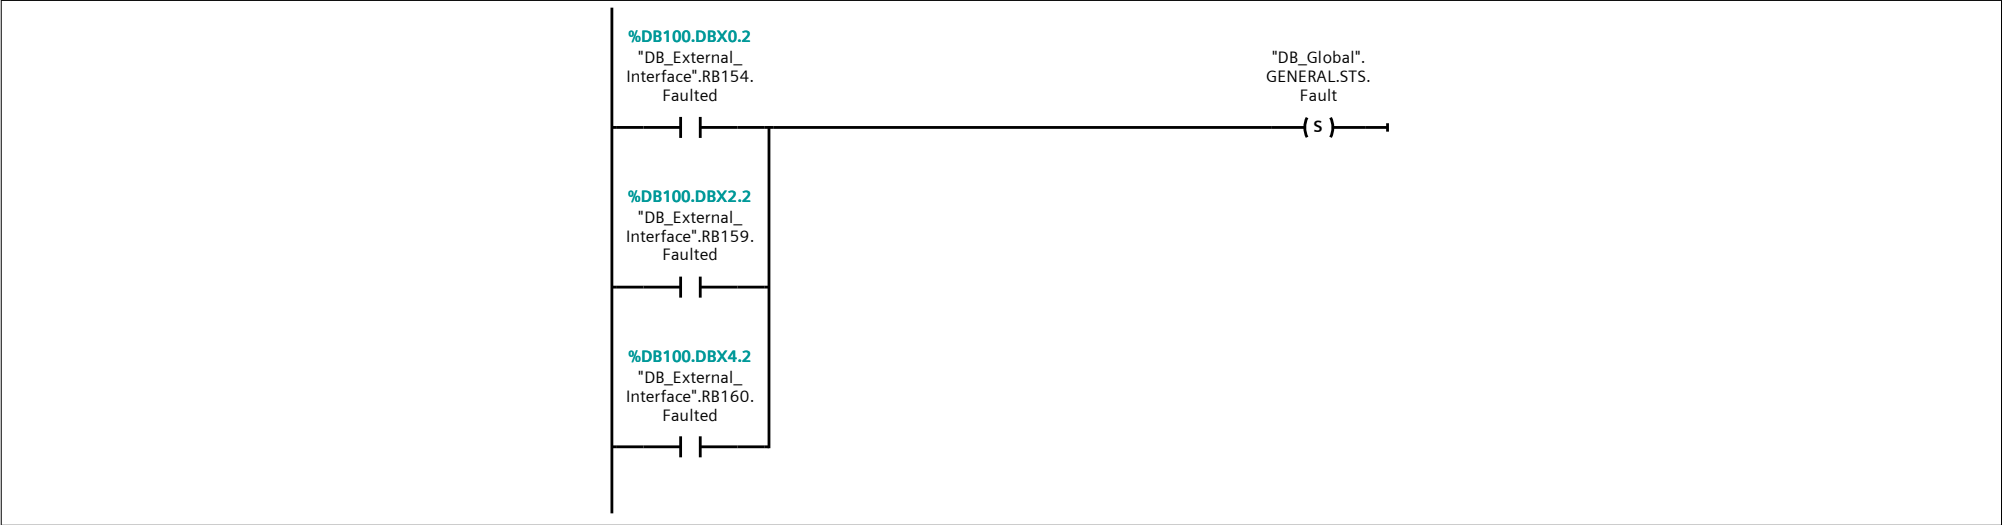


Network 4: Luces de indicaciones segun la condicion de la instalacion.

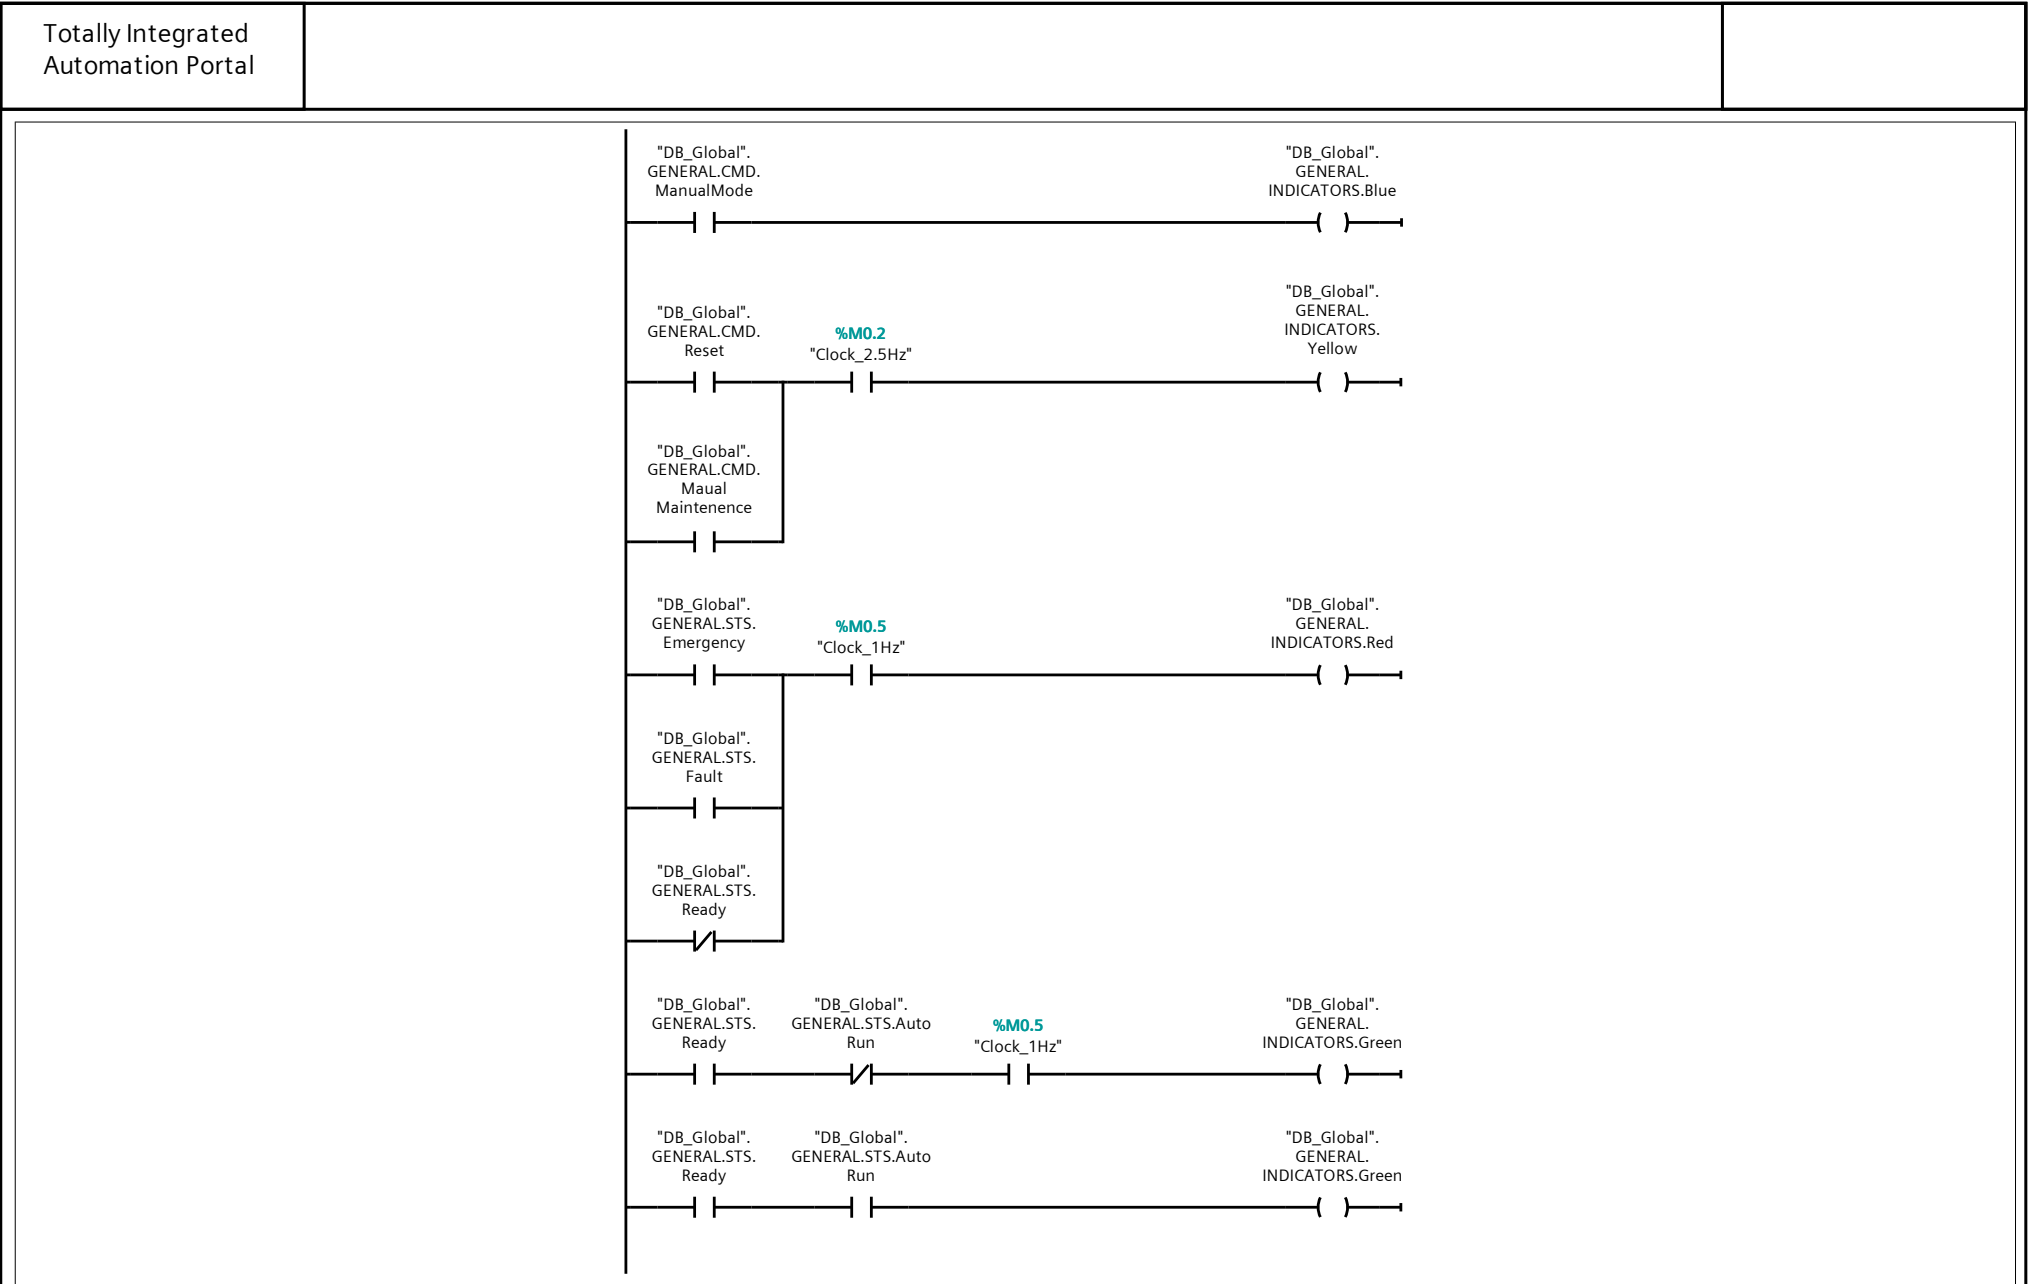

Network 5: Comando de Reset general de alarmas

Network 5: Comando de Reset general de alarmas (1.1 / 2.1)

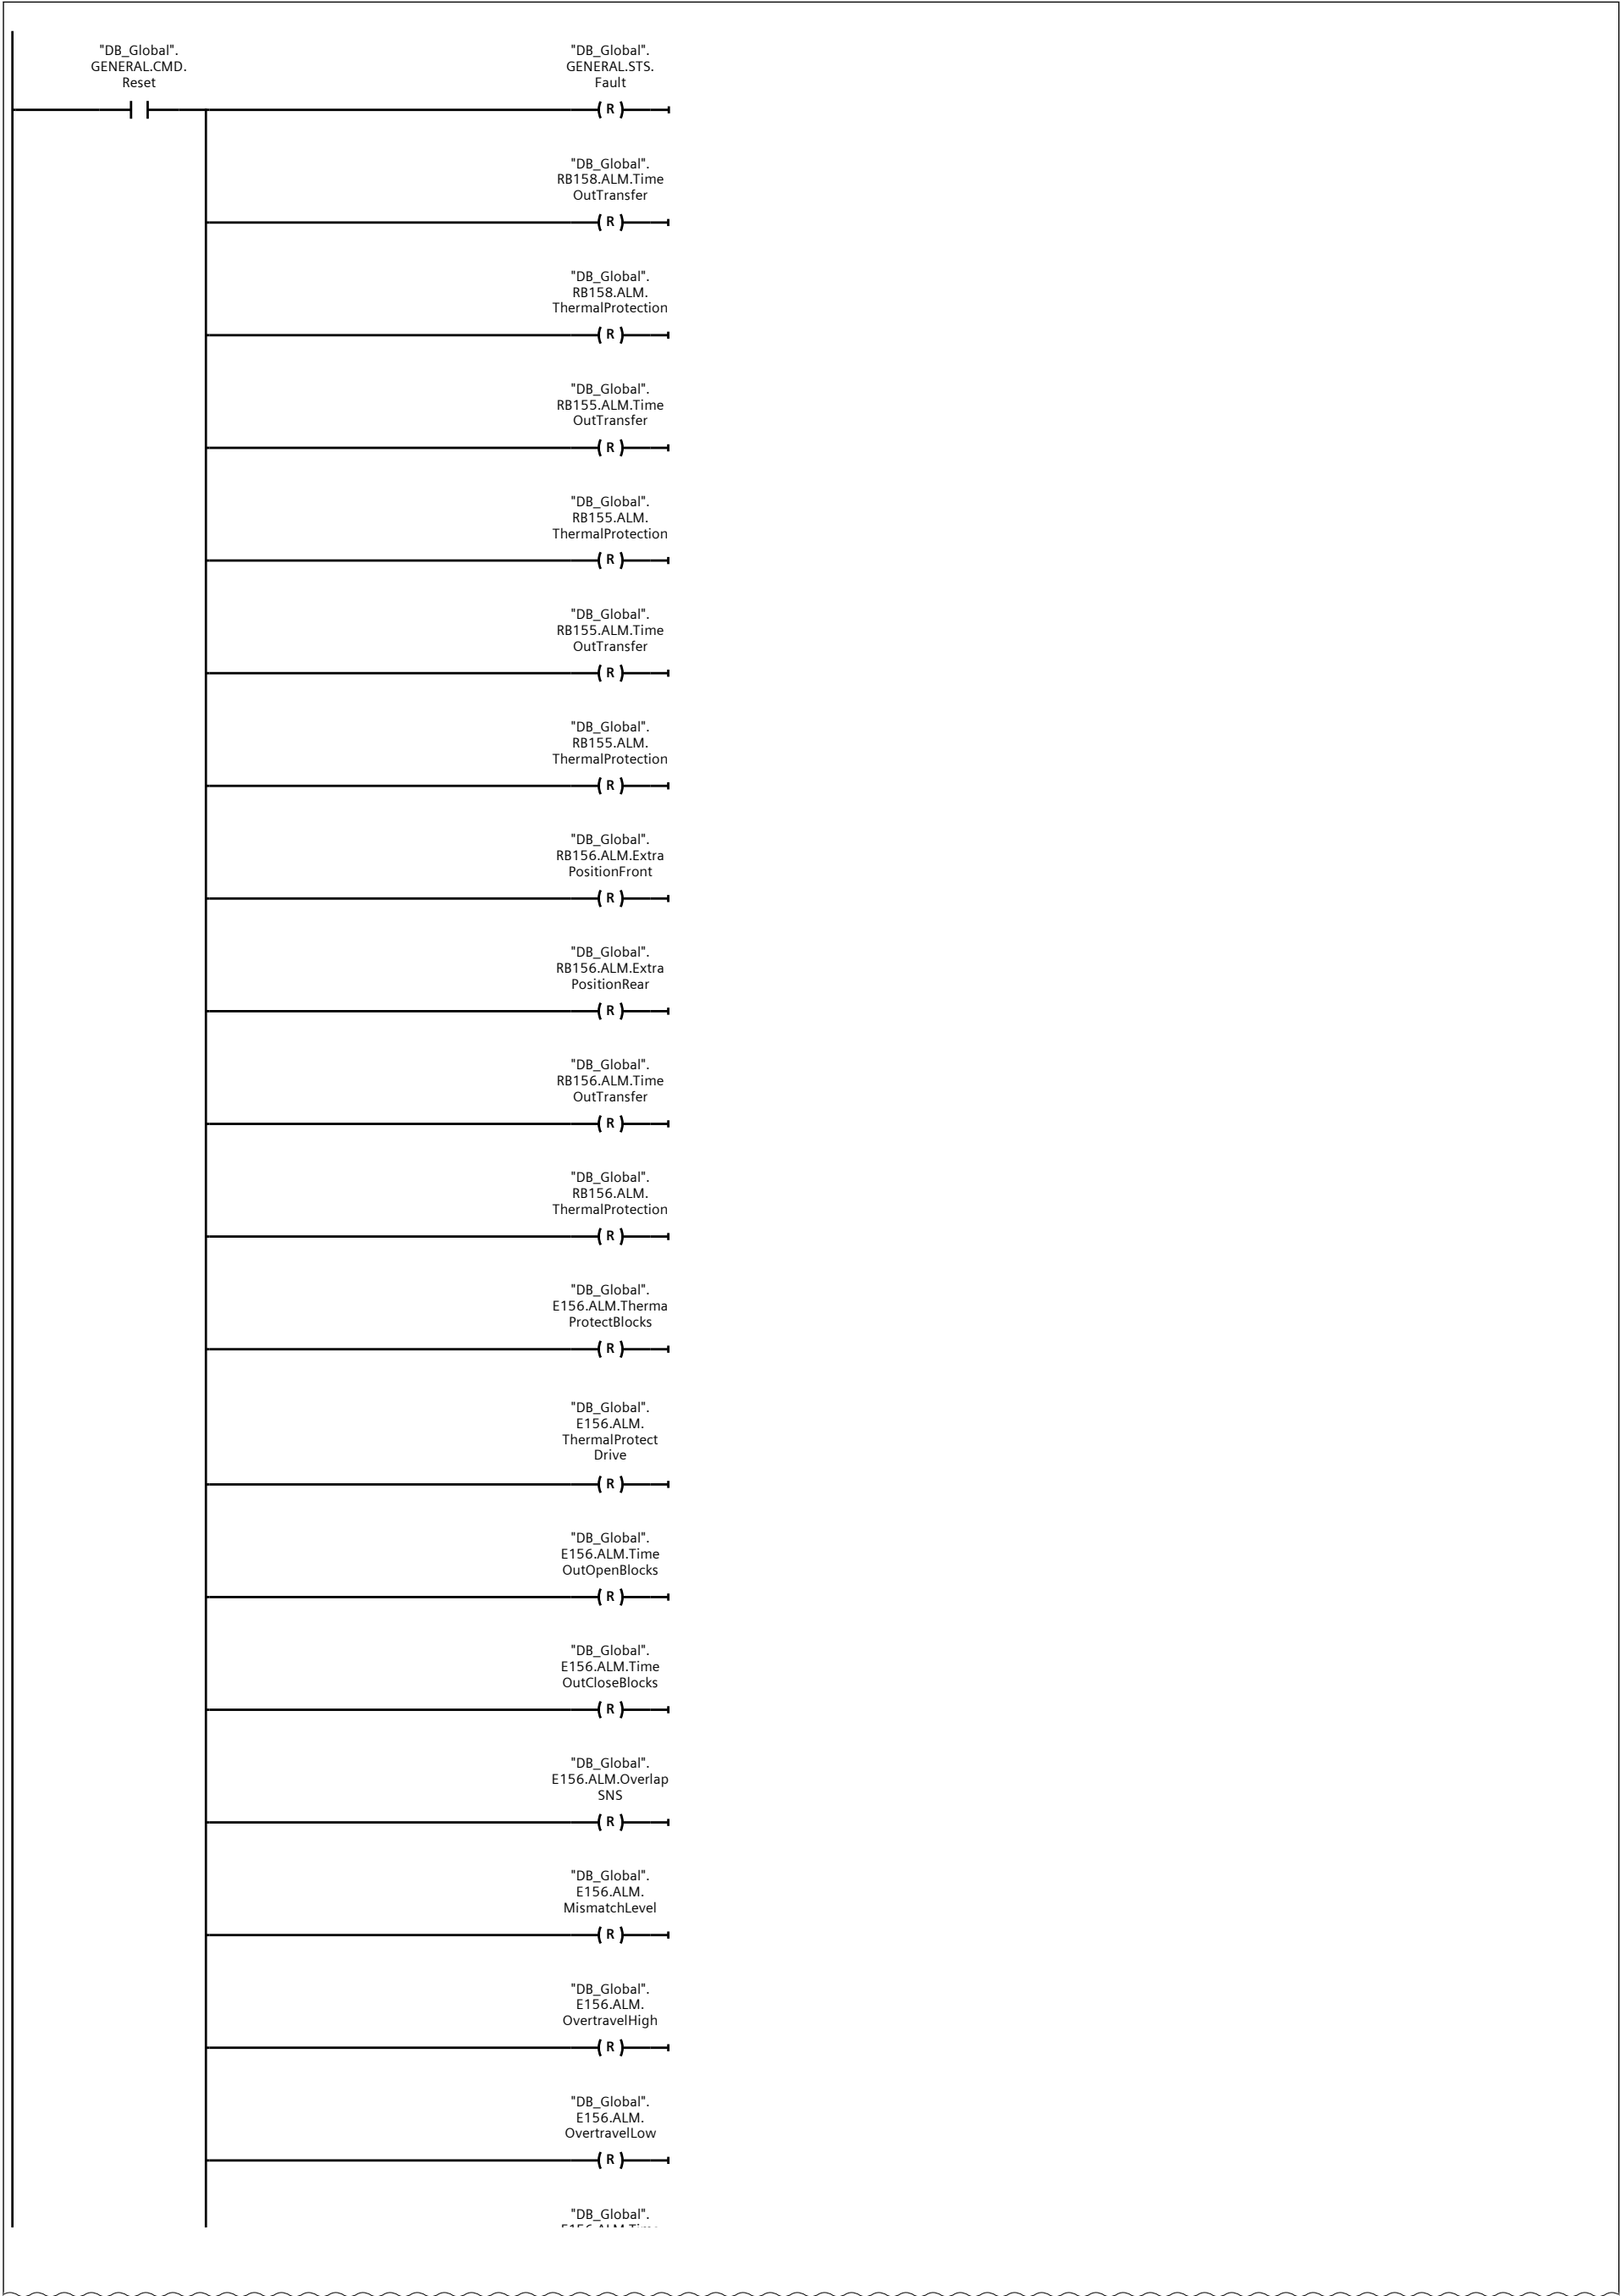

Network 5: Comando de Reset general de alarmas (2.1 / 2.1)

1.1 (Page1 - 4)

