




DC Opportunity

Es Meser et Courtes Parts 25400 Exincourt

25400 Exincourt


GPS: 47.506038, 6.827314

Production date: 23/09/2026

Verdict — Decision summary

GO UNDER CONDITIONS — score 59 / 100

Score breakdown

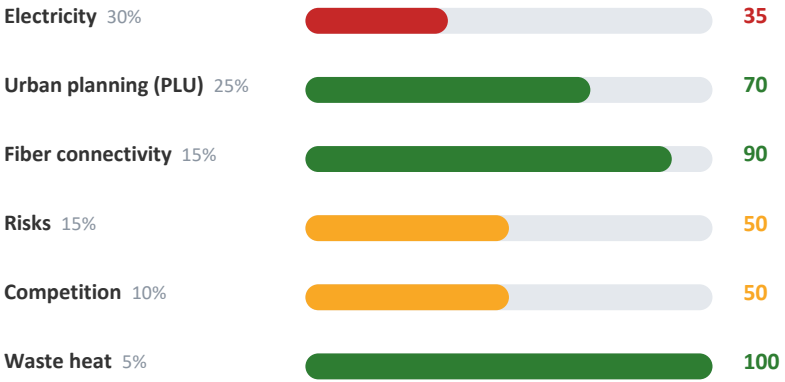

757 MW
Estimated need

500 MW
Gross capacity

Points of attention


– Electricity needs (slide 16) NOT COVERED by existing substations: estimated need 757.0 MW > max gross capacity…
– PLU height measured at the roof eaves: technical rooftop structures (cooling units, antennas) are included in…
– Flooding: existing hazard (at my address)

Favorable points

– Nearby RTE substation: RTE (63 kV) at 0.66 km — maximum gross capacity ~500 MW (sum of substations ≤ 5 km) — insufficient for…
– Nearby fiber backbone: fiber route fiber optic map — Arteria (FON SNCF) at 1.4 km
– Aeronautical easements (slide 17) NOT IMPACTED — Aérodrome de Montbéliard-Courcelles at 3.3 km (outside GPU zone)

Deterministic weighted score — to be confirmed by RTE PTF, complete PLU regulations and operator quotes.

Location — France view

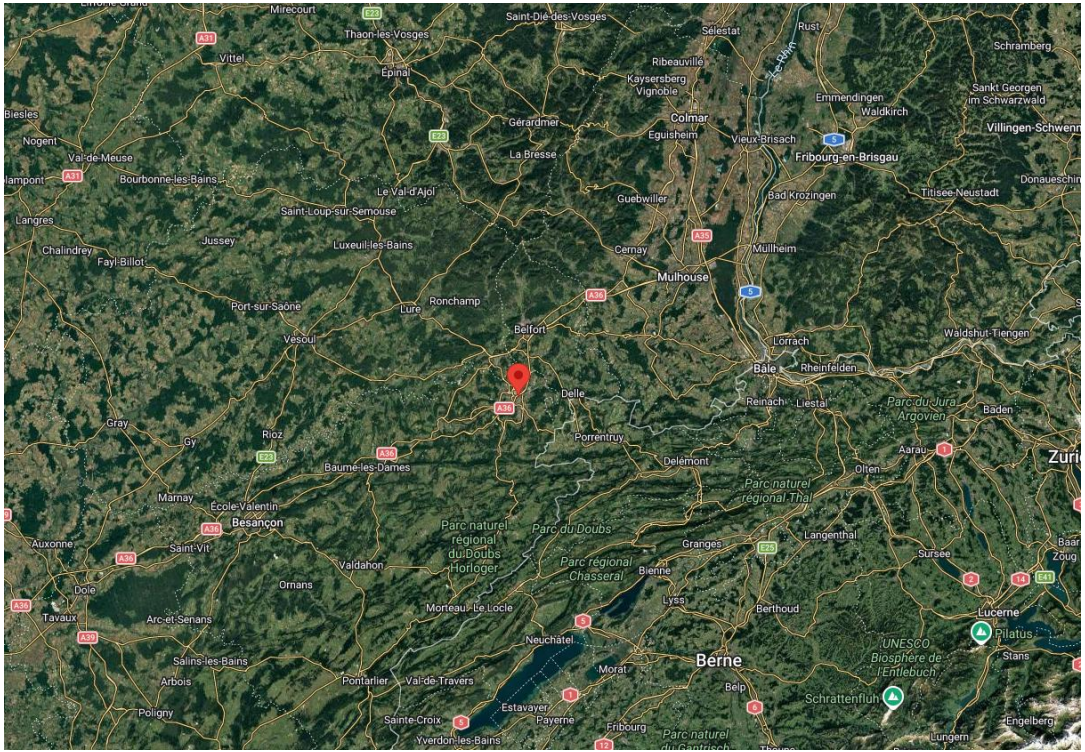

Comments

Whole France view — site location in the country.

Site coordinates: 47.506038, 6.827314

City: **25400 Exincourt**

Major nearby cities: Belfort (15 km), Mulhouse (47 km), Biel/Bienne (51 km)


Location & Advantages



Comments

- **City:** 25400 Exincourt
- **Region:** Bourgogne-Franche-Comté
- **Highway:** A36
- **National road:** Not identified

Plot Specifications

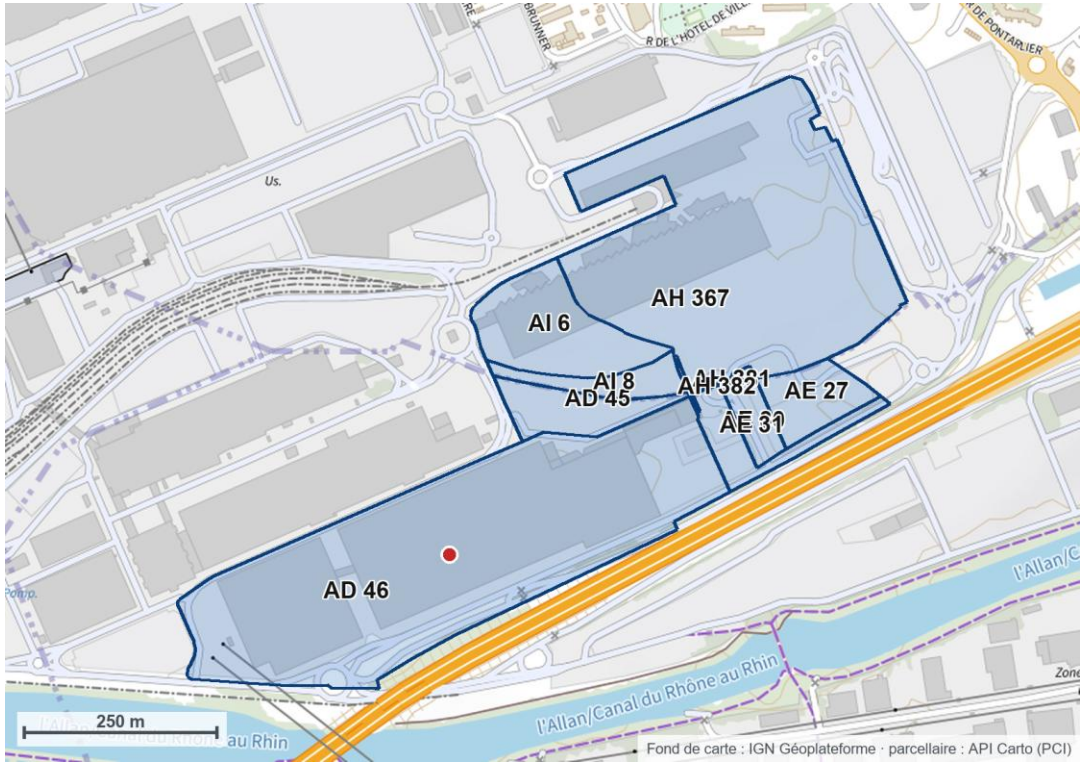

Comments

▸ **Property Composition**

- Property composed of 10 plot(s) — total area: **30.28 ha** (302,804 m²)
- ⚠ Property spread across 2 municipalities (INSEE: 25230, 25547). The PLU (plan local d'urbanisme) for EACH municipality is analyzed separately (one slide per municipality); other data (electricity, risks, fiber) are centered on the largest plot, INSEE municipality 25230.
- Plot details:
  - AD 45: 10,245 m² (1.02 ha) | AD 46: 127,217 m² (12.72 ha)
  - AE 27: 9,969 m² (1.00 ha) | AE 30: 4,876 m² (0.49 ha)
  - AE 31: 8,574 m² (0.86 ha) | AH 367: 112,813 m² (11.28 ha)
  - AH 381: 525 m² (0.05 ha) | AH 382: 30 m² (0.00 ha)
  - AI 6: 21,729 m² (2.17 ha) | AI 8: 6,826 m² (0.68 ha)

▸ **Reference Point**

- Centroid plot AD 46 — GPS 47.506038, 6.827314

▸ **Local Property Value (DVF, actual sales)**

- Selected comparables: land ≥ 30,280 m² (10% of site area)

Local Competition (50 km radius)

1 Competitor(s) within 50 km — 1 in service · 0 in project

Extendo Datacenter EXISTING ↗ DC site link **15.4 km**

90 - Territoire-de-Belfort · Bourgogne-Franche-Comté · 47.64452, 6.84332

IT Area: **1700 m²**



- Analyzed site
- Competitor (circle = 50 km)

PLU Analysis — Zone UYb (Exincourt) (1/3)

Regulatory PLU Analysis — Exincourt (zone UYb)

• **Area concerned in this municipality: 5 plot(s), 16.09 ha**

IDENTIFIED ZONE

Zone: UYb — Urbanized zone primarily intended for industrial activities: sector where urban planning rules are adapted to the specific context and uses (Urban zone)
Usage type: urban zone — often compatible with activity
Easements: no surface prescription at the point

DETAILED REGULATION ANALYSIS

Zone: UYb zone primarily intended for industrial activities (PSA production site north of the A36 highway).

1. IMPLANTATION / SETBACK

- Relative to public roads: 5 meters minimum (Article UY/UX 6 [PAGE 54])

Quote: "Constructions must be set back from the reference limit with a minimum setback of 5 meters."

- Relative to property lines: H/2 with a minimum of 5 meters (Article UY/UX 7 [PAGE 54])

Quote: "Buildings must be set back by H/2 with a minimum of 5 meters."

2. MAXIMUM HEIGHT

40 meters (Article UY/UX 10 [PAGE 55])

Quote: "The height of constructions is limited to 10 meters at the eaves. [...] In the UYb sector, this maximum height is increased to 40 meters."

PLU Analysis — Zone UYb (Exincourt) (2/3)

Regulatory PLU Analysis — Exincourt (zone UYb)

Height measurement point: at the eaves
Technical roof structures (antennas, cooling units): counted in the height — no exceeding possible
Height retained for the building: 35 m (40 m minus 5 m for superstructures reserve)

3. BUILDING FOOTPRINT (CES / COS)

No rule set — project free on this point (Article UY/UX 9 [PAGE 55])

Quote: "The building footprint coefficient is limited to 60%, except in the UYb sector, where it is not regulated."

4. MANDATORY GREEN SPACES

Not mentioned in the provided extracts

5. PARKING

The building permit may be subject to the creation of facilities designed to ensure off-street parking for vehicles corresponding to the needs of the building to be constructed. (Article UY/UX 3 [PAGE 52])

Quote: "The issuance of the building permit may be subject to: a) the creation of facilities designed to ensure off-street parking for vehicles corresponding to the needs of the building to be constructed"

6. AUTHORIZED CONSTRUCTIONS

Not mentioned in the provided extracts

7. PROHIBITED CONSTRUCTIONS

Not mentioned in the provided extracts

8. SPECIAL CONDITIONS / OTHER RULES APPLICABLE TO THE PROJECT

Compliance with provisions related to mining risks (index m or rm) and classified facilities (ICPE). (Article UY/UX 2 [PAGE 52])

PLU Analysis — Zone UYb (Exincourt) (3/3)

Regulatory PLU Analysis — Exincourt (zone UYb)

9. PROJECT FEASIBILITY CONCLUSION

Overall Status: PROBABLE YES

Warehouse / Datacenter: N/A — to be verified manually

Zone UYb is intended for industrial activities. A **datacenter**, as an industrial activity (technical process), is compatible with the zone's purpose.

10. DATACENTER CLASSIFICATION — WHICH REGULATION APPLIES?

Recommended sub-destination: **Industry**

Justification: The **datacenter** requires cooling infrastructure and industrial electrical power, which corresponds to the industrial purpose of zone UYb.

- **Industry: YES (Article UY/UX 1 and 2)**
- **Warehouse: YES (Article UY/UX 1 and 2)**
- Public interest equipment: N/A — to be verified manually

→ Recommendation: Classify the project as 'Industry' to match the primary purpose of zone UYb. Verify the presence of mining risk indicators (m or rm) on the specific plot to anticipate construction constraints.

PLU Analysis — Zone UZ (Sochaux)

PLU Regulatory Analysis — Sochaux (zone UZ)

• **Footprint concerned in this municipality: 4 plot(s), 14.19 ha**

IDENTIFIED ZONE

Zone: UZ — UZ: Industrial activity zone (Urban zone)

Usage type: urban zone — often compatible with activity

Easements at point: Maximum height of 25 m

DETAILED REGULATION ANALYSIS

{

"zone_description": "Zone UZ is intended for predominantly industrial activities, concerned by the presence of classified facilities for environmental protection (ICPE), particularly those subject to authorization."

"siting": {

"public_roads": {

"value": "5 meters minimum from the alignment of all public roads. Exceptions for public utility equipment/installations or those of collective interest, extensions and height increases

PLU Analysis — Zone UYb (Sochaux) (1/3)

PLU Regulatory Analysis — Sochaux (zone UYb)

• **Area concerned in this municipality: 1 parcel(s), 0.00 ha**

IDENTIFIED ZONE

Zone: UYb — Urbanized zone primarily intended for industrial activities: sector where urban planning rules are adapted to the specific context and uses (Urban zone)

Usage type: urban zone — often compatible with activity

Easements: no surface prescription at the point

DETAILED REGULATION ANALYSIS

Zone: Zone UYb: PSA production site north of highway A36, primarily intended for industrial activities.

1. IMPLANTATION / SETBACK

- Relative to public roads: 5 meters minimum, 40 meters from the axis of highway A36, 15 meters from RD 437 and from the axis of Rue des Bouquières (Article UY/UX 6 [PAGE 54])

Quote: "Buildings must be set back from the reference limit with a minimum setback of 5 meters. This setback is increased to: 40 meters from the axis of highway A36, 15 meters from RD 437 and from the axis of Rue des Bouquières."

- Relative to property lines: H/2 with a minimum of 5 meters (Article UY/UX 7 [PAGE 54])

Quote: "Buildings must be set back by H/2 with a minimum of 5 meters."

2. MAXIMUM HEIGHT

40 meters (Article UY/UX 10 [PAGE 55])

Quote: "Building height is limited to 10 meters at the eaves. [...] In the UYb sector, this maximum height is increased to 40 meters."

PLU Analysis — Zone UYb (Sochaux) (2/3)

PLU Regulatory Analysis — Sochaux (zone UYb)

Height measurement point: at the eaves
Technical roof structures (antennas, cooling units): counted in the height — no exceeding possible
Height retained for the building: 35 m (40 m minus 5 m for superstructures reserve)

3. BUILDING FOOTPRINT (CES / COS)

No rule set — project free on this point (Article UY/UX 9 [PAGE 55])

Quote: "The building footprint coefficient is limited to 60%, except in the UYb sector, where it is not regulated."

4. MANDATORY GREEN SPACES

Not mentioned in the provided extracts

5. PARKING

The issuance of the building permit may be subject to the creation of facilities designed to ensure off-street parking for vehicles corresponding to the needs of the building to be constructed. (Article UY/UX 3 [PAGE 52])

Quote: "The issuance of the building permit may be subject to: a) the creation of facilities designed to ensure off-street parking for vehicles corresponding to the needs of the building to be constructed"

6. AUTHORIZED CONSTRUCTIONS

Not mentioned in the provided extracts

7. PROHIBITED CONSTRUCTIONS

Not mentioned in the provided extracts

8. SPECIAL CONDITIONS / OTHER RULES APPLICABLE TO THE PROJECT

Compliance with the provisions of Article R 111-2 of the Urban Planning Code for classified installations (ICPE). (Article UY/UX 2 [PAGE 51])

PLU Analysis — Zone UYb (Sochaux) (3/3)

PLU Regulatory Analysis — Sochaux (zone UYb)

9. PROJECT FEASIBILITY CONCLUSION

Overall Status: PROBABLE YES

Warehouse / Datacenter: AUTHORIZED (51)

Zone UYb is explicitly designated for industrial activities, which allows for the siting of a **datacenter** under the sub-destination 'Industry'.

10. DATACENTER CLASSIFICATION — WHICH REGULATION APPLIES?


Recommended sub-destination: **Industry**

Justification: The **datacenter** is a heavy technical infrastructure (cooling, energy) corresponding to the industrial purpose of Zone UYb.

- **Industry: YES (Article UY/UX 1 and 2)**
- **Warehouse: YES (Article UY/UX 1 and 2)**
- Public interest equipment: N/A — to be verified manually

→ Recommendation: Submit the permit under the sub-destination 'Industry' to match the primary purpose of Zone UYb.

Electrical Environment

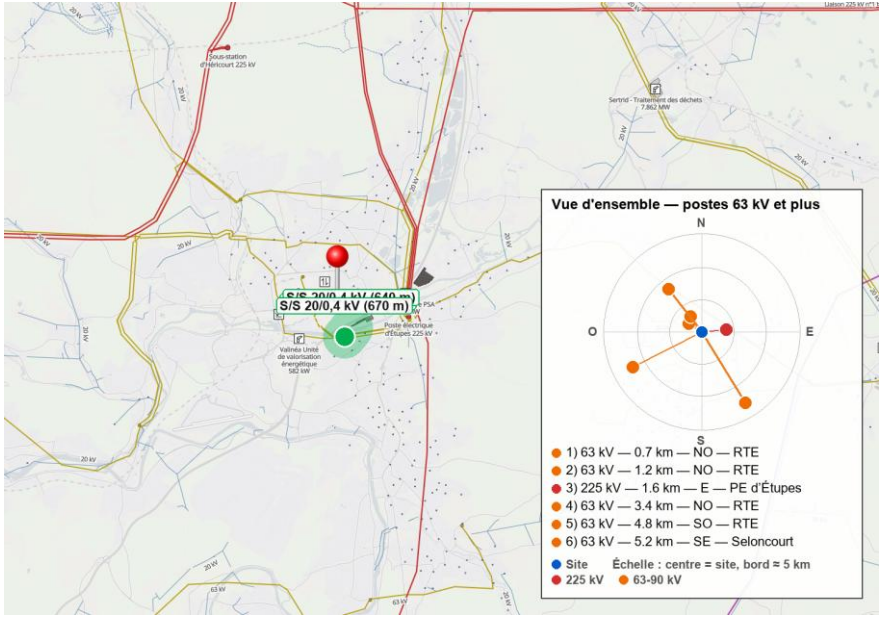

pin: analyzed site ● green: Enedis distribution substation bottom-right box: RTE source substations (63 kV and above), color = voltage level

Comments

RTE source substations (electricity transmission network operator) — high voltage transmission

- RTE source substation **≥ 225 kV**: Étupes ES (225 kV) at **1.56 km** — E direction
- Closest RTE source substation: RTE (63 kV) at **0.66 km**
- **Maximum gross capacity: ~500 MW**
  sum of 5 RTE substations within 5 km:
  - Étupes ES (225 kV ~300 MW) at **1.6 km**
  - RTE (63 kV ~50 MW) at **0.7 km**
  - RTE (63 kV ~50 MW) at **1.2 km**
  - RTE (63 kV ~50 MW) at **3.4 km**
  - RTE (63 kV ~50 MW) at **4.8 km**

Nearby electrical lines


- Closest overhead line: **63 kV** at **300 m**
- Closest underground line: none (15 km radius)
- Tapping option: **225 kV** line at **1.49 km** — potential capacity ~300 MW via in-line connection + creation of a customer substation

Enedis Distribution (MV/LV)

- Closest Enedis substation 20/0.4 kV: **620 m** — Enedis

  3 closest: 620m ✓; 640m ✓; 670m ✓ (✓=20/0.4 kV confirmed,?=presumed)

Map of electrical substations (30 km)

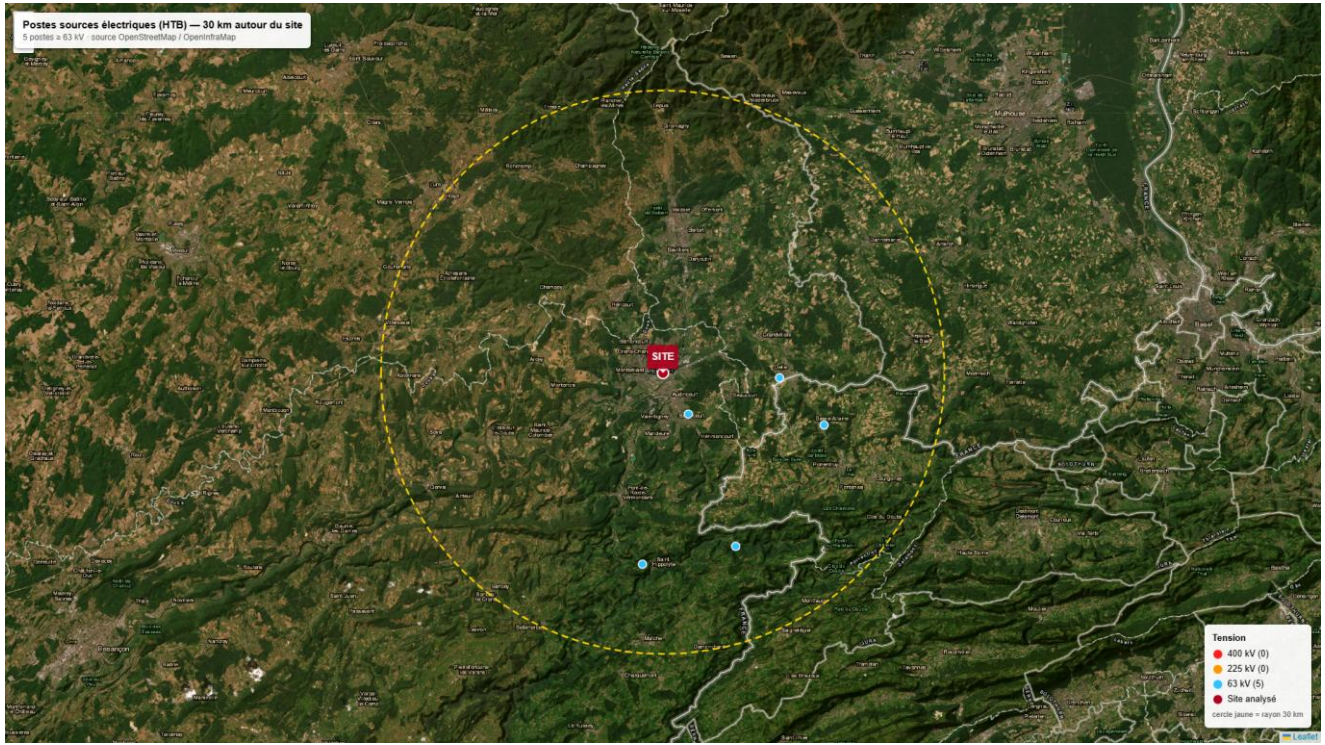

Electricity Needs

Estimated Electrical Power Required

1. Input Data

- Total plot area: 30.28 ha (302,804 m²)
- Maximum ground footprint (PLU): 50%
- Maximum height (PLU): 35.0 m

2. Intermediate Calculations

- Ground area dedicated to datacenter = 30.28 ha × 50% = 15.14 ha (151,402 m²)
- Number of possible floors = ⌊ 35.0 m / 7 m ⌋ = 5 floor(s)
- *Selected electrical density: 10 MW per hectare per floor*

3. Result

- Need = 15.14 ha × 5 floor(s) × 10 MW/ha/floor

➜ Estimated electricity need: 757.0 MW


4. Comparison need / available capacity

- Maximum gross capacity (sum of RTE substations ≤ 5 km, otherwise the closest): 500 MW

⚠ Insufficient capacity: need 757.0 MW exceeds capacity by 257 MW (ratio 151%)

Note: theoretical estimate based on maximum plot valuation (ground footprint × regulatory height). Maximum gross capacity: sum of RTE substations at ≤5 km, tiers 63 kV→50 MW, 220 kV→300 MW, 400 kV→1 GW per substation (otherwise the closest RTE substation, alone).


Aeronautical Easements

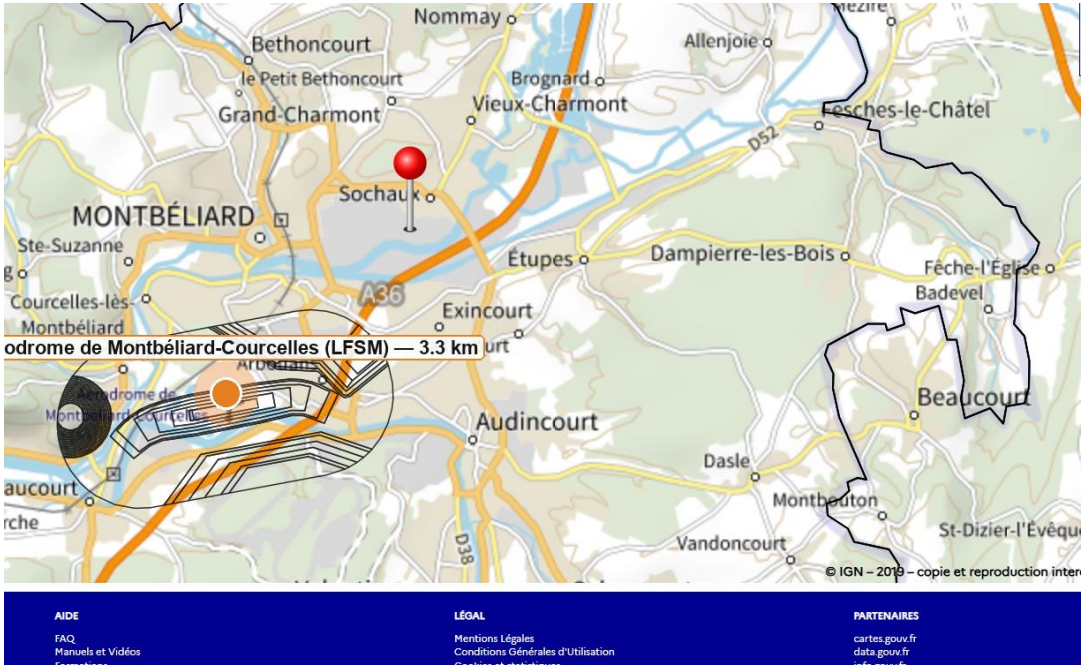

Comments

- **Closest airport**
  - Montbéliard-Courcelles Aerodrome (LFSM) at **3.3 km**
- **Site overflight**
  - Axes not determinable — visual map reading
- **Permissible height (indicative)**
  - To be read on the official PSA (DGAC)
- **Verdict**
  - **NOT IMPACTED — no aeronautical easement polygon at the point (official GPU source)**


Backbone Connectivity (fiber optic)

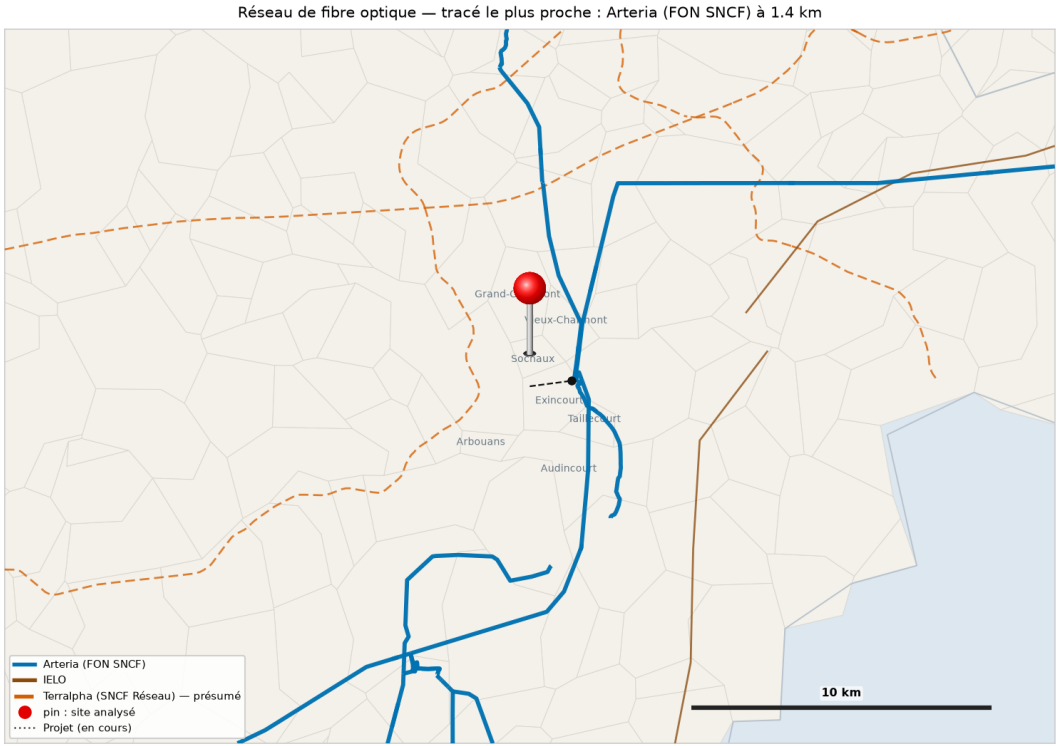

Comments

- Operators within 5 km: Arteria up to 1 Tbit/s (1.4 km), Terralpha 10 to 800 Gbit/s (1.7 km) (+1 between 5 and 25 km)
- Terralpha: reconstructed route (unpublished). Fiber very probable, track equipped with ground-to-train radio. To be confirmed with the operator.
- Closest FLAP-D (Frankfurt, London, Amsterdam, Paris, Dublin) interconnection hub: Frankfurt — **320 km** (~3.4 ms one-way fiber)

Heat Reuse

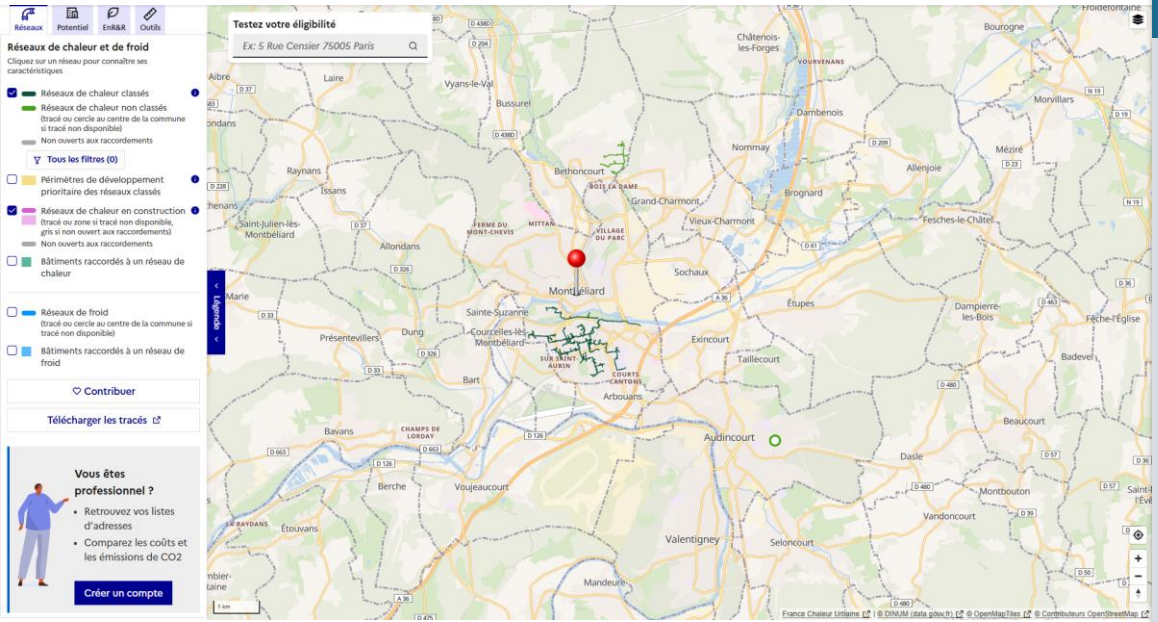


Existing Network

Planned Network

Comments

- **Closest Existing Network**
  - Existing Network: Montbéliard Network — Montbéliard Energies (DALKIA) at **0.90 km** to the W
  - Energy mix: 45% fossil fuels · 55% renewable & recovery
- **Projects in development**
  - Project in development: Network project — Montbéliard Energies (DALKIA) **1.75 km** to the W

Flood Risk

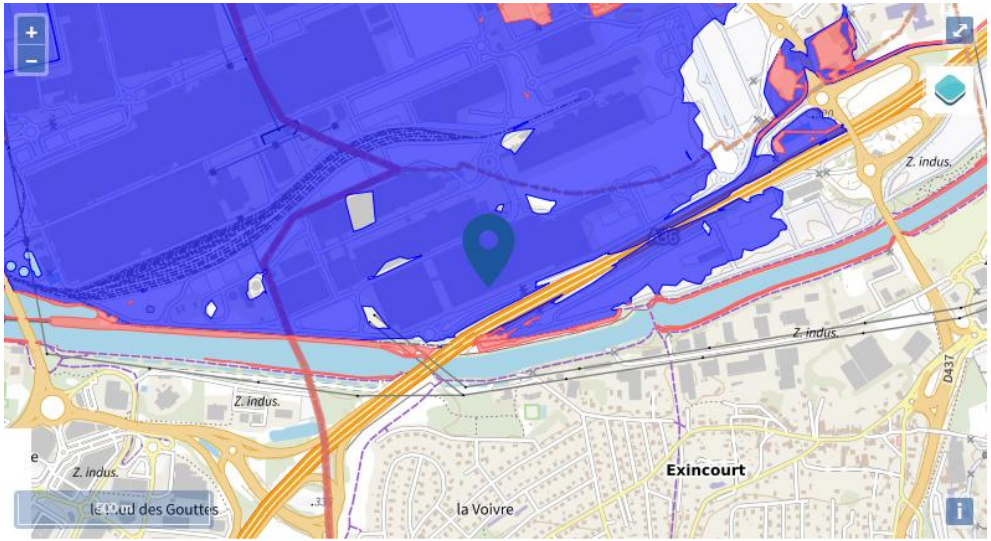

Légende :


- Prescription hors zone d'aléa
- Prescriptions
- Interdiction
- Interdiction stricte
- Zone à risque d'inondation entrainant une servitude d'utilité publique
- Délaissement possible
- Expropriation possible
- Zones hors prescription
- Non identifié

Comments

At my address: EXISTING

In the municipality: EXISTING

Water table depth

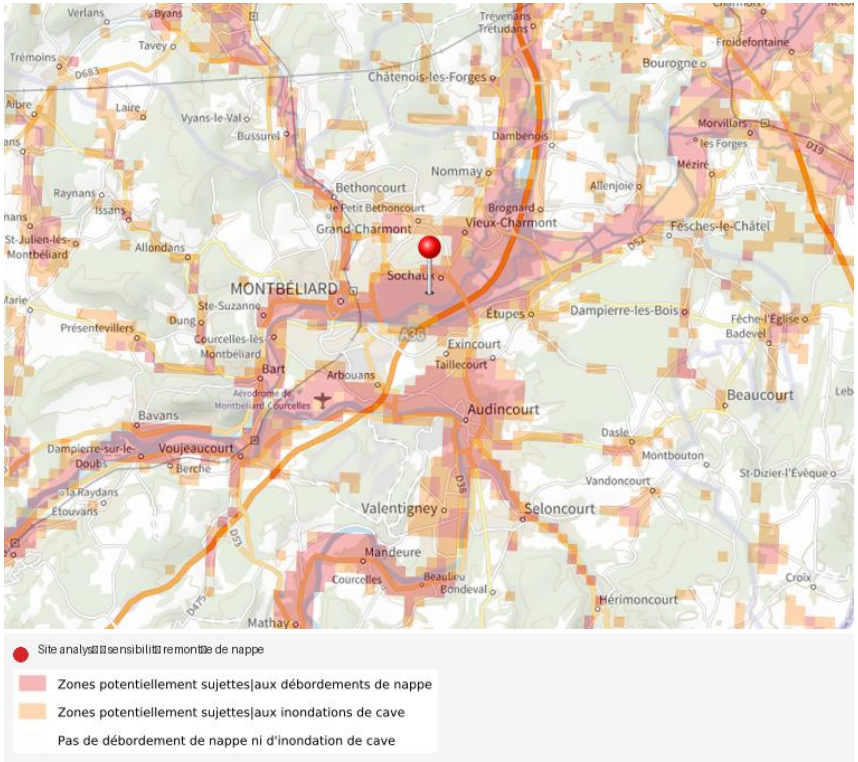

Comments

- Water table depth: **30.41 m** below ground — measured **9.14 km** from the site (last measurement 2026-09-22)
- Piezometric level: **329.3 m** NGF (general leveling of France, altitude reference)
- Reference piezometer: 04438X0018/S

Soil Composition




Lithologie du site : Grès (Roches Sédimentaires)

Carte géologique BRGM au 1/50 000

Comments

- Dominant subsoil: Sandstone
- Rock type: Sedimentary Rocks
- 4 underground cavity(ies) identified within 2 km (the closest at 1.44 km)

Former Underground Quarries

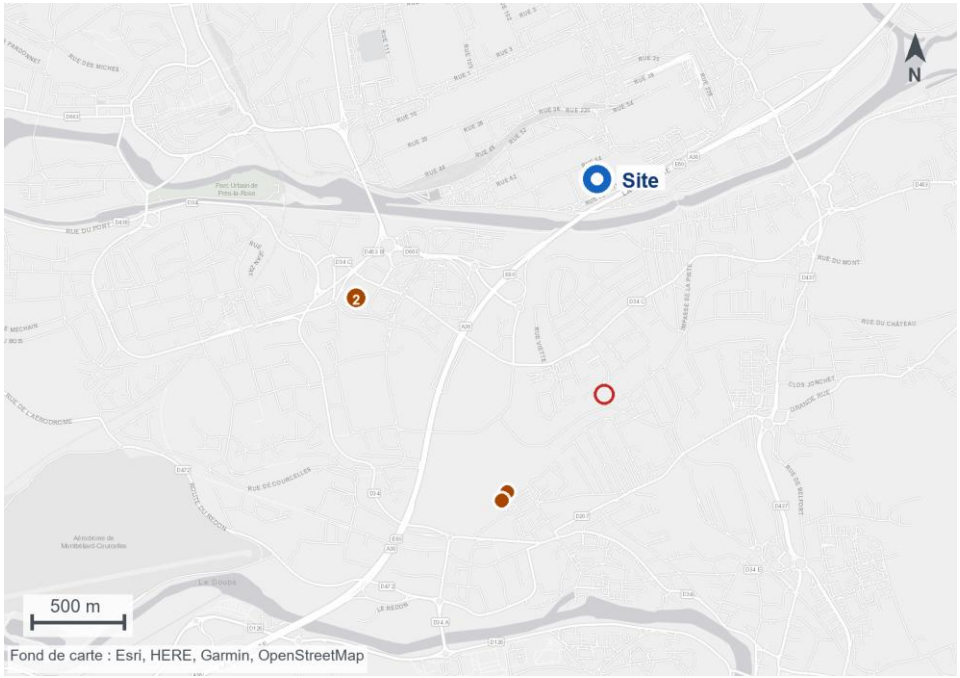

● *blue: analyzed site* ● *brown: cavity identified* ● *red: proven ground movement*

Comments


▸ **Finding**

- 4 cavities within 2 km, including 4 of 'natural' type, the closest at **1.4 km**
- Dominant Hazard: karstic dissolution, natural cavity collapse

▸ **To be done before permit**

- Geotechnical study G2 with boreholes on the footprint


Underground Infrastructure (Metro/Tunnel)

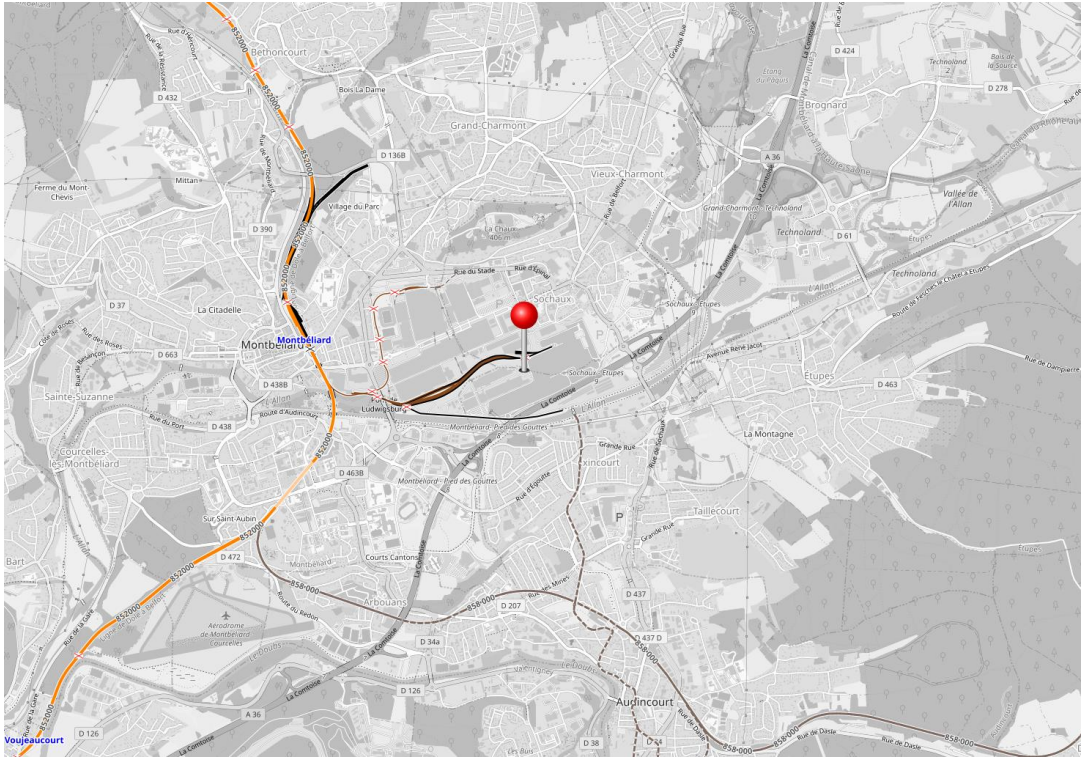

Comments

- 2 railway/metro tunnel(s) detected within a radius of 2 km
- Closest tunnel: **~2180 m**
  - Dole to Belfort Line (rail) — **2180 m**
  - Dole to Belfort Line (rail) — **2180 m**
- Possible ground load constraint (~5 T/m²) in deep underground zone — to be confirmed with the operator (RATP / Société du Grand Paris / SNCF Réseau)

Seveso Sites nearby — Mapping

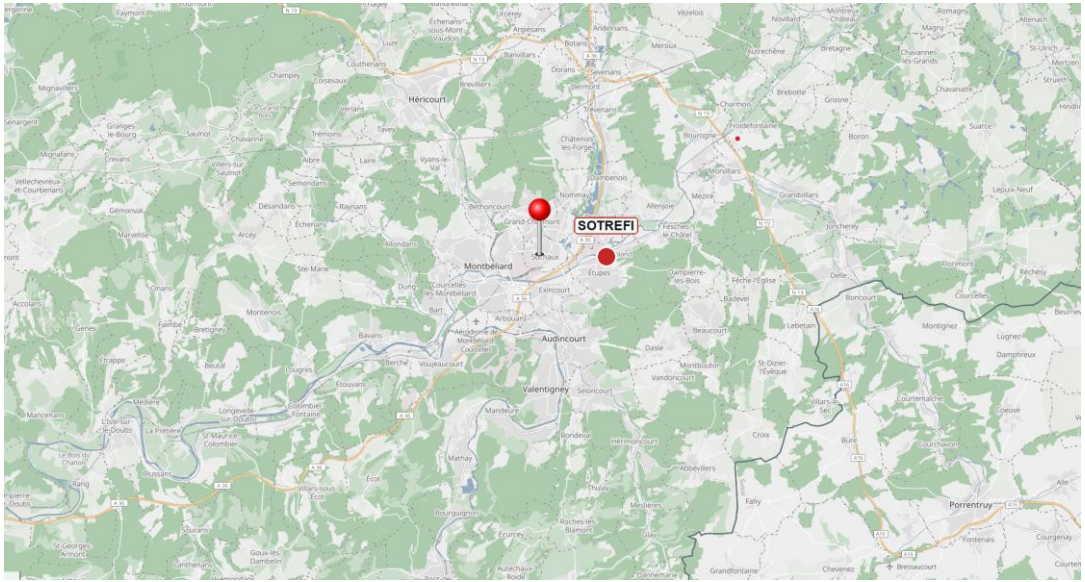

pin: analyzed site ● red: Seveso site

Comments

- 1 Seveso site(s) identified near the project (10 km radius)
  - SOTREFI (Seveso lower tier) — **3.0 km**
- ✓ Site OUTSIDE any regulated PPRT perimeter
- Detailed sheet for each site on the following slides

Seveso Site — SOTREFI

Detailed sheet 1/1 — Seveso lower tier — 3.0 km from the project

1. Site Identity

- Address: 48 rue des Tonneliers, 25460, Étupes
- Seveso status: Seveso lower tier
- Activity Status: In operation with permit
- Activity: NAF 38
- Administrative Regime: Authorization — IED, National Priority

2. Main ICPE Categories (substances / quantities)

- Category 3550 — temporary waste storage — 250,000 t — [Authorization]
- Category 2795 — Washing of drums, containers,... of substances or mixtures ... — 19,500 m3/day — [Declaration with control]
- Category 2716 — non-hazardous non-inert waste (transit) — 0.000 m3 — [Declaration with control]
- Category 2790 — Treatment of hazardous waste — [Authorization]

... 1 additional category

3. Inspection Monitoring

- Last inspection report: 2026-09-08
- 7 prefectural order(s) / annexed document(s)

4. Risk Analysis for the Datacenter Project

Seveso lower tier site 3.0 km from the project. Effect distances are specific to each establishment and are detailed in its hazard study; the enforceable perimeter is that of the PPRT (cf. Cartography slide).

Géorisques — Summary of hazards at the address

Legend: green = no hazard / not applicable · orange = to be verified · red = concerned / problem

Hazard	Status	Detail
TMD Pipelines	Concerned	CONCERNED
Industrial (ICPE)	OK	NOT APPLICABLE
Flood	To be verified	EXISTING
Ground movements	OK	UNKNOWN
Radon	To be verified	MODERATE
Water table rise	To be verified	EXISTING
Dam failure	OK	UNKNOWN

Hazard	Status	Detail
Clay shrinkage-swelling	To be verified	MODERATE
Seismicity	To be verified	MODERATE
Soil pollution	Concerned	CONCERNED
Marine submersion	OK	No risk present
Mining risks	OK	No risk present
Forest fires	OK	No risk present
Nuclear (PPI)	OK	No risk present

Summary — Summary table

Legend: green = no problem · orange = to be verified / research · red = significant problem

Theme	Status	Detail
PLU / zoning	To be verified	UZ Zone (Sochaux, the most restrictive across 2 municipalities) —
Electricity (substations)	To be verified	Substation at 0.7 km BUT insufficient capacity (~500 MW < need
Backbone connectivity	Connectable	Fiber route at 1.4 km
Heat reuse	Strong	Network at 900 m
Aeronautical easements	OK	Outside easement (airport 3.3 km)
Seveso / PPRT	OK	Outside PPRT perimeter (site at 3.0 km)
Georisques (hazards)	Problem	2 problem(s), 5 to be verified — see Georisques slide