

HVAC & MEP INSPECTION REPORT

Site: Test Site - Ajman Tower

Site Information


Site Name:	Test Site - Ajman Tower
Visit Date:	2026-03-12
Report Generated:	2026-07-19 16:13:46 (GST)
Total Items Inspected:	2

Inspection Items

Item 1: Chiller Unit A

Asset Name:	Chiller Unit A
System Type:	HVAC
Description:	Main chiller for building cooling
Quantity:	1
Brand:	Carrier
Specification:	500 TR
Comments:	In good condition
Photos Attached:	2

Attached Photos (2 total):

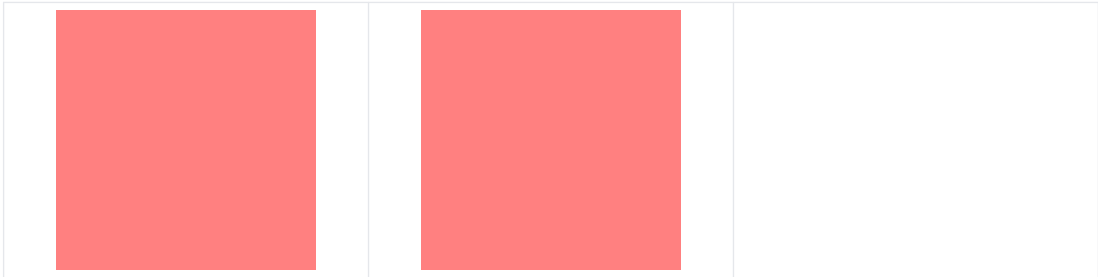


Item 2: AHU-01

Asset Name:	AHU-01
System Type:	HVAC
Description:	Air handling unit Floor 1
Quantity:	1
Brand:	Trane
Specification:	10,000 CFM


Comments:	Filter replacement recommended
Photos Attached:	1

Attached Photos (1 total):

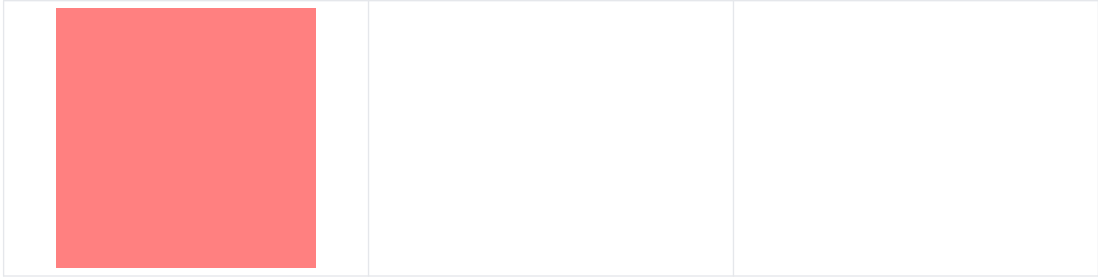

Supervisor Review

Inspection completed. Minor maintenance required.

Supervisor Signature:	
-----------------------	---

Document signed on: July 19, 2026 at 16:13 (GST)