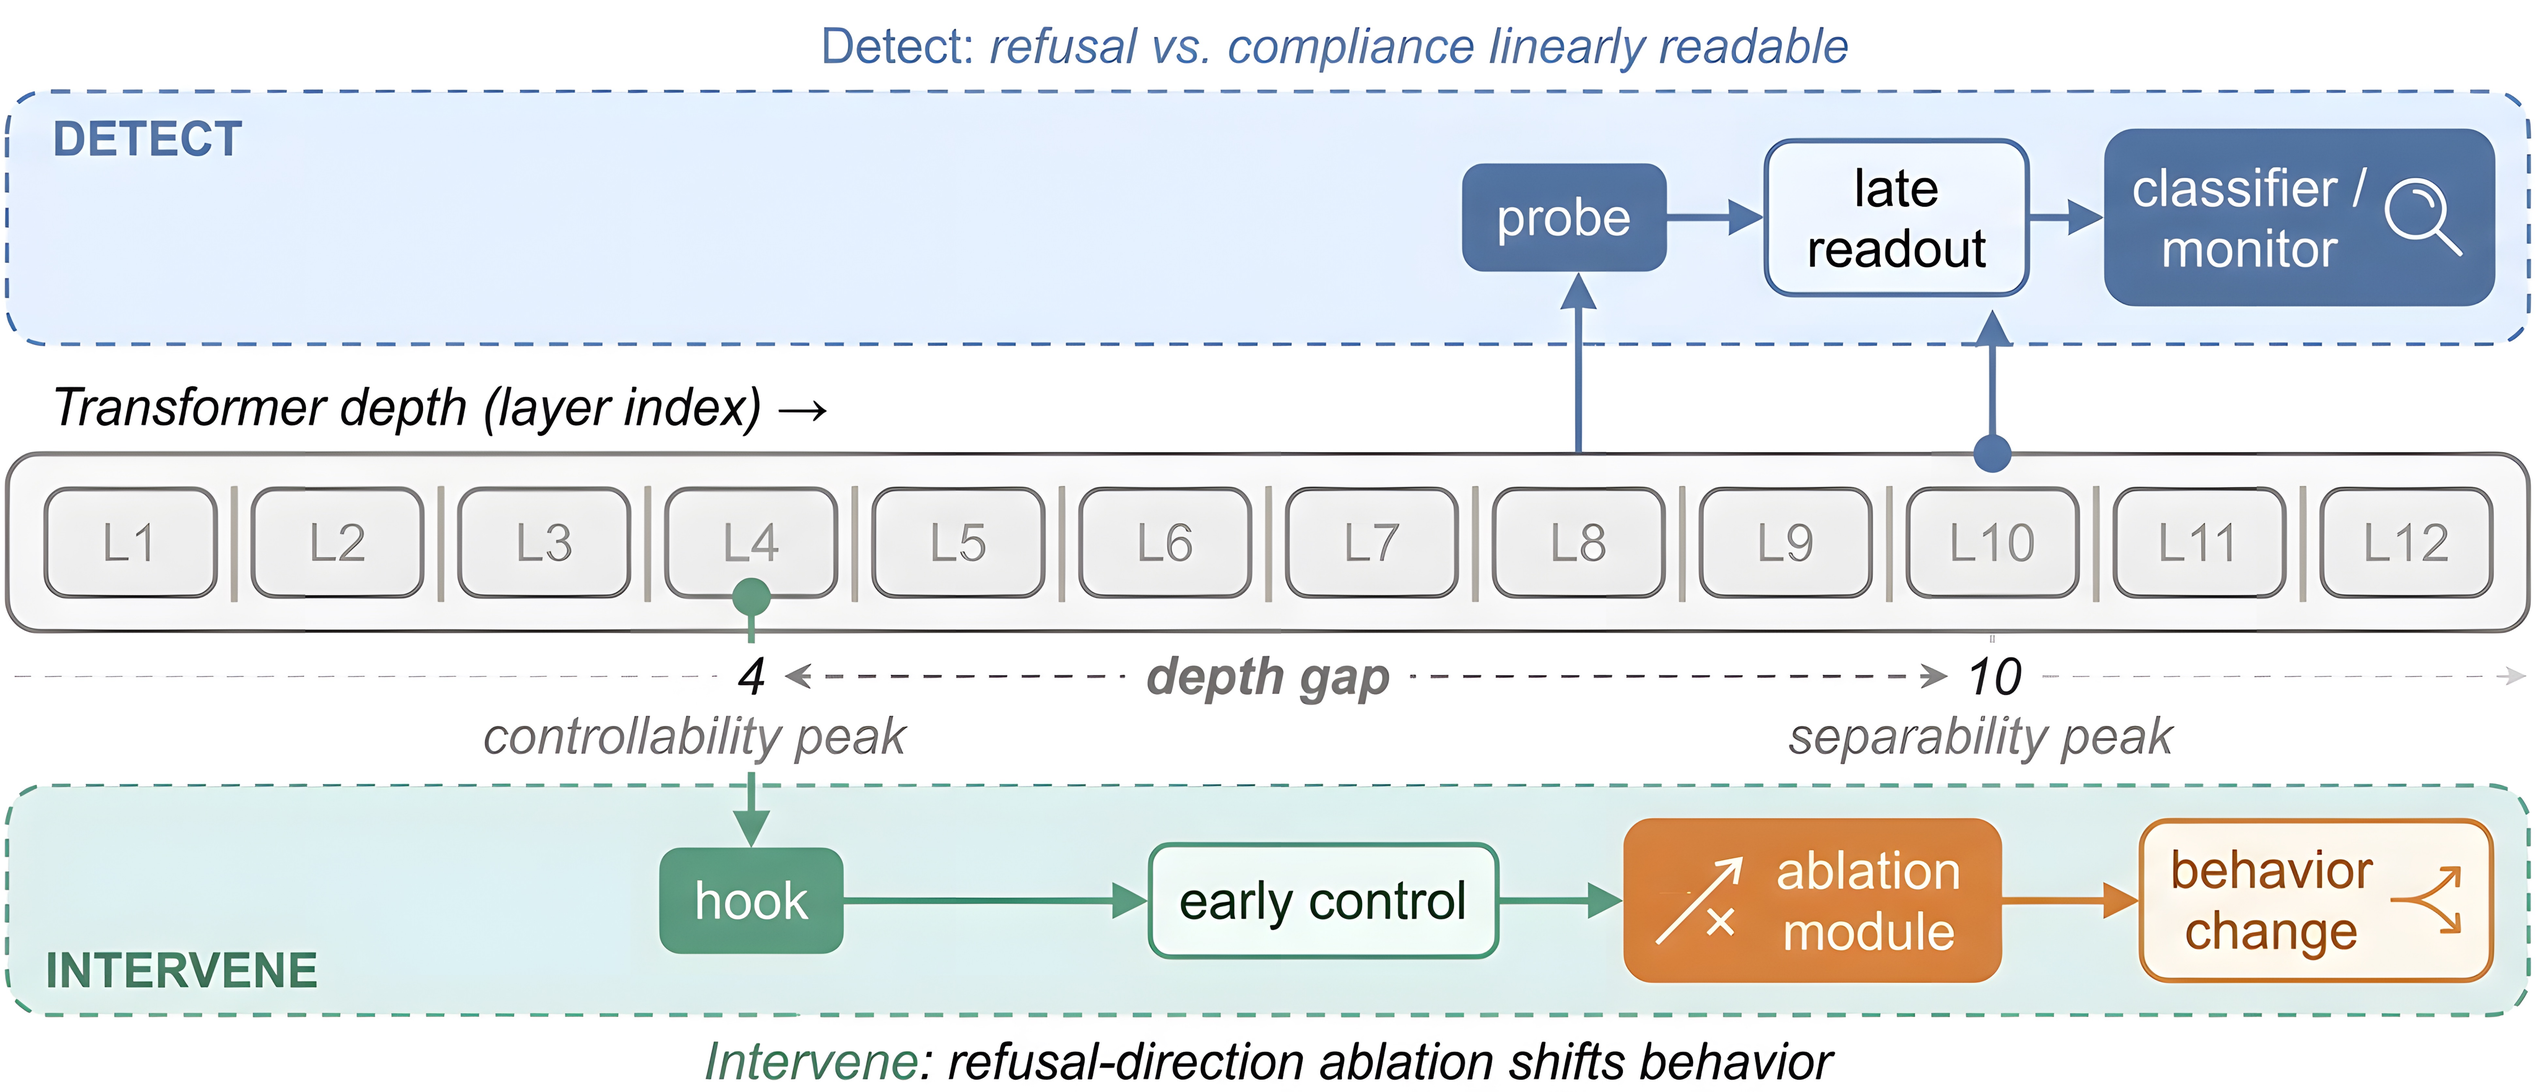
Detect: refusal vs. compliance linearly readable
DETECT
probe
late readout
classifier / monitor
Transformer depth (layer index) →
L1
L2
L3
L4
L5
L6
L7
L8
L9
L10
L11
L12
4
depth gap
10
controllability peak
separability peak
hook
early control
ablation module
behavior change
INTERVENE
Intervene: refusal-direction ablation shifts behavior