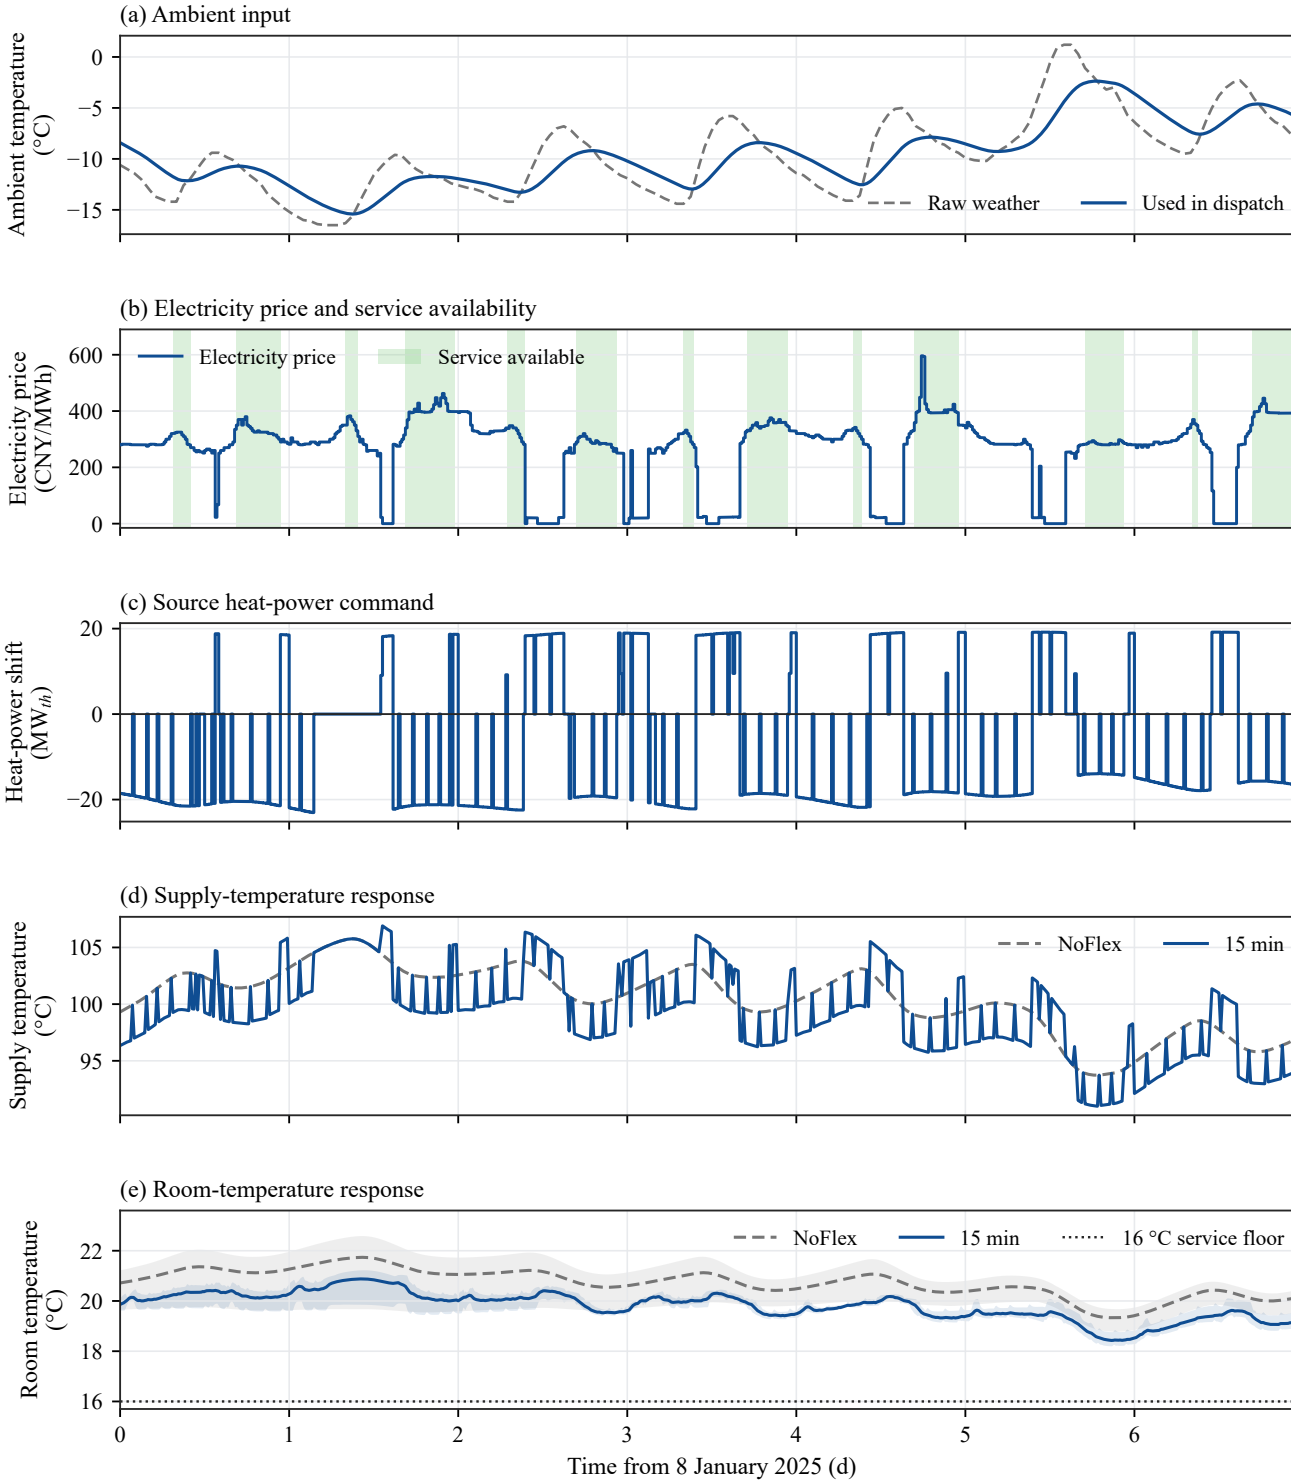

(a) Ambient input
Ambient temperature (°C)
0
−5
−10
−15
Raw weather
Used in dispatch
(b) Electricity price and service availability
Electricity price (CNY/MWh)
600
400
200
0
Electricity price
Service available
(c) Source heat-power command
Heat-power shift (MW_{th})
20
0
−20
(d) Supply-temperature response
Supply temperature (°C)
105
100
95
NoFlex
15 min
(e) Room-temperature response
Room temperature (°C)
22
20
18
16
NoFlex
15 min
16 °C service floor
0
1
2
3
4
5
6
7
Time from 8 January 2025 (d)