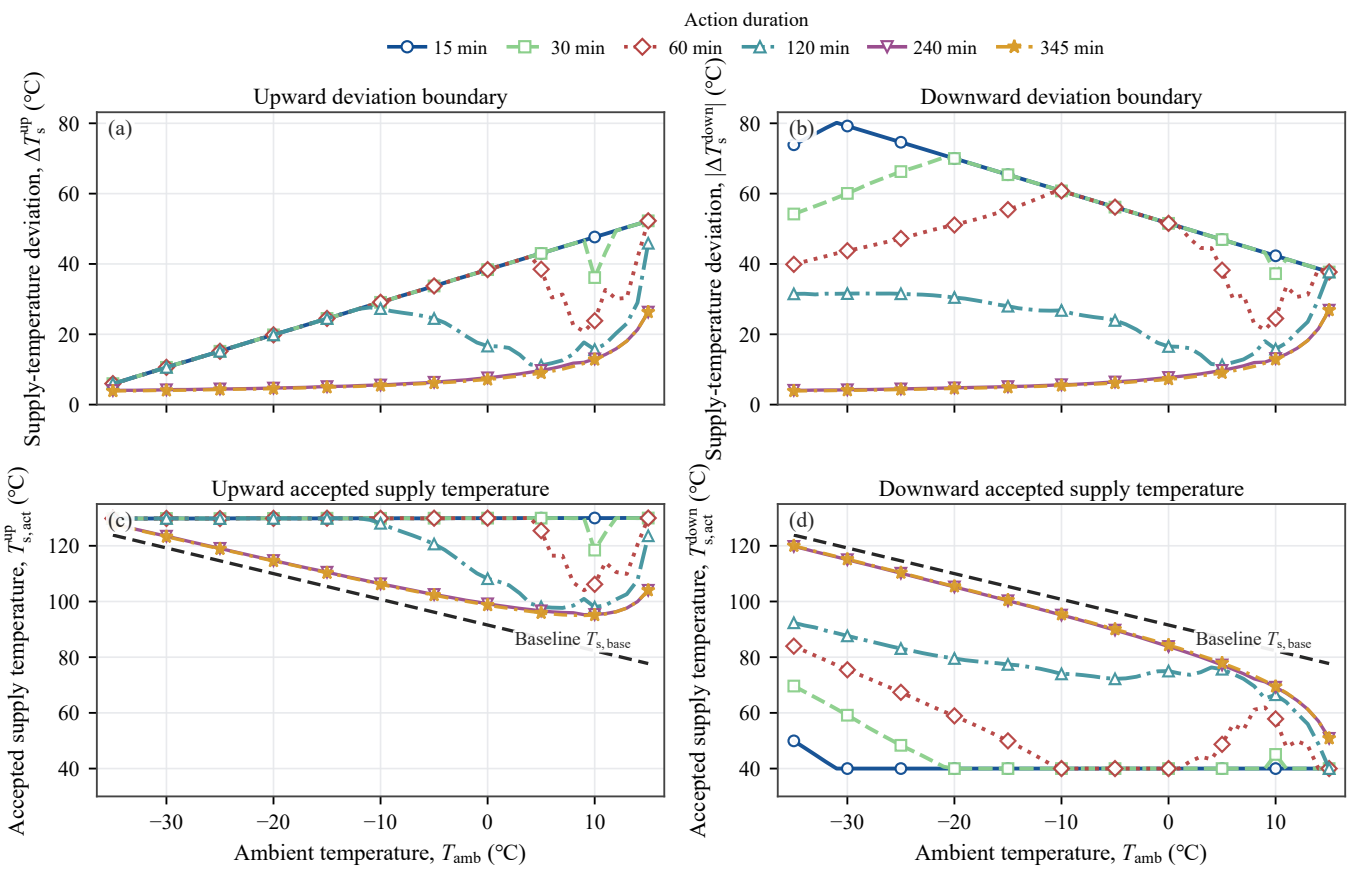

Action duration
15 min
30 min
60 min
120 min
240 min
345 min
Upward deviation boundary
Downward deviation boundary
(a)
(b)
Supply-temperature deviation, $\Delta T_s^{up}$ (°C)
Supply-temperature deviation, $|\Delta T_s^{down}|$ (°C)
Upward accepted supply temperature
Downward accepted supply temperature
(c)
(d)
Baseline $T_{s,base}$
Accepted supply temperature, $T_{s,act}^{up}$ (°C)
Accepted supply temperature, $T_{s,act}^{down}$ (°C)
Ambient temperature, $T_{amb}$ (°C)
Ambient temperature, $T_{amb}$ (°C)