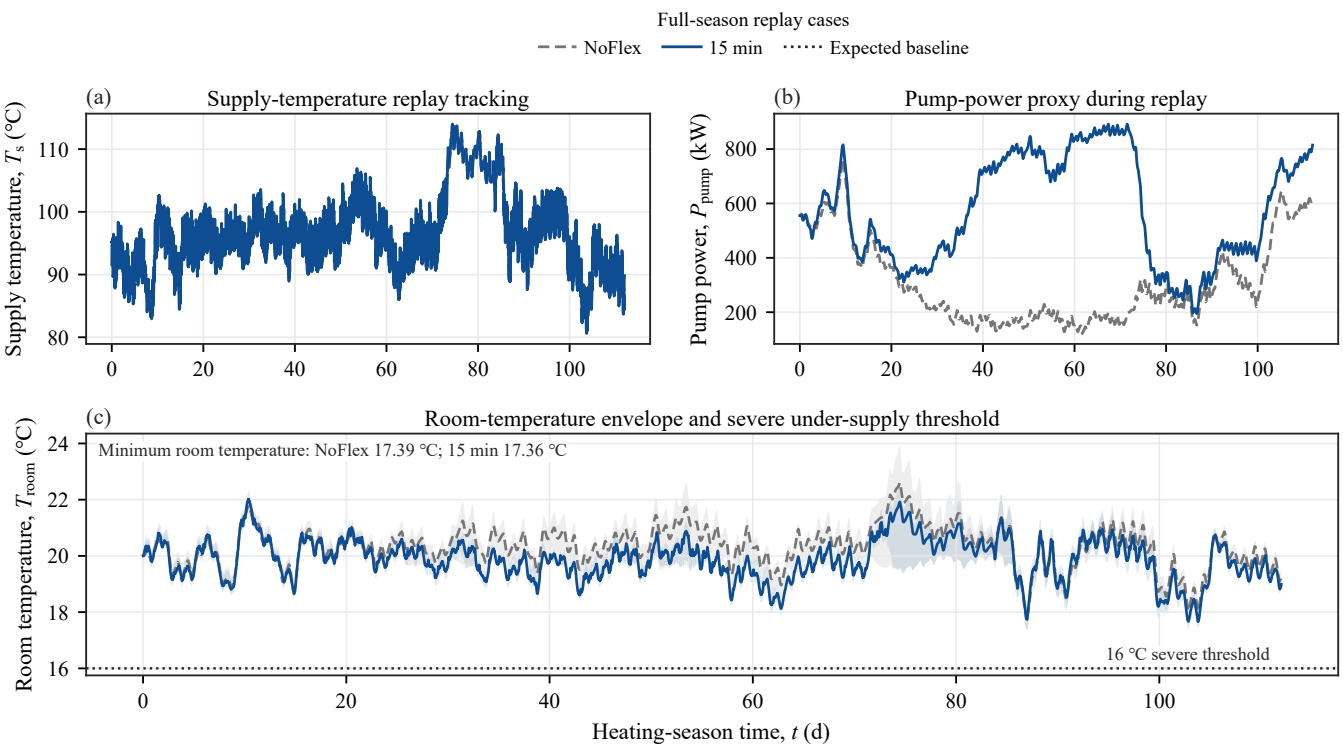

Full-season replay cases
NoFlex
15 min
Expected baseline
(a)
Supply-temperature replay tracking
Supply temperature, T_s (°C)
110
100
90
80
0
20
40
60
80
100
(b)
Pump-power proxy during replay
Pump power, P_{pump} (kW)
800
600
400
200
0
20
40
60
80
100
(c)
Room-temperature envelope and severe under-supply threshold
Minimum room temperature: NoFlex 17.39 °C; 15 min 17.36 °C
Room temperature, T_{room} (°C)
24
22
20
18
16
16 °C severe threshold
0
20
40
60
80
100
Heating-season time, t (d)