



F-DD-04



1410

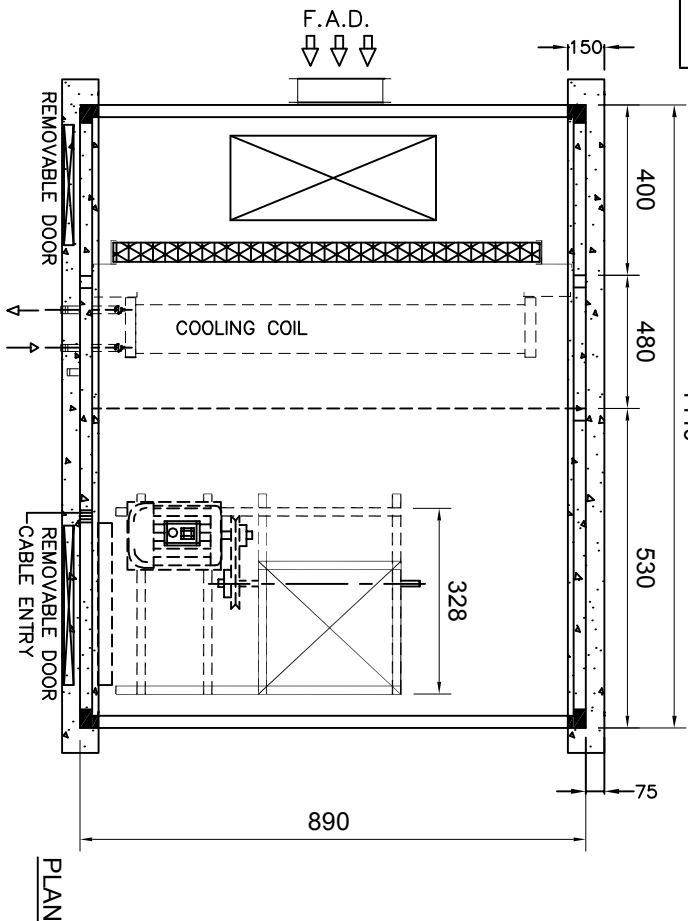

SECTION  
FILTER GRID DETAIL



CONDENSATE DRAIN TRAP BY CUSTOMER

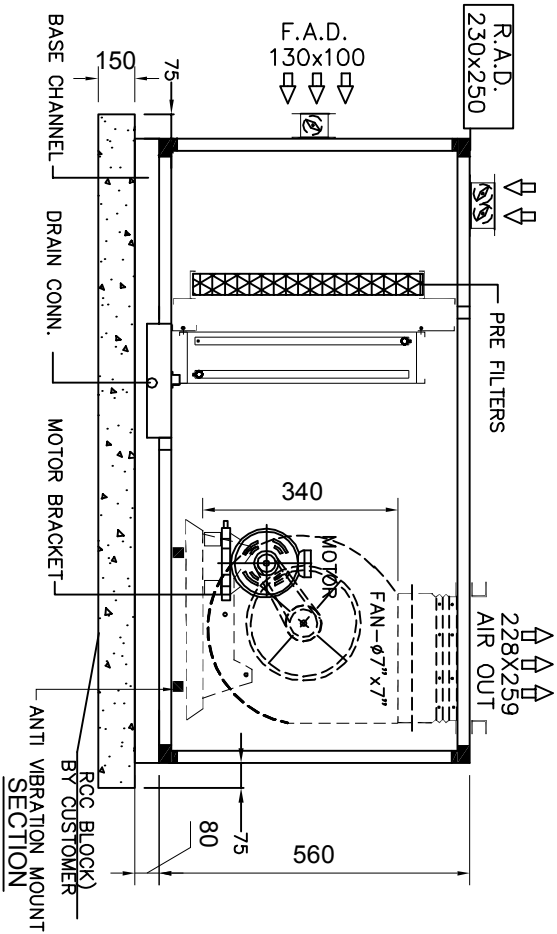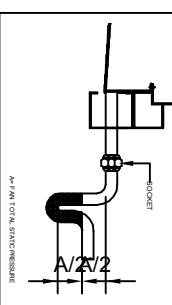

KINDLY TICK THE FOLLOWING WHILE APPROVING THE DRAWING (FACING FROM FILTER SIDE)

1) MOTOR LOCATION ☐ RHS ☐ LHS

2) COIL CONNECTION ☐ RHS ☐ LHS

3) FAN DISCHARGE ☐ TOP ☐ BOTTOM

PLEASE NOTE:  
UNIT SUPPLIED IN ASSEMBLED CONDITION DULY FACTORY RUN TESTED.  
NOTE: ALL DIMENSIONS ARE IN MILLIMETERS. ALL DIMENSIONS SHALL BE OPERATED EXCEPTED. CONTACT CUSTOMER IF DIMENSIONS IN EXCEPTED.

UNIT DISPATCH CONDITION ☒ ASSEMBLED ☐ SEMI KNOCK DOWN

UNIT QTY. -2 NOS.		DATE		REV. BY	
REV.	DESCRIPTION	DATE	REV.	BY	
<b>ZECO AIRCON LIMITED</b> #01 - 05 OLD INDUSTRIAL AREA, BAHADURGARH PIN # 01276-244650, 244651, 244652, 244653 FAX # 01276-244666 EMAIL # design@zecoaircon.com					
CONSULTANT:-		DRN. BY	SHIKHA		
CLIENT:-		CHKD. BY	SUMIT		
M/S PAVANI ENGINEERS		APPD. BY			
TITLE:-		DATE	29.12.14		
(1100 CFM)		SCALE	N.T.S.		
DRAWING NO. ZAL-141391-01		PROJECT	IIT HYDERABAD		