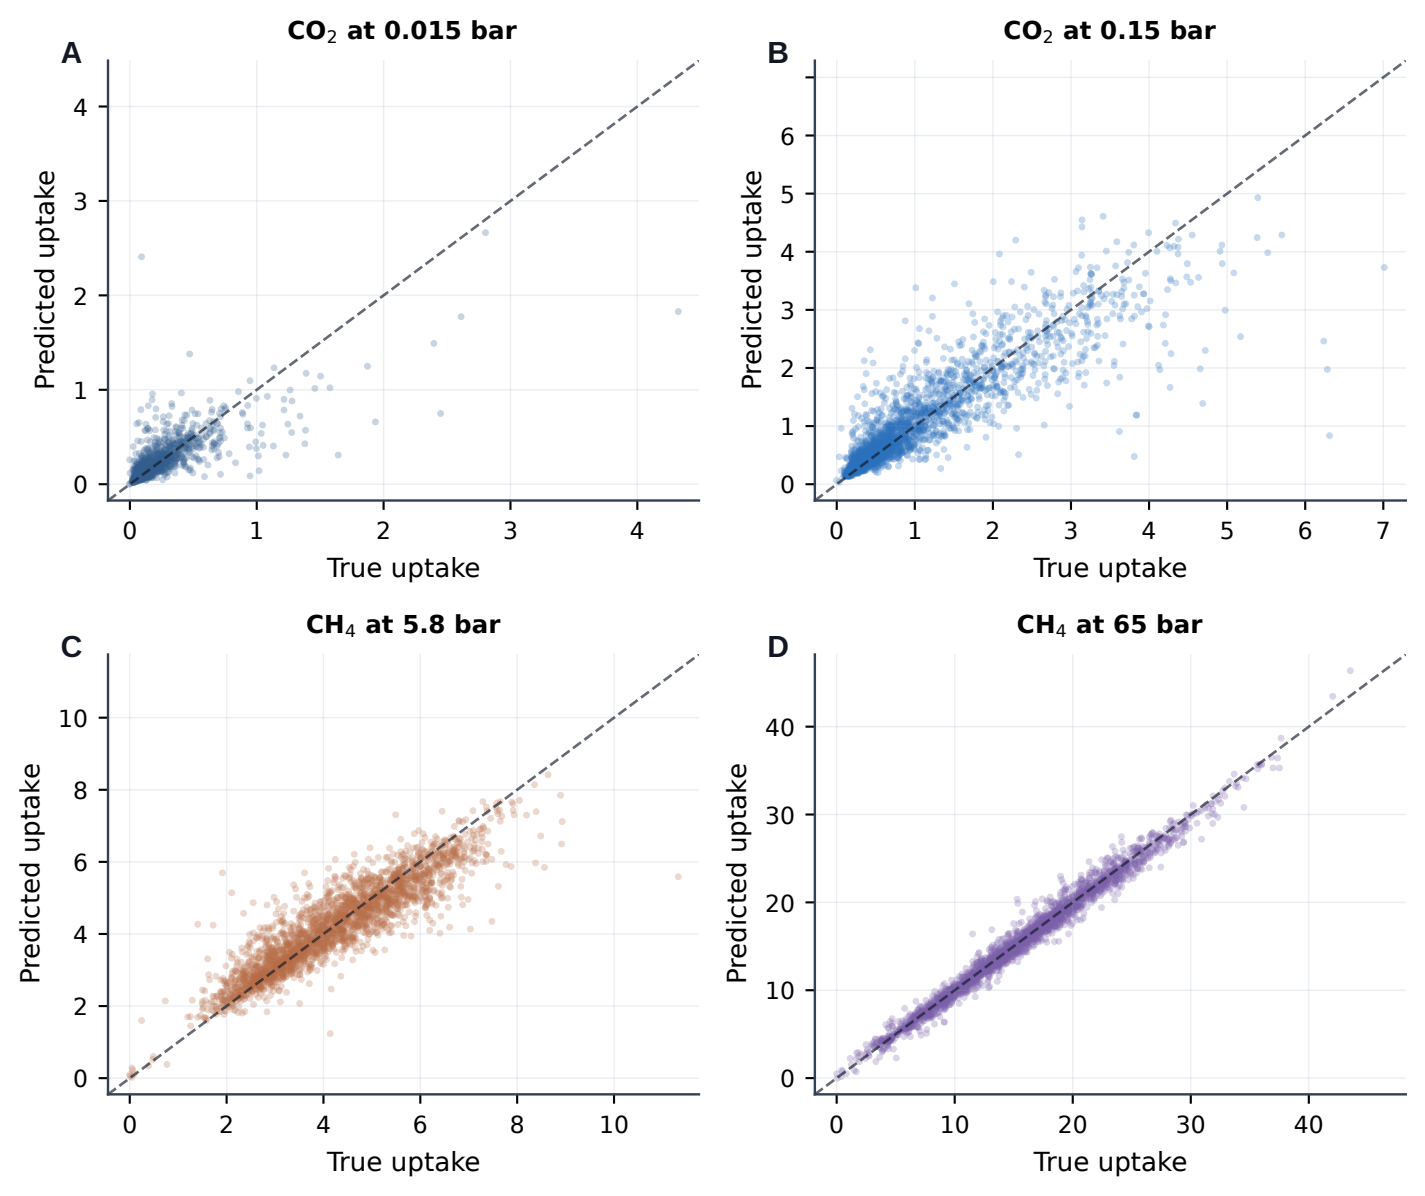

A
CO_2 at 0.015 bar
Predicted uptake
True uptake
B
CO_2 at 0.15 bar
Predicted uptake
True uptake
C
CH_4 at 5.8 bar
Predicted uptake
True uptake
D
CH_4 at 65 bar
Predicted uptake
True uptake