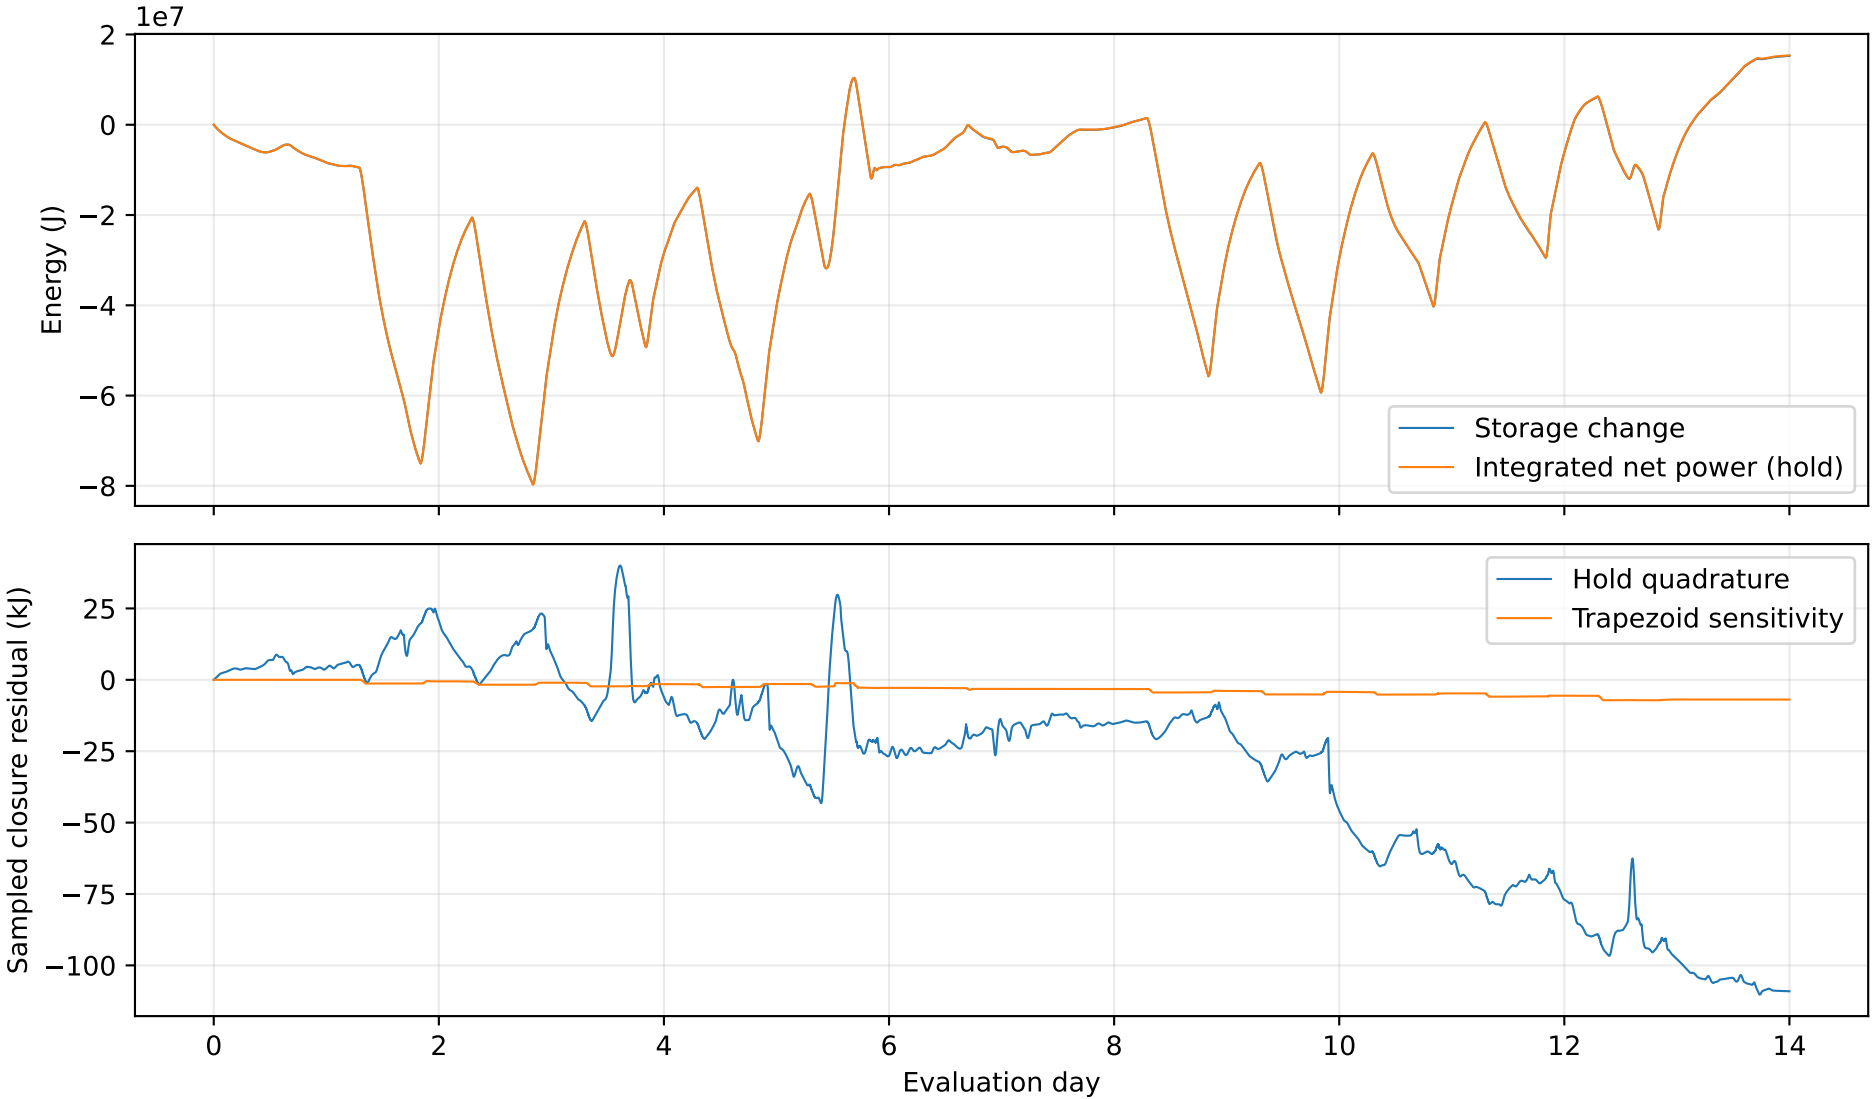
1e7
2
0
−2
−4
−6
−8
Energy (J)
Storage change
Integrated net power (hold)
25
0
−25
−50
−75
−100
Sampled closure residual (kJ)
Hold quadrature
Trapezoid sensitivity
0
2
4
6
8
10
12
14
Evaluation day