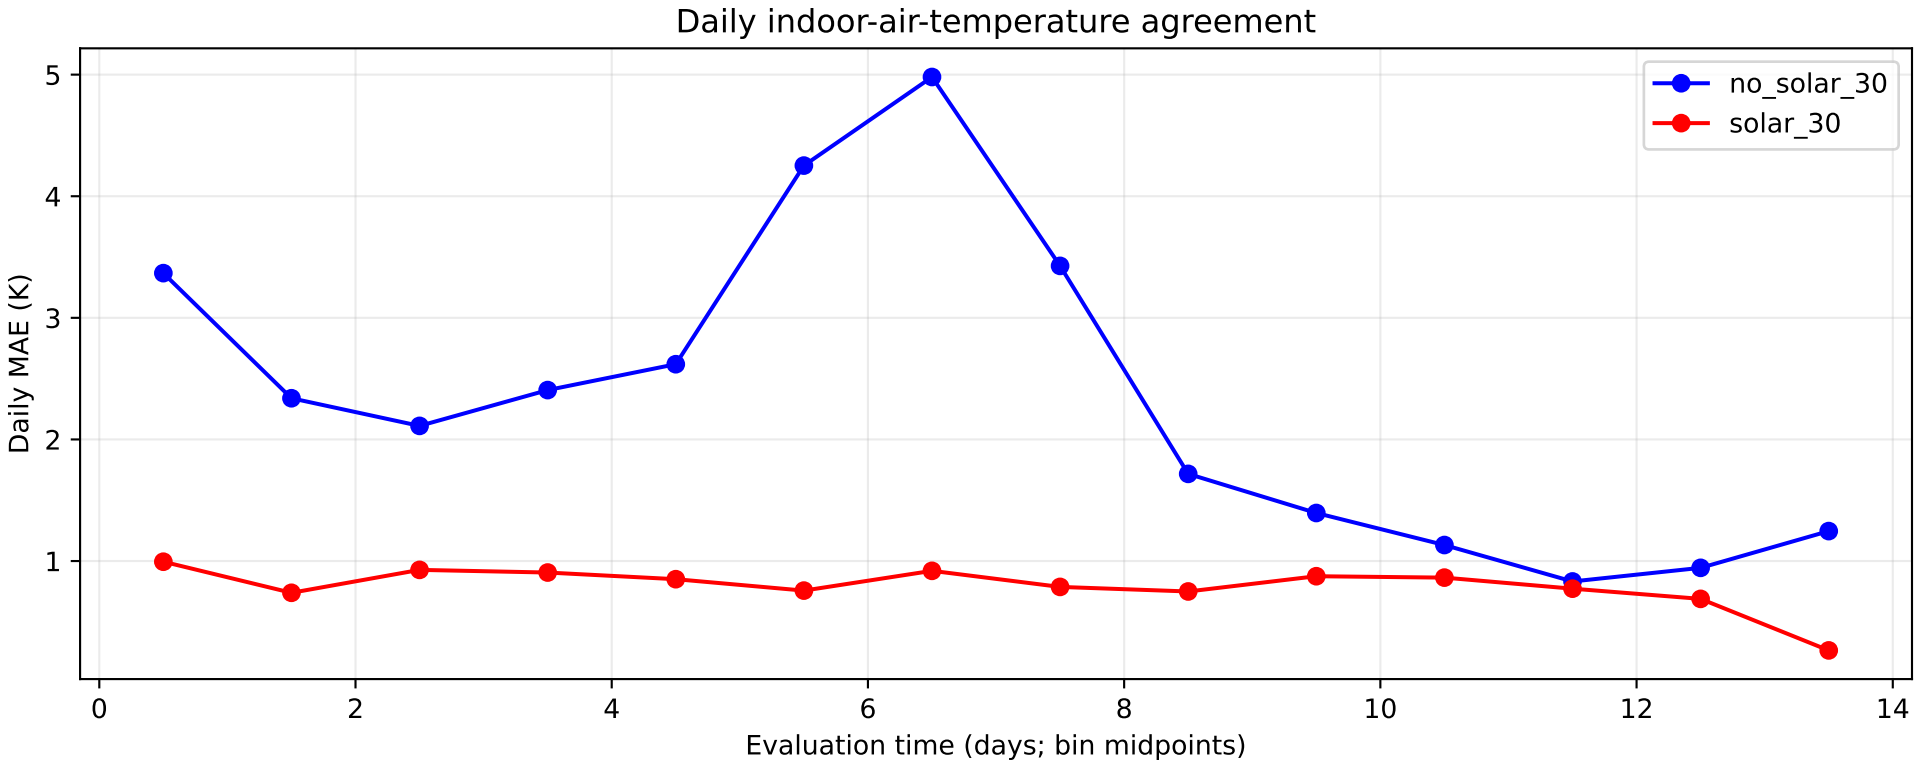
Daily indoor-air-temperature agreement
Daily MAE (K)
Evaluation time (days; bin midpoints)
no_solar_30
solar_30
0
2
4
6
8
10
12
14
1
2
3
4
5