





- LEGEND**
- A-A** Section — refer PDC-DWG-008
B-B Section — refer PDC-DWG-009
- White space
▨ Electrical / mechanical support

- NOTES**
1. All four data halls are identical. Refer PDC-DWG-003 for the typical enlarged hall plan.
2. Each hall is a separate fire compartment, minimum EI 120.
3. Halls are separated by one clear structural bay (18 m) so that Sections 2-4 can be built without entering an operating hall.
4. Shared MEP spine and mezzanine over is sized for the full 10 MW and is completed in Section 1.
5. Clear internal height in white space 4.2 m minimum under the lowest service.

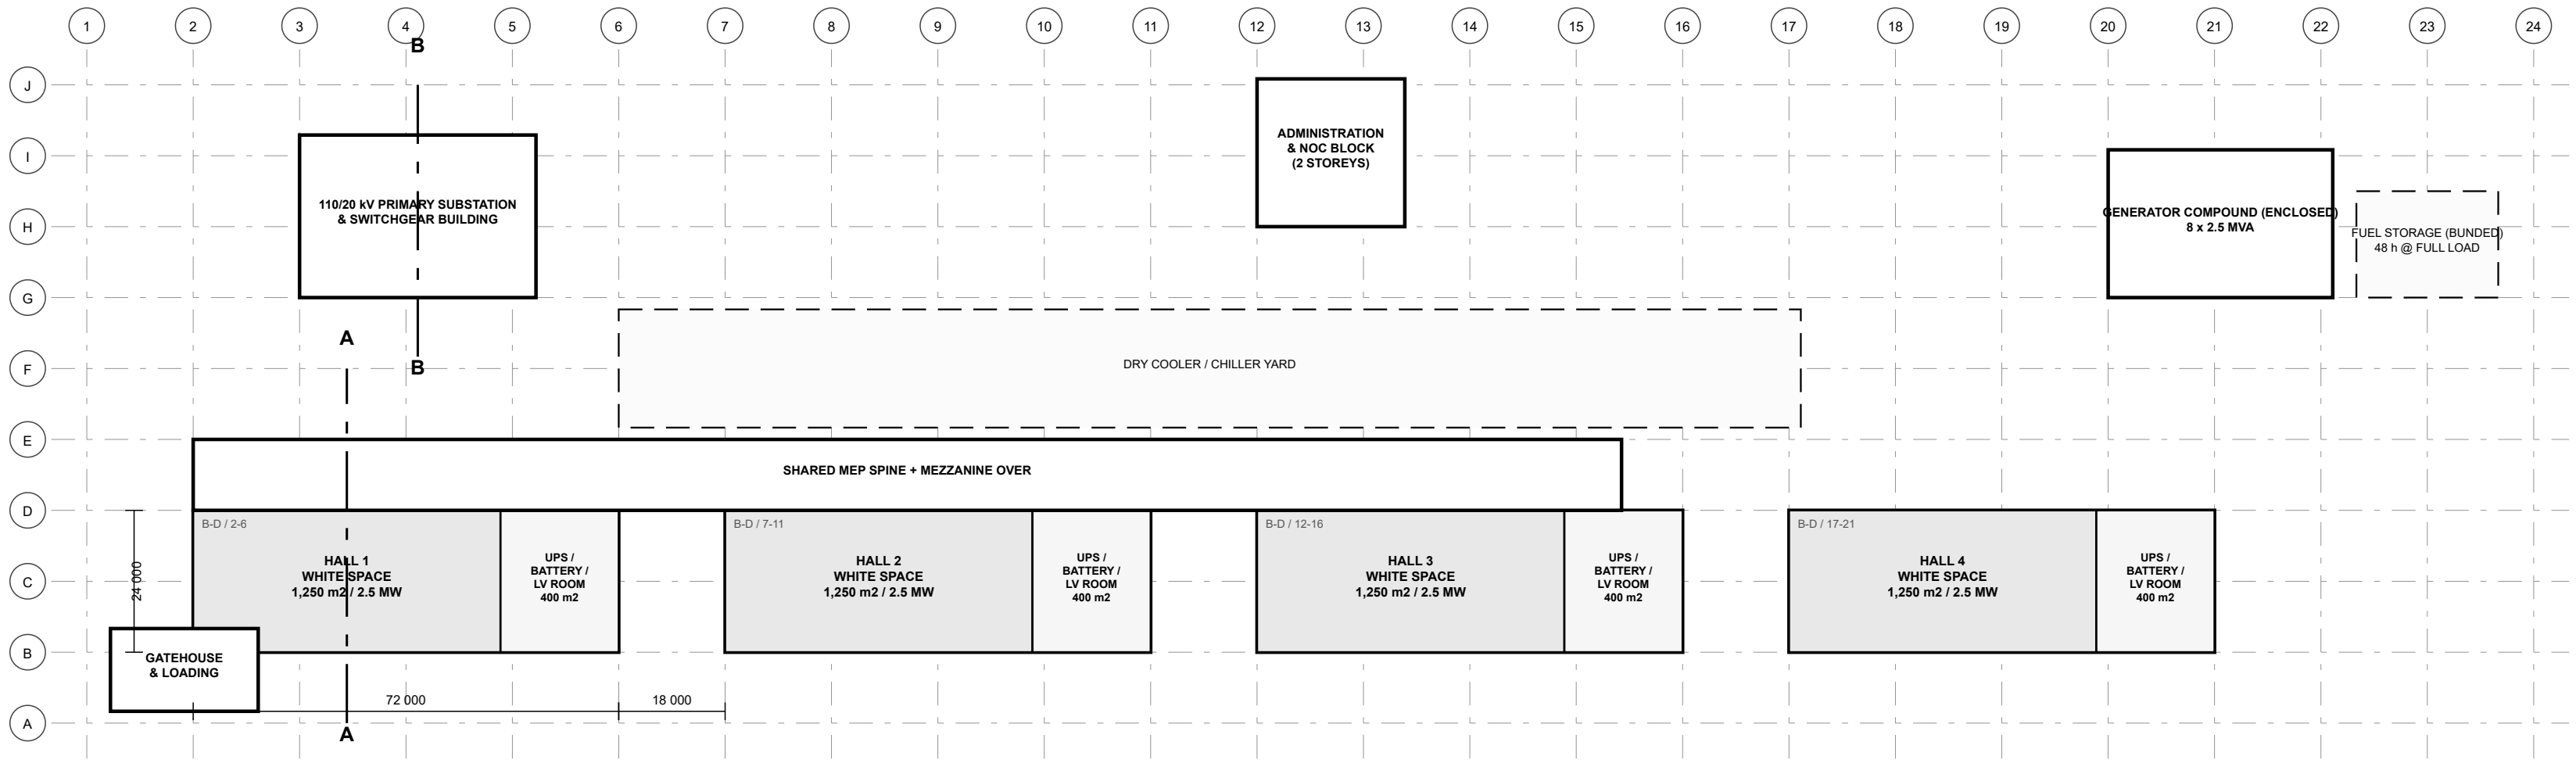

PROJECT
POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE...

EMPLOYER
POLARIS DIGITAL INFRASTRUCTURE OY

CONTRACTOR
NORDBUILD OY

DRAWING
GENERAL ARRANGEMENT — GROUND FLOOR PLAN

DISCIPLINE
ARCHITECTURAL

DWG No PDC-DWG-002 SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT	REV A	DATE 24.02.2026	SCALE 1:1000
--	-----------------	---------------------------	------------------------