





- LEGEND**
- Rack row (Tenant supplied)
 - C CRAH unit
 - U UPS module
 - B Battery string
 - = Overhead busway

- NOTES**
1. Typical for Data Halls 1 to 4. White space 1,250 m². IT load 2.5 MW, design density 8 kW average / 15 kW peak per rack.
 2. Overhead containment and busway. No raised floor.
 3. Cold-aisle containment. Supply air 24 °C +/- 1.5 K at rack inlet.
 4. 7 CRAH units per hall (N+1: 6 duty + 1 standby).
 5. 4 x 1000 kVA UPS modules per hall (N+1), with separate battery room.
 6. Racks and containment doors are supplied by the Tenant. Containment framework and blanking are by the Contractor.
 7. Aspiring smoke detection throughout white space. Suppression subject to fire engineering approval — refer PDC-DWG-015.

TYPICAL HALL DATA	
IT LOAD	2.5 MW
WHITE SPACE	1,250 m ²
GROSS FOOTPRINT	1,728 m ² (72 x 24 m)
NET FUNCTIONAL AREA	1,650 m ²
RACK DENSITY	8 kW AVERAGE / 15 kW PEAK
CLEAR HEIGHT	4.2 m MIN. UNDER LOWEST SERVICE
SUPPLY AIR	24 °C +/- 1.5 K AT RACK INLET
CRAH UNITS	7 No. (N+1)
UPS	4 x 1000 kVA (N+1)
COMPARTMENTATION	EI 120 TO ADJACENT HALLS

WHITE SPACE — 1,250 m²

SUPPORT — 400 m²

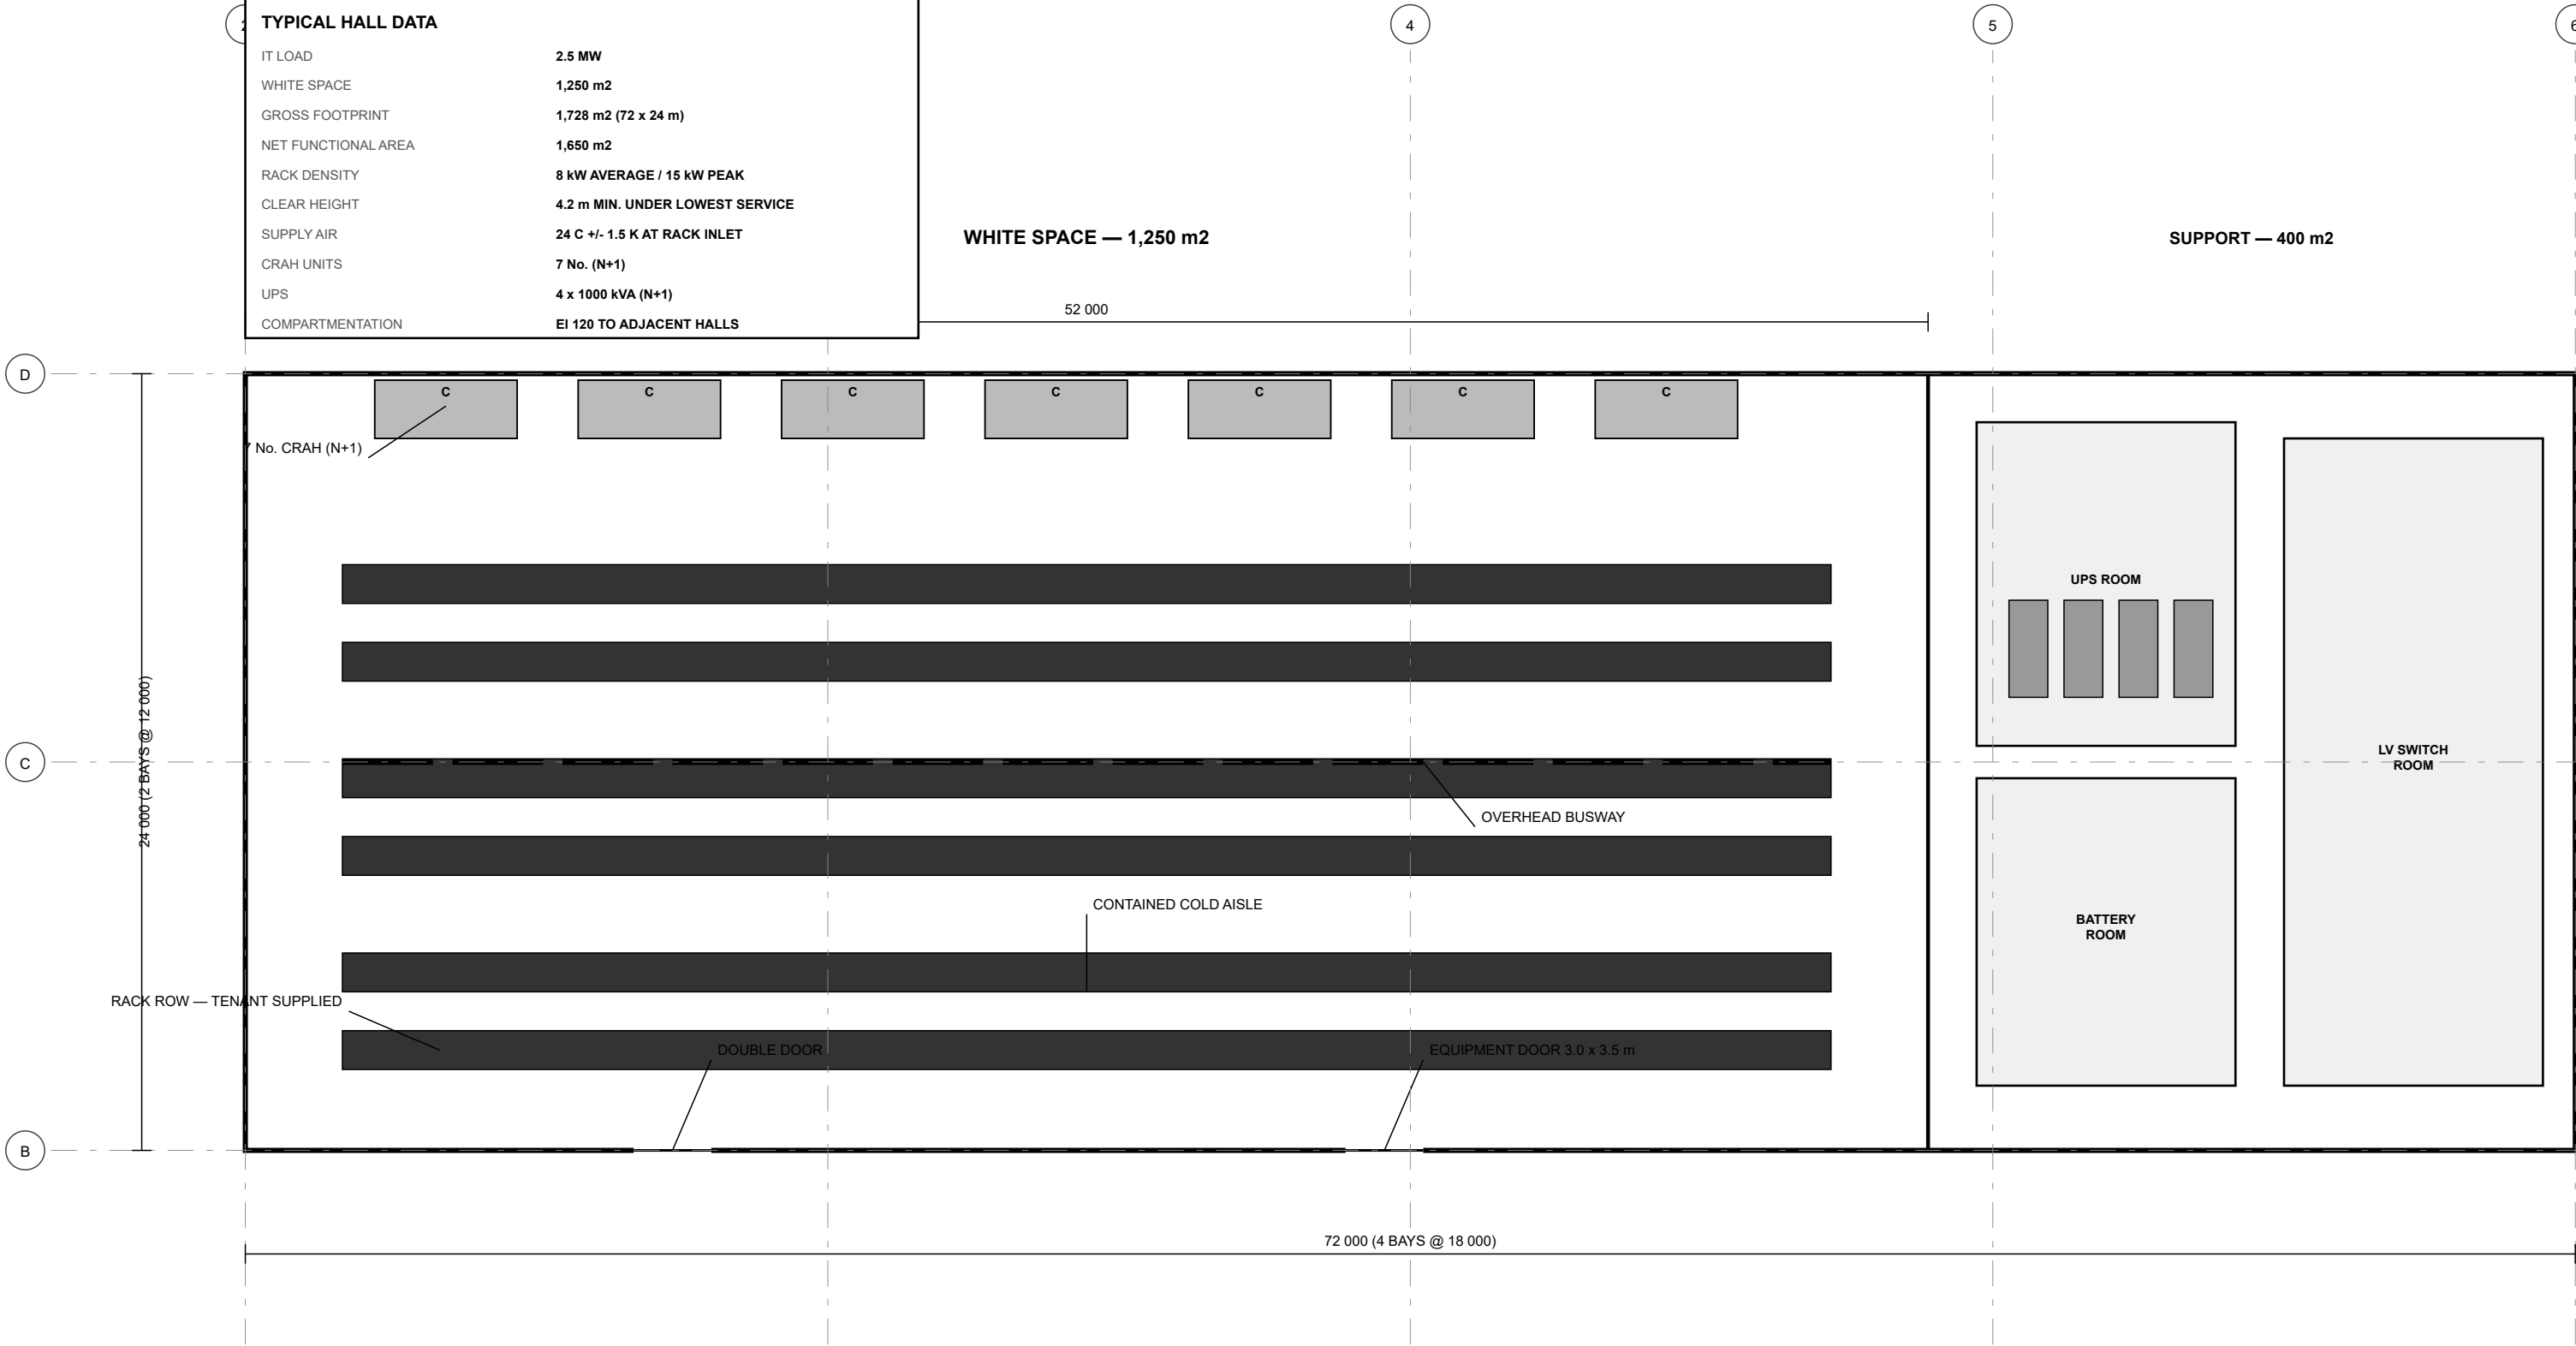

PROJECT POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE...			
EMPLOYER POLARIS DIGITAL INFRASTRUCTURE OY			
CONTRACTOR NORDBUILD OY			
DRAWING TYPICAL DATA HALL — ENLARGED PLAN			
DESCRIPTION ARCHITECTURAL			
DWG No PDC-DWG-003 SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT	REV A	DATE 24.02.2026	SCALE 1:200