




- LEGEND**
- Ground-bearing slab
 - Foundation on glacial till
 - Overhead containment / busway
 - CRAH unit
 - Level marker

- NOTES**
- Section cut A-A is located on PDC-DWG-002, running north-south through Data Hall 1 (2 bays @ 12 m = 24 m deep) and the shared MEP spine (12 m deep).
 - Ground-bearing slab designed for 25 kN/m², on foundations bearing on glacial till — refer geotechnical report; founding depth assumed, confirm on site.
 - Warm roof build-up, U = 0.09 W/m²K, on the data hall and MEP spine alike.
 - Clear height 4.2 m minimum under the lowest service (overhead containment/busway) throughout white space.
 - 7 No. CRAH units per hall (N+1, 6 duty + 1 standby); 2 shown diagrammatically at the hall/spine interface.
 - No raised floor — all IT power and data distribution is via overhead containment and busway.

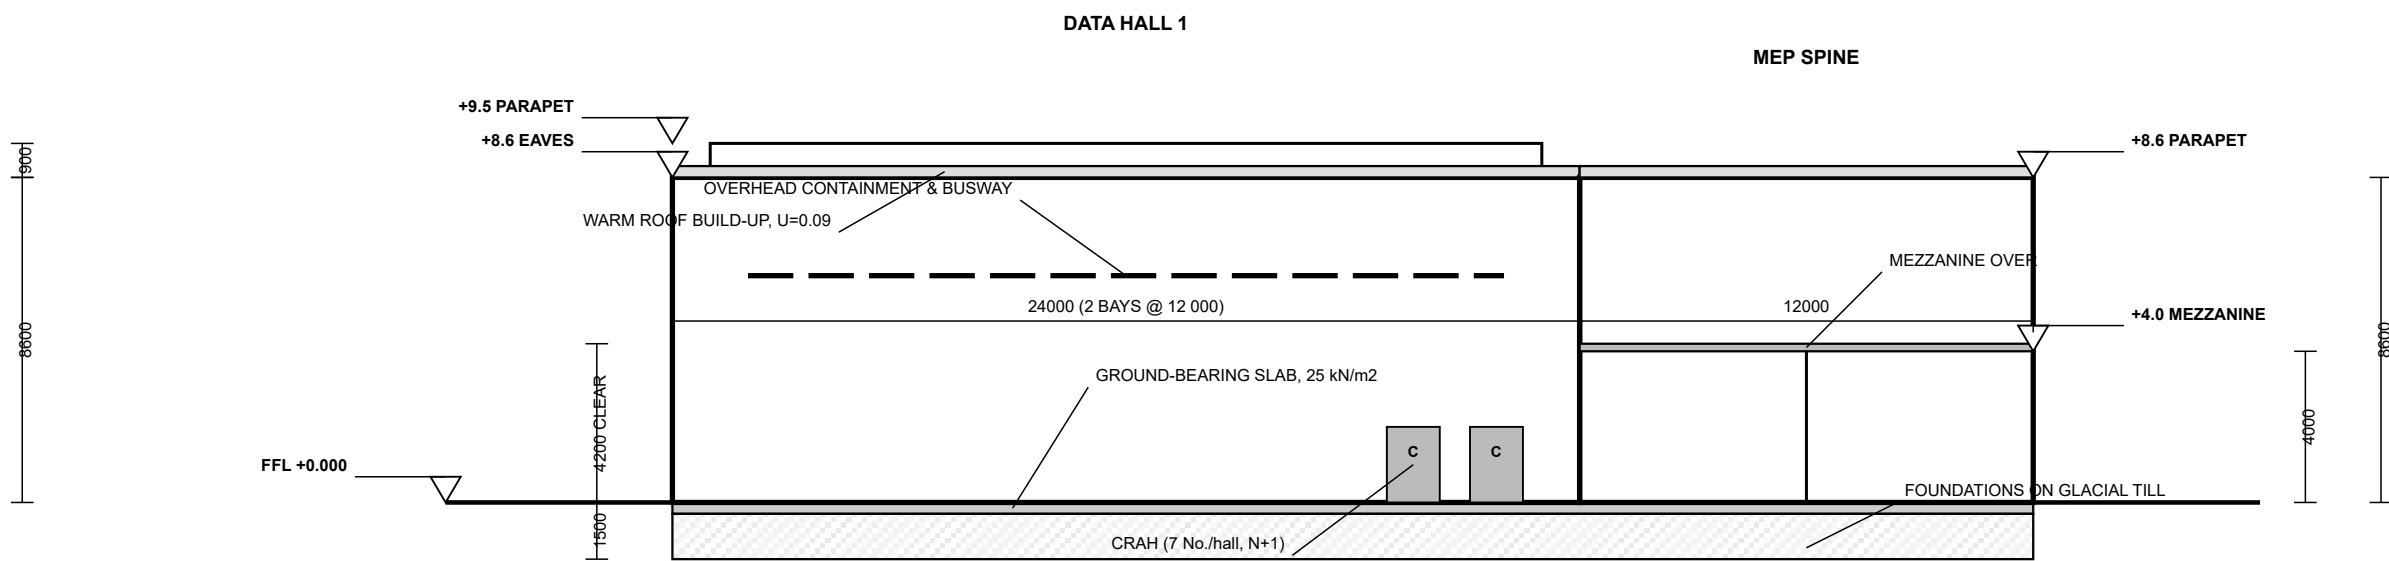

PROJECT
POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE...

EMPLOYER
POLARIS DIGITAL INFRASTRUCTURE OY

CONTRACTOR
NORDBUILD OY

DRAWING
SECTION A-A — THROUGH DATA HALL & MEP SPINE

DISCIPLINE
ARCHITECTURAL

DWG No	REV	DATE	SCALE
PDC-DWG-008	A	24.02.2026	1:200
SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT			