





- LEGEND**
- Transformer (110/20 KV)
 - Blastfire separation wall, EI 240
 - Oil containment bund
 - Cable basement / trench
 - Level marker

- NOTES**
- Section cut B-B is located on PDC-DWG-002, running north-south through the 110/20 KV Substation building.
 - 2 No. 110/20 KV transformers (dual, N+1), each rated for the full 16 MVA site connection.
 - Reinforced concrete blastfire separation wall between transformer bays, EI 240, with independent oil containment bunding to each bay.
 - Cable basement beneath the 20 KV switchgear room; shallower cable trench beneath the transformer bays, both connecting to the site duct bank.
 - 20 KV switchgear room is naturally ventilated at high level; no external louvers to the blast-wall faces.

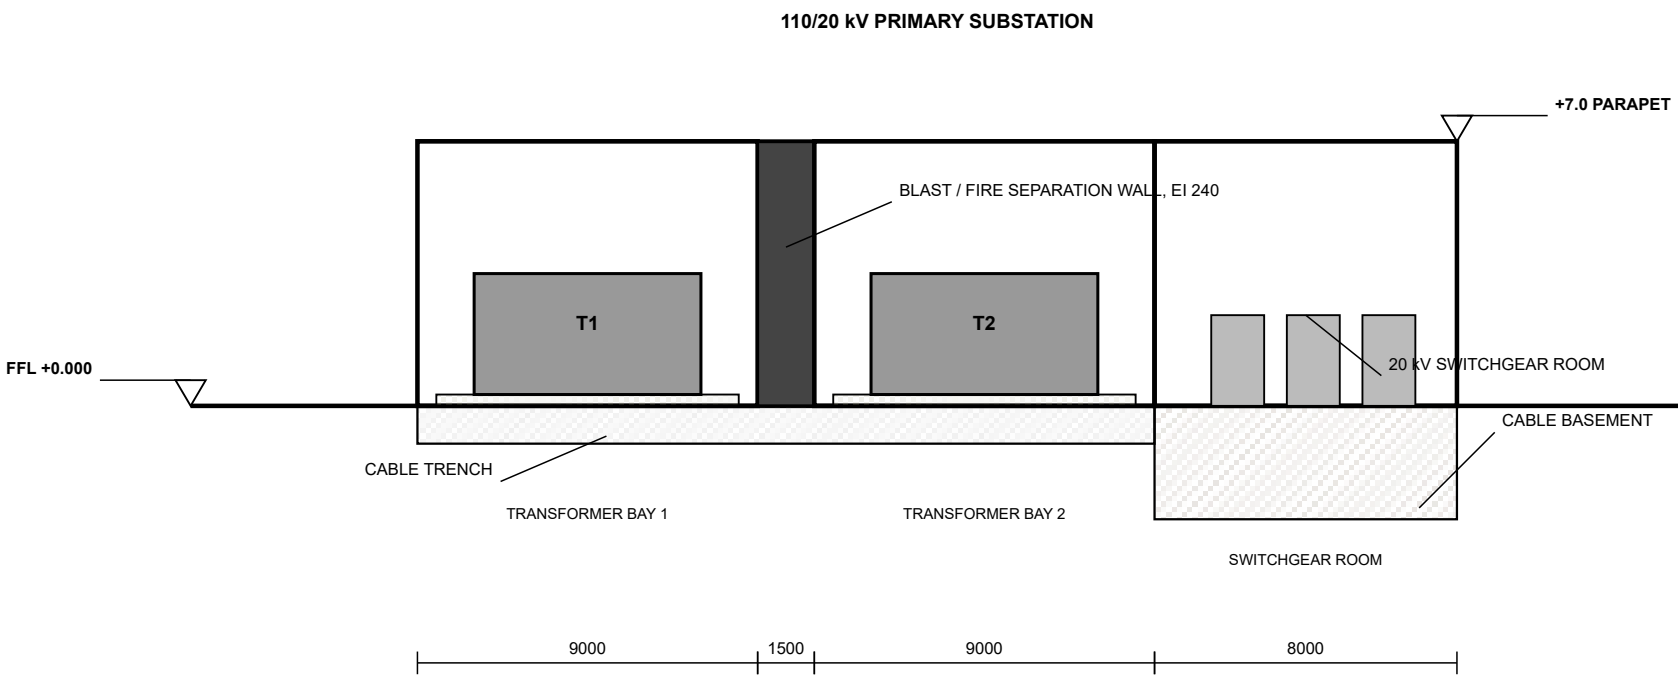

PROJECT POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE...			
EMPLOYER POLARIS DIGITAL INFRASTRUCTURE OY			
CONTRACTOR NORDBUILD OY			
DRAWING SECTION B-B — THROUGH PRIMARY SUBSTATION			
DISCIPLINE ARCHITECTURAL			
DWG No PDC-DWG-009 SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT	REV A	DATE 24.02.2026	SCALE 1:200