





- LEGEND**
- ↓ Roof fall direction
 - Rainwater outlet (RWO)
 - ▨ PV array zone
 - ▨ Roof-mounted plant zone
 - Safety access walkway
 - ☒ Smoke ventilation (AOV)
 - - Parapet upstand

- NOTES**
1. Roof imposed load allowance: 0.75 kN/m² uniform for PV panels and mounting rail, plus point loads at rooftop plant curbs, in addition to the Finnish National Annex snow and wind loading — refer PDC-BOD-001 Section 4.3.
 2. Characteristic ground snow load taken as $s_k = 2.5$ kN/m² (Finnish National Annex to EN 1991-1-3, Uusimaa/Vantaa region). Snow drift accumulation at parapets and plant upstands to be checked at S2 detailed design.
 3. Minimum roof fall 1.5% to perimeter rainwater outlets (RWOs). Box gutters and overflow weirs sized to the Finnish design rainfall intensity — refer PDC-SPEC-1 drainage.
 4. Parapet height 0.9 m minimum, to conceal rooftop plant and the PV array from ground-level sightlines.
 5. Automatic opening vents (smoke ventilation) over each half's white space, final count and free area subject to the fire-engineering submission — refer PDC-BOD-001 Section 8.1.
 6. GRP walkways and edge protection provided to all maintained roof areas (PV, plant, RWOs); no PV or plant access without edge protection.

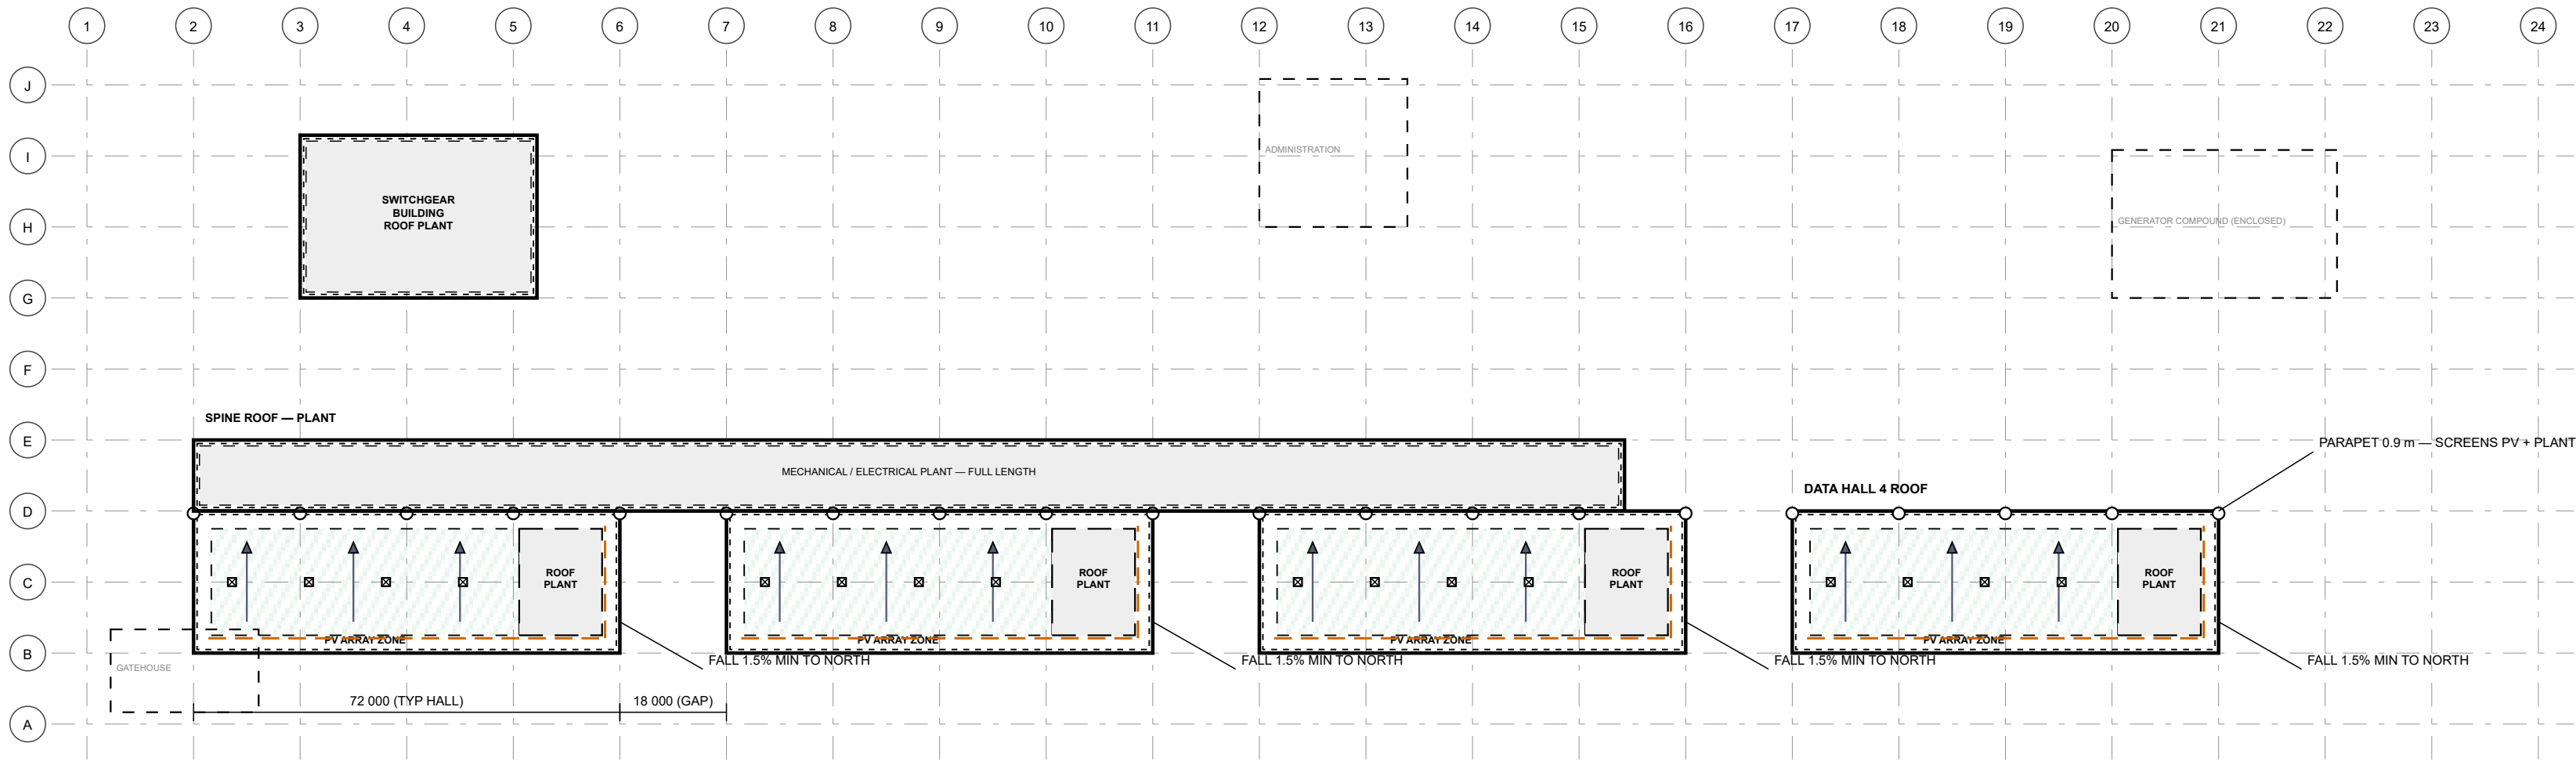

PROJECT POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE... EMPLOYER POLARIS DIGITAL INFRASTRUCTURE OY CONTRACTOR NORDBUILD OY DRAWING ROOF PLAN DISCIPLINE STRUCTURAL/ARCHITECTURAL			
DWG No PDC-DWG-005 SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT	REV A	DATE 24.02.2026	SCALE 1:1000