





- LEGEND**
- Aspirating detection pipe run (white space)
 - A Addressable detection point
 - Suppression zone
 - == Compartment wall, EI 120
 - Escape route to exit
 - Exit door
 - H Fire hydrant / fire-fighting access point

- NOTES**
- Aspirating smoke detection (ASD) throughout white space, addressable point detection elsewhere (ER §5).
 - White-space suppression is inert gas or water mist and **REQUIRES** fire-engineering approval by the authority having jurisdiction — not a standard sprinkler system.
 - Suppression in support/office areas is sprinkler to the National Building Code, with dry riser where required.
 - Compartmentation: each data hall is a separate fire compartment, minimum 2 hours (EI 120), per ER §5.
 - Escape routes and travel distances are demonstrated by the Contractor per Finnish requirements.
 - Fire-fighting access follows the site road along the south boundary; hydrants at approximately 90 m centres.

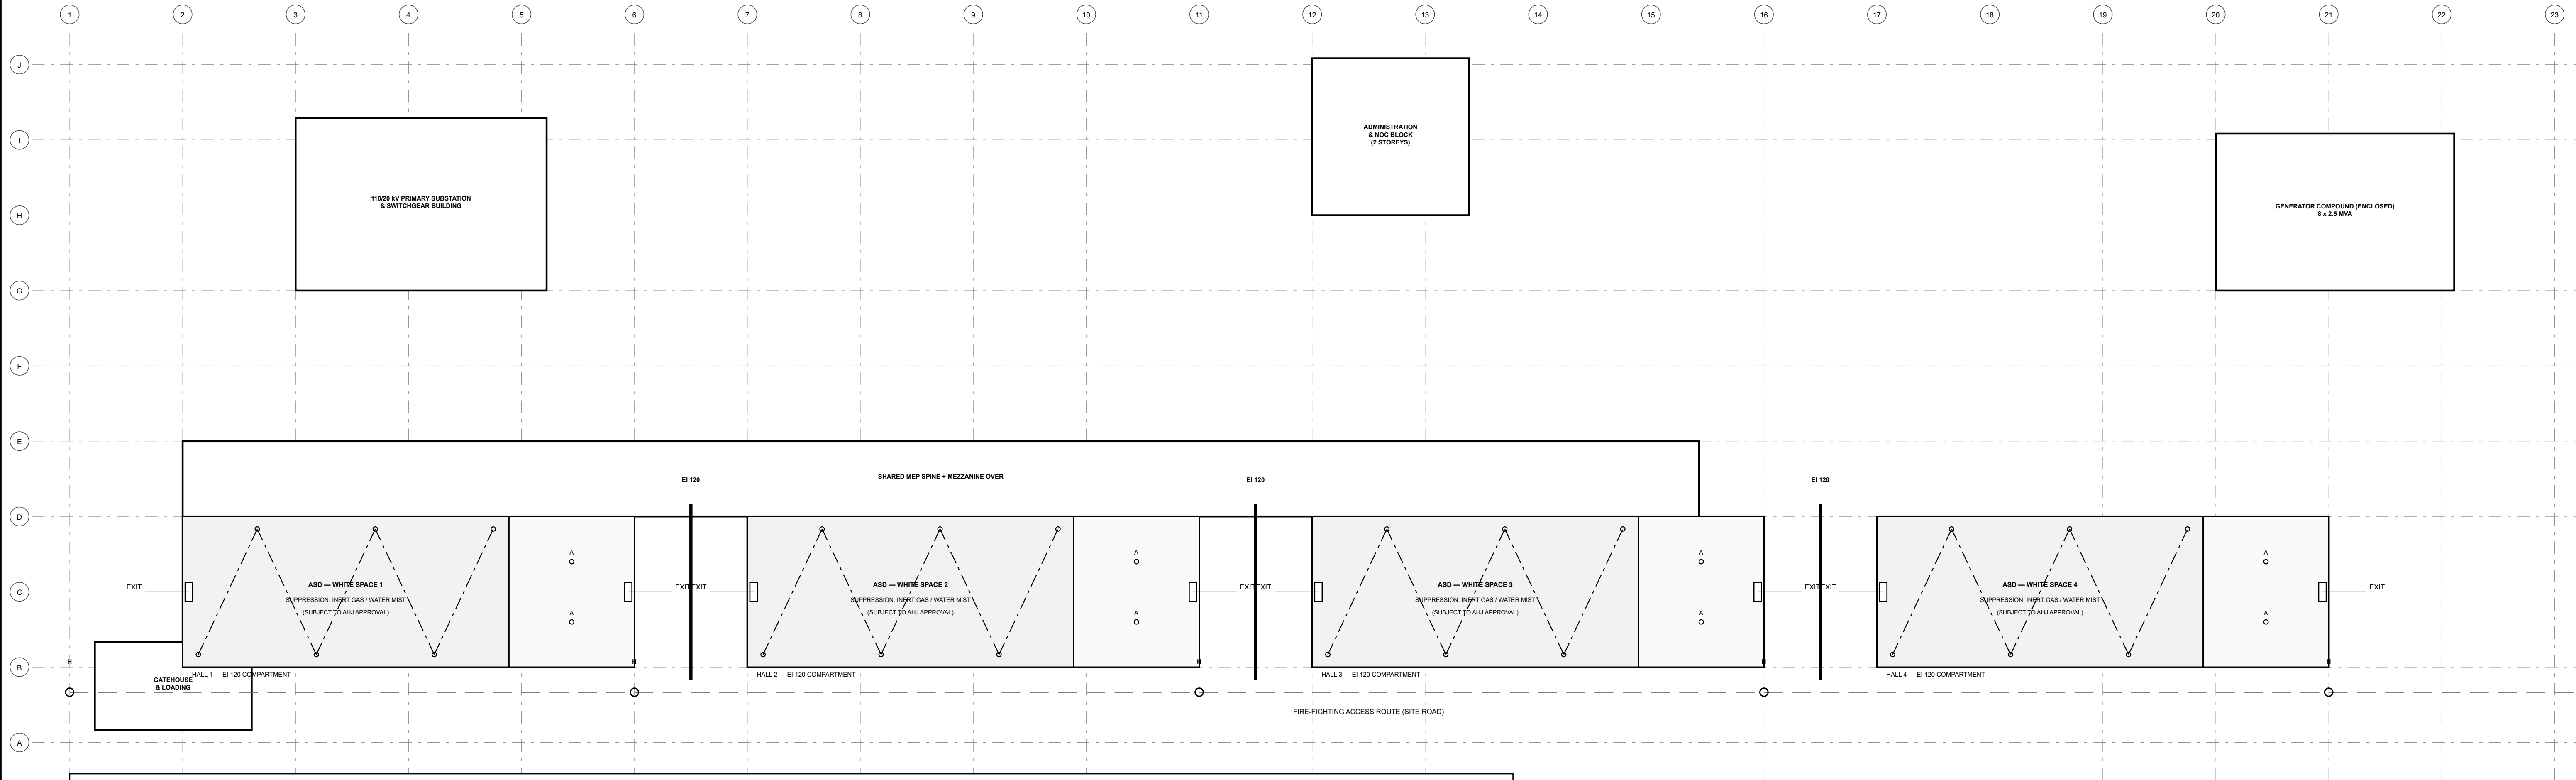

FIRE ZONE SCHEDULE				
ZONE	GFA m ²	DETECTION	SUPPRESSION	COMPART.
DATA HALL 1	1,650	ASD (white space) + addressable (support)	Inert gas / water mist (AHJ approval req'd)	EI 120
DATA HALL 2	1,650	ASD (white space) + addressable (support)	Inert gas / water mist (AHJ approval req'd)	EI 120
DATA HALL 3	1,650	ASD (white space) + addressable (support)	Inert gas / water mist (AHJ approval req'd)	EI 120
DATA HALL 4	1,650	ASD (white space) + addressable (support)	Inert gas / water mist (AHJ approval req'd)	EI 120
SHARED MEP SPINE + MEZZANINE OVER	2,900	Addressable	Sprinkler to NBC	Standard
110/20 kV PRIMARY SUBSTATION	1,100	Addressable	Sprinkler to NBC	Standard
GENERATOR COMPOUND (ENCLOSED)	950	Addressable	Sprinkler + fuel-fire suppression	EI 120
ADMINISTRATION	1,250	Addressable	Sprinkler to NBC	Standard
GATEHOUSE	350	Addressable	Sprinkler to NBC	Standard



PROJECT
POLARIS DC-1 — AVIAPOLIS DATA CAMPUS, PHASE...

EMPLOYER
POLARIS DIGITAL INFRASTRUCTURE OY

CONTRACTOR
NORDBUILD OY

DRAWING
FIRE DETECTION & SUPPRESSION LAYOUT

DISCIPLINE
FIRE

DWG No PDC-DWG-015 SYNTHETIC DEMONSTRATION DATA — NOT A REAL PROJECT	REV A	DATE 24.02.2026	SCALE 1:500
--	-----------------	---------------------------	-----------------------