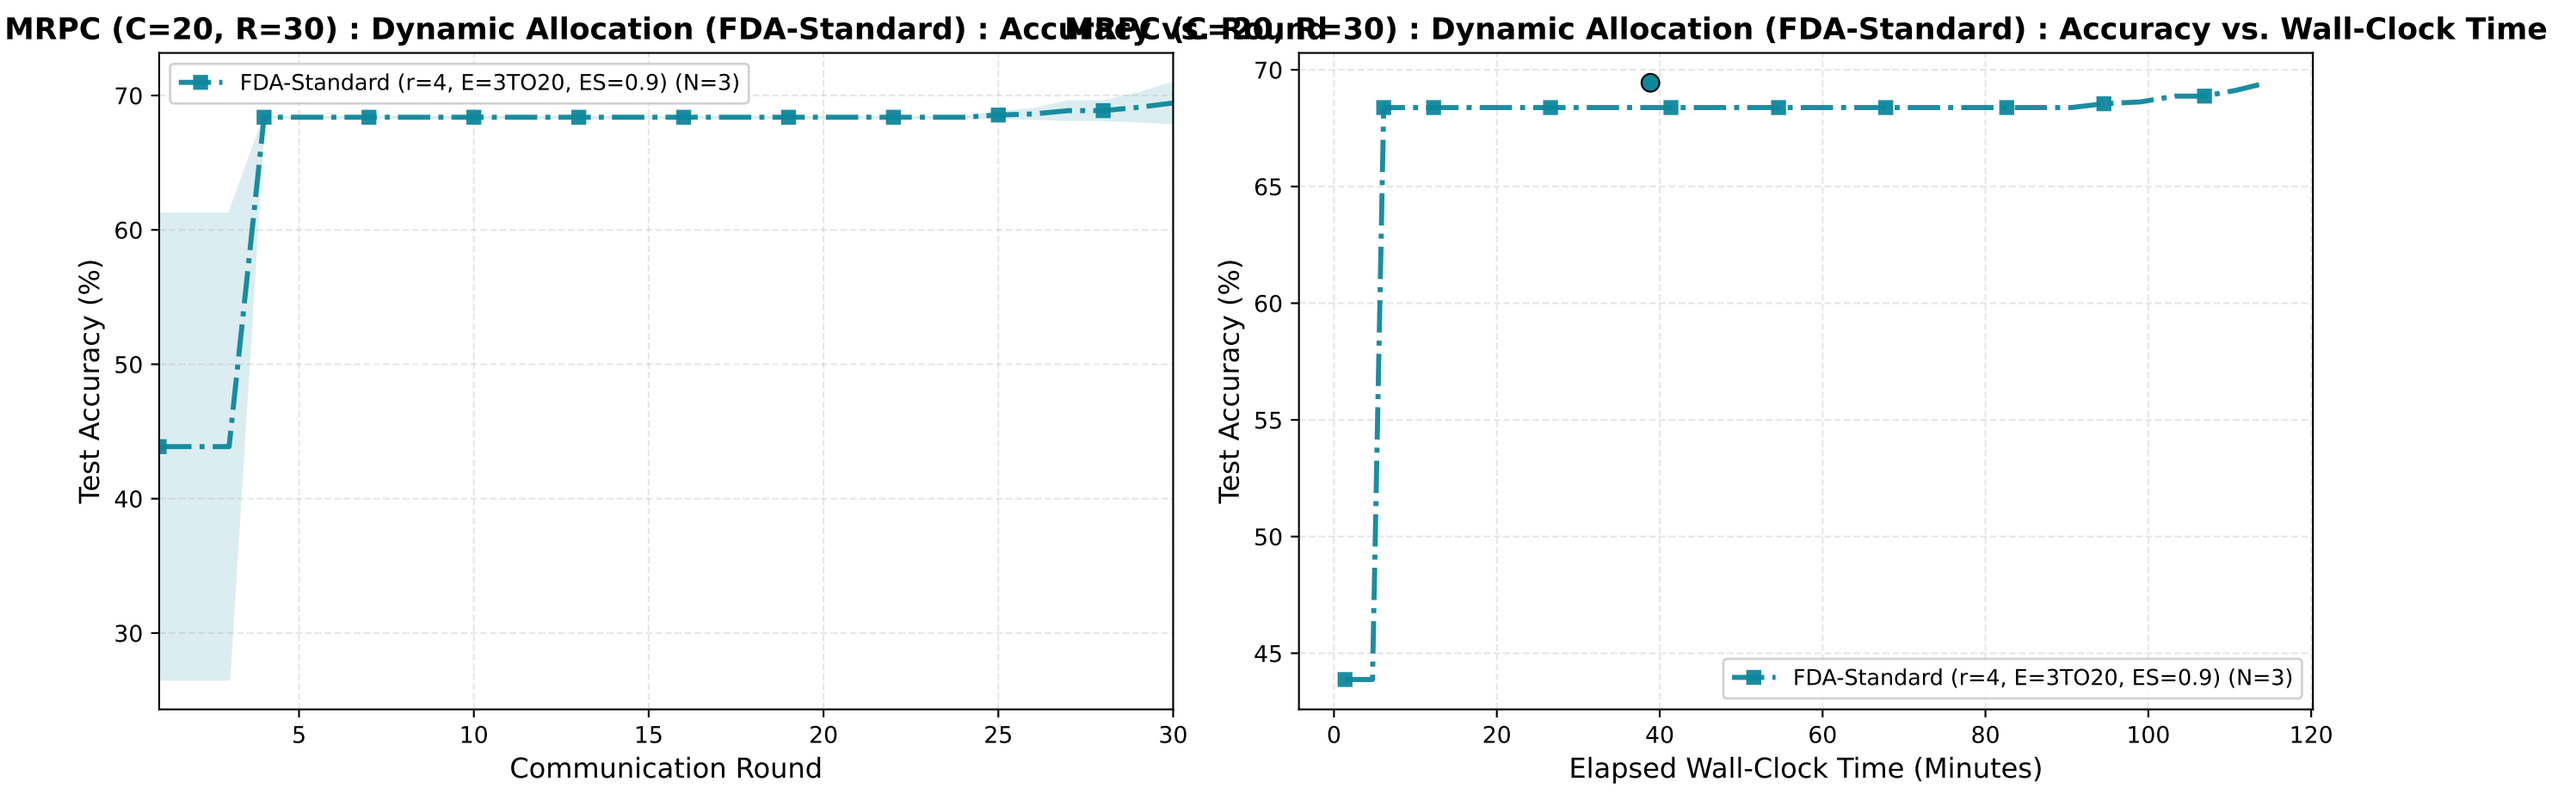
MRPC (C=20, R=30) : Dynamic Allocation (FDA-Standard) : Accuracy vs. Communication Rounds
Test Accuracy (%)
Communication Round
FDA-Standard (r=4, E=3TO20, ES=0.9) (N=3)
MRPC (C=20, R=30) : Dynamic Allocation (FDA-Standard) : Accuracy vs. Wall-Clock Time
Test Accuracy (%)
Elapsed Wall-Clock Time (Minutes)
FDA-Standard (r=4, E=3TO20, ES=0.9) (N=3)