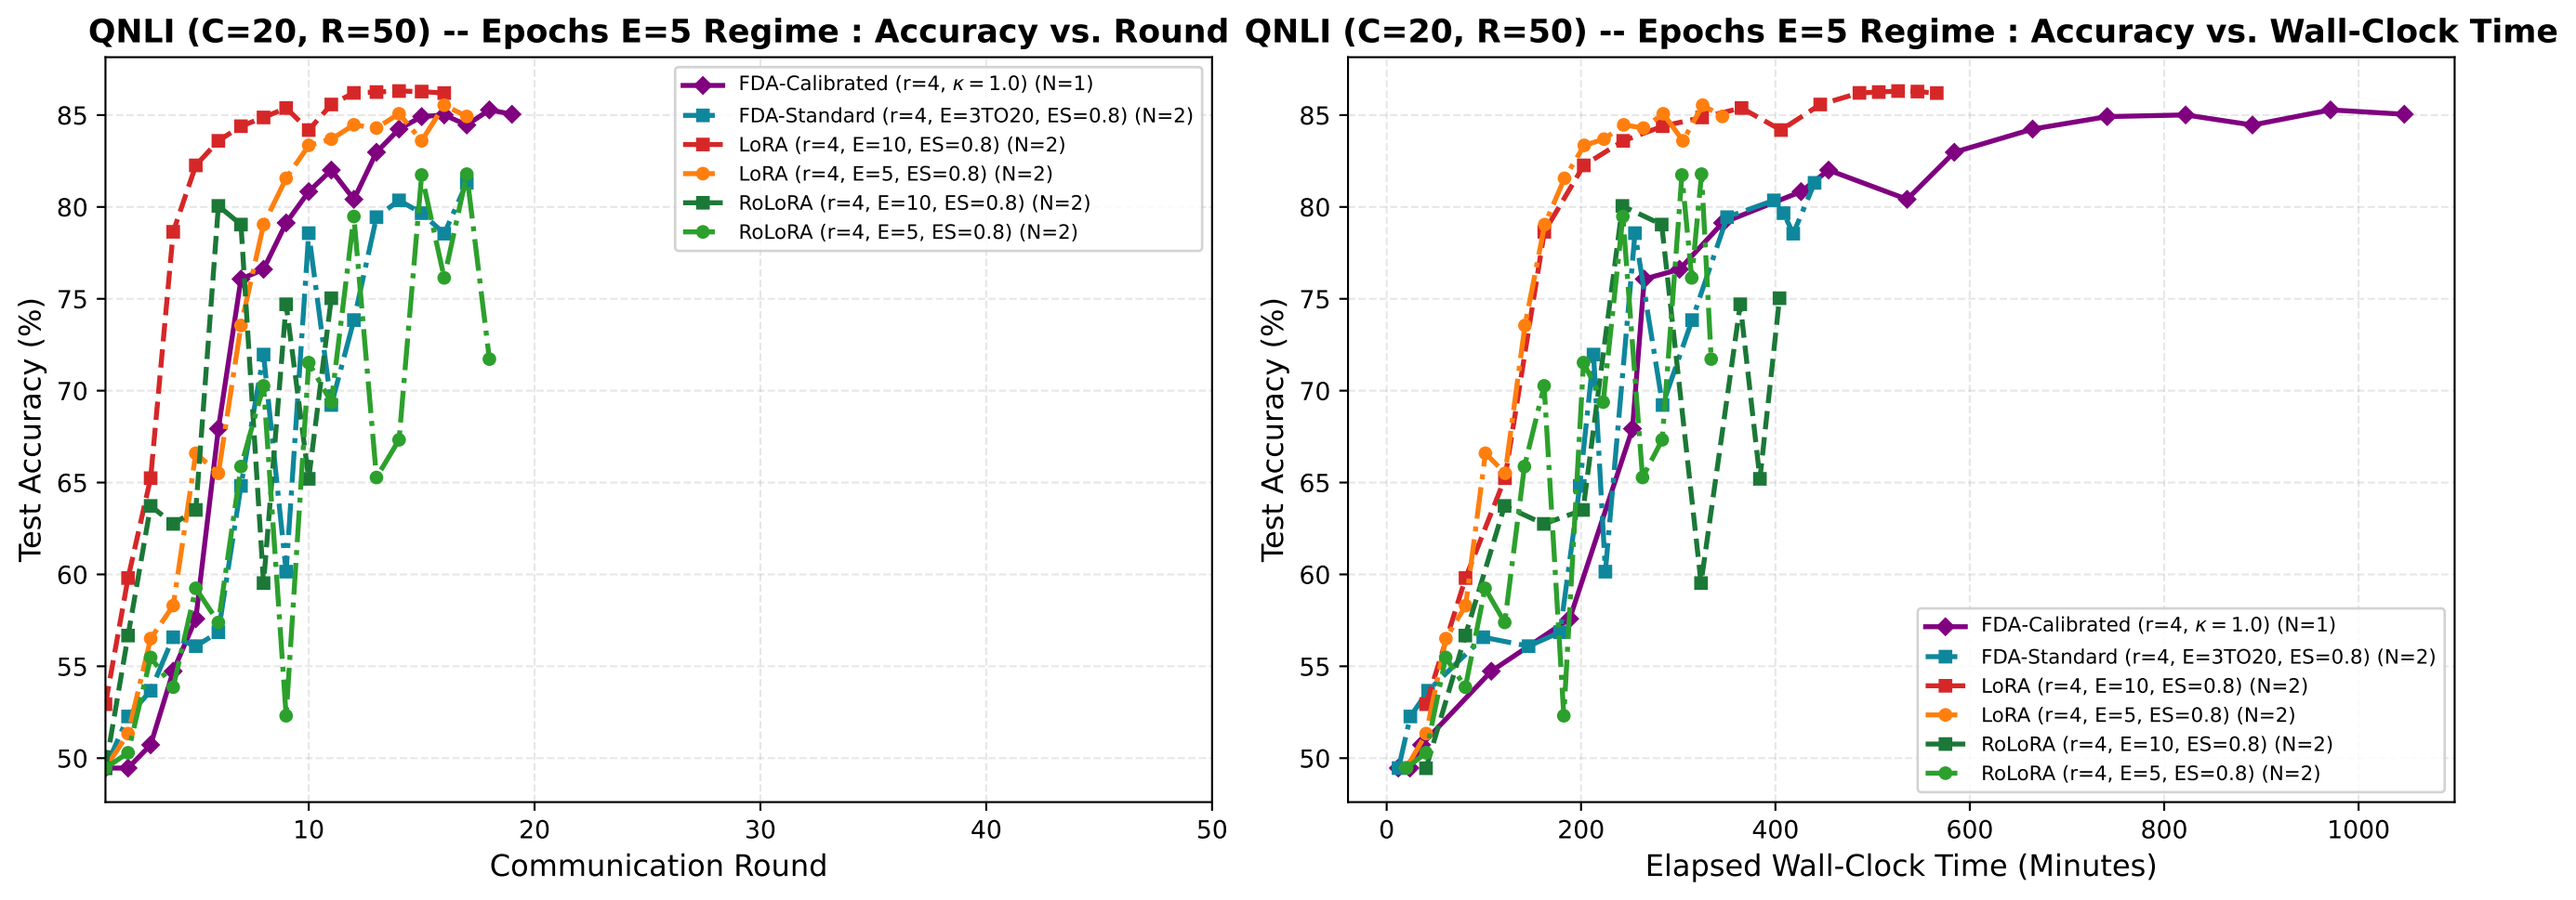
QNLI (C=20, R=50) -- Epochs E=5 Regime : Accuracy vs. Round
Test Accuracy (%)
Communication Round
FDA-Calibrated (r=4, κ = 1.0) (N=1)
FDA-Standard (r=4, E=3TO20, ES=0.8) (N=2)
LoRA (r=4, E=10, ES=0.8) (N=2)
LoRA (r=4, E=5, ES=0.8) (N=2)
RoLoRA (r=4, E=10, ES=0.8) (N=2)
RoLoRA (r=4, E=5, ES=0.8) (N=2)
QNLI (C=20, R=50) -- Epochs E=5 Regime : Accuracy vs. Wall-Clock Time
Test Accuracy (%)
Elapsed Wall-Clock Time (Minutes)
FDA-Calibrated (r=4, κ = 1.0) (N=1)
FDA-Standard (r=4, E=3TO20, ES=0.8) (N=2)
LoRA (r=4, E=10, ES=0.8) (N=2)
LoRA (r=4, E=5, ES=0.8) (N=2)
RoLoRA (r=4, E=10, ES=0.8) (N=2)
RoLoRA (r=4, E=5, ES=0.8) (N=2)