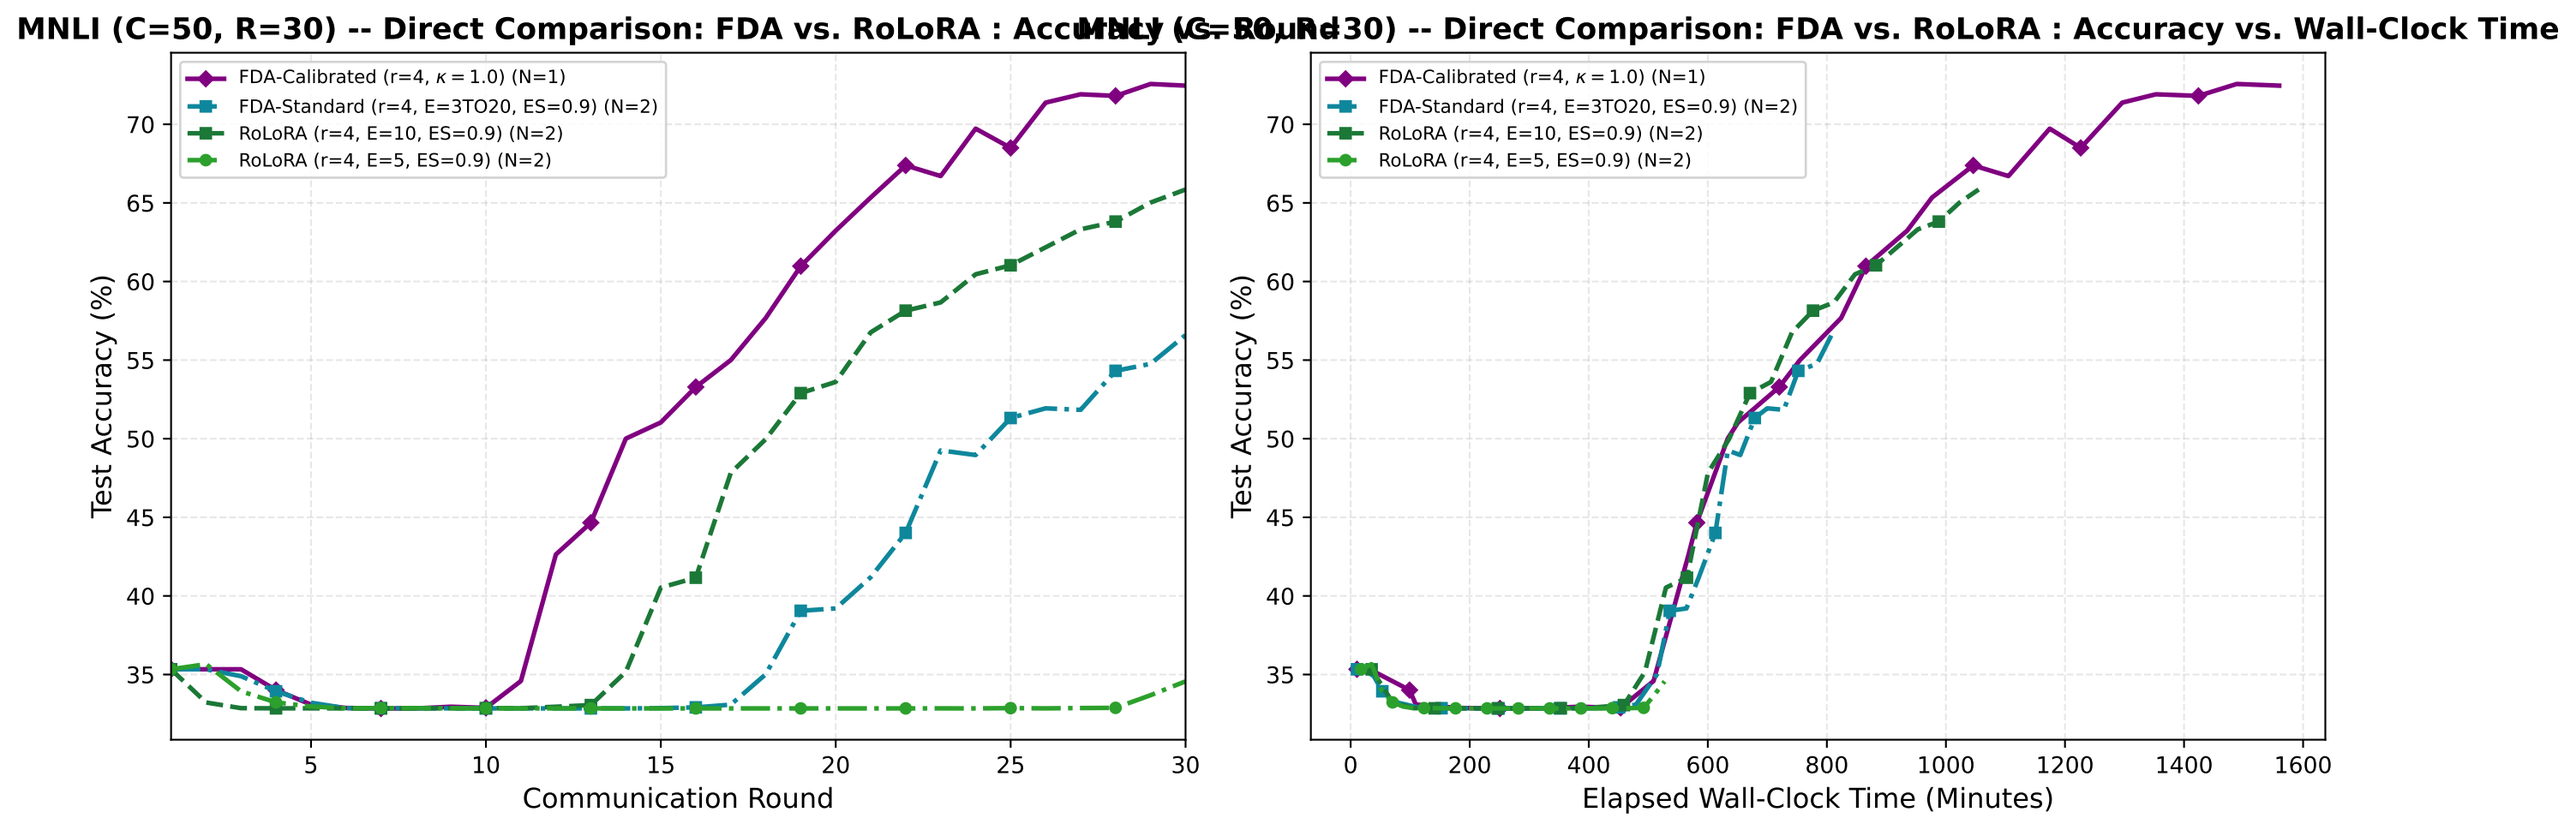
MNLI (C=50, R=30) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Communication Rounds
MNLI (C=50, R=30) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Wall-Clock Time
FDA-Calibrated (r=4, κ = 1.0) (N=1)
FDA-Standard (r=4, E=3TO20, ES=0.9) (N=2)
RoLoRA (r=4, E=10, ES=0.9) (N=2)
RoLoRA (r=4, E=5, ES=0.9) (N=2)
Test Accuracy (%)
Communication Round
Elapsed Wall-Clock Time (Minutes)