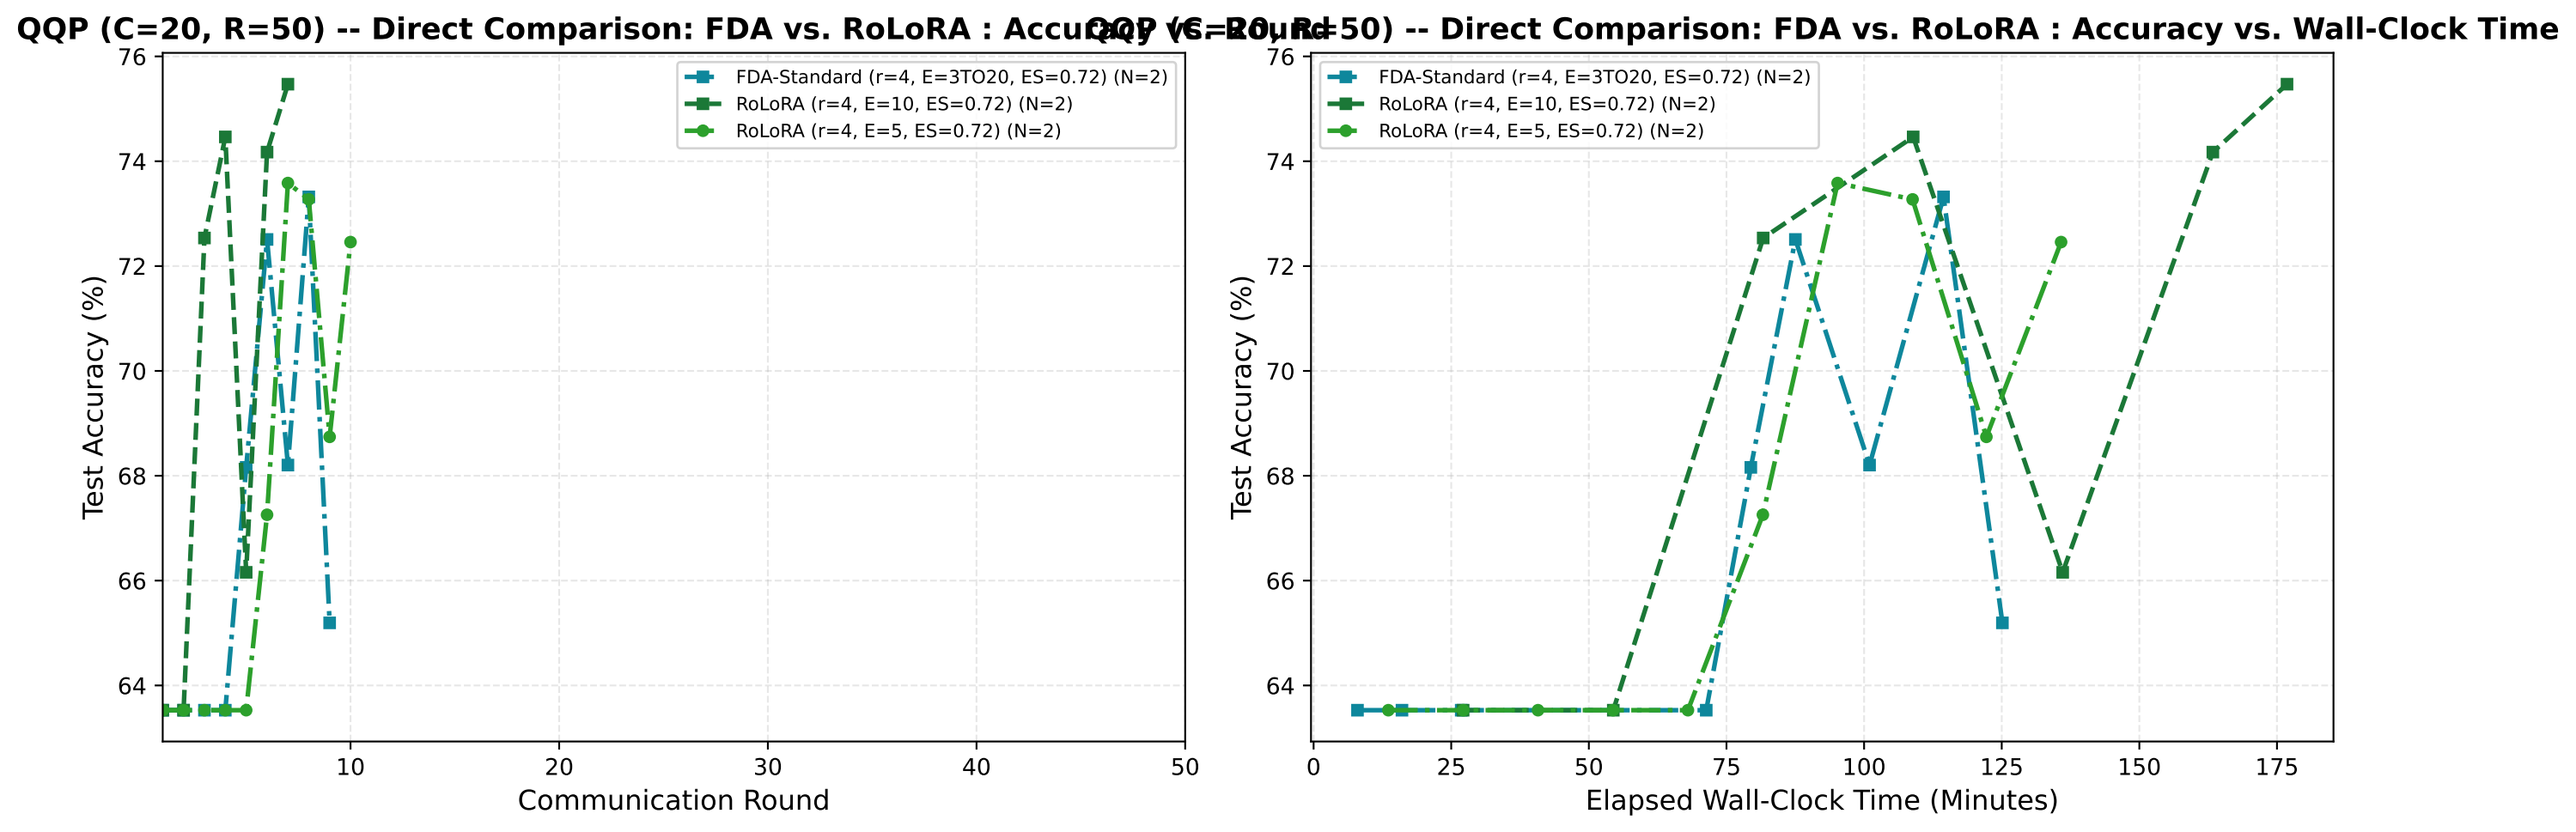
QQP (C=20, R=50) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Communication Round
QQP (C=20, R=50) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Wall-Clock Time
FDA-Standard (r=4, E=3TO20, ES=0.72) (N=2)
RoLoRA (r=4, E=10, ES=0.72) (N=2)
RoLoRA (r=4, E=5, ES=0.72) (N=2)
Test Accuracy (%)
Communication Round
Elapsed Wall-Clock Time (Minutes)
64
66
68
70
72
74
76
10
20
30
40
50
0
25
50
75
100
125
150
175