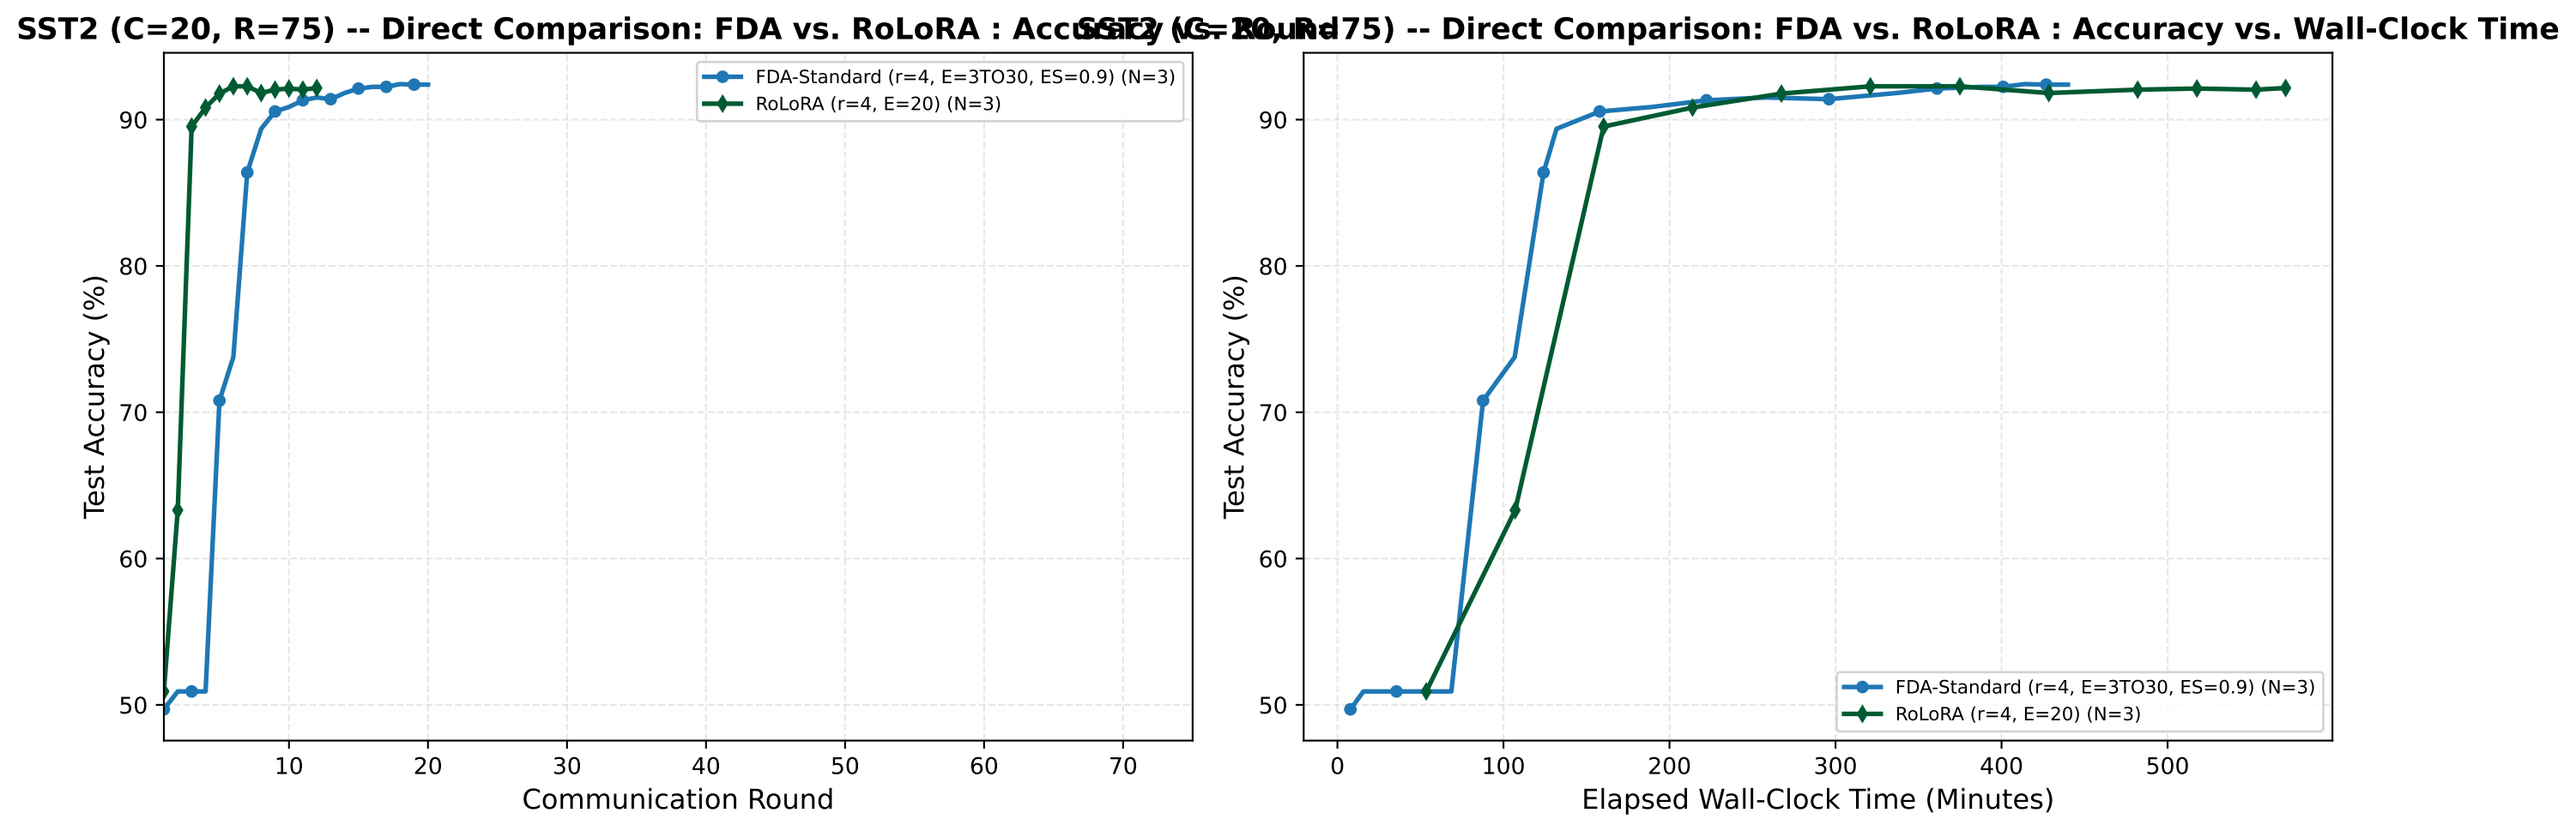
SST2 (C=20, R=75) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Communication Round
SST2 (C=20, R=75) -- Direct Comparison: FDA vs. RoLoRA : Accuracy vs. Wall-Clock Time
Test Accuracy (%)
Communication Round
Elapsed Wall-Clock Time (Minutes)
FDA-Standard (r=4, E=3TO30, ES=0.9) (N=3)
RoLoRA (r=4, E=20) (N=3)
50
60
70
80
90
10
20
30
40
50
60
70
0
100
200
300
400
500