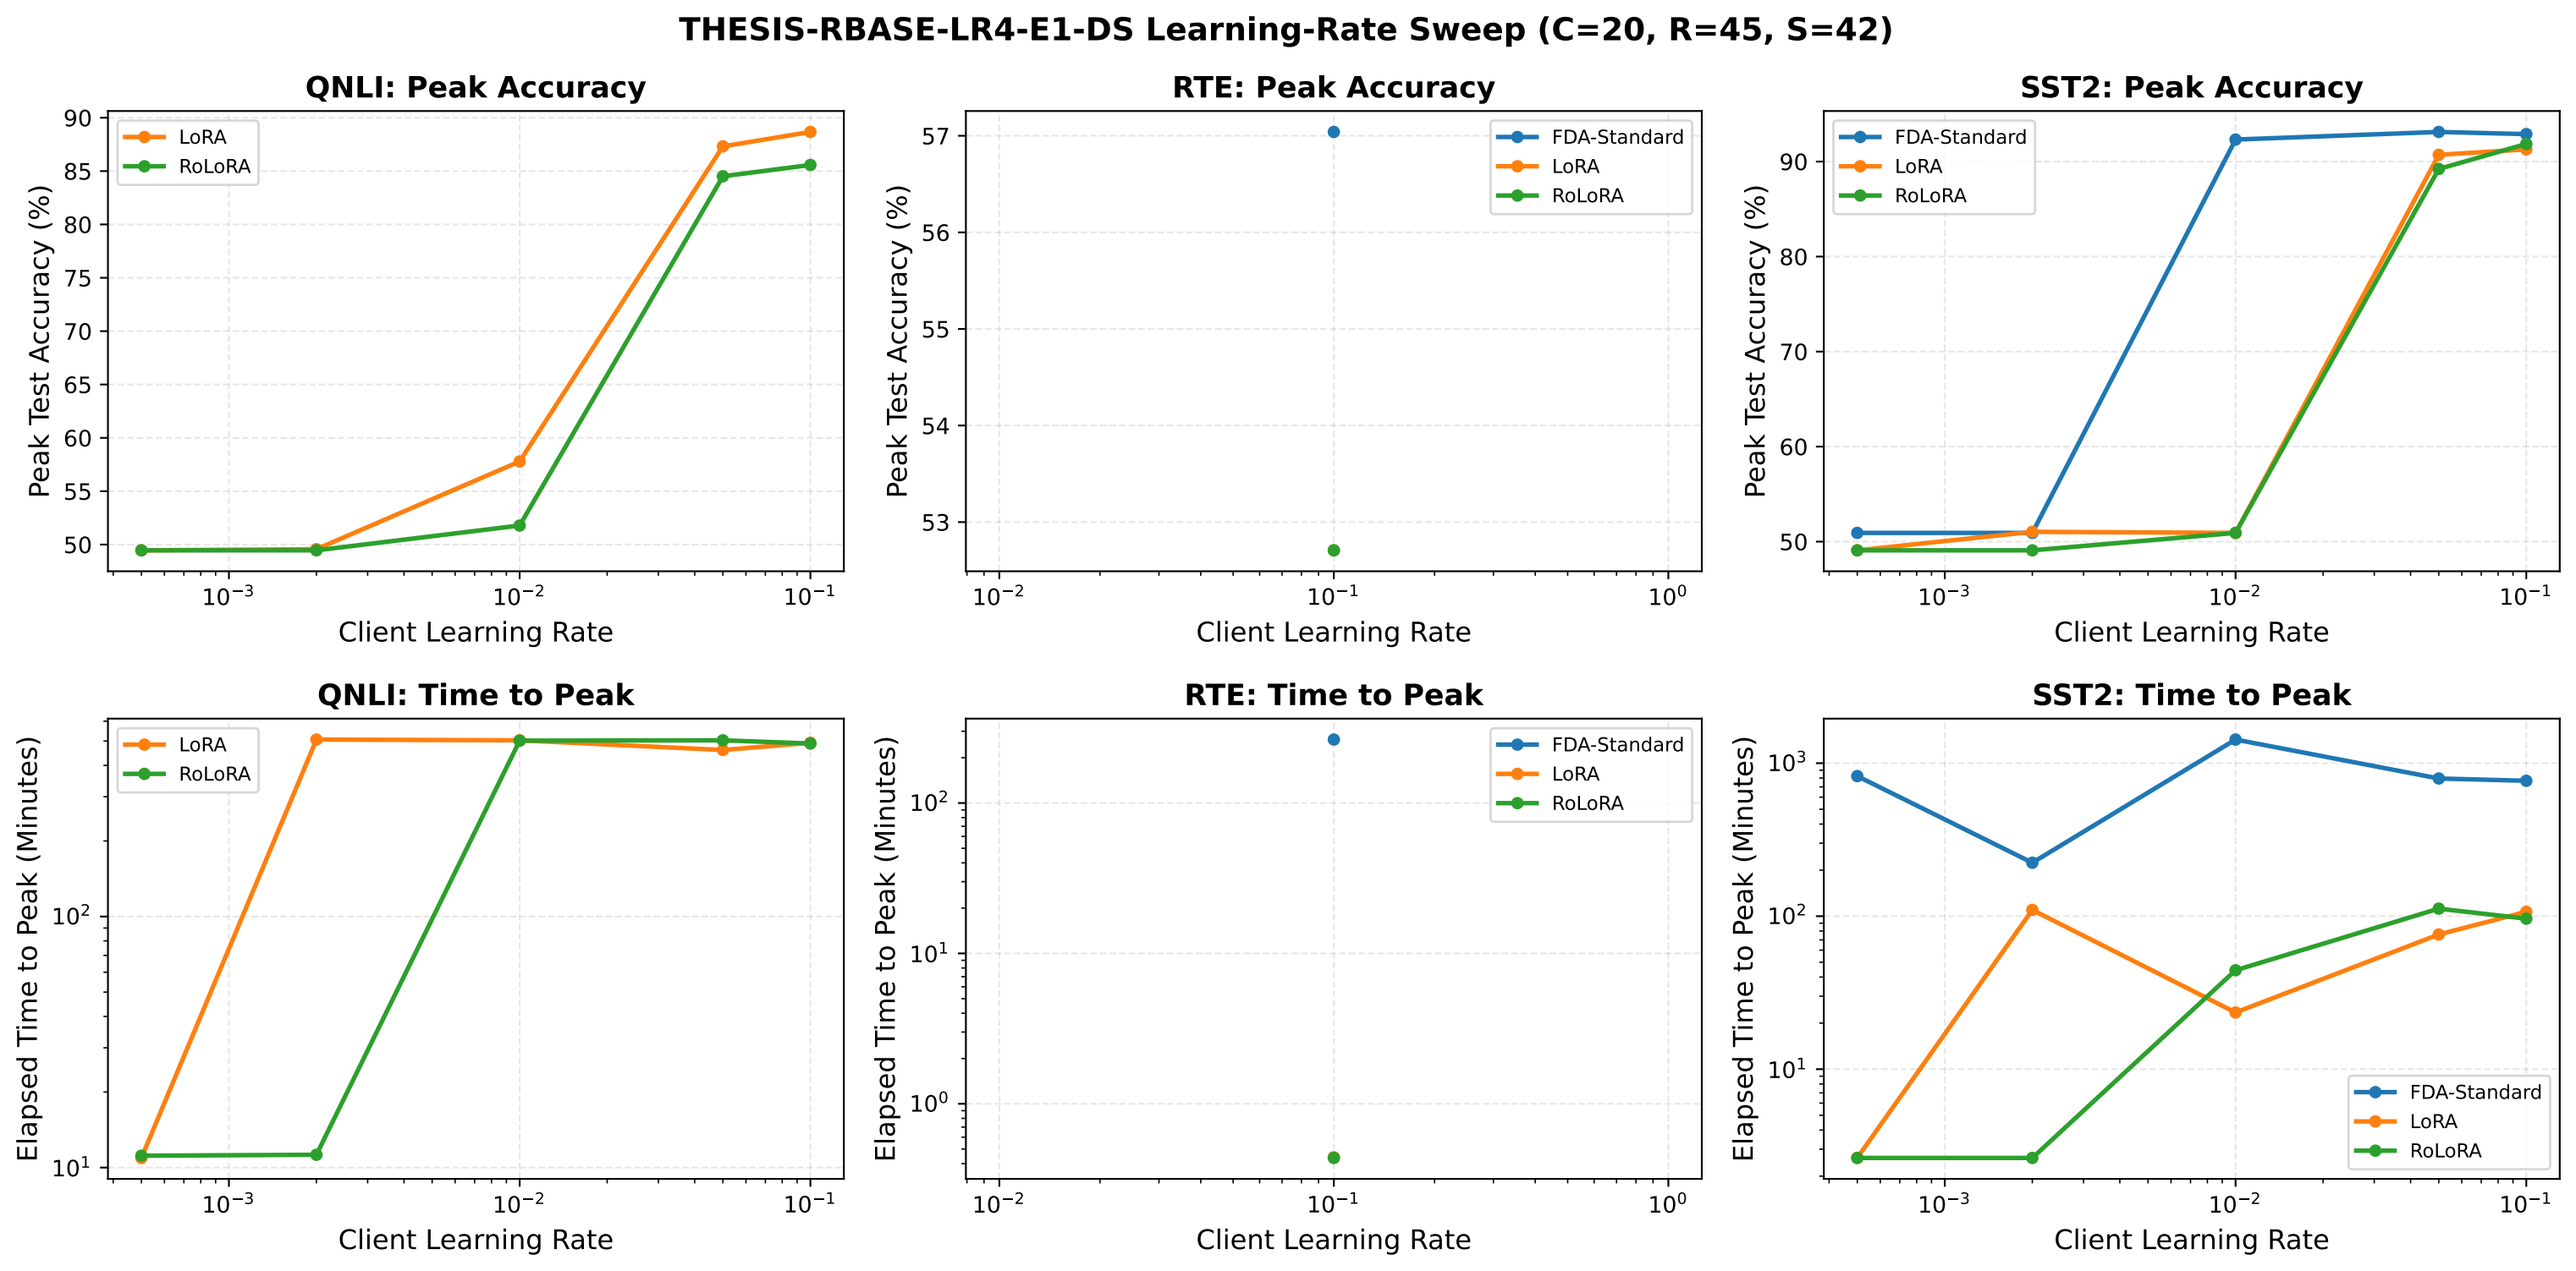
THESIS-RBASE-LR4-E1-DS Learning-Rate Sweep (C=20, R=45, S=42)
QNLI: Peak Accuracy
RTE: Peak Accuracy
SST2: Peak Accuracy
Peak Test Accuracy (%)
Client Learning Rate
LoRA
RoLoRA
FDA-Standard
QNLI: Time to Peak
RTE: Time to Peak
SST2: Time to Peak
Elapsed Time to Peak (Minutes)