Pure Performance

Home

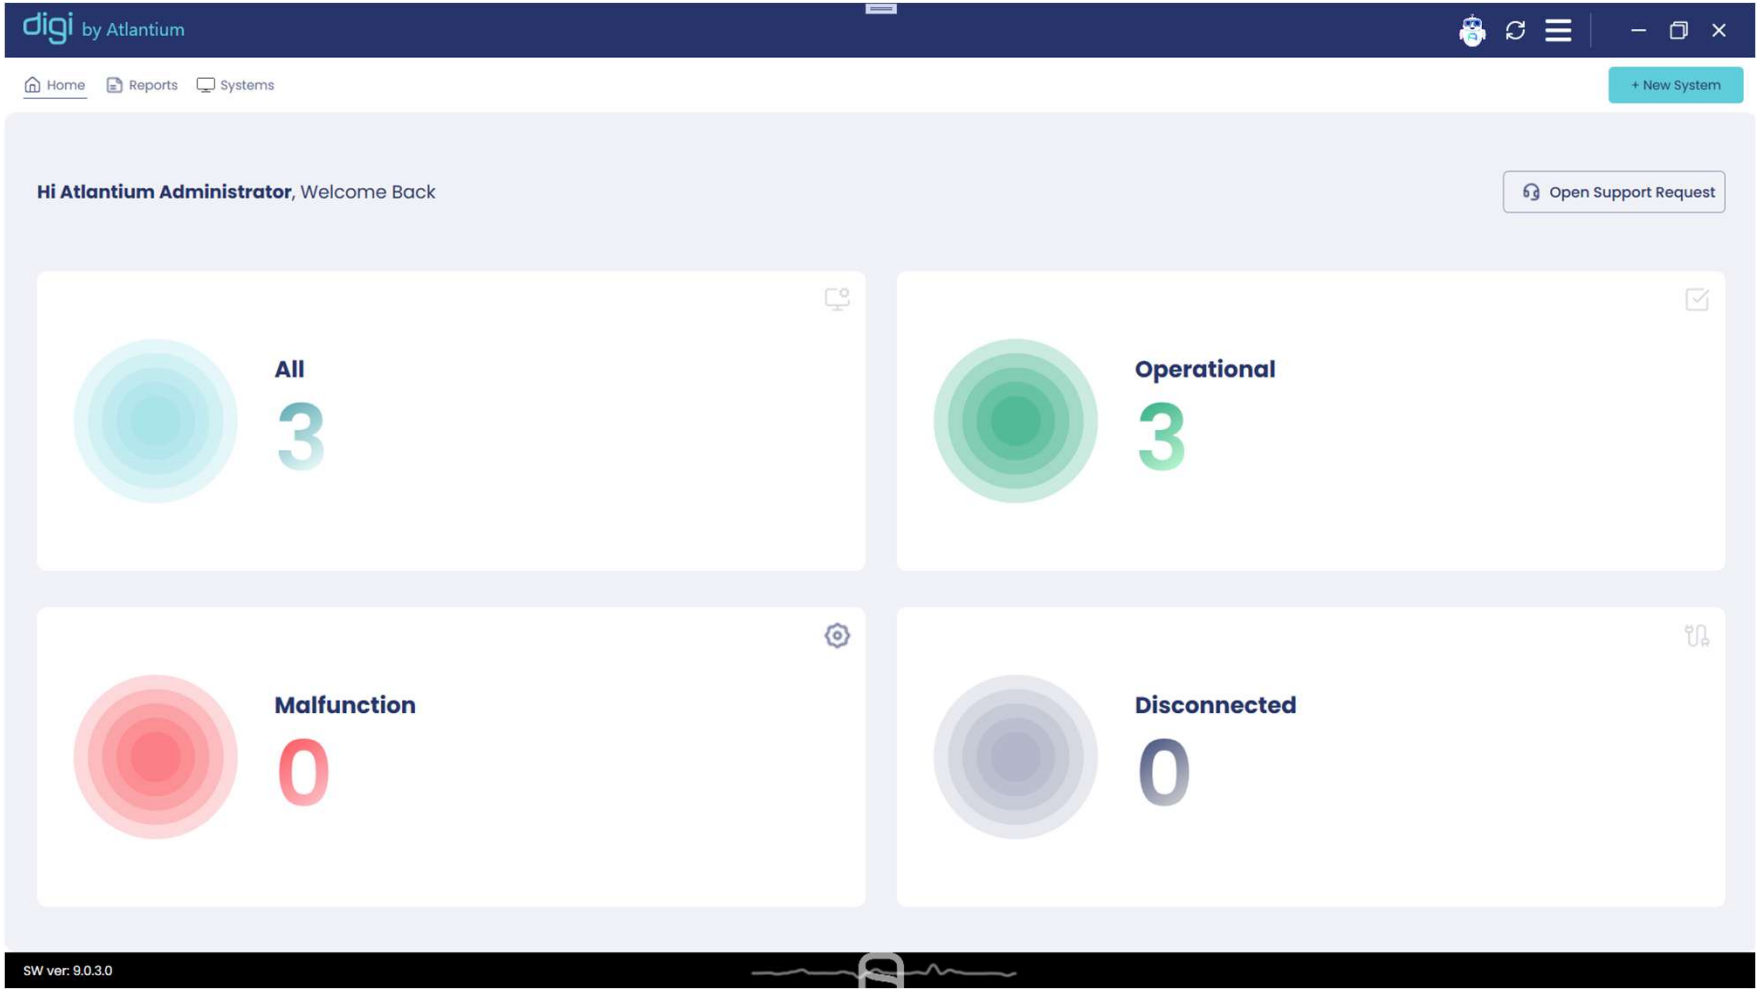
digi by Atlantium
Home
Reports
Systems
+ New System
Hi Atlantium Administrator, Welcome Back
Open Support Request
All
3
Operational
3
Malfunction
0
Disconnected
0
SW ver: 9.0.3.0

Controller List

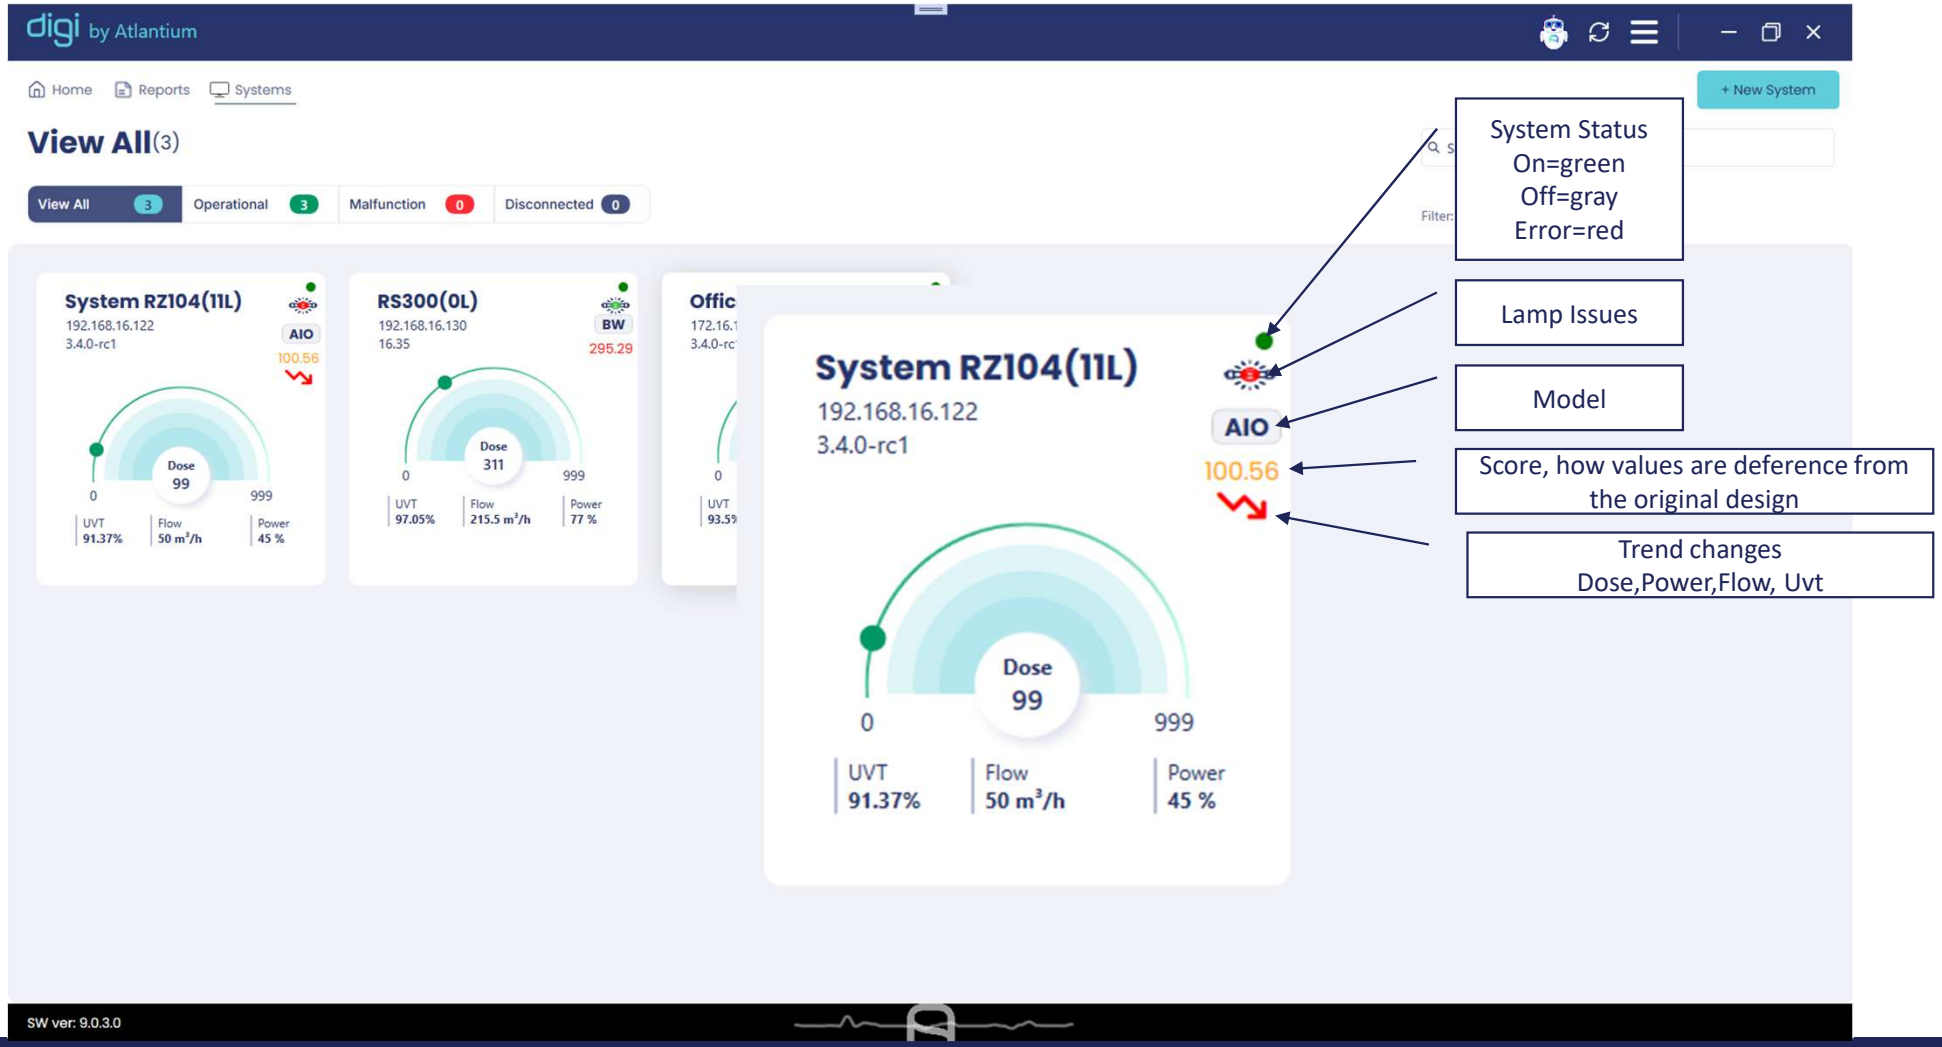

Event log

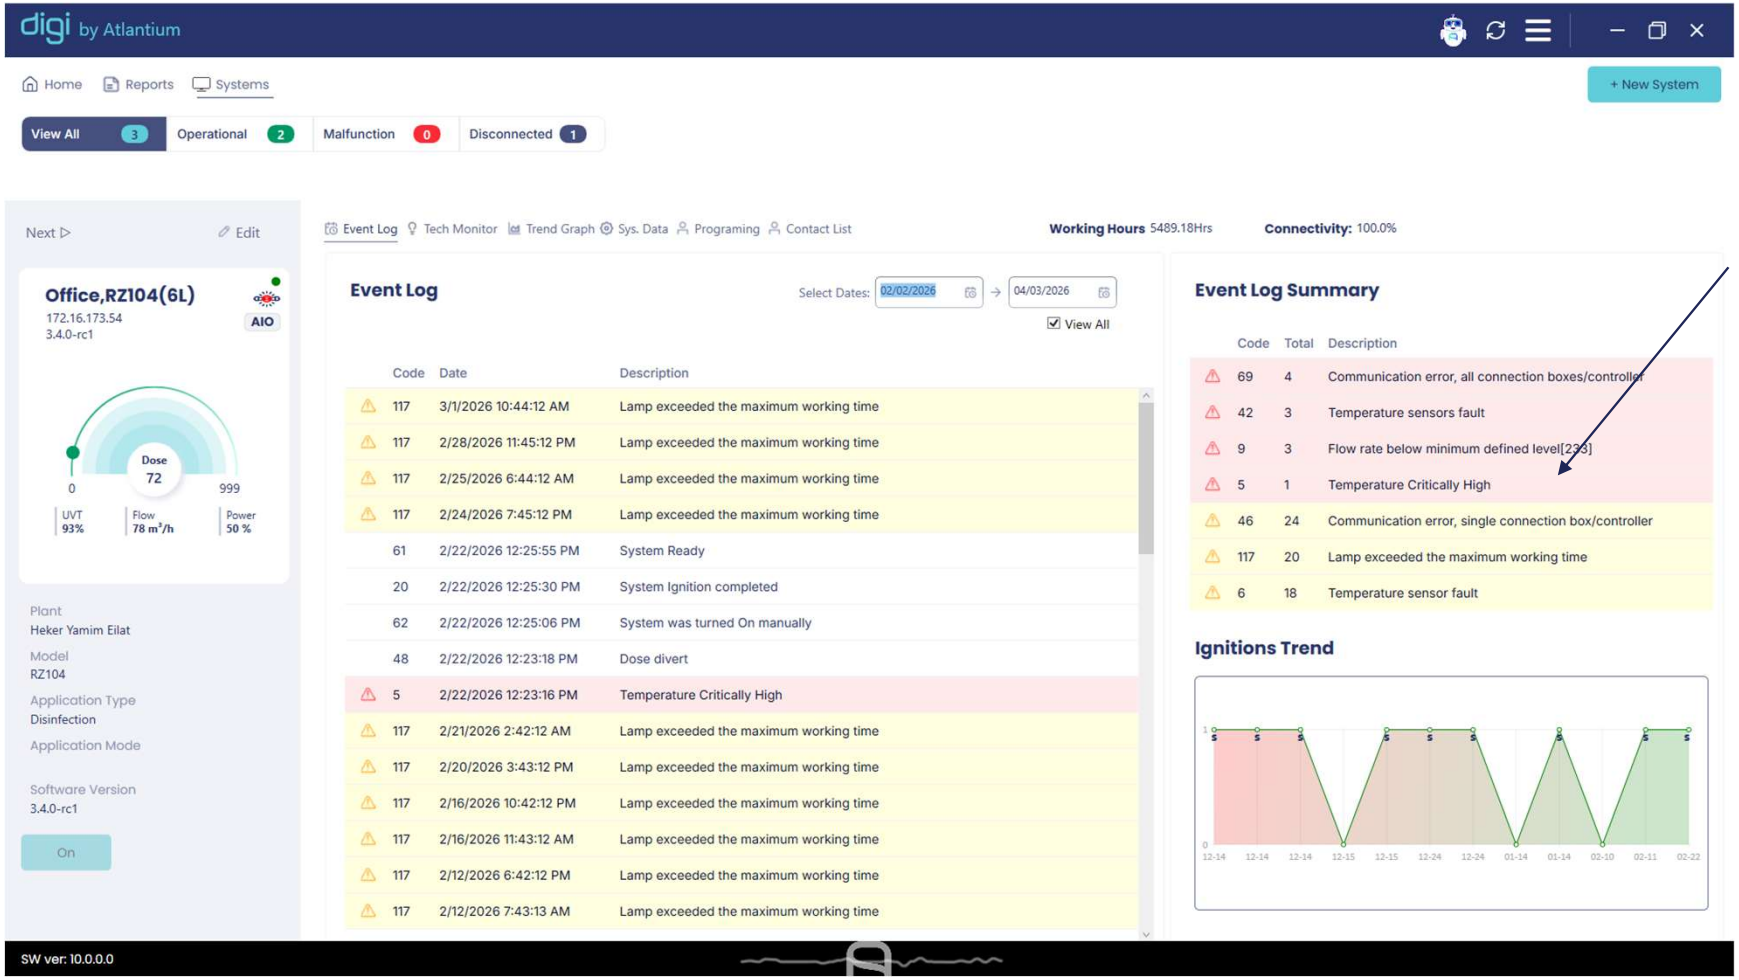

Calculate data From the history log file

Event log

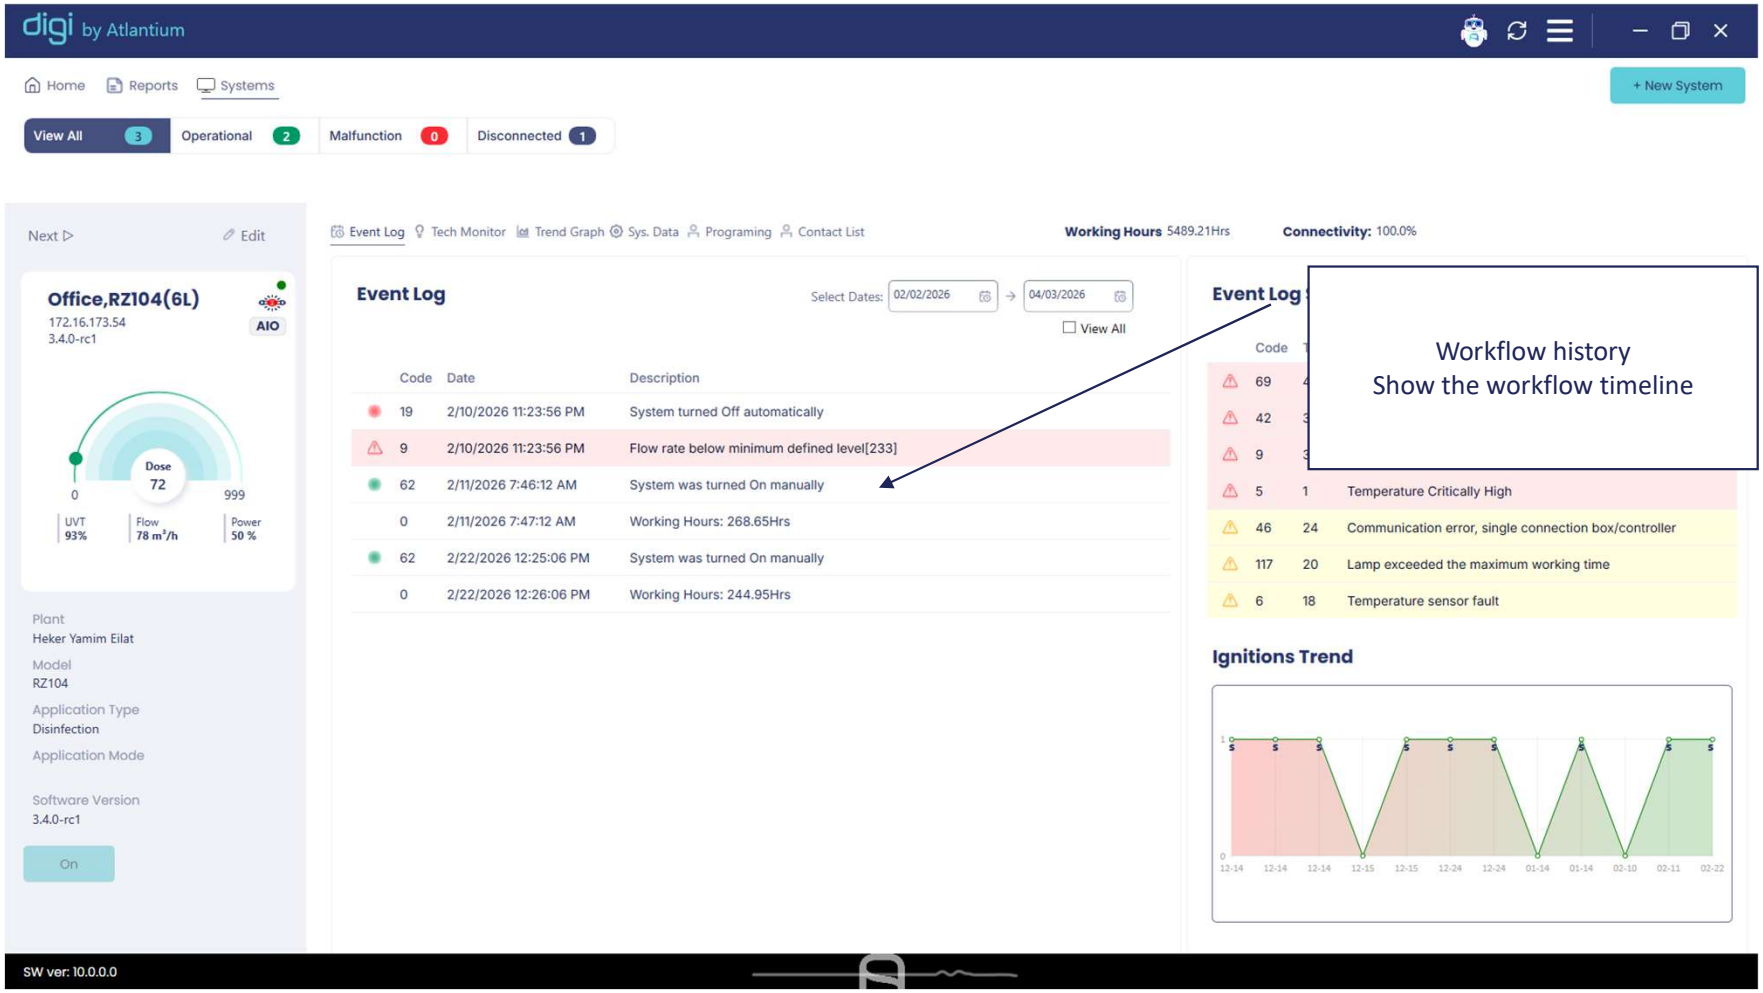

Workflow history
Show the workflow timeline

Tech Monitor

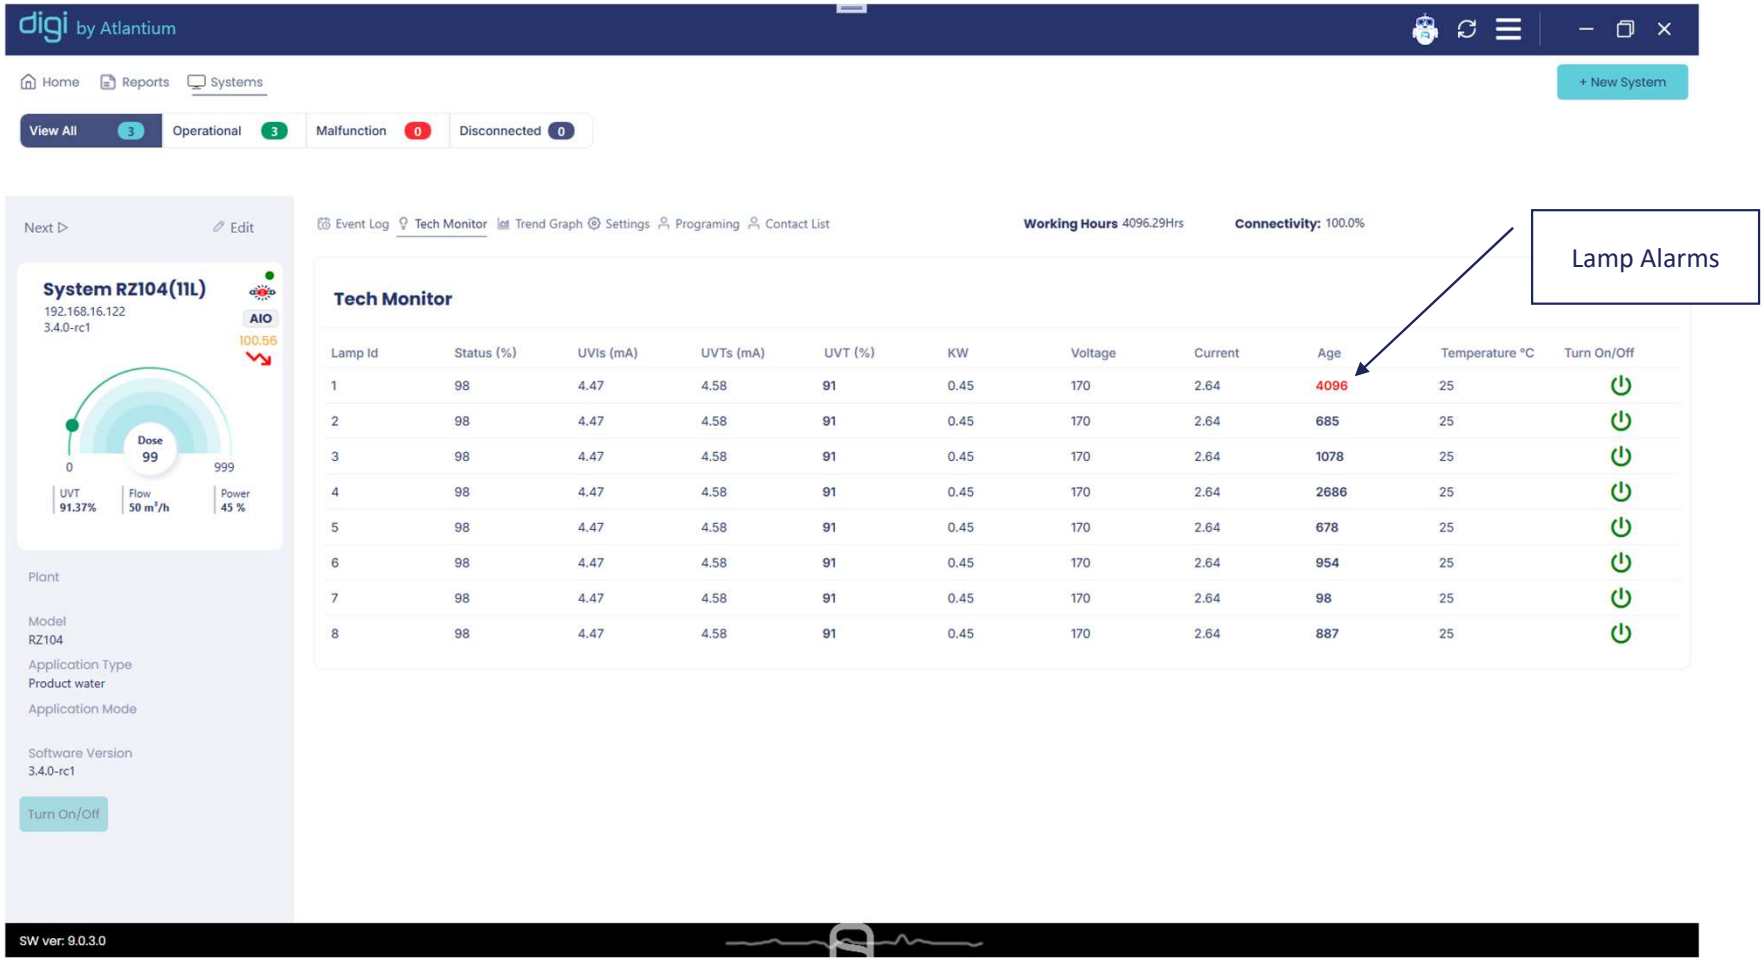

Lamp Id	Status (%)	UVIs (mA)	UVTs (mA)	UVT (%)	KW	Voltage	Current	Age	Temperature °C	Turn On/Off
1	98	4.47	4.58	91	0.45	170	2.64	4096	25	
2	98	4.47	4.58	91	0.45	170	2.64	685	25	
3	98	4.47	4.58	91	0.45	170	2.64	1078	25	
4	98	4.47	4.58	91	0.45	170	2.64	2686	25	
5	98	4.47	4.58	91	0.45	170	2.64	678	25	
6	98	4.47	4.58	91	0.45	170	2.64	954	25	
7	98	4.47	4.58	91	0.45	170	2.64	98	25	
8	98	4.47	4.58	91	0.45	170	2.64	887	25	

Trend Graphs

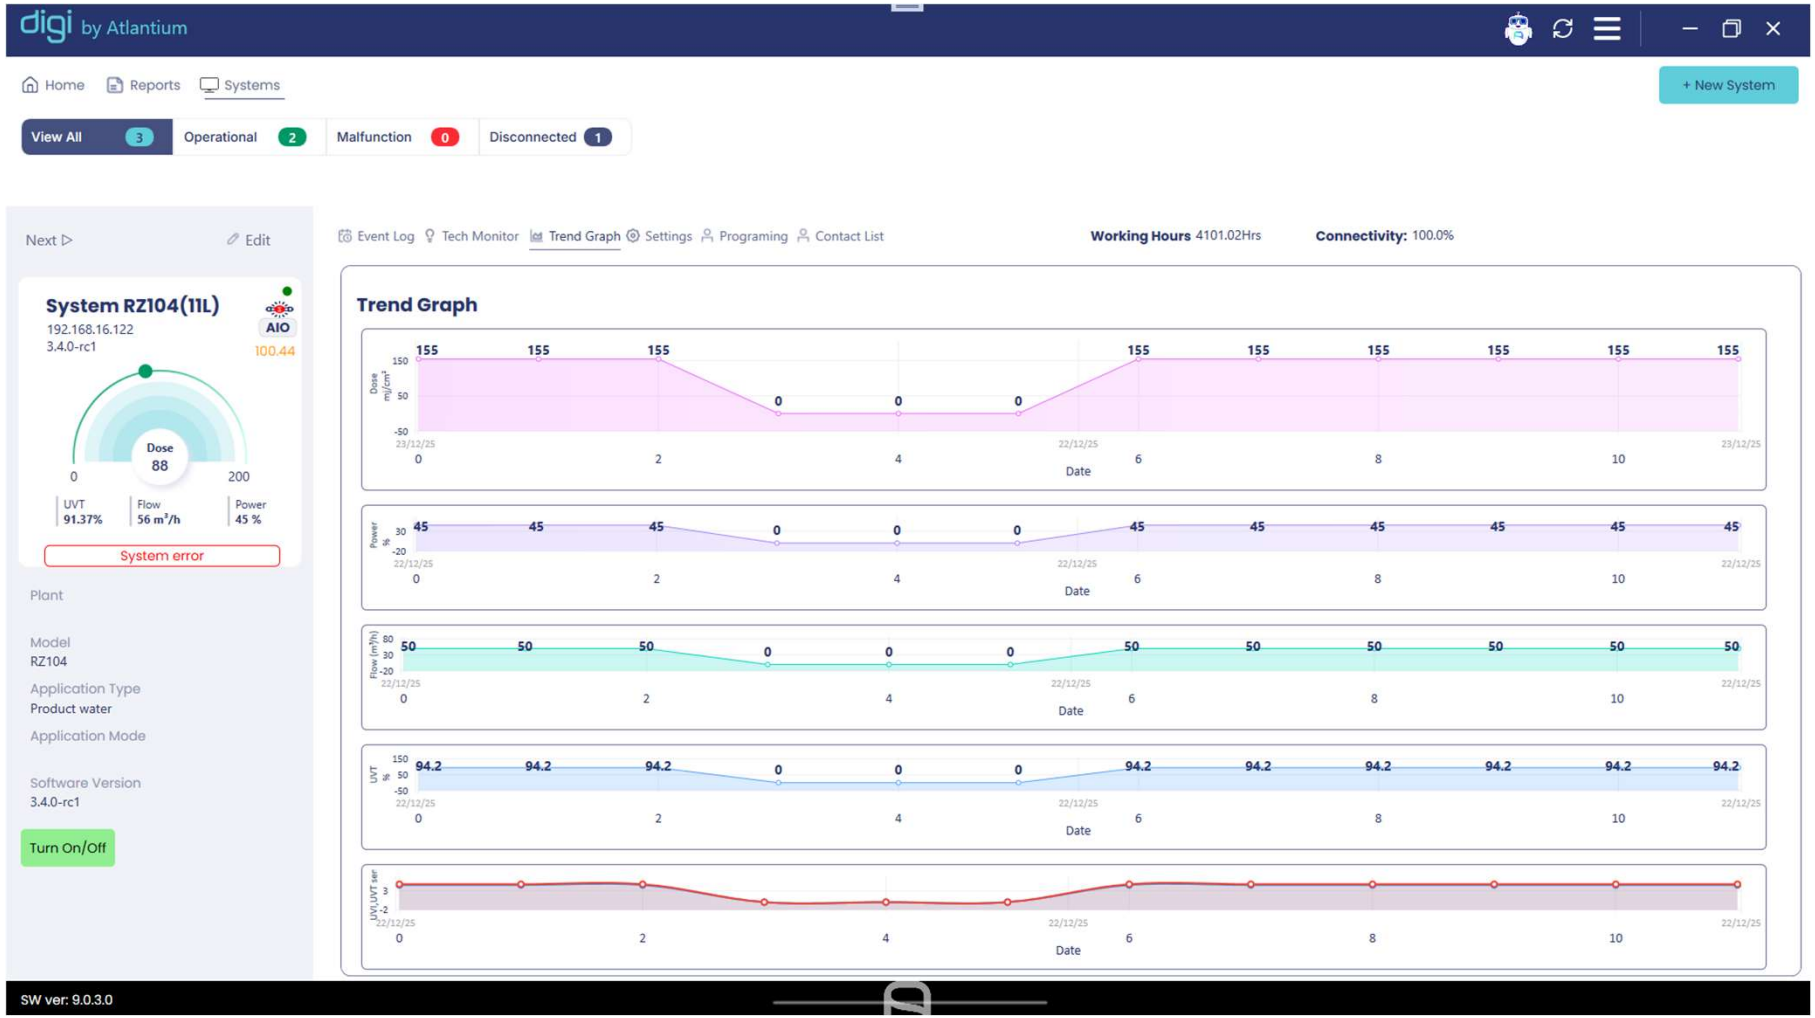

System Data

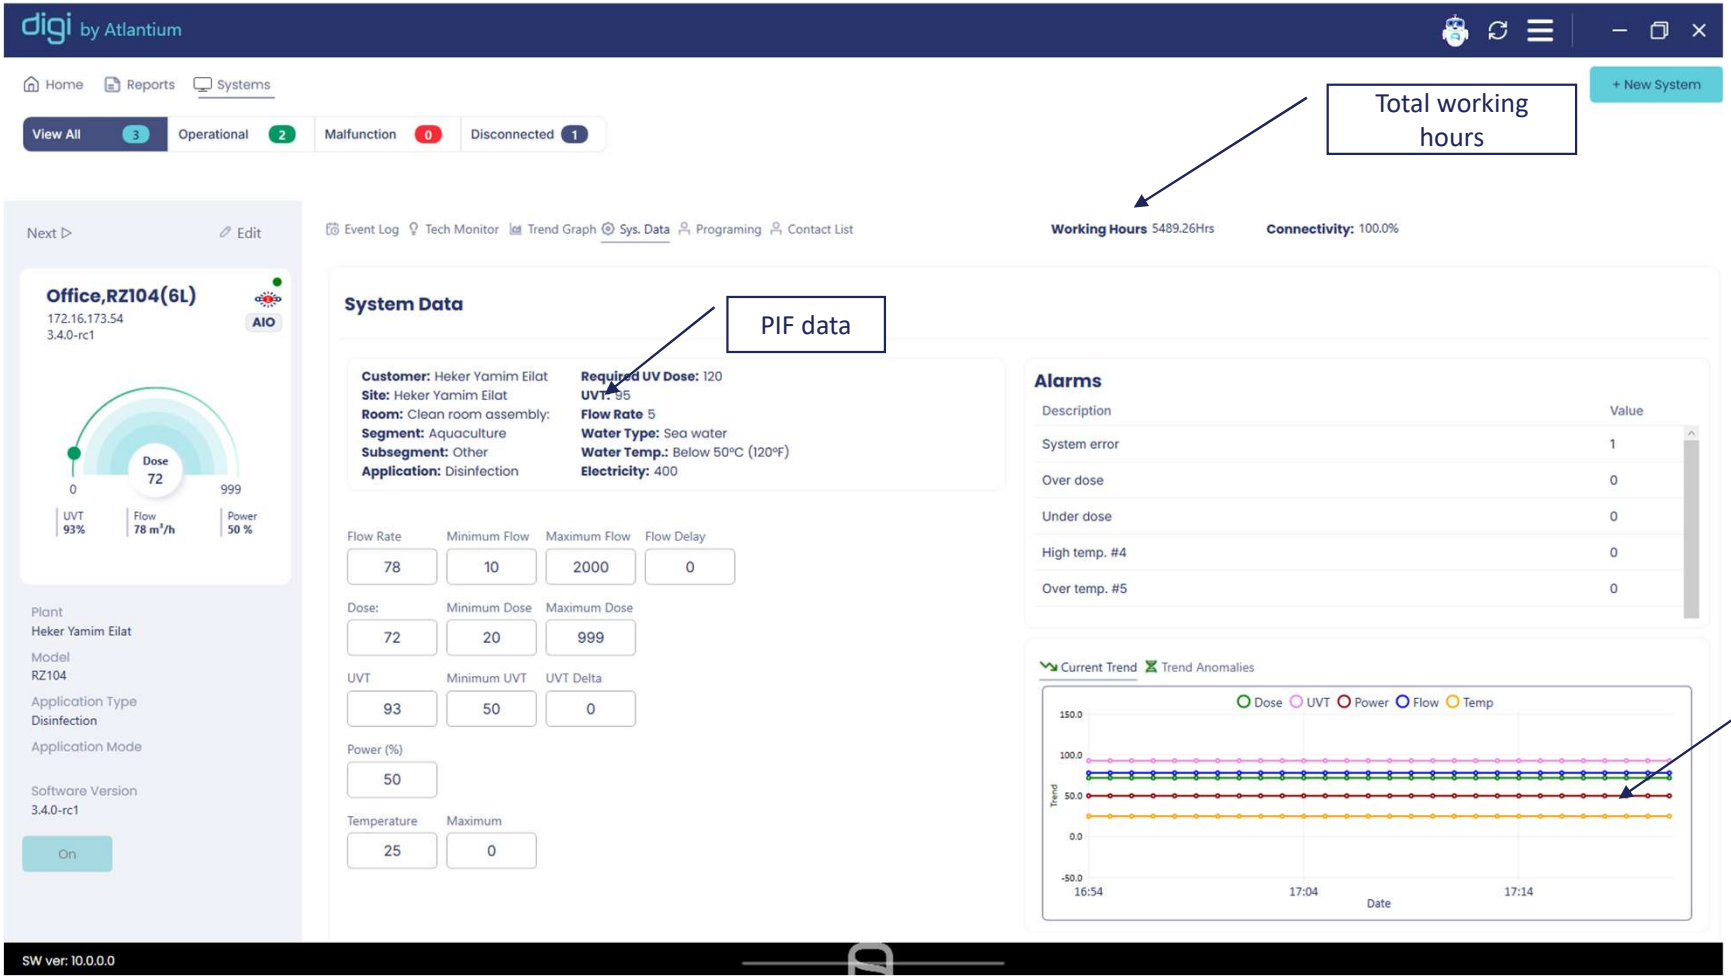
digi by Atlantium
Home
Reports
Systems
+ New System
View All 3
Operational 2
Malfunction 0
Disconnected 1
Total working hours
Next
Edit
Event Log
Tech Monitor
Trend Graph
Sys. Data
Programing
Contact List
Working Hours 5489.26Hrs
Connectivity: 100.0%
Office,RZ104(6L)
172.16.173.54
3.4.0-rc1
AIO
Dose
72
0
999
UVT 93%
Flow 78 m³/h
Power 50 %
Plant
Heker Yamim Eilat
Model
RZ104
Application Type
Disinfection
Application Mode
Software Version
3.4.0-rc1
On
System Data
PIF data
Customer: Heker Yamim Eilat
Site: Heker Yamim Eilat
Room: Clean room assembly:
Segment: Aquaculture
Subsegment: Other
Application: Disinfection
Required UV Dose: 120
UVT: 95
Flow Rate 5
Water Type: Sea water
Water Temp.: Below 50°C (120°F)
Electricity: 400
Flow Rate 78
Minimum Flow 10
Maximum Flow 2000
Flow Delay 0
Dose: 72
Minimum Dose 20
Maximum Dose 999
UVT 93
Minimum UVT 50
UVT Delta 0
Power (%) 50
Temperature 25
Maximum 0
Alarms
Description
Value
System error 1
Over dose 0
Under dose 0
High temp. #4 0
Over temp. #5 0
Current Trend
Trend Anomalies
Dose
UVT
Power
Flow
Temp
150.0
100.0
50.0
0.0
-50.0
Trend
16:54
17:04
17:14
Date
Work trend graph
SW ver: 10.0.0.0

System Data

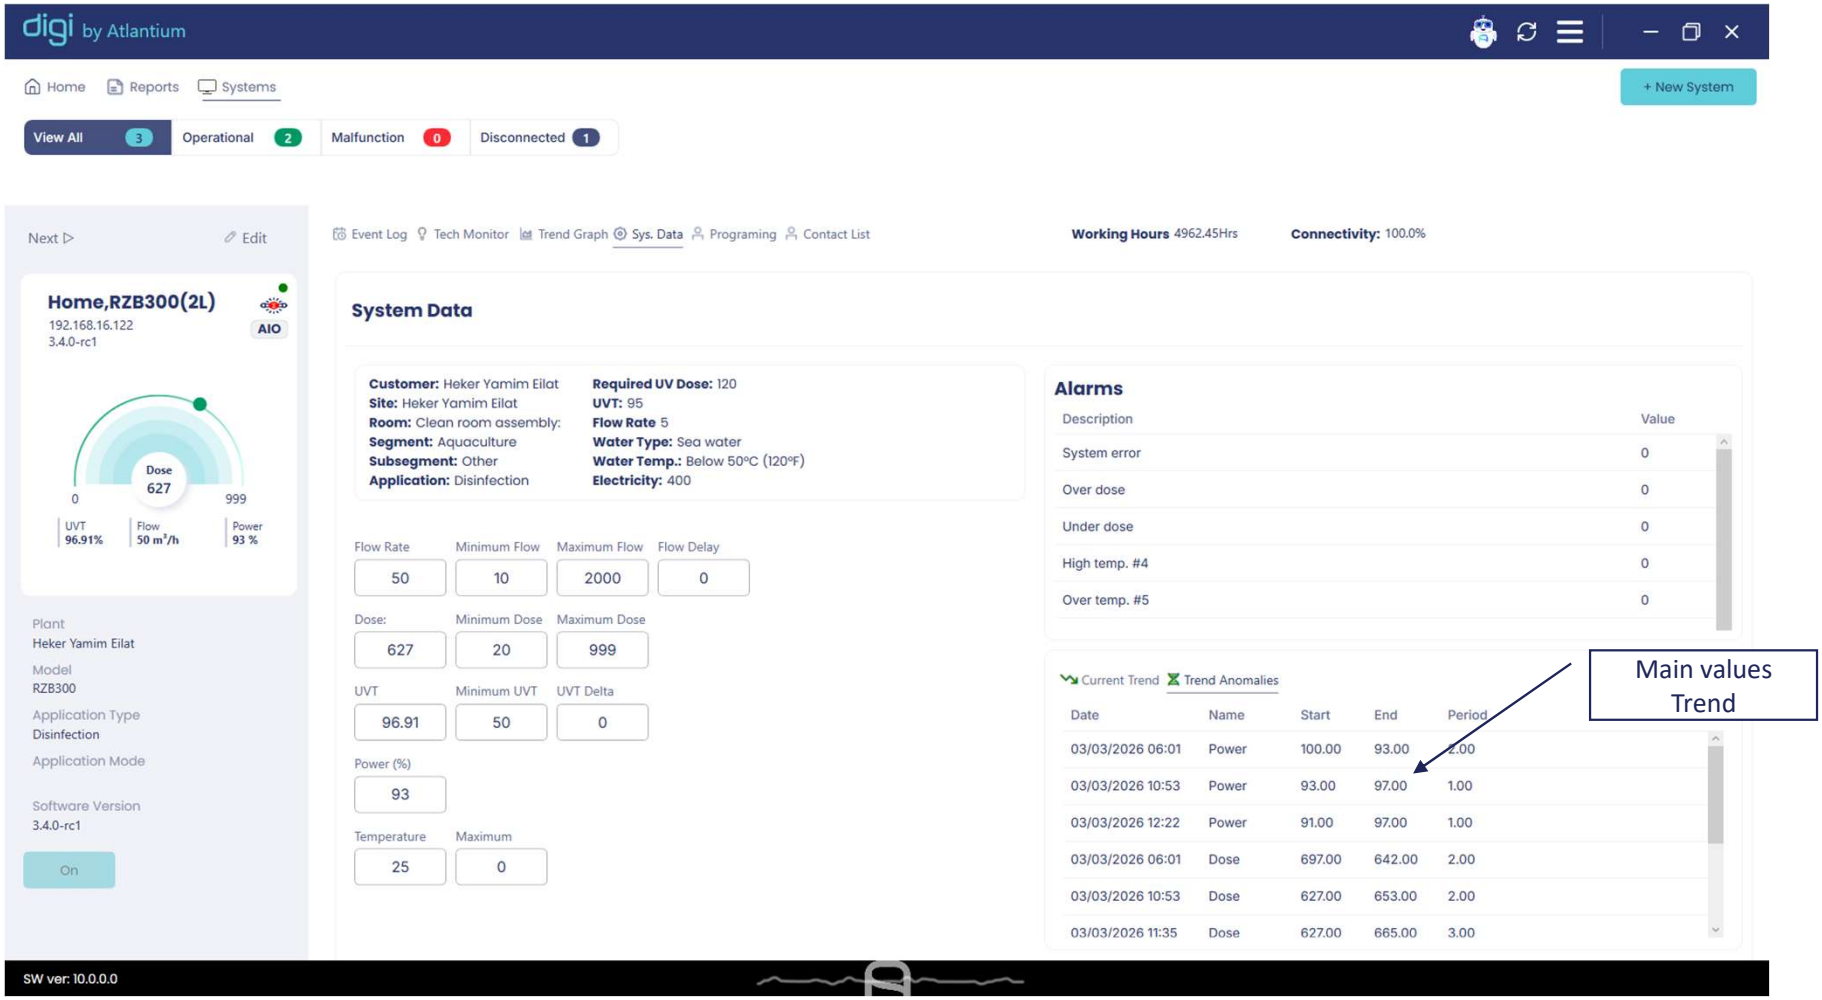

Main values Trend

Contacts

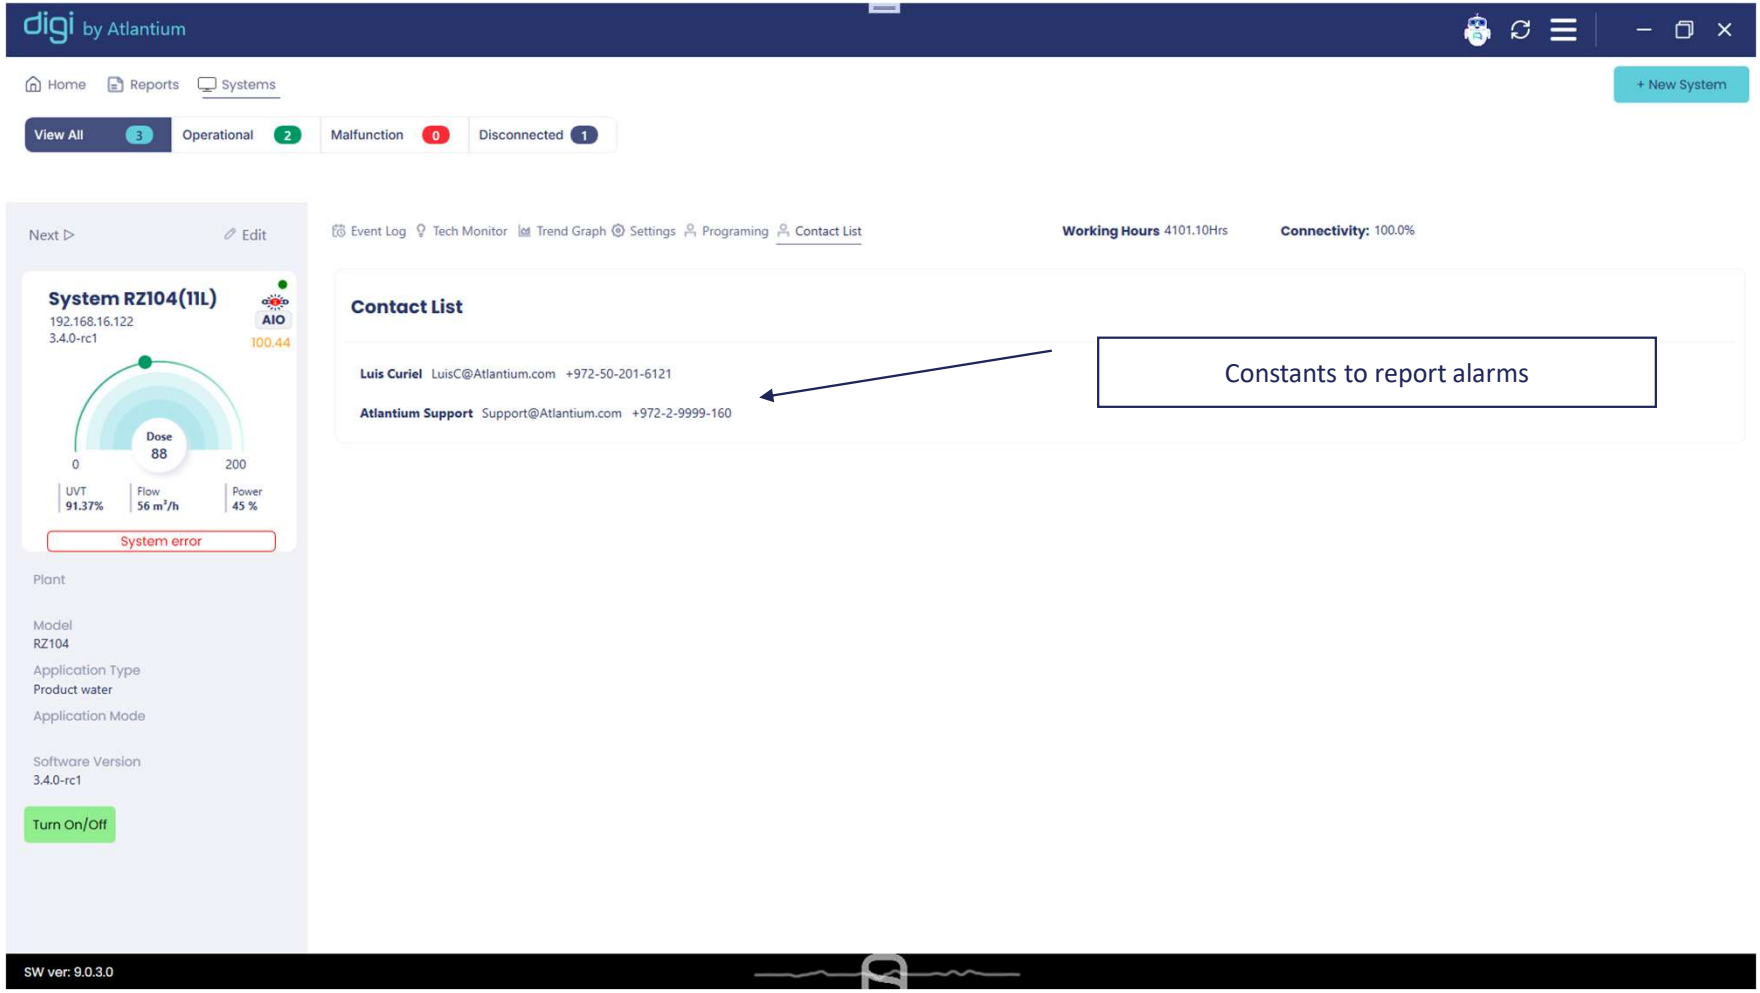
digi by Atlantium
Home
Reports
Systems
+ New System
View All 3
Operational 2
Malfunction 0
Disconnected 1
Next
Edit
System RZ104(11L)
192.168.16.122
3.4.0-rc1
AIO
100.44
Dose
88
0
200
UVT
91.37%
Flow
56 m³/h
Power
45 %
System error
Plant
Model
RZ104
Application Type
Product water
Application Mode
Software Version
3.4.0-rc1
Turn On/Off
Event Log
Tech Monitor
Trend Graph
Settings
Programing
Contact List
Working Hours 4101.10Hrs
Connectivity: 100.0%
Contact List
Luis Curiel LuisC@Atlantium.com +972-50-201-6121
Atlantium Support Support@Atlantium.com +972-2-9999-160
Constants to report alarms
SW ver: 9.0.3.0

Reports

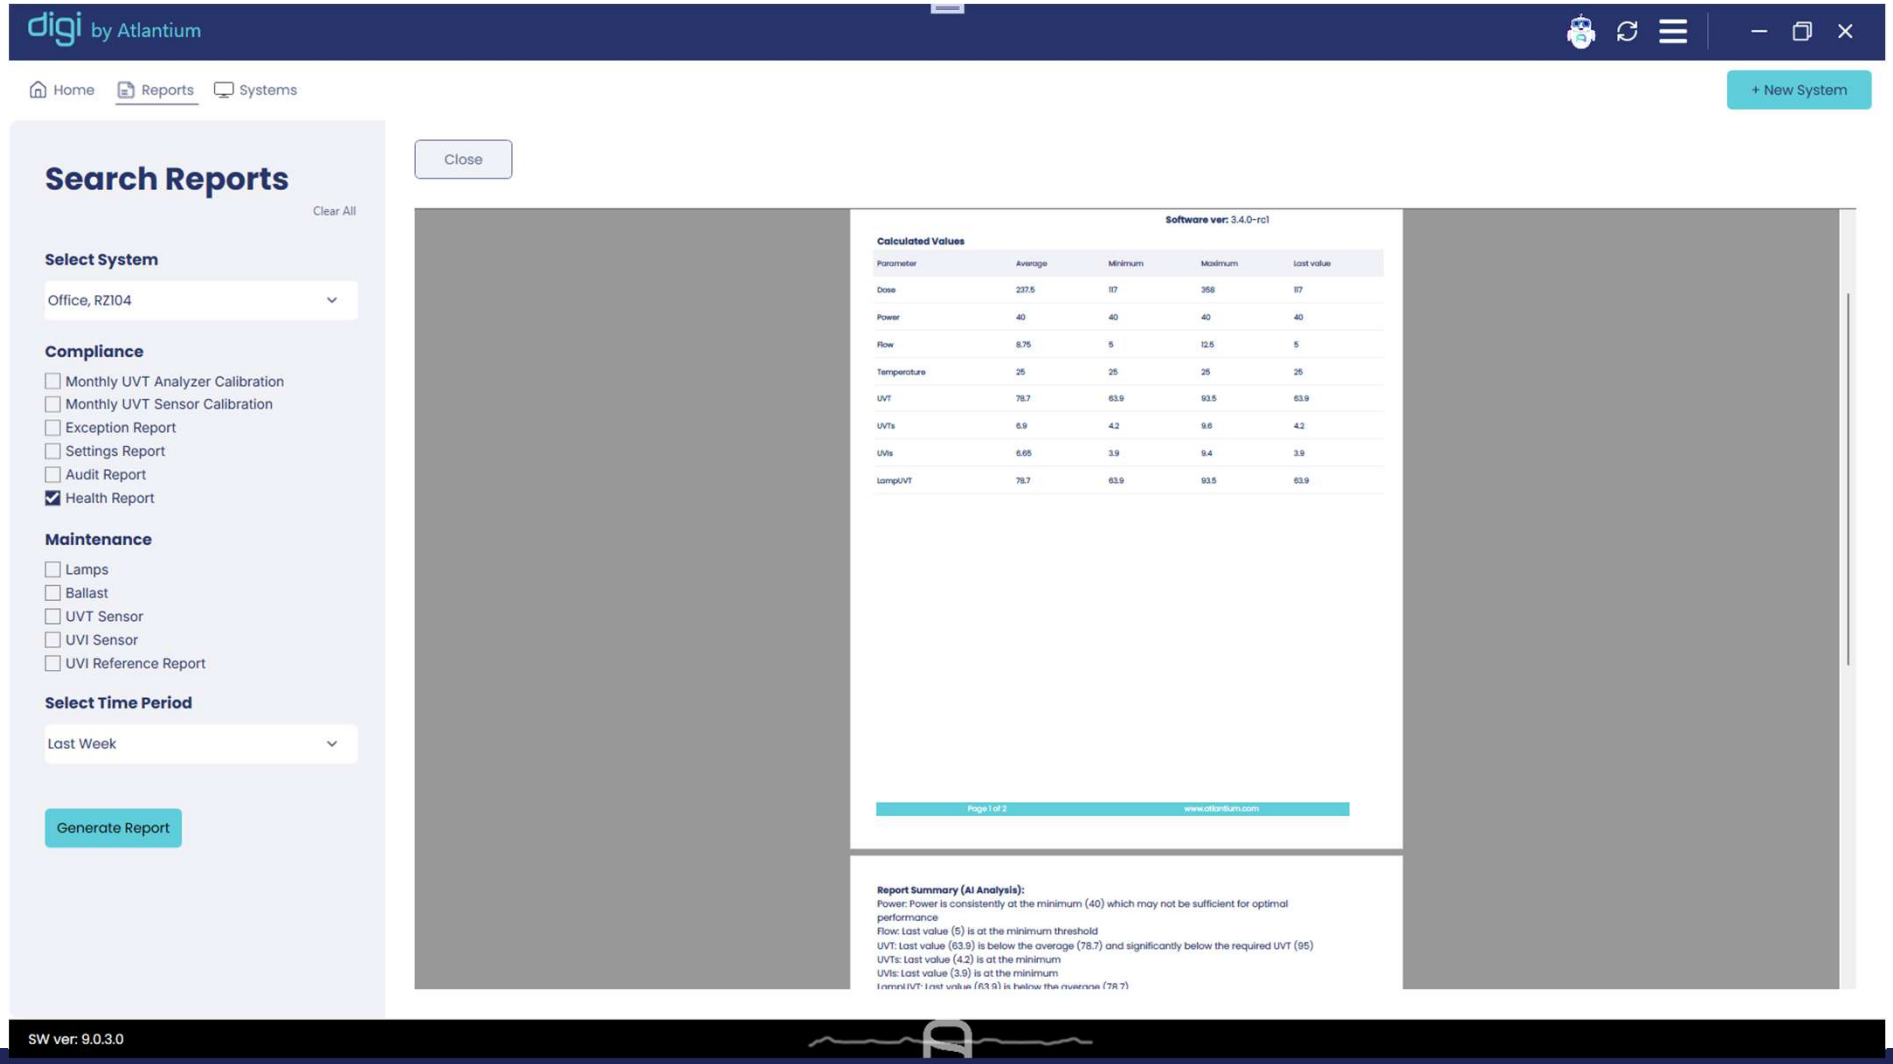
digi by Atlantium
Home
Reports
Systems
+ New System
Search Reports
Clear All
Select System
Office, RZ104
Compliance
Monthly UVT Analyzer Calibration
Monthly UVT Sensor Calibration
Exception Report
Settings Report
Audit Report
Health Report
Maintenance
Lamps
Ballast
UVT Sensor
UVI Sensor
UVI Reference Report
Select Time Period
Last Week
Generate Report
Close
Software ver: 3.4.0-rc1
Calculated Values
Parameter | Average | Minimum | Maximum | Last value
Dose | 237.5 | 117 | 358 | 117
Power | 40 | 40 | 40 | 40
Flow | 8.75 | 5 | 12.5 | 5
Temperature | 25 | 25 | 25 | 25
UVT | 78.7 | 63.9 | 93.5 | 63.9
UVTs | 6.9 | 4.2 | 9.6 | 4.2
UVIs | 6.65 | 3.9 | 9.4 | 3.9
LampUVT | 78.7 | 63.9 | 93.5 | 63.9
Page 1 of 2
www.atlantium.com
Report Summary (AI Analysis):
Power: Power is consistently at the minimum (40) which may not be sufficient for optimal performance
Flow: Last value (5) is at the minimum threshold
UVT: Last value (63.9) is below the average (78.7) and significantly below the required UVT (95)
UVTs: Last value (4.2) is at the minimum
UVIs: Last value (3.9) is at the minimum
SW ver: 9.0.3.0

Digi bot

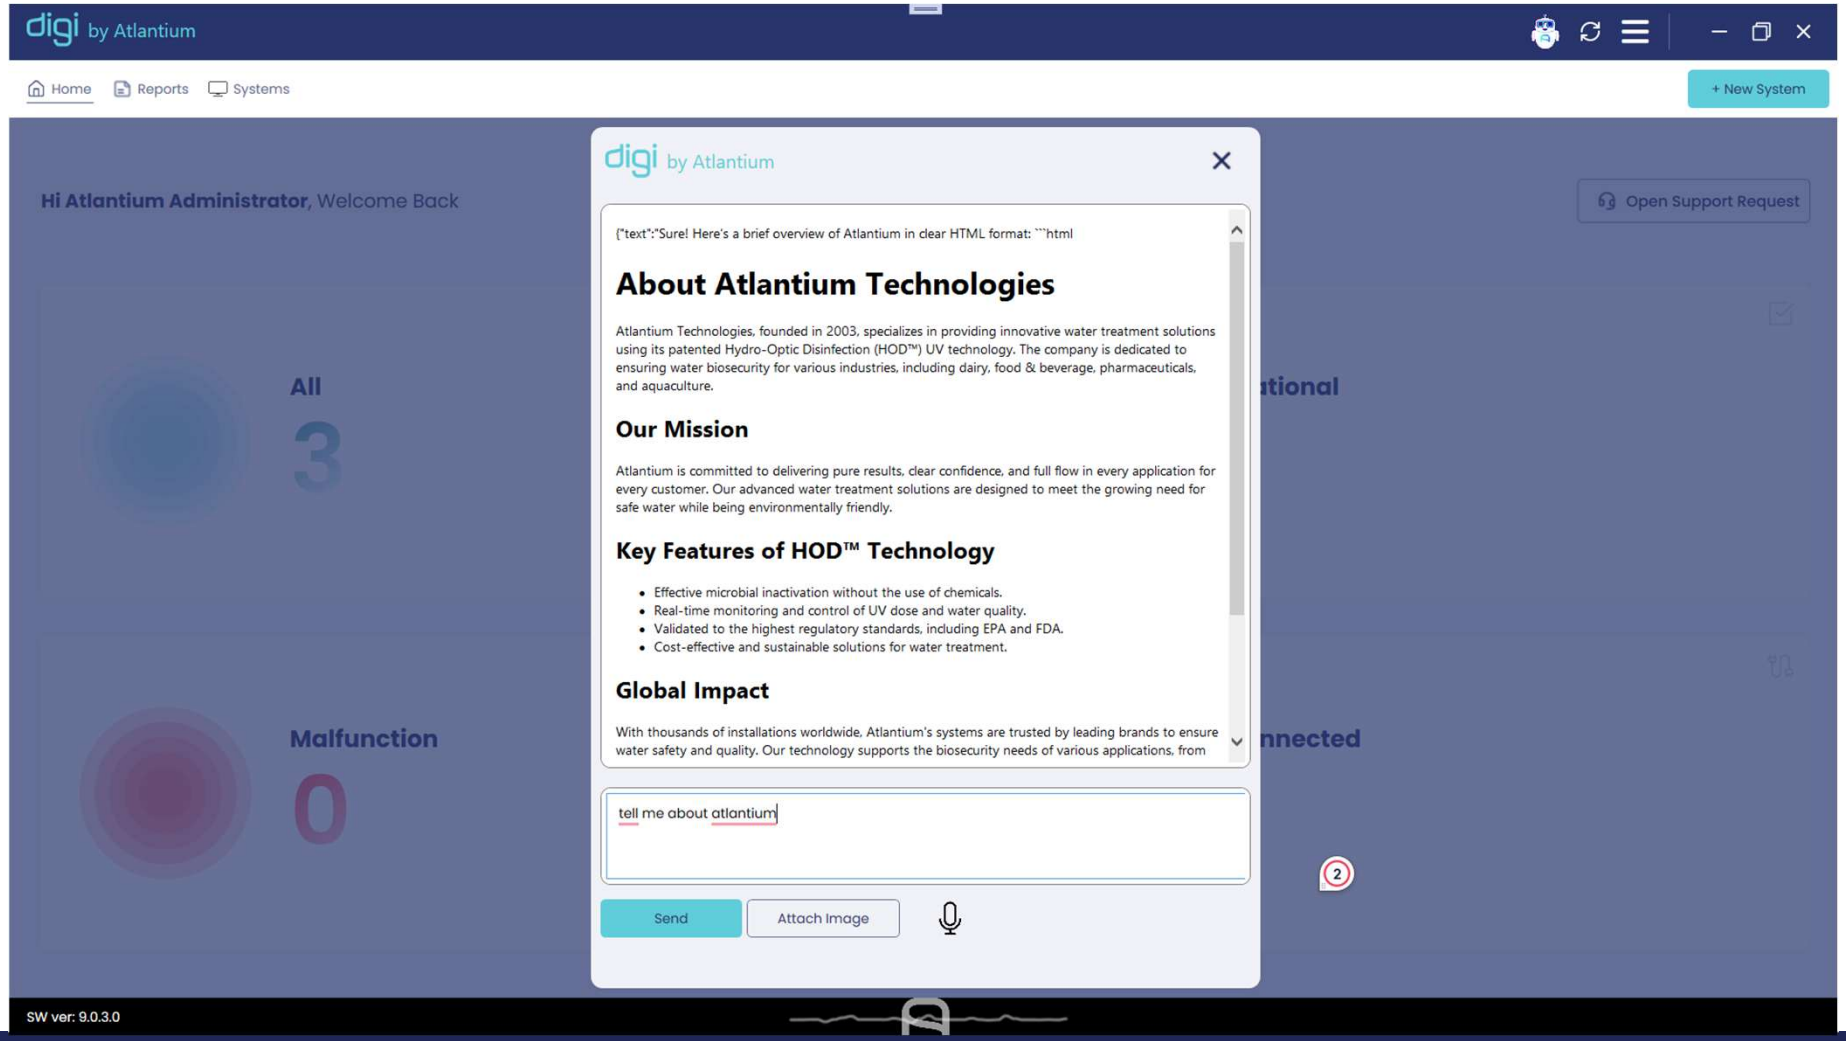
digi by Atlantium
Home
Reports
Systems
+ New System
Hi Atlantium Administrator, Welcome Back
Open Support Request
All
3
Malfunction
0
digi by Atlantium
{"text":"Sure! Here's a brief overview of Atlantium in clear HTML format: ```html
About Atlantium Technologies
Atlantium Technologies, founded in 2003, specializes in providing innovative water treatment solutions using its patented Hydro-Optic Disinfection (HOD™) UV technology. The company is dedicated to ensuring water biosecurity for various industries, including dairy, food & beverage, pharmaceuticals, and aquaculture.
Our Mission
Atlantium is committed to delivering pure results, clear confidence, and full flow in every application for every customer. Our advanced water treatment solutions are designed to meet the growing need for safe water while being environmentally friendly.
Key Features of HOD™ Technology
Effective microbial inactivation without the use of chemicals.
Real-time monitoring and control of UV dose and water quality.
Validated to the highest regulatory standards, including EPA and FDA.
Cost-effective and sustainable solutions for water treatment.
Global Impact
With thousands of installations worldwide, Atlantium's systems are trusted by leading brands to ensure water safety and quality. Our technology supports the biosecurity needs of various applications, from
tell me about atlantium
Send
Attach Image
SW ver: 9.0.3.0

Digi monitor screens map

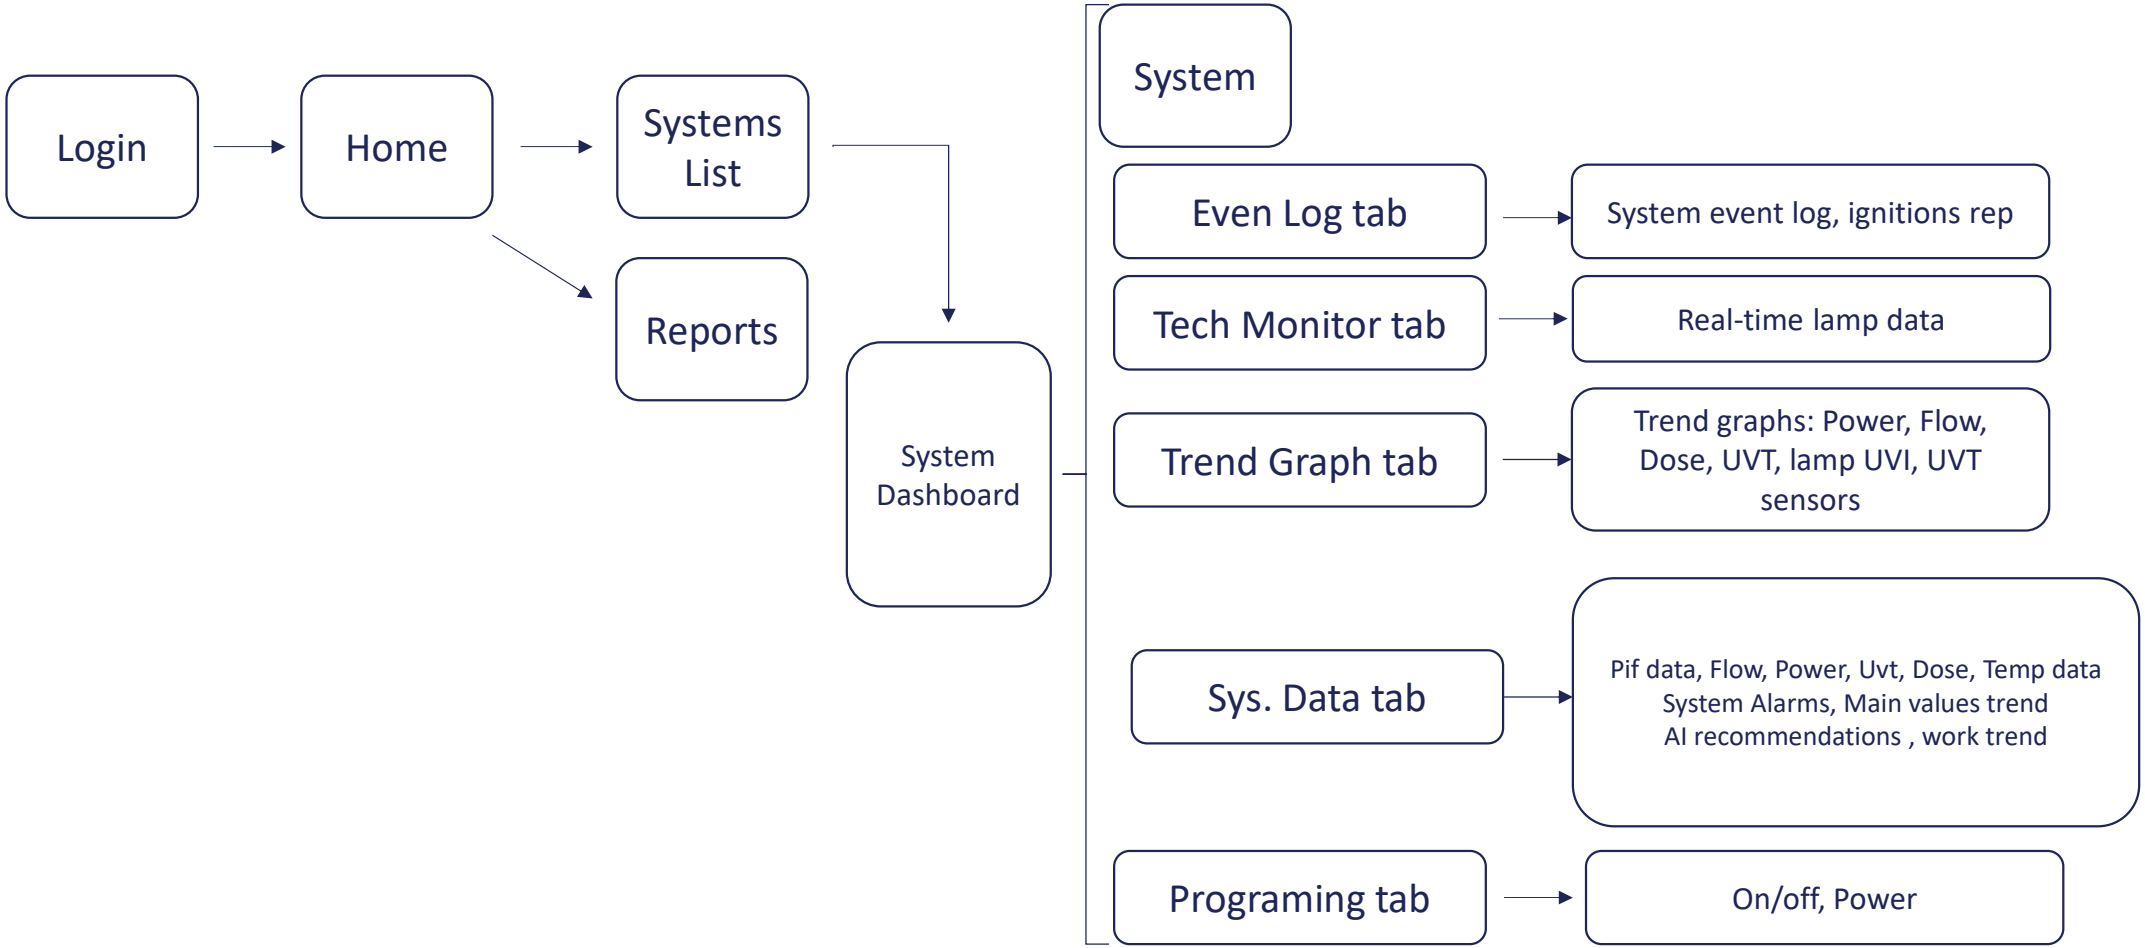

Thank You

ATLANTIUM
Pure Performance