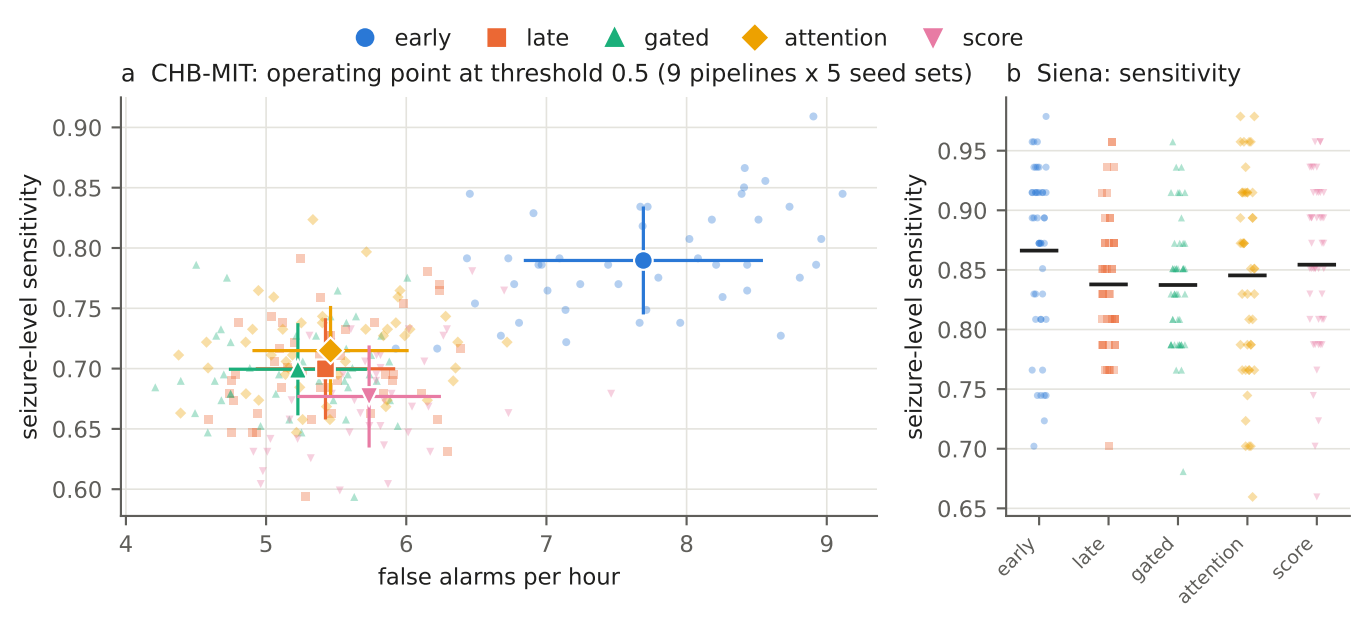
early
late
gated
attention
score
a CHB-MIT: operating point at threshold 0.5 (9 pipelines x 5 seed sets)
b Siena: sensitivity
seizure-level sensitivity
0.90
0.85
0.80
0.75
0.70
0.65
0.60
4
5
6
7
8
9
false alarms per hour
seizure-level sensitivity
0.95
0.90
0.85
0.80
0.75
0.70
0.65
early
late
gated
attention
score