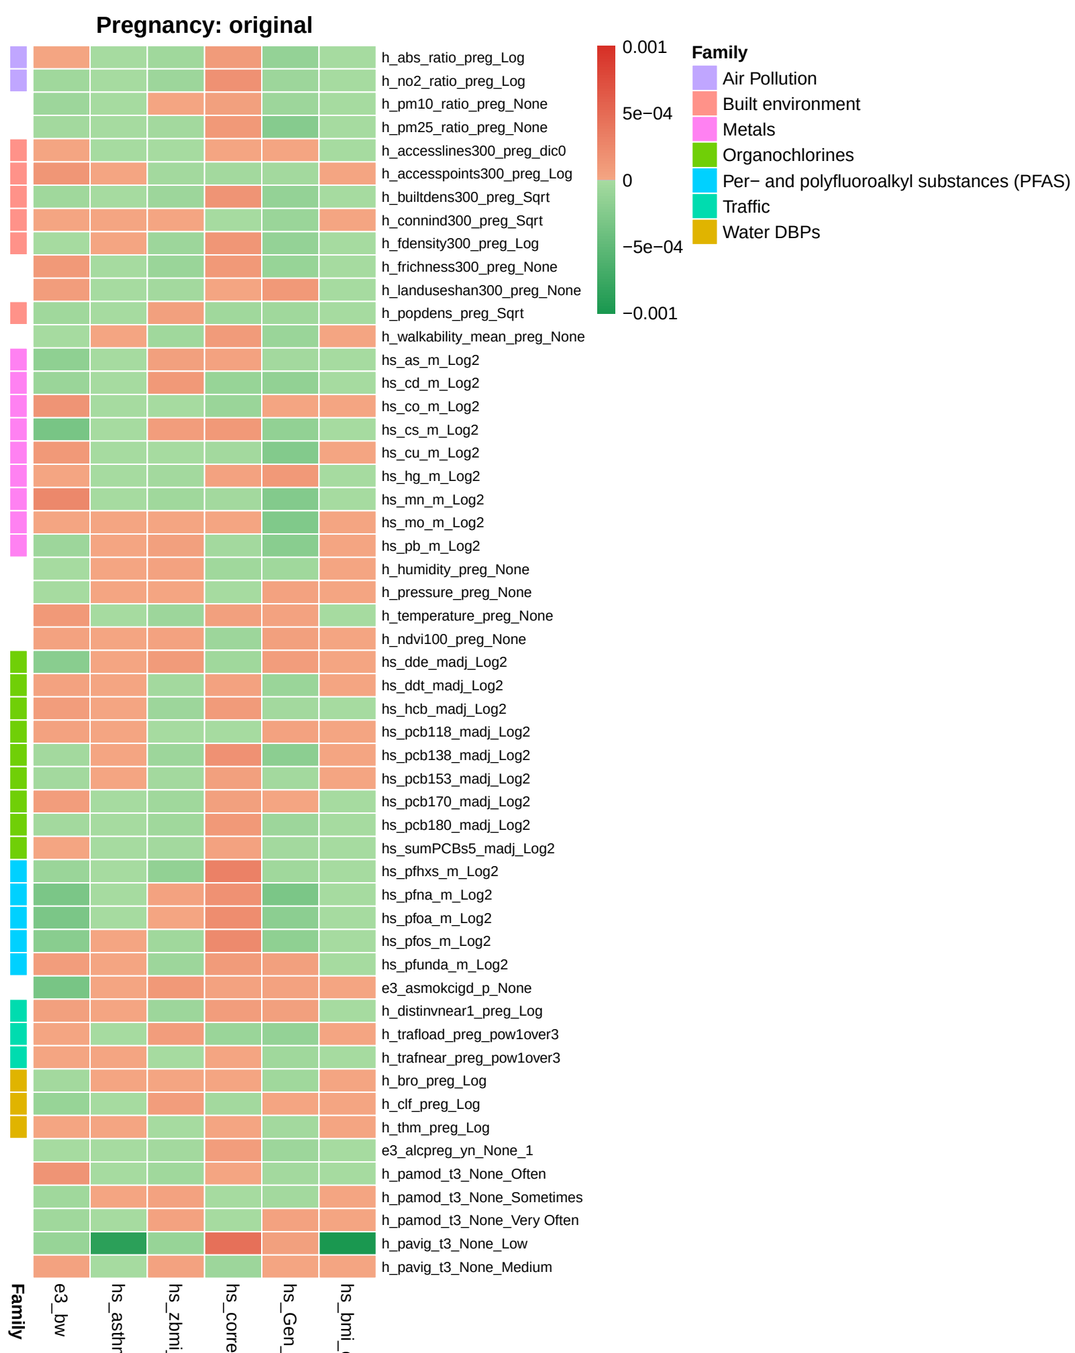
Pregnancy: original
h_abs_ratio_preg_Log
h_no2_ratio_preg_Log
h_pm10_ratio_preg_None
h_pm25_ratio_preg_None
h_accesslines300_preg_dic0
h_accesspoints300_preg_Log
h_builtdens300_preg_Sqrt
h_connind300_preg_Sqrt
h_fdensity300_preg_Log
h_frichness300_preg_None
h_landuseshan300_preg_None
h_popdens_preg_Sqrt
h_walkability_mean_preg_None
hs_as_m_Log2
hs_cd_m_Log2
hs_co_m_Log2
hs_cs_m_Log2
hs_cu_m_Log2
hs_hg_m_Log2
hs_mn_m_Log2
hs_mo_m_Log2
hs_pb_m_Log2
h_humidity_preg_None
h_pressure_preg_None
h_temperature_preg_None
h_ndvi100_preg_None
hs_dde_madj_Log2
hs_ddt_madj_Log2
hs_hcb_madj_Log2
hs_pcb118_madj_Log2
hs_pcb138_madj_Log2
hs_pcb153_madj_Log2
hs_pcb170_madj_Log2
hs_pcb180_madj_Log2
hs_sumPCBs5_madj_Log2
hs_pfhxs_m_Log2
hs_pfna_m_Log2
hs_pfoa_m_Log2
hs_pfos_m_Log2
hs_pfunda_m_Log2
e3_asmokcigd_p_None
h_distinvnear1_preg_Log
h_trafload_preg_pow1over3
h_trafnear_preg_pow1over3
h_bro_preg_Log
h_clf_preg_Log
h_thm_preg_Log
e3_alcpreg_yn_None_1
h_pamod_t3_None_Often
h_pamod_t3_None_Sometimes
h_pamod_t3_None_Very Often
h_pavig_t3_None_Low
h_pavig_t3_None_Medium
hs_bmi_c_cat
hs_Gen_Tot
hs_correct_raven
hs_zbmi_who
hs_asthma
e3_bw
Family
0.001
5e−04
0
−5e−04
−0.001
Family
Air Pollution
Built environment
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic
Water DBPs

Pregnancy: bootstrap stable
sel_prob >= 0.9; sign_consistency >= 0.8
h_abs_ratio_preg_Log
h_no2_ratio_preg_Log
h_pm10_ratio_preg_None
h_pm25_ratio_preg_None
h_accesslines300_preg_dic0
h_accesspoints300_preg_Log
h_builtdens300_preg_Sqrt
h_connind300_preg_Sqrt
h_fdensity300_preg_Log
h_frichness300_preg_None
h_landuseshan300_preg_None
h_popdens_preg_Sqrt
h_walkability_mean_preg_None
hs_as_m_Log2
hs_cd_m_Log2
hs_co_m_Log2
hs_cs_m_Log2
hs_cu_m_Log2
hs_hg_m_Log2
hs_mn_m_Log2
hs_mo_m_Log2
hs_pb_m_Log2
h_humidity_preg_None
h_pressure_preg_None
h_temperature_preg_None
h_ndvi100_preg_None
hs_dde_madj_Log2
hs_ddt_madj_Log2
hs_hcb_madj_Log2
hs_pcb118_madj_Log2
hs_pcb138_madj_Log2
hs_pcb153_madj_Log2
hs_pcb170_madj_Log2
hs_pcb180_madj_Log2
hs_sumPCBs5_madj_Log2
hs_pfhxs_m_Log2
hs_pfna_m_Log2
hs_pfoa_m_Log2
hs_pfos_m_Log2
hs_pfunda_m_Log2
e3_asmokcigd_p_None
h_distinvnear1_preg_Log
h_trafload_preg_pow1over3
h_trafnear_preg_pow1over3
h_bro_preg_Log
h_clf_preg_Log
h_thm_preg_Log
e3_alcpreg_yn_None_1
h_pamod_t3_None_Often
h_pamod_t3_None_Sometimes
h_pamod_t3_None_Very Often
h_pavig_t3_None_Low
h_pavig_t3_None_Medium
hs_bmi_c_cat
hs_Gen_Tot
hs_correct_raven
hs_zbmi_who
hs_asthma
e3_bw
Family
0.001
5e−04
0
−5e−04
−0.001
Family
Air Pollution
Built environment
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic
Water DBPs

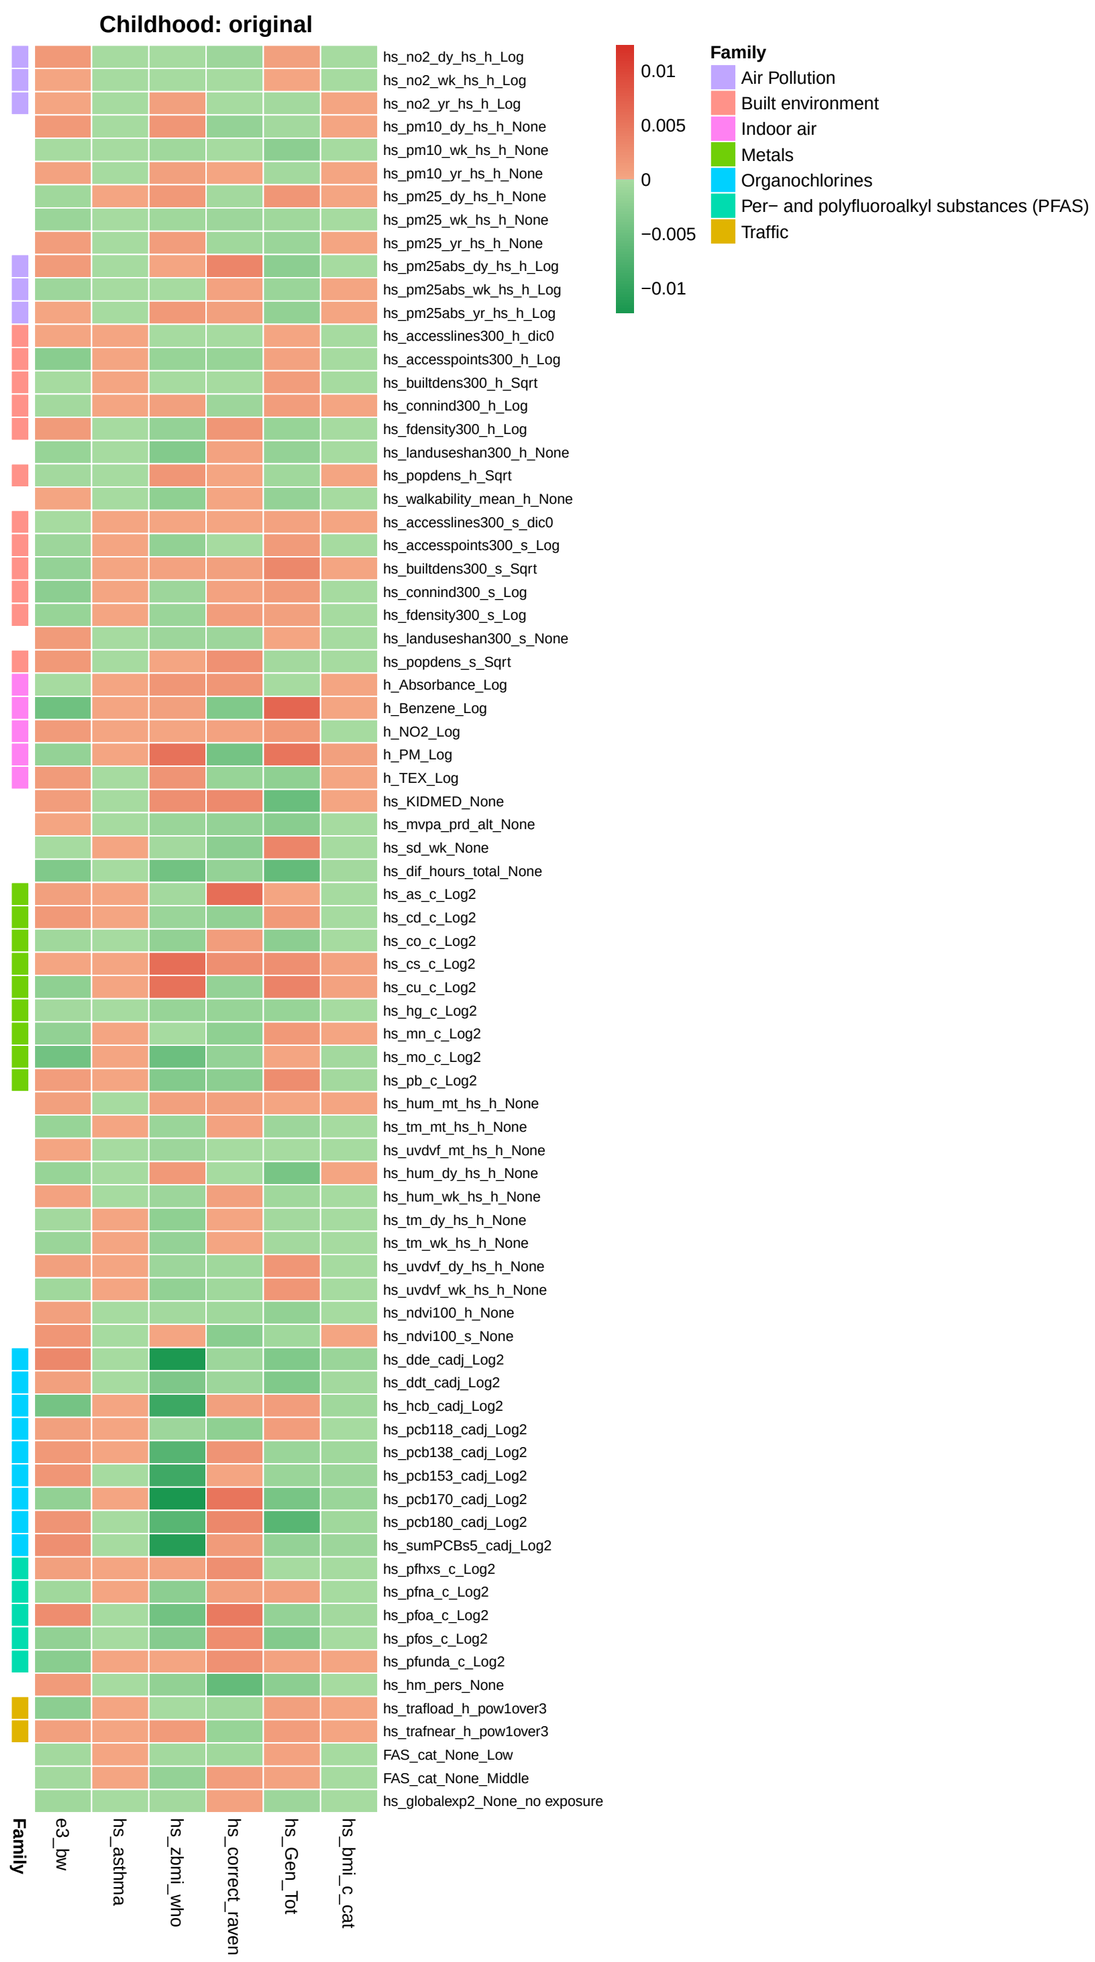
Childhood: original
hs_no2_dy_hs_h_Log
hs_no2_wk_hs_h_Log
hs_no2_yr_hs_h_Log
hs_pm10_dy_hs_h_None
hs_pm10_wk_hs_h_None
hs_pm10_yr_hs_h_None
hs_pm25_dy_hs_h_None
hs_pm25_wk_hs_h_None
hs_pm25_yr_hs_h_None
hs_pm25abs_dy_hs_h_Log
hs_pm25abs_wk_hs_h_Log
hs_pm25abs_yr_hs_h_Log
hs_accesslines300_h_dic0
hs_accesspoints300_h_Log
hs_builtdens300_h_Sqrt
hs_connind300_h_Log
hs_fdensity300_h_Log
hs_landuseshan300_h_None
hs_popdens_h_Sqrt
hs_walkability_mean_h_None
hs_accesslines300_s_dic0
hs_accesspoints300_s_Log
hs_builtdens300_s_Sqrt
hs_connind300_s_Log
hs_fdensity300_s_Log
hs_landuseshan300_s_None
hs_popdens_s_Sqrt
h_Absorbance_Log
h_Benzene_Log
h_NO2_Log
h_PM_Log
h_TEX_Log
hs_KIDMED_None
hs_mvpa_prd_alt_None
hs_sd_wk_None
hs_dif_hours_total_None
hs_as_c_Log2
hs_cd_c_Log2
hs_co_c_Log2
hs_cs_c_Log2
hs_cu_c_Log2
hs_hg_c_Log2
hs_mn_c_Log2
hs_mo_c_Log2
hs_pb_c_Log2
hs_hum_mt_hs_h_None
hs_tm_mt_hs_h_None
hs_uvdvf_mt_hs_h_None
hs_hum_dy_hs_h_None
hs_hum_wk_hs_h_None
hs_tm_dy_hs_h_None
hs_tm_wk_hs_h_None
hs_uvdvf_dy_hs_h_None
hs_uvdvf_wk_hs_h_None
hs_ndvi100_h_None
hs_ndvi100_s_None
hs_dde_cadj_Log2
hs_ddt_cadj_Log2
hs_hcb_cadj_Log2
hs_pcb118_cadj_Log2
hs_pcb138_cadj_Log2
hs_pcb153_cadj_Log2
hs_pcb170_cadj_Log2
hs_pcb180_cadj_Log2
hs_sumPCBs5_cadj_Log2
hs_pfhxs_c_Log2
hs_pfna_c_Log2
hs_pfoa_c_Log2
hs_pfos_c_Log2
hs_pfunda_c_Log2
hs_hm_pers_None
hs_trafload_h_pow1over3
hs_trafnear_h_pow1over3
FAS_cat_None_Low
FAS_cat_None_Middle
hs_globalexp2_None_no exposure
Family
e3_bw
hs_asthma
hs_zbmi_who
hs_correct_raven
hs_Gen_Tot
hs_bmi_c_cat
0.01
0.005
0
−0.005
−0.01
Family
Air Pollution
Built environment
Indoor air
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic

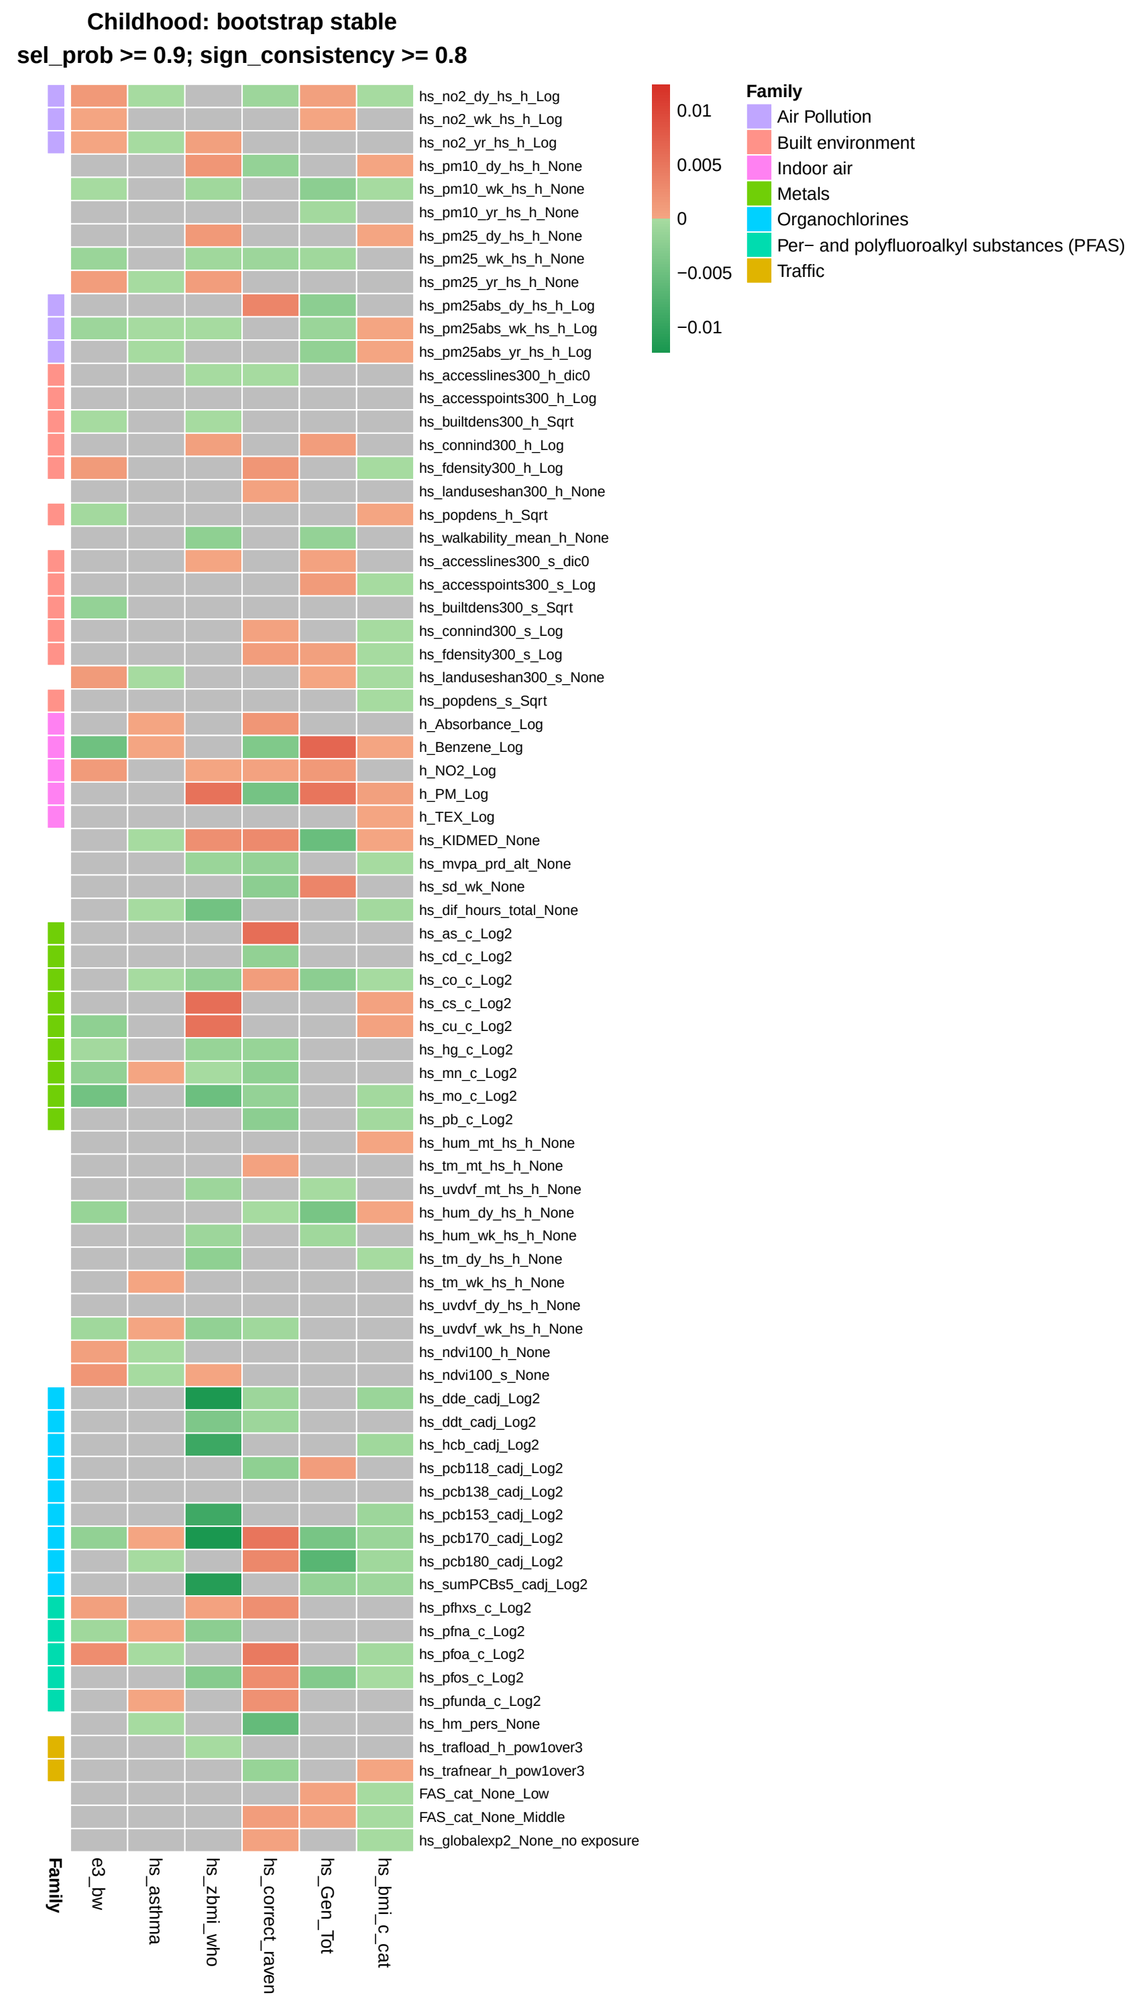
Childhood: bootstrap stable
sel_prob >= 0.9; sign_consistency >= 0.8
hs_no2_dy_hs_h_Log
hs_no2_wk_hs_h_Log
hs_no2_yr_hs_h_Log
hs_pm10_dy_hs_h_None
hs_pm10_wk_hs_h_None
hs_pm10_yr_hs_h_None
hs_pm25_dy_hs_h_None
hs_pm25_wk_hs_h_None
hs_pm25_yr_hs_h_None
hs_pm25abs_dy_hs_h_Log
hs_pm25abs_wk_hs_h_Log
hs_pm25abs_yr_hs_h_Log
hs_accesslines300_h_dic0
hs_accesspoints300_h_Log
hs_builtdens300_h_Sqrt
hs_connind300_h_Log
hs_fdensity300_h_Log
hs_landuseshan300_h_None
hs_popdens_h_Sqrt
hs_walkability_mean_h_None
hs_accesslines300_s_dic0
hs_accesspoints300_s_Log
hs_builtdens300_s_Sqrt
hs_connind300_s_Log
hs_fdensity300_s_Log
hs_landuseshan300_s_None
hs_popdens_s_Sqrt
h_Absorbance_Log
h_Benzene_Log
h_NO2_Log
h_PM_Log
h_TEX_Log
hs_KIDMED_None
hs_mvpa_prd_alt_None
hs_sd_wk_None
hs_dif_hours_total_None
hs_as_c_Log2
hs_cd_c_Log2
hs_co_c_Log2
hs_cs_c_Log2
hs_cu_c_Log2
hs_hg_c_Log2
hs_mn_c_Log2
hs_mo_c_Log2
hs_pb_c_Log2
hs_hum_mt_hs_h_None
hs_tm_mt_hs_h_None
hs_uvdvf_mt_hs_h_None
hs_hum_dy_hs_h_None
hs_hum_wk_hs_h_None
hs_tm_dy_hs_h_None
hs_tm_wk_hs_h_None
hs_uvdvf_dy_hs_h_None
hs_uvdvf_wk_hs_h_None
hs_ndvi100_h_None
hs_ndvi100_s_None
hs_dde_cadj_Log2
hs_ddt_cadj_Log2
hs_hcb_cadj_Log2
hs_pcb118_cadj_Log2
hs_pcb138_cadj_Log2
hs_pcb153_cadj_Log2
hs_pcb170_cadj_Log2
hs_pcb180_cadj_Log2
hs_sumPCBs5_cadj_Log2
hs_pfhxs_c_Log2
hs_pfna_c_Log2
hs_pfoa_c_Log2
hs_pfos_c_Log2
hs_pfunda_c_Log2
hs_hm_pers_None
hs_trafload_h_pow1over3
hs_trafnear_h_pow1over3
FAS_cat_None_Low
FAS_cat_None_Middle
hs_globalexp2_None_no exposure
Family
e3_bw
hs_asthma
hs_zbmi_who
hs_correct_raven
hs_Gen_Tot
hs_bmi_c_cat
0.01
0.005
0
−0.005
−0.01
Family
Air Pollution
Built environment
Indoor air
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic

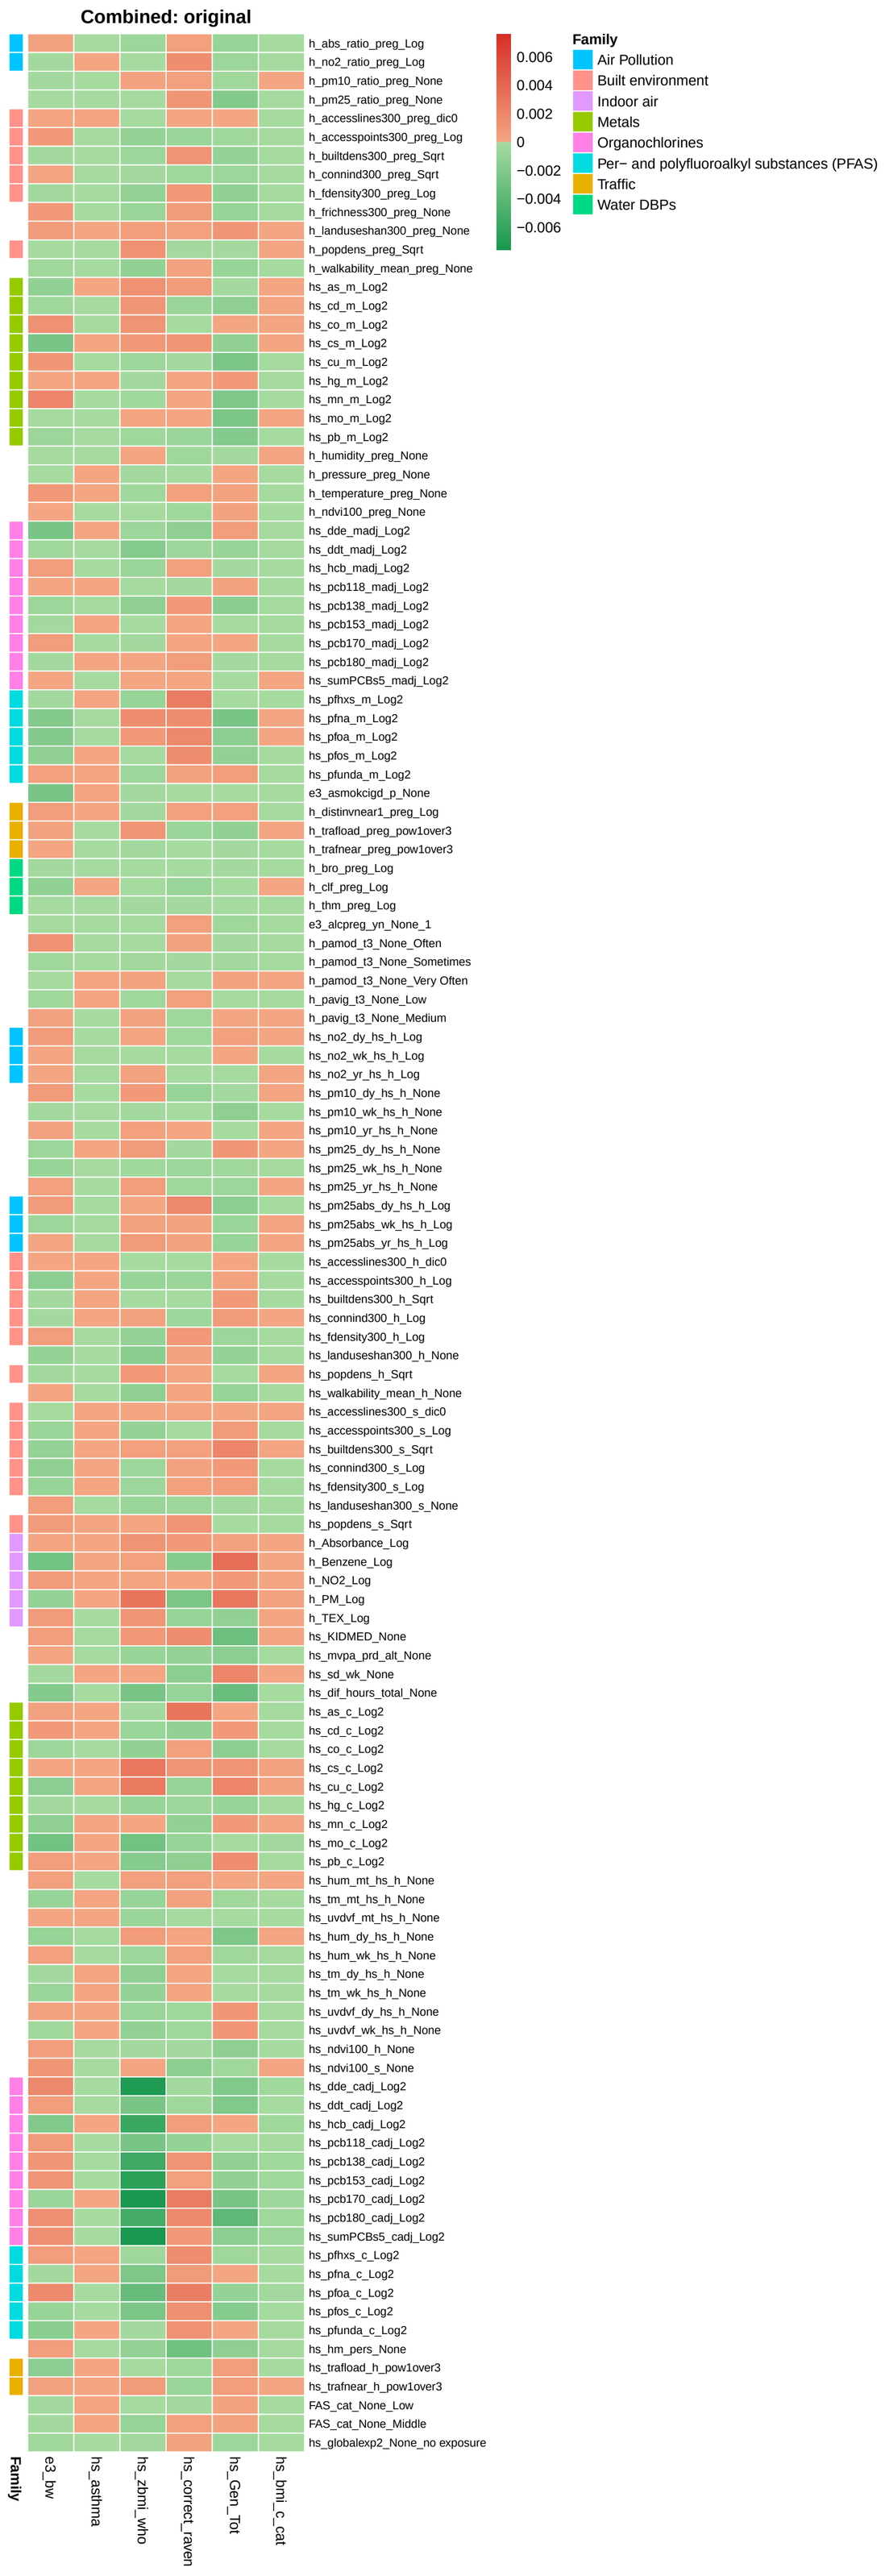
Combined: original
h_abs_ratio_preg_Log
h_no2_ratio_preg_Log
h_pm10_ratio_preg_None
h_pm25_ratio_preg_None
h_accesslines300_preg_dic0
h_accesspoints300_preg_Log
h_builtdens300_preg_Sqrt
h_connind300_preg_Sqrt
h_fdensity300_preg_Log
h_frichness300_preg_None
h_landuseshan300_preg_None
h_popdens_preg_Sqrt
h_walkability_mean_preg_None
hs_as_m_Log2
hs_cd_m_Log2
hs_co_m_Log2
hs_cs_m_Log2
hs_cu_m_Log2
hs_hg_m_Log2
hs_mn_m_Log2
hs_mo_m_Log2
hs_pb_m_Log2
h_humidity_preg_None
h_pressure_preg_None
h_temperature_preg_None
h_ndvi100_preg_None
hs_dde_madj_Log2
hs_ddt_madj_Log2
hs_hcb_madj_Log2
hs_pcb118_madj_Log2
hs_pcb138_madj_Log2
hs_pcb153_madj_Log2
hs_pcb170_madj_Log2
hs_pcb180_madj_Log2
hs_sumPCBs5_madj_Log2
hs_pfhxs_m_Log2
hs_pfna_m_Log2
hs_pfoa_m_Log2
hs_pfos_m_Log2
hs_pfunda_m_Log2
e3_asmokcigd_p_None
h_distinvnear1_preg_Log
h_trafload_preg_pow1over3
h_trafnear_preg_pow1over3
h_bro_preg_Log
h_clf_preg_Log
h_thm_preg_Log
e3_alcpreg_yn_None_1
h_pamod_t3_None_Often
h_pamod_t3_None_Sometimes
h_pamod_t3_None_Very Often
h_pavig_t3_None_Low
h_pavig_t3_None_Medium
hs_no2_dy_hs_h_Log
hs_no2_wk_hs_h_Log
hs_no2_yr_hs_h_Log
hs_pm10_dy_hs_h_None
hs_pm10_wk_hs_h_None
hs_pm10_yr_hs_h_None
hs_pm25_dy_hs_h_None
hs_pm25_wk_hs_h_None
hs_pm25_yr_hs_h_None
hs_pm25abs_dy_hs_h_Log
hs_pm25abs_wk_hs_h_Log
hs_pm25abs_yr_hs_h_Log
hs_accesslines300_h_dic0
hs_accesspoints300_h_Log
hs_builtdens300_h_Sqrt
hs_connind300_h_Log
hs_fdensity300_h_Log
hs_landuseshan300_h_None
hs_popdens_h_Sqrt
hs_walkability_mean_h_None
hs_accesslines300_s_dic0
hs_accesspoints300_s_Log
hs_builtdens300_s_Sqrt
hs_connind300_s_Log
hs_fdensity300_s_Log
hs_landuseshan300_s_None
hs_popdens_s_Sqrt
h_Absorbance_Log
h_Benzene_Log
h_NO2_Log
h_PM_Log
h_TEX_Log
hs_KIDMED_None
hs_mvpa_prd_alt_None
hs_sd_wk_None
hs_dif_hours_total_None
hs_as_c_Log2
hs_cd_c_Log2
hs_co_c_Log2
hs_cs_c_Log2
hs_cu_c_Log2
hs_hg_c_Log2
hs_mn_c_Log2
hs_mo_c_Log2
hs_pb_c_Log2
hs_hum_mt_hs_h_None
hs_tm_mt_hs_h_None
hs_uvdvf_mt_hs_h_None
hs_hum_dy_hs_h_None
hs_hum_wk_hs_h_None
hs_tm_dy_hs_h_None
hs_tm_wk_hs_h_None
hs_uvdvf_dy_hs_h_None
hs_uvdvf_wk_hs_h_None
hs_ndvi100_h_None
hs_ndvi100_s_None
hs_dde_cadj_Log2
hs_ddt_cadj_Log2
hs_hcb_cadj_Log2
hs_pcb118_cadj_Log2
hs_pcb138_cadj_Log2
hs_pcb153_cadj_Log2
hs_pcb170_cadj_Log2
hs_pcb180_cadj_Log2
hs_sumPCBs5_cadj_Log2
hs_pfhxs_c_Log2
hs_pfna_c_Log2
hs_pfoa_c_Log2
hs_pfos_c_Log2
hs_pfunda_c_Log2
hs_hm_pers_None
hs_trafload_h_pow1over3
hs_trafnear_h_pow1over3
FAS_cat_None_Low
FAS_cat_None_Middle
hs_globalexp2_None_no exposure
Family
e3_bw
hs_asthma
hs_zbmi_who
hs_correct_raven
hs_Gen_Tot
hs_bmi_c_cat
0.006
0.004
0.002
0
−0.002
−0.004
−0.006
Family
Air Pollution
Built environment
Indoor air
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic
Water DBPs

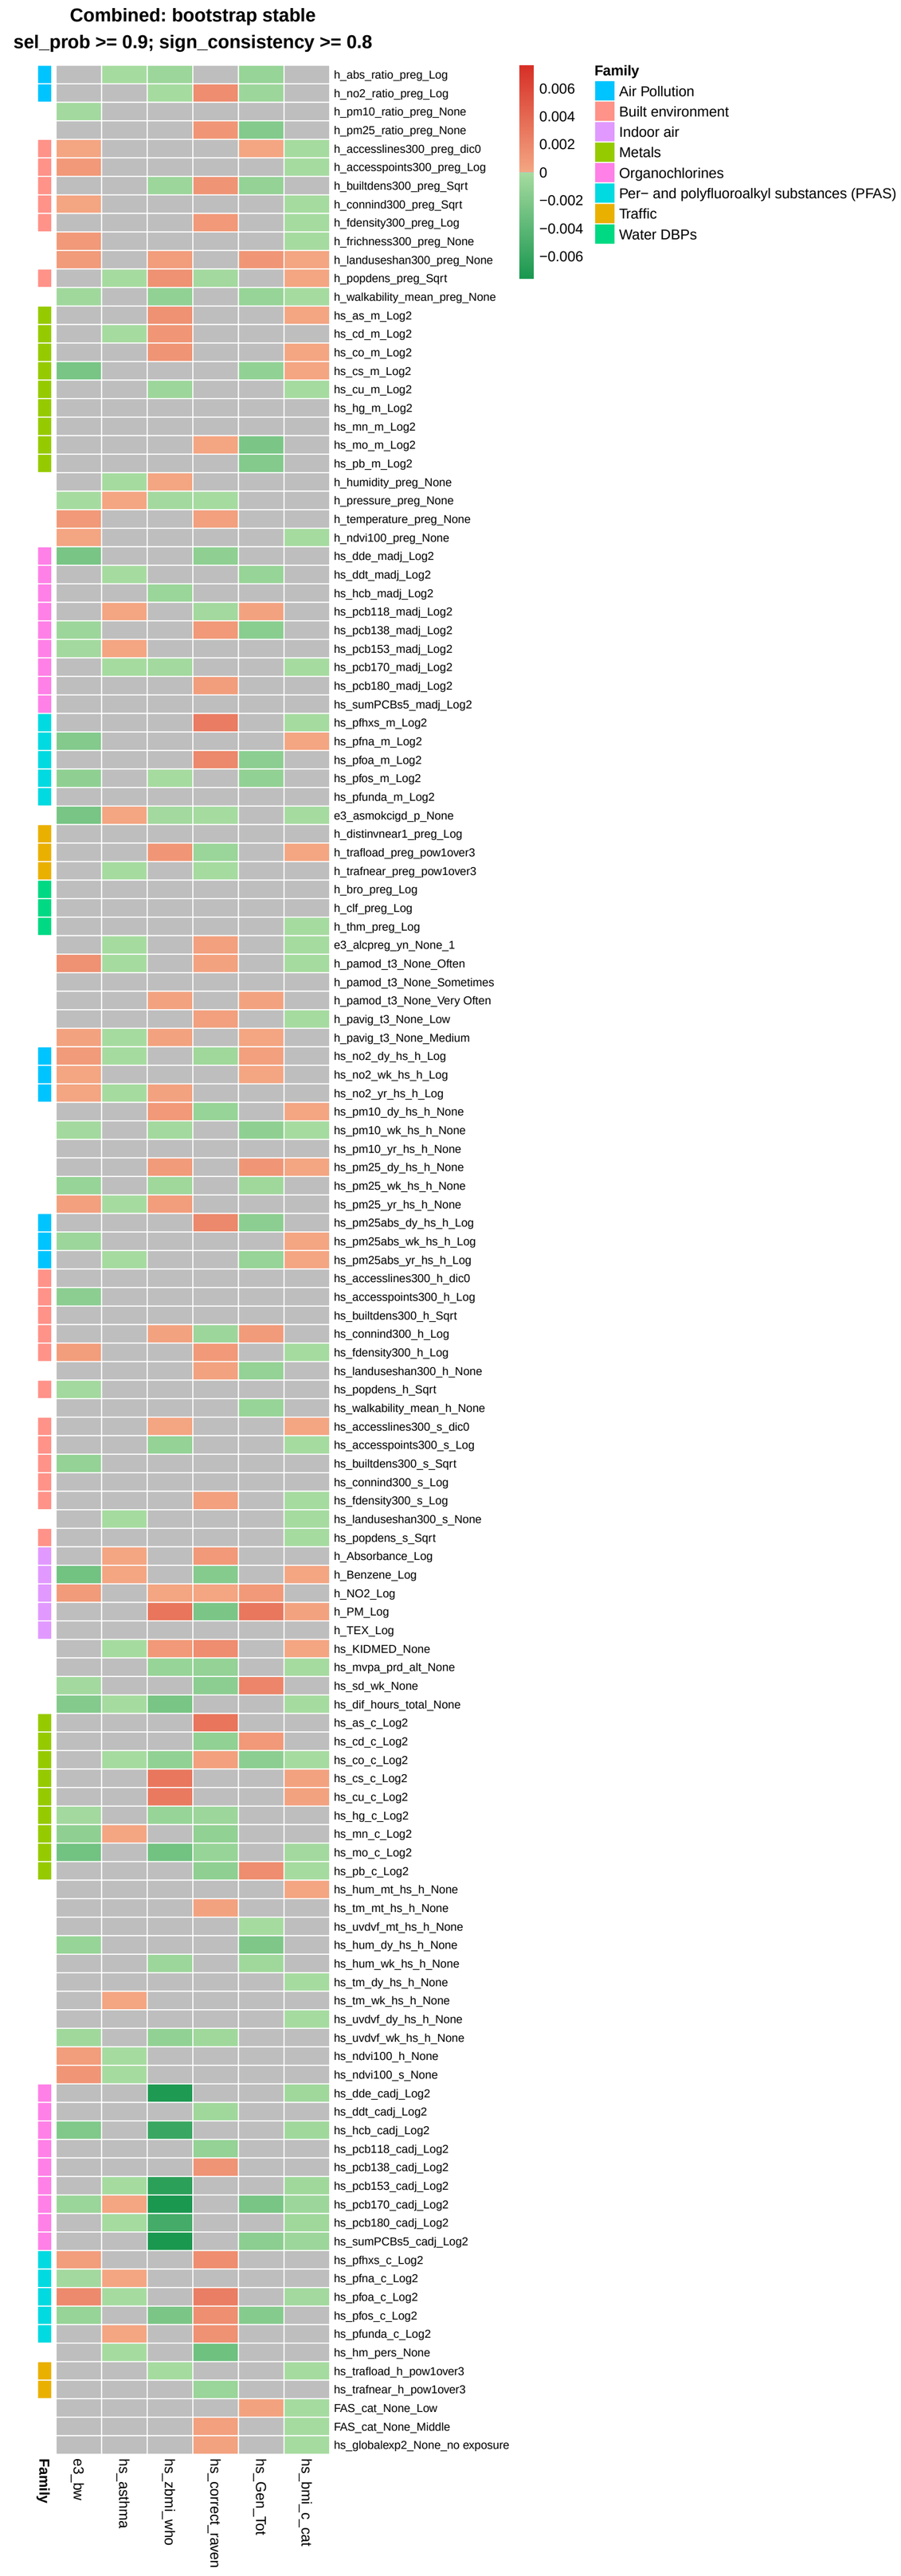
Combined: bootstrap stable
sel_prob >= 0.9; sign_consistency >= 0.8
h_abs_ratio_preg_Log
h_no2_ratio_preg_Log
h_pm10_ratio_preg_None
h_pm25_ratio_preg_None
h_accesslines300_preg_dic0
h_accesspoints300_preg_Log
h_builtdens300_preg_Sqrt
h_connind300_preg_Sqrt
h_fdensity300_preg_Log
h_frichness300_preg_None
h_landuseshan300_preg_None
h_popdens_preg_Sqrt
h_walkability_mean_preg_None
hs_as_m_Log2
hs_cd_m_Log2
hs_co_m_Log2
hs_cs_m_Log2
hs_cu_m_Log2
hs_hg_m_Log2
hs_mn_m_Log2
hs_mo_m_Log2
hs_pb_m_Log2
h_humidity_preg_None
h_pressure_preg_None
h_temperature_preg_None
h_ndvi100_preg_None
hs_dde_madj_Log2
hs_ddt_madj_Log2
hs_hcb_madj_Log2
hs_pcb118_madj_Log2
hs_pcb138_madj_Log2
hs_pcb153_madj_Log2
hs_pcb170_madj_Log2
hs_pcb180_madj_Log2
hs_sumPCBs5_madj_Log2
hs_pfhxs_m_Log2
hs_pfna_m_Log2
hs_pfoa_m_Log2
hs_pfos_m_Log2
hs_pfunda_m_Log2
e3_asmokcigd_p_None
h_distinvnear1_preg_Log
h_trafload_preg_pow1over3
h_trafnear_preg_pow1over3
h_bro_preg_Log
h_clf_preg_Log
h_thm_preg_Log
e3_alcpreg_yn_None_1
h_pamod_t3_None_Often
h_pamod_t3_None_Sometimes
h_pamod_t3_None_Very Often
h_pavig_t3_None_Low
h_pavig_t3_None_Medium
hs_no2_dy_hs_h_Log
hs_no2_wk_hs_h_Log
hs_no2_yr_hs_h_Log
hs_pm10_dy_hs_h_None
hs_pm10_wk_hs_h_None
hs_pm10_yr_hs_h_None
hs_pm25_dy_hs_h_None
hs_pm25_wk_hs_h_None
hs_pm25_yr_hs_h_None
hs_pm25abs_dy_hs_h_Log
hs_pm25abs_wk_hs_h_Log
hs_pm25abs_yr_hs_h_Log
hs_accesslines300_h_dic0
hs_accesspoints300_h_Log
hs_builtdens300_h_Sqrt
hs_connind300_h_Log
hs_fdensity300_h_Log
hs_landuseshan300_h_None
hs_popdens_h_Sqrt
hs_walkability_mean_h_None
hs_accesslines300_s_dic0
hs_accesspoints300_s_Log
hs_builtdens300_s_Sqrt
hs_connind300_s_Log
hs_fdensity300_s_Log
hs_landuseshan300_s_None
hs_popdens_s_Sqrt
h_Absorbance_Log
h_Benzene_Log
h_NO2_Log
h_PM_Log
h_TEX_Log
hs_KIDMED_None
hs_mvpa_prd_alt_None
hs_sd_wk_None
hs_dif_hours_total_None
hs_as_c_Log2
hs_cd_c_Log2
hs_co_c_Log2
hs_cs_c_Log2
hs_cu_c_Log2
hs_hg_c_Log2
hs_mn_c_Log2
hs_mo_c_Log2
hs_pb_c_Log2
hs_hum_mt_hs_h_None
hs_tm_mt_hs_h_None
hs_uvdvf_mt_hs_h_None
hs_hum_dy_hs_h_None
hs_hum_wk_hs_h_None
hs_tm_dy_hs_h_None
hs_tm_wk_hs_h_None
hs_uvdvf_dy_hs_h_None
hs_uvdvf_wk_hs_h_None
hs_ndvi100_h_None
hs_ndvi100_s_None
hs_dde_cadj_Log2
hs_ddt_cadj_Log2
hs_hcb_cadj_Log2
hs_pcb118_cadj_Log2
hs_pcb138_cadj_Log2
hs_pcb153_cadj_Log2
hs_pcb170_cadj_Log2
hs_pcb180_cadj_Log2
hs_sumPCBs5_cadj_Log2
hs_pfhxs_c_Log2
hs_pfna_c_Log2
hs_pfoa_c_Log2
hs_pfos_c_Log2
hs_pfunda_c_Log2
hs_hm_pers_None
hs_trafload_h_pow1over3
hs_trafnear_h_pow1over3
FAS_cat_None_Low
FAS_cat_None_Middle
hs_globalexp2_None_no exposure
Family
e3_bw
hs_asthma
hs_zbmi_who
hs_correct_raven
hs_Gen_Tot
hs_bmi_c_cat
0.006
0.004
0.002
0
−0.002
−0.004
−0.006
Family
Air Pollution
Built environment
Indoor air
Metals
Organochlorines
Per− and polyfluoroalkyl substances (PFAS)
Traffic
Water DBPs