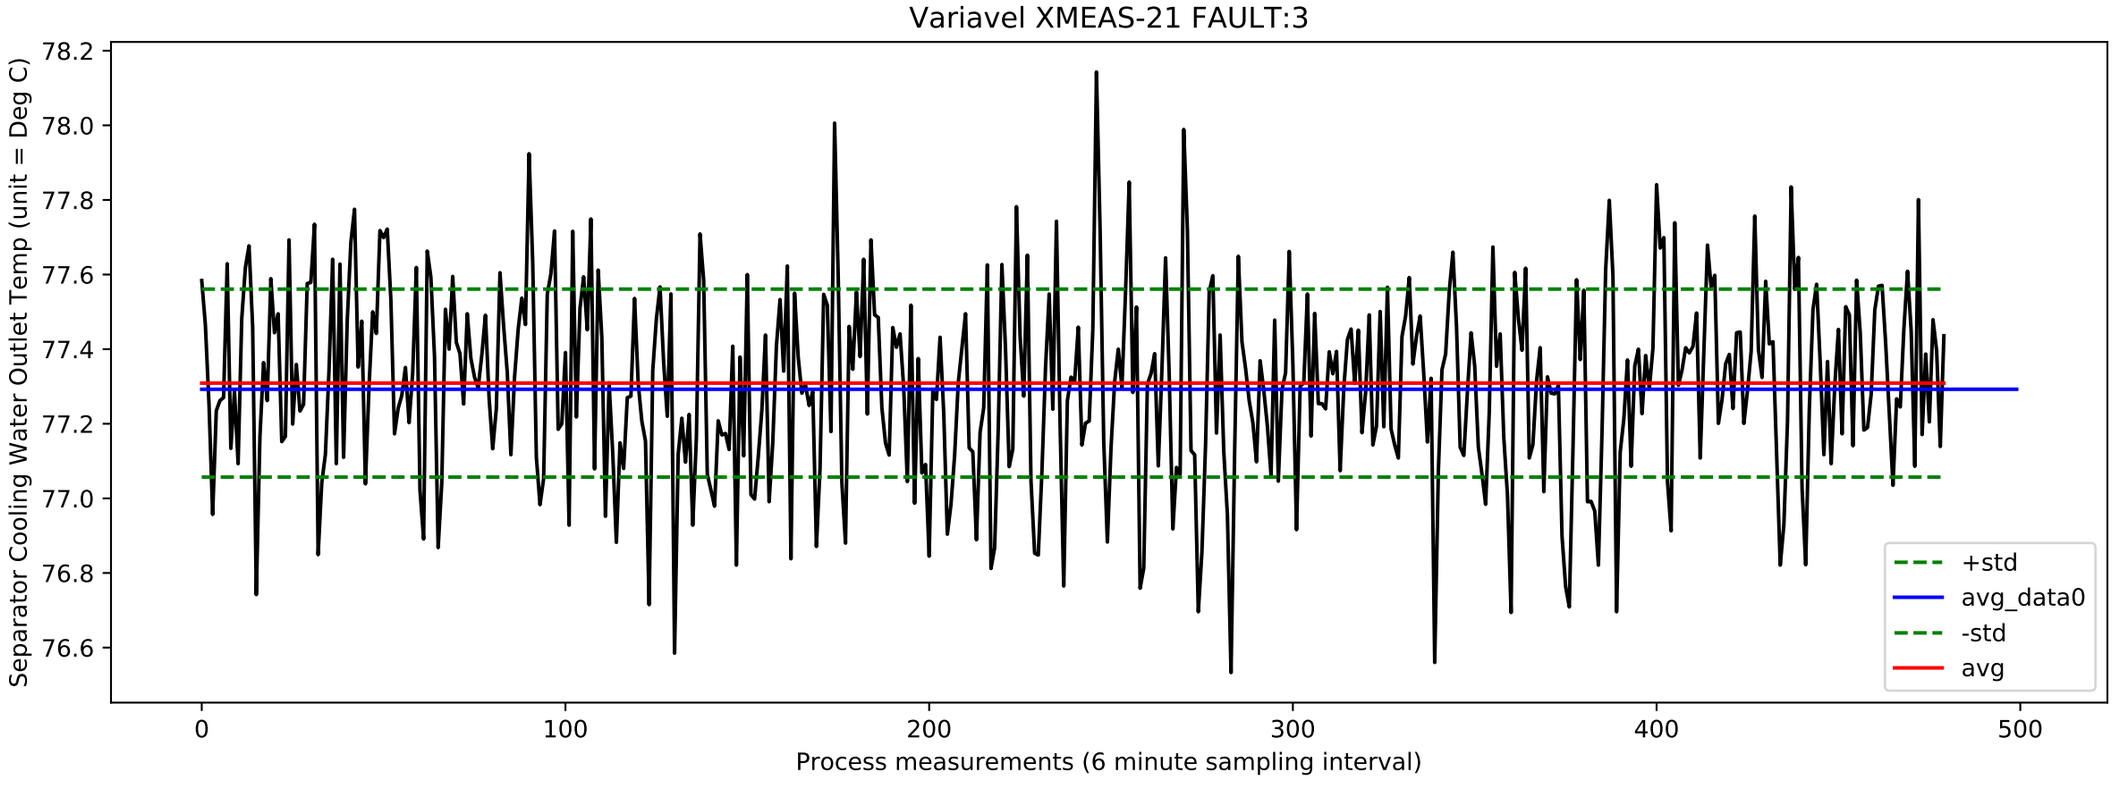
Variavel XMEAS-21 FAULT:3
Separator Cooling Water Outlet Temp (unit = Deg C)
78.2
78.0
77.8
77.6
77.4
77.2
77.0
76.8
76.6
0
100
200
300
400
500
Process measurements (6 minute sampling interval)
+std
avg_data0
-std
avg