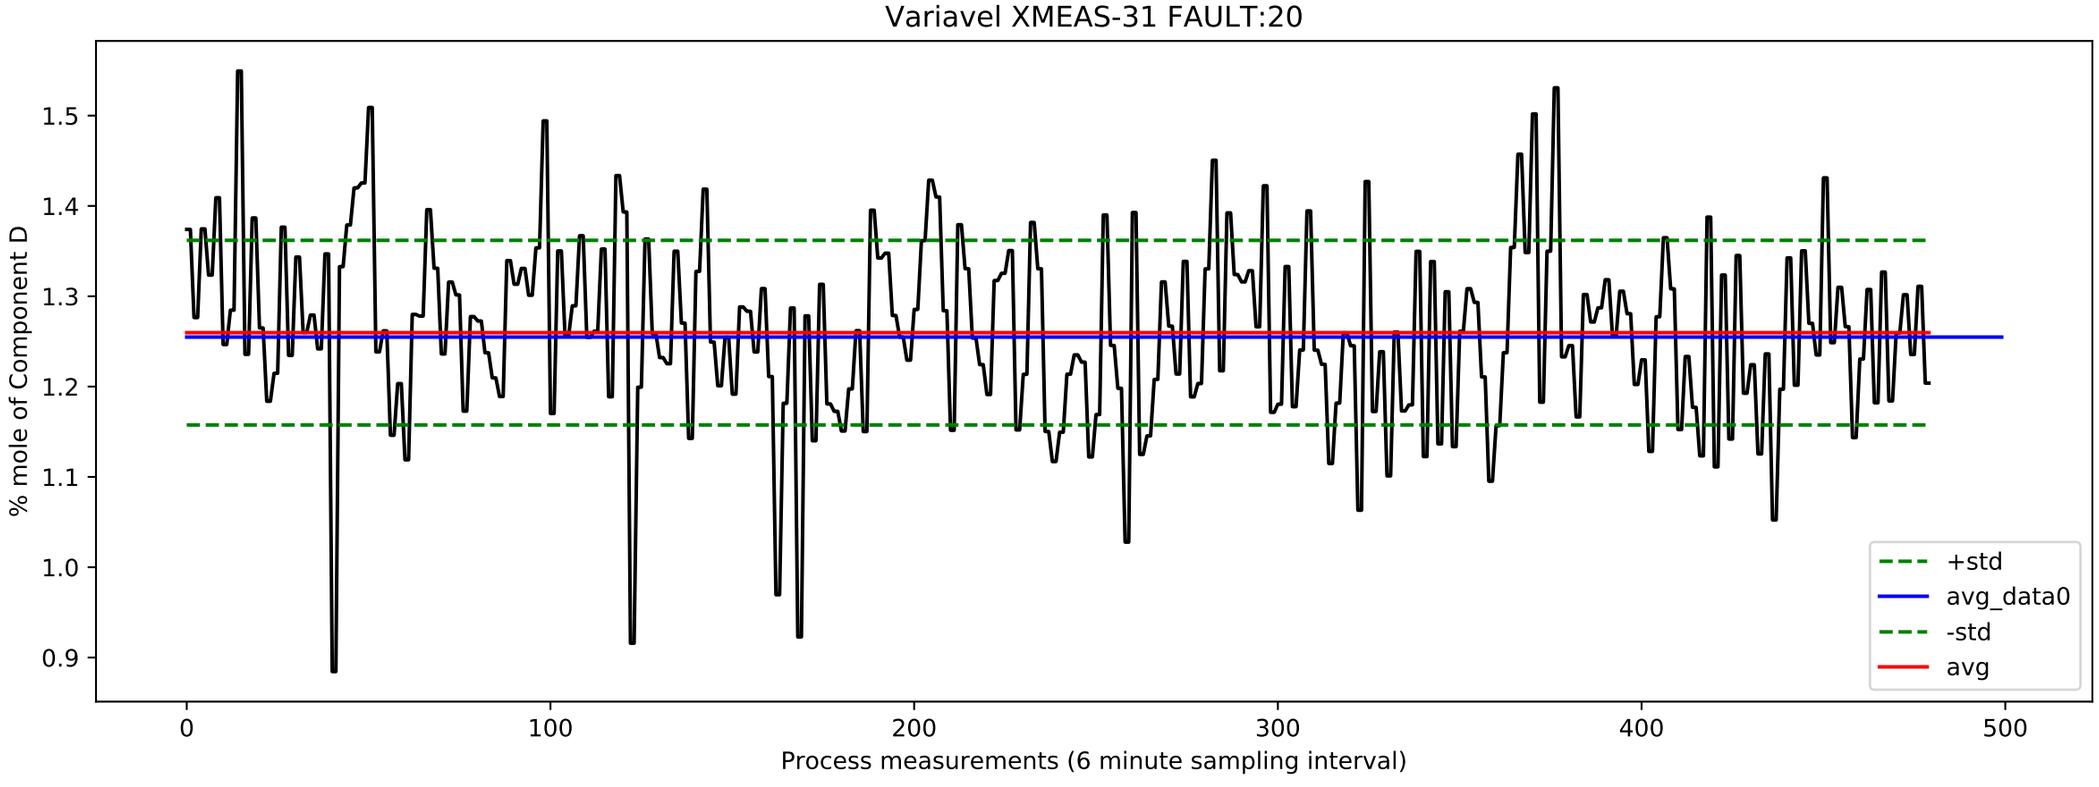
Variavel XMEAS-31 FAULT:20
% mole of Component D
1.5
1.4
1.3
1.2
1.1
1.0
0.9
0
100
200
300
400
500
Process measurements (6 minute sampling interval)
+std
avg_data0
-std
avg