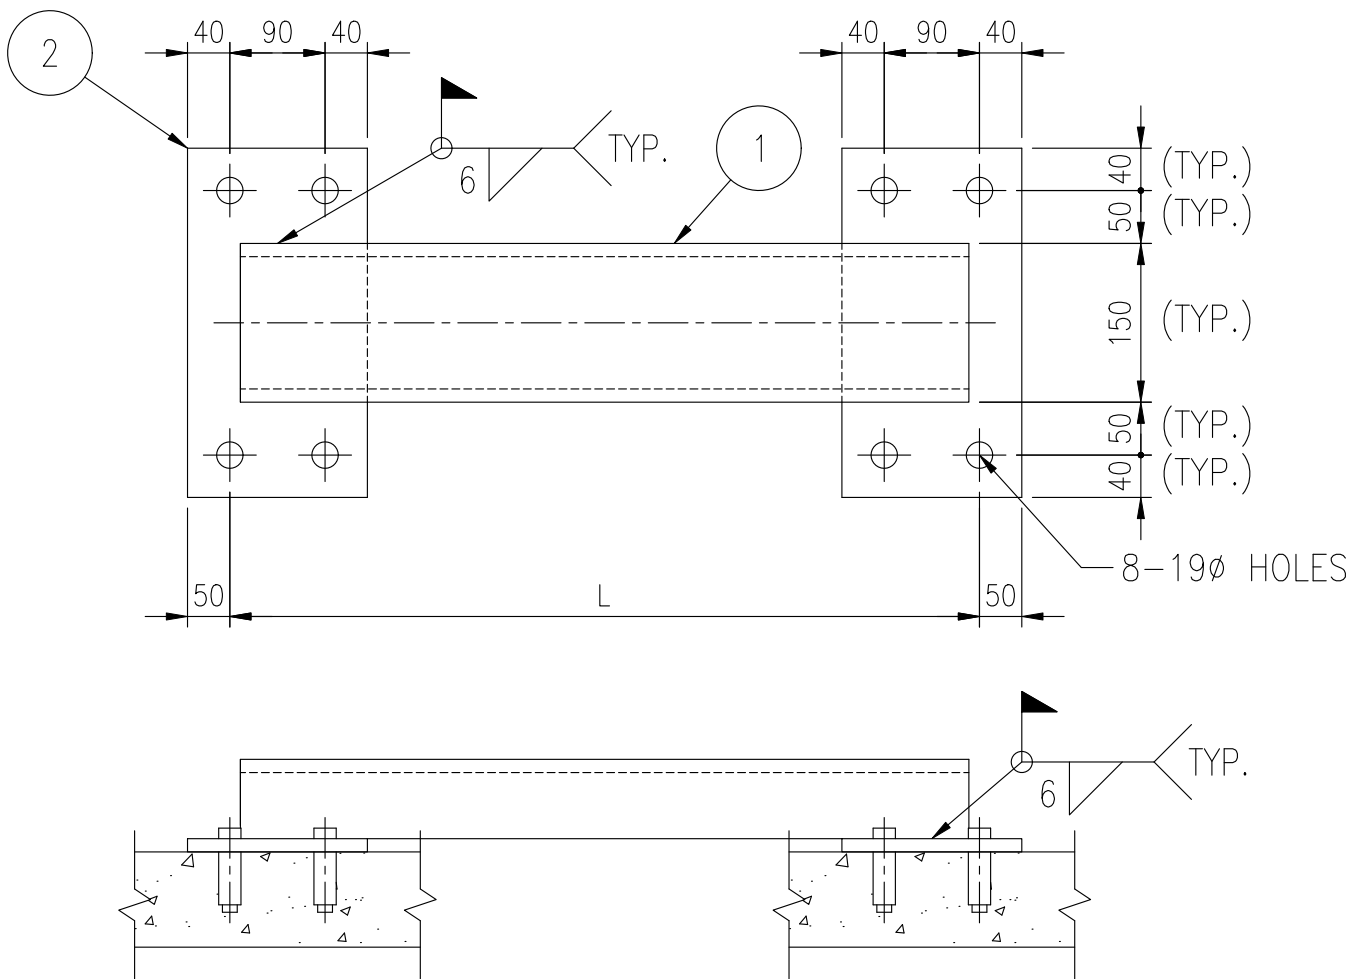






ITEM NO.	DESCRIPTION	SIZE	MAT'L	Q'TY	REMARK
1	CHANNEL	C150x75x6.5	A36	1	
2	BASE PLATE	PL.12tx170x330	A283 Gr.C	2	
3	EXPANSION BOLT	EB2-M16x125L	A307 Gr.8	8	REFER TO EB2

NOTES :

1. L max. = 1,500 mm
2. LENGTH "L" SHOULD BE CUT TO SUIT BY FIELD.
3. DESIGNATION NUMBER :

127- □ L

└── LENGTH OF SUPPORT "L"

PLAN	SPOOL
 F526-100L	 F526-100L NOTE:SHOWN ON THE LARGEST PIPE LINE.

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		D-137	
DATE	7/15/'24		APPR.	CHEN			
DETAIL OF PIPE SUPPORT TYPE-127 (1 OF 1)						REV. 1	