



FOR PIPE SIZE 3/4" - 24"

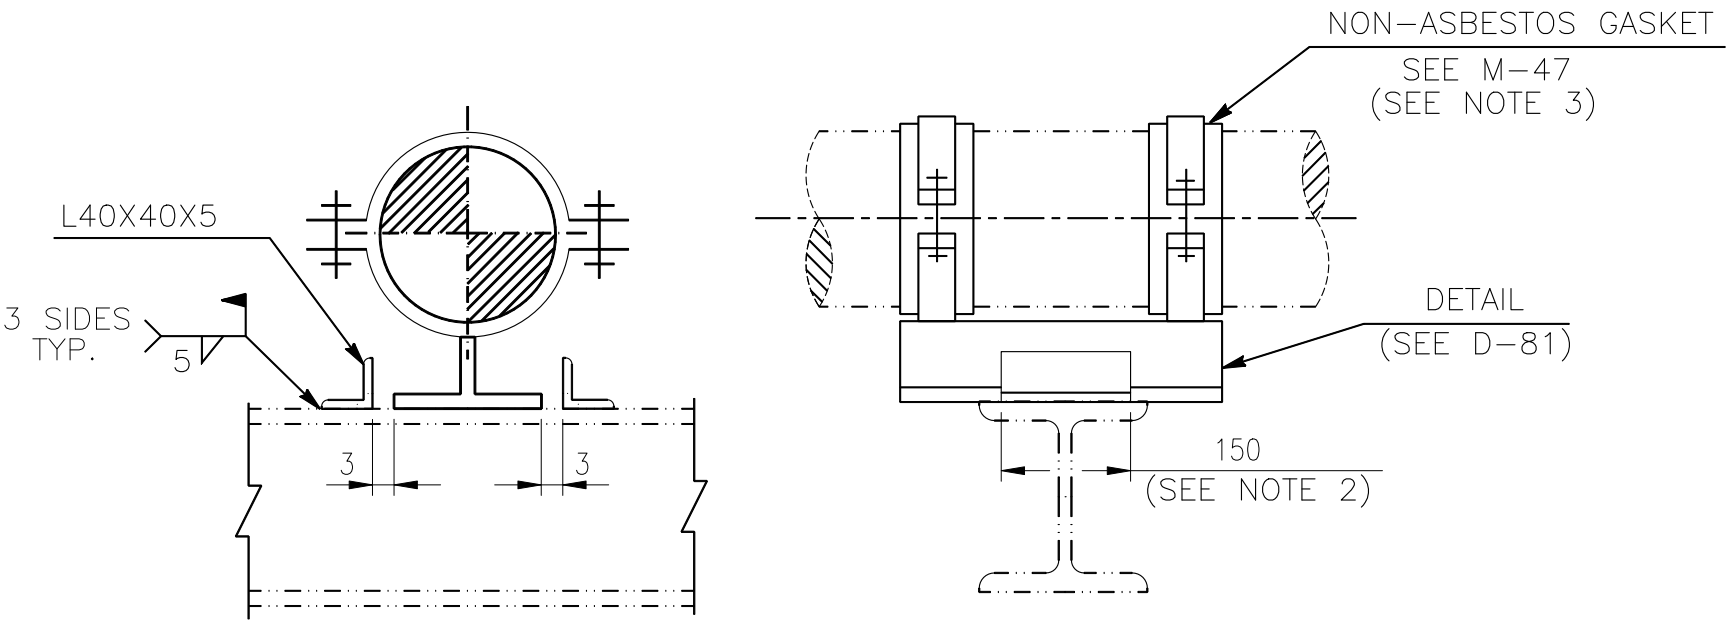

(8" & SMALLER)

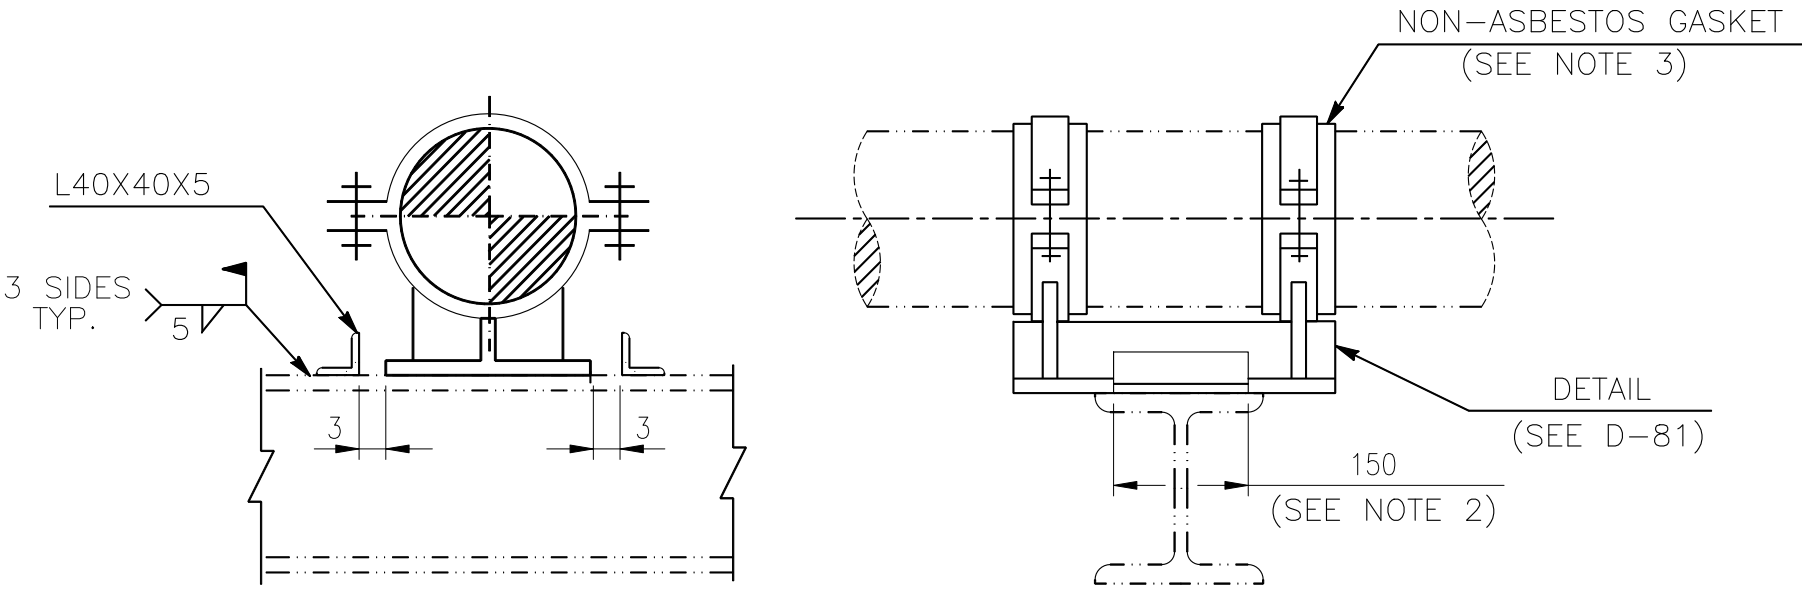

(10" TO 24" PIPE)

ELEV.

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

55-2B-A-130-500
DENOTE TYPE NO. DENOTE LINE SIZE
MODIFY LOPS=500 (IN mm) IF ANY
MODIFY HOPS=130 (IN mm) IF ANY
SEE SH'T D-80A TABLE "A"

2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.

3. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES (MAX. LINE TEMP. : 750°F)

4. HOPS=HEIGHT OF SHOE, LOPS=LENGTH OF SHOE.

FILE: D-66M.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		DETAIL OF PIPE SUPPORT TYPE-55 (1 OF 2)	REV.
DATE	7/15/'24		APPR.	CHEN			1