


FOR PIPE SIZE 26"-42"

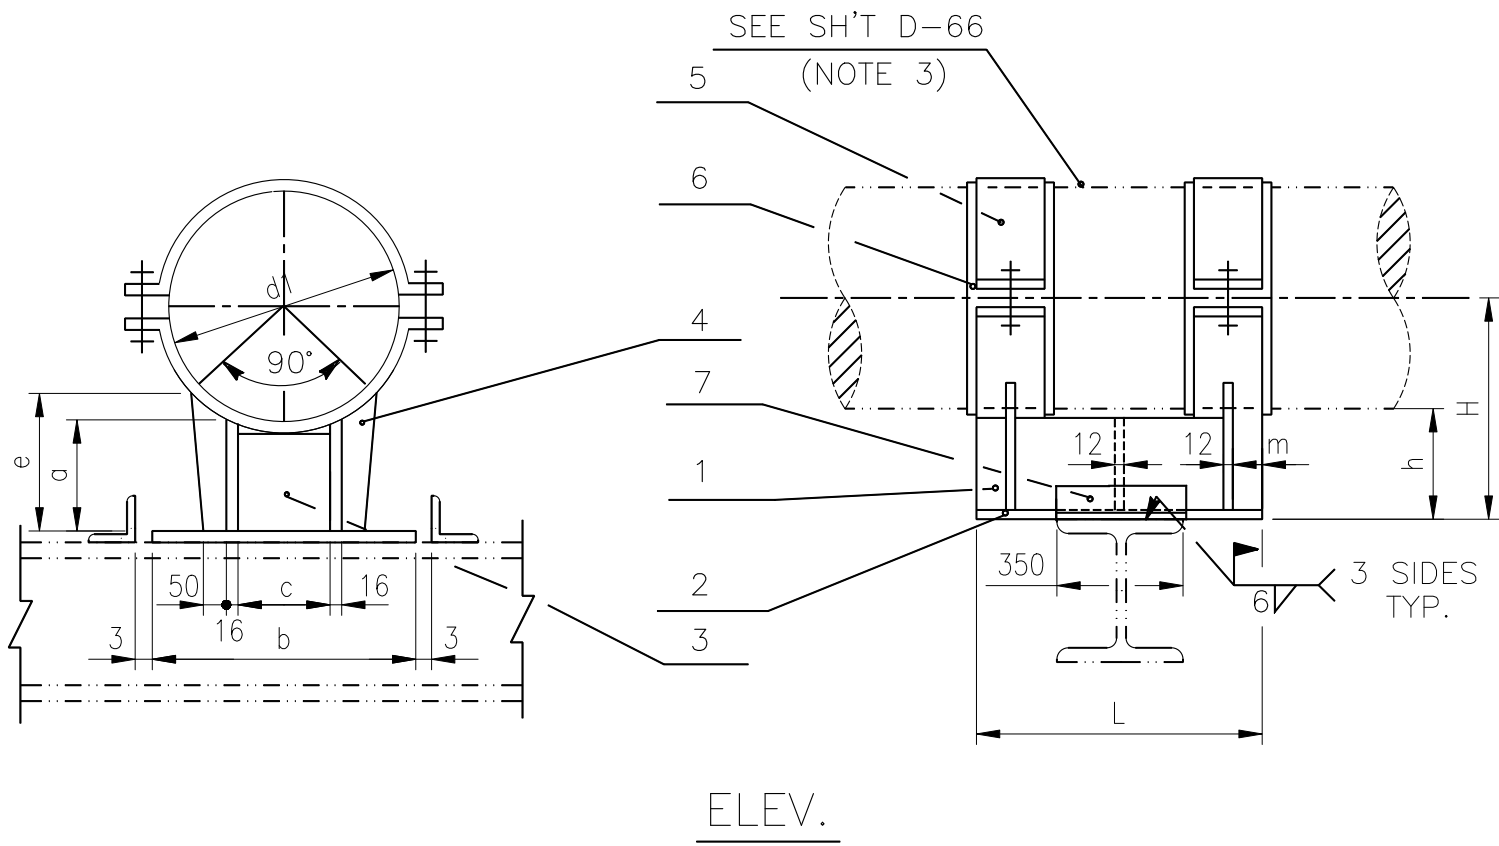

NO.	7
PIECE	2
PIPE SIZE	GUIDE
26"	L50X50X6
28"	
30"	
32"	
36"	
40"	
42"	

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-81A.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

55-30B-A-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE NOTE 3
3. TYPE-A FOR INSULATION THICKNESS ≤ 100
TYPE-B FOR INSULATION THICKNESS $>100 \leq 150$
4. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F.
5. HOPS=HEIGHT OF SHOE, LOPS=LENGTH OF SHOE.

FILE: D-66MA.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		D-66A	
DATE	7/15/'24		APPR.	CHEN			
DETAIL OF PIPE SUPPORT TYPE-55						REV. 1	
						(2 OF 2)	