



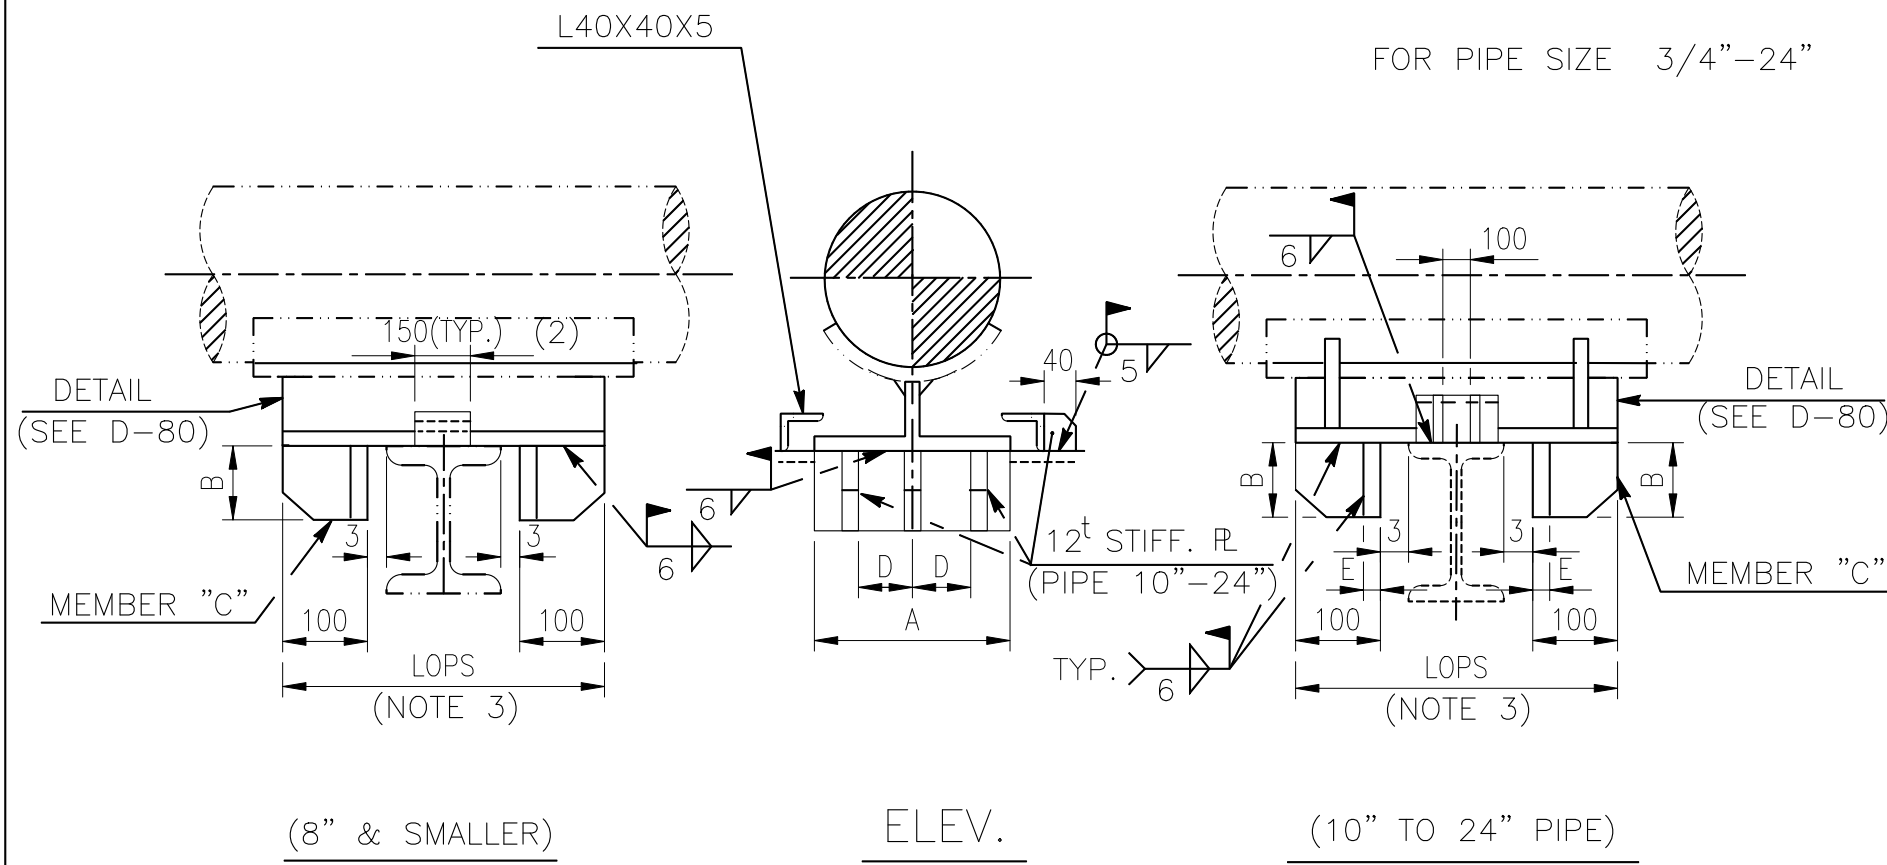

DIMENSIONS (mm)					
LINE SIZE	A	B	C	D	E
3/4"	100	100	CUT FROM H200X100X5.5X8	—	—
1"	100	100		—	—
1 1/2"	100	100		—	—
2"	100	100		—	—
2 1/2"	100	100		—	—
3"	100	100		—	—
4"	100	100		—	—
5"	100	100		—	—
6"	100	100		—	—
8"	100	100		—	—
10"	200	200	CUT FORM H200X200X8X12	70	—
12"	200	200		70	—
14"	200	200		70	—
16"	300	250	FAB. FORM 12 ^t PL	100	12
18"	300	250		100	12
20"	300	250		100	12
24"	350	250		100	12

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

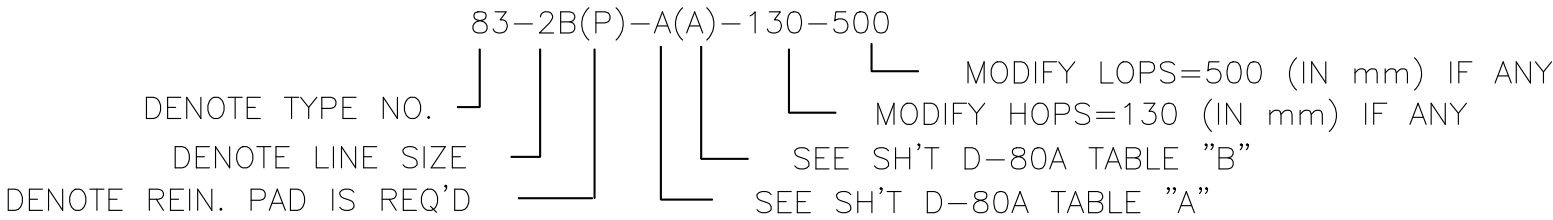

2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.
3. PIPE SHOE LENGTH (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.
4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		DETAIL OF PIPE SUPPORT TYPE-83 (1 OF 2)	REV. 1
DATE	7/15/'24		APPR.	CHEN			

FILE: D-101M.DWG