
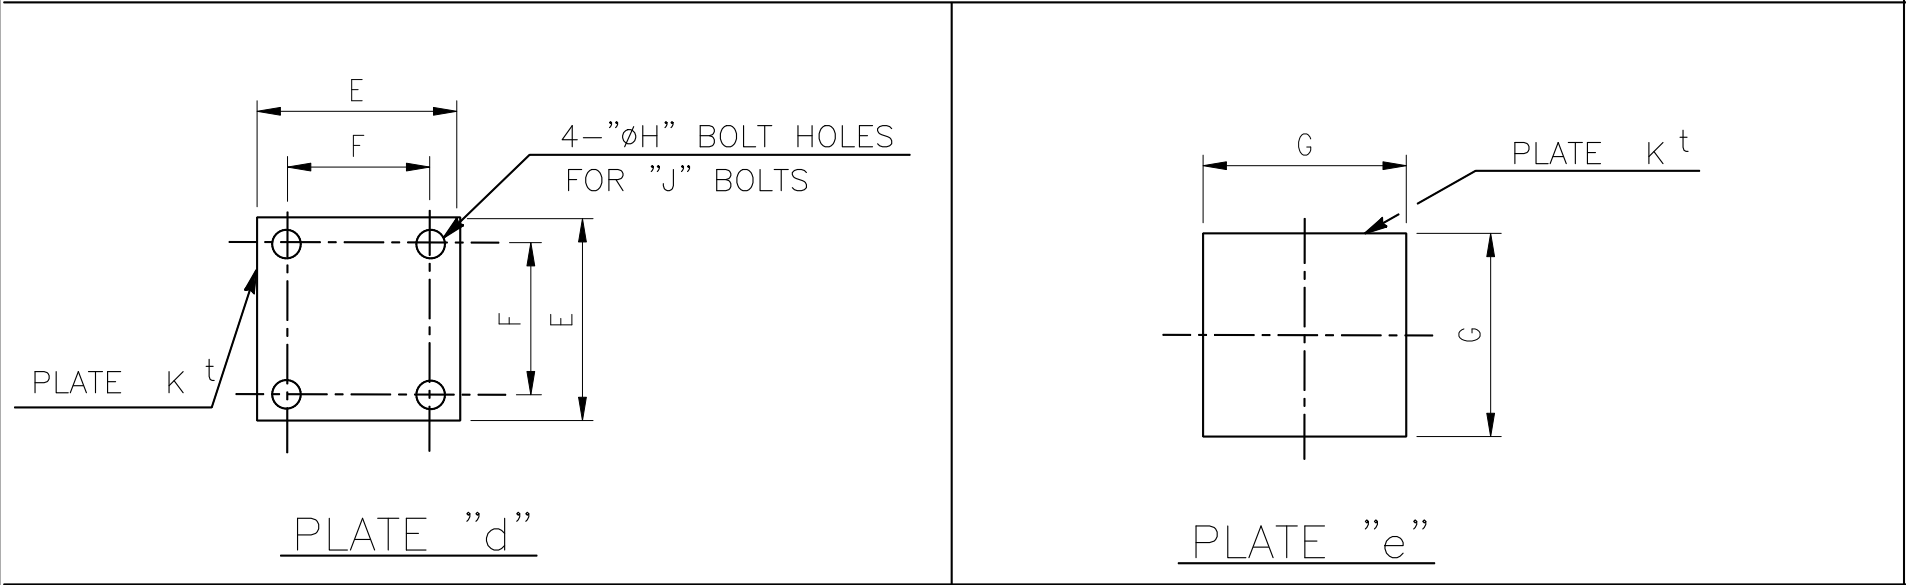
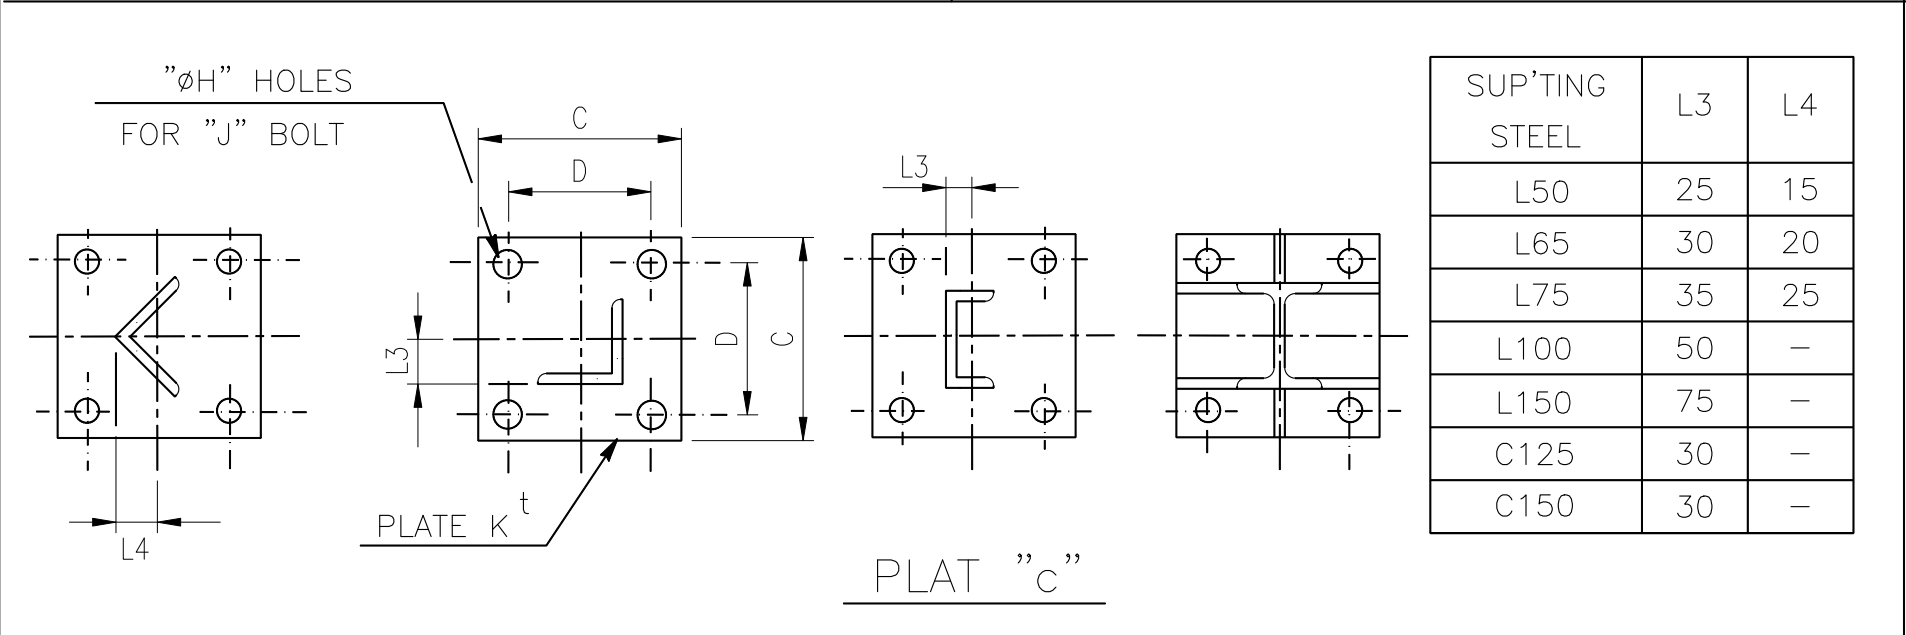


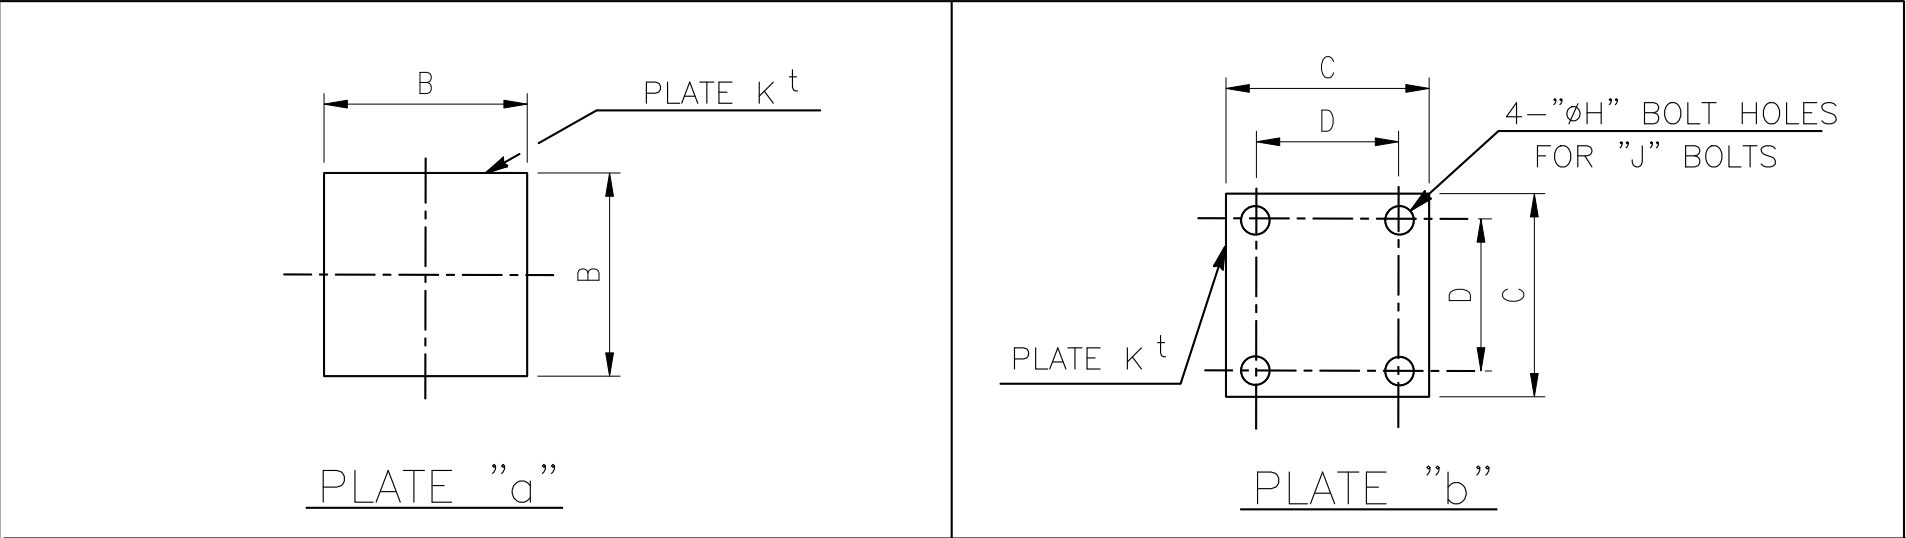

SUPPORTING PIPE	SUPPORTING STEEL	B	C	D	E	F	G	EXP. BOLT		K
								H	J	
1"~3"	L50,L65	150	180	110	290	220	200	19	5/8"	9
4"~6"	L75,L100	230	260	190	370	300	280	19	5/8"	9
8"	C125	330	380	300	490	410	380	22	3/4"	16
10"	C150	330	380	300	490	410	380	22	3/4"	16
12"	H150,H250	380	500	410	560	470	430	26	7/8"	16
14"	—	440	580	490	580	490	580	26	7/8"	16
16"	—	490	630	540	630	540	630	26	7/8"	16
18"	—	540	680	590	680	590	680	26	7/8"	16
24"	—	690	830	740	830	740	830	26	7/8"	16
28"	—	790	930	840	930	840	930	26	7/8"	16

- NOTES :
- IF TYPE-B AND TYPE-H USED FOR SUPPORT TYPE-09. PLATE "a" SHALL BE DELETED.
 - GRATING SHALL BE CUT FOR LOWER COMPONENT TYPE C,F,R AND S IF REQUIRED.

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						LOWER COMPONENT OF BASE SUPPORT (3 OF 3)			ENGINEERING STANDARD	
BY	SHIH		CHK.	YANG					HP6-DSD-A4-500-001	
DATE	7/15/'24		APPR.	CHEN					M-43	REV. 1