


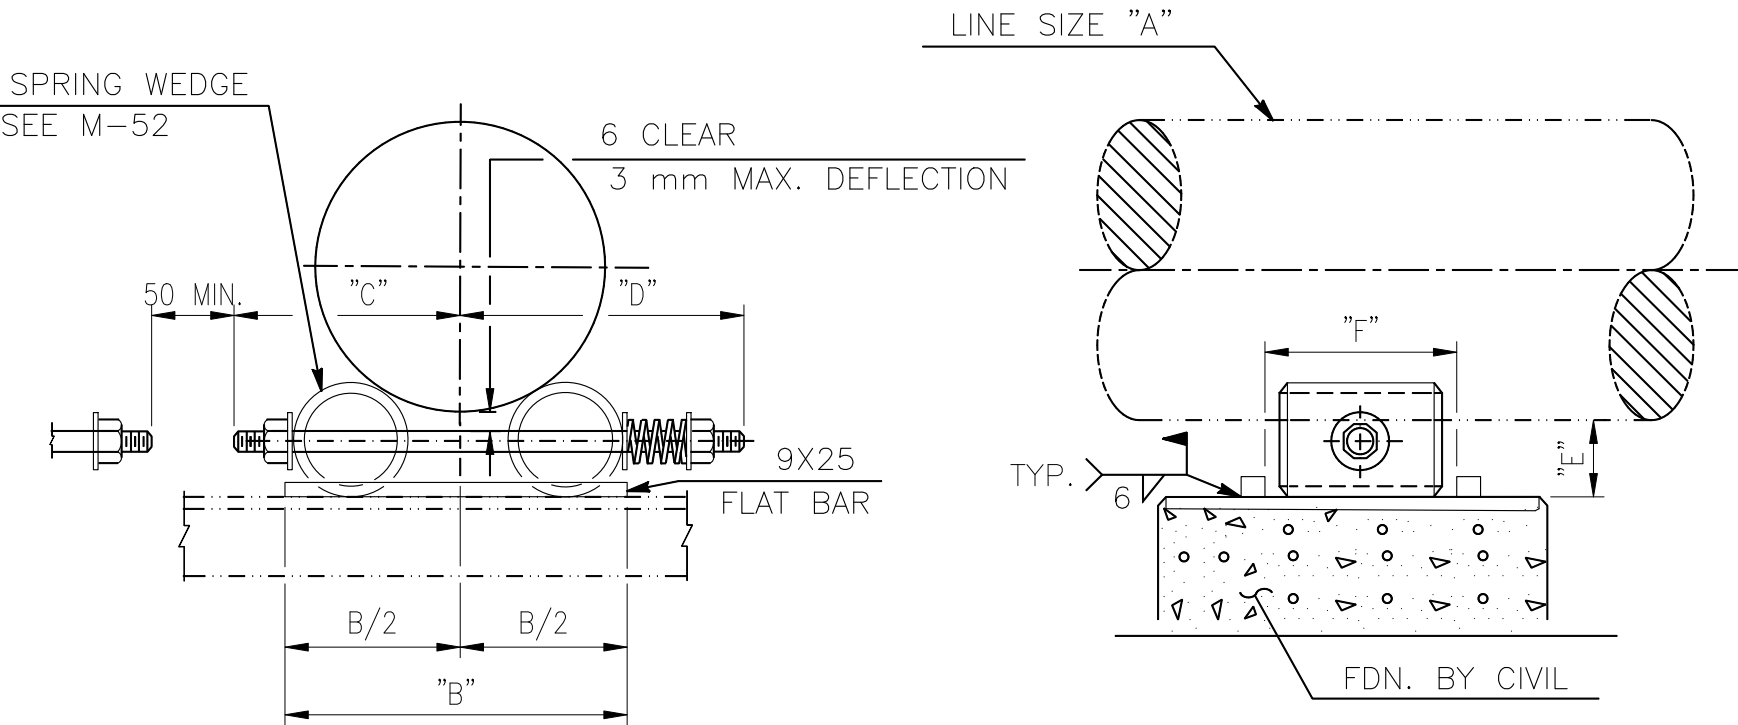

DIMENSIONS (mm)

LINE SIZE "A"	B	C	D	E	F
2"	170	115	180	43	160
3"	170	115	180	43	160
4"	170	115	180	43	160
6"	200	135	210	46	160
8"	200	135	210	46	160
10"	290	200	270	60	160
12"	290	200	270	60	160
14"	290	200	270	60	160
16"	330	215	290	60	160
18"	330	215	290	60	160
20"	330	215	290	60	160
24"	380	240	370	64	235

NOTES:

1. USE SPRING WEDGE WHERE REQUIRED BY VIBRATION ANALYSIS ON PULSATING LINES AT RECIPROCATING PUMPS AND COMPERSSORS.
2. DESIGNATION NUMBER DENOTE AS FOLLOW:

104 - 2B

DENOTE LINE SIZE "A"

DENOTE TYPE NO.

3. WEDGE BOLT TO BE TIGHTENED AFTER COMPRESSOR HAS ATTAINED RUNNING TEMPERATURE. TIGHTEN WEDGE BOLT ONLY ENOUGH TO SUPPORT WEIGHT OF PIPE, AS OVERTIGHTENING WILL FORCE NOZZLE OVERLOADED.
- FILE: D-113M.DWG
- | | | | | | | | |
|--|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司
CHUNG WEI ENGINEERING CONSULTING CO., LTD. | | | | | | ENGINEERING STANDARD | |
| | | | | | | HP6-DSD-A4-500-001 | |
| BY | SHIH | | CHK. | YANG | | D-113 | |
| DATE | 7/15/'24 | | APPR. | CHEN | | | |
| DETAIL OF PIPE SUPPORT
TYPE-104 | | | | | | REV.
1 | |