


NOTES :

1. FOR ALLOY PIPING, LUG PLATE OR FLAT BAR SHALL BE OF THE MATERIAL HAVING THE EQUIVALENT QUALITY WITH THE RUN PIPE.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS:

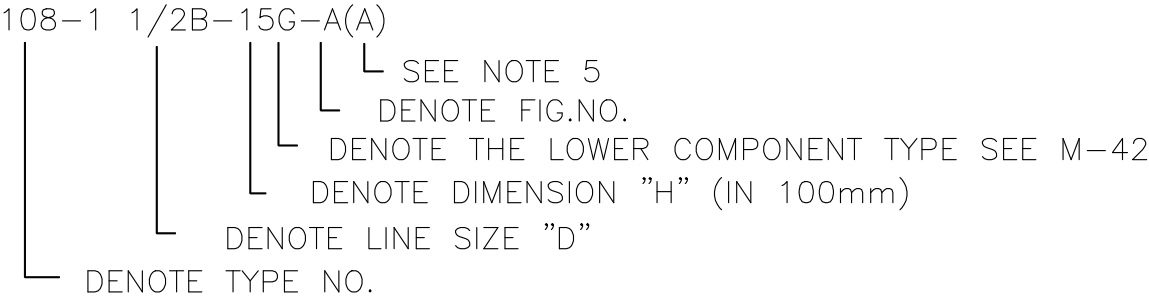

3. DIMENSION SHALL BE CUT TO SUIT IN FIELD .

4. THE LOWER COMPONENT TYPE USED IN THIS DETAIL TO BE TYPE-G, J OR R ONLY.

5.

MAT'L OF MAIN PIPE	SYMBOL
CARBON STEEL	NONE
ALLOY STEEL	(A)
STAINLESS STEEL	(S)

FILE: D-120M.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		D-120	REV.
DATE	7/15/'24		APPR.	CHEN			1

DETAIL OF PIPE SUPPORT
TYPE-108
(2 OF 2)