


FOR PIPE SIZE 26"-50"

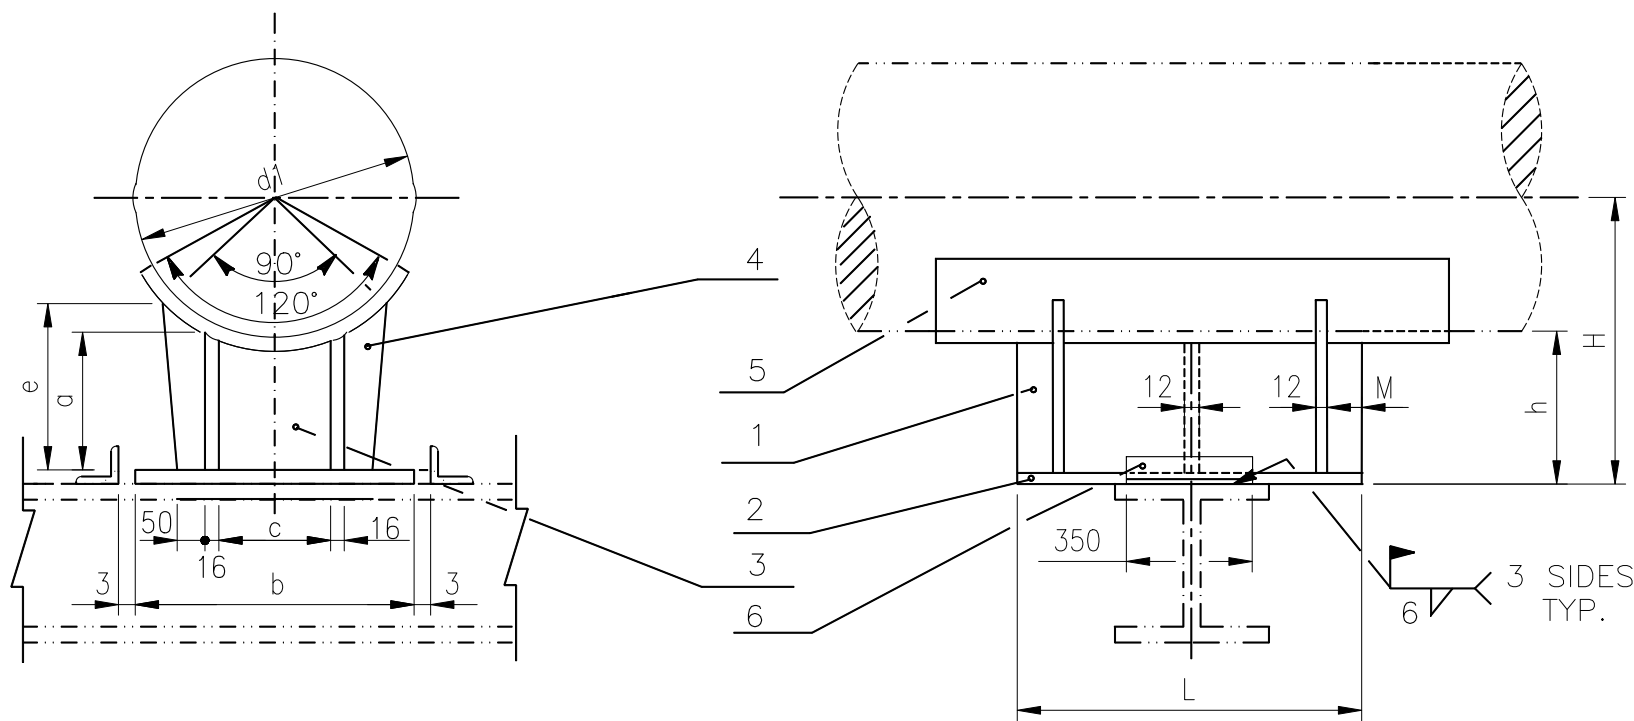

ELEV.

NO.	6
PIECE	2
PIPE SIZE	GUIDE
26"	L50X50X6
28"	
30"	
32"	
36"	
40"	
42"	
44"	
46"	L75X75X9
48"	
50"	

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

53-30B-A(A)-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

SEE NOTE 3

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"

3. TYPE-A FOR INSULATION THICKNESS ≤ 100
TYPE-B FOR INSULATION THICKNESS $> 100 \leq 150$

4. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F & PRESSURE 300 PSI .

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FILE: D-64MA.DGN

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		D-64A	
DATE	7/15/'24		APPR.	CHEN			
DETAIL OF PIPE SUPPORT TYPE-53						REV. 1	
						(2 OF 2)	