

NOTES : (CONT'D)

5.

TABLE "A"



INSULATION TH'K (mm)	HEIGHT OF SHOE (mm) (SAY HOPS)	SYMBOL
75 & LESSER	100	NONE
80 THRU. 125	150	A
130 THRU. 175	200	B
180 THRU. 200	220(NOTE 1)	C

TABLE "B"

MAT'L OF SHOES	FABRICATED FROM (NOTE 1)	SYMBOL
CARBON STEEL	SHAPE STEEL OR C/S PLATE	NONE
ALLOY STEEL	A/S PLATE	(A)
STAINLESS STEEL	S/S PLATE	(S)

6. FOR MATERIAL SPECIFICATION SEE SH'T P-2.



7. FIELD WELD OF PIPE SHOE .

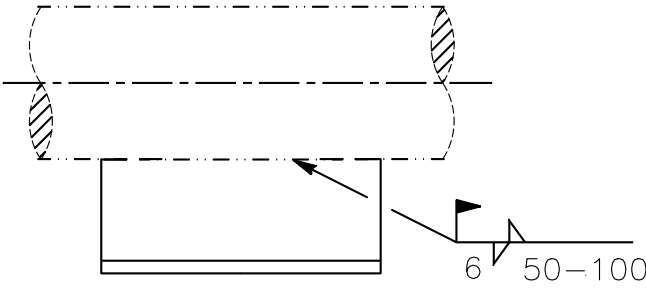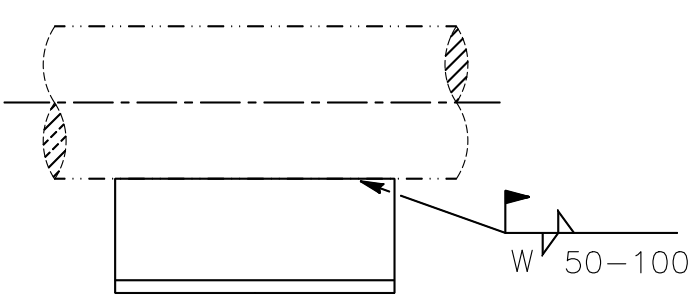

W=4 FOR PIPE SCH. 80 & BELOW
W=6 FOR PIPE SCH. 160 & ABOVE

1/2"~2"

2 1/2"~8"

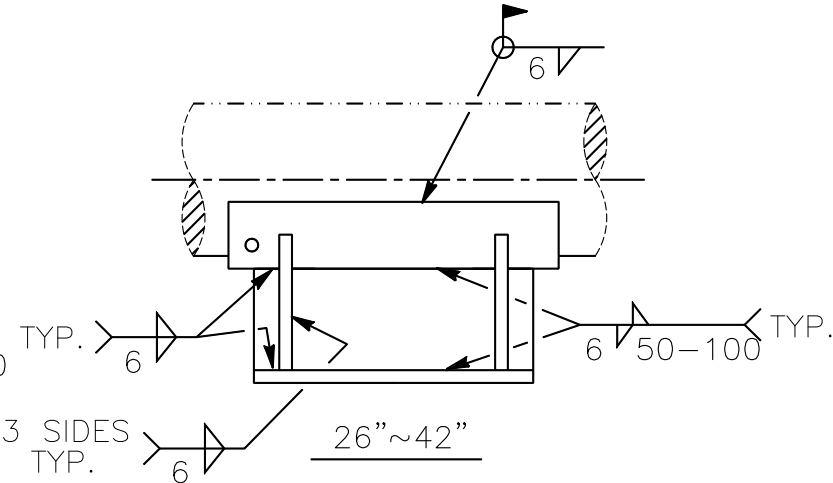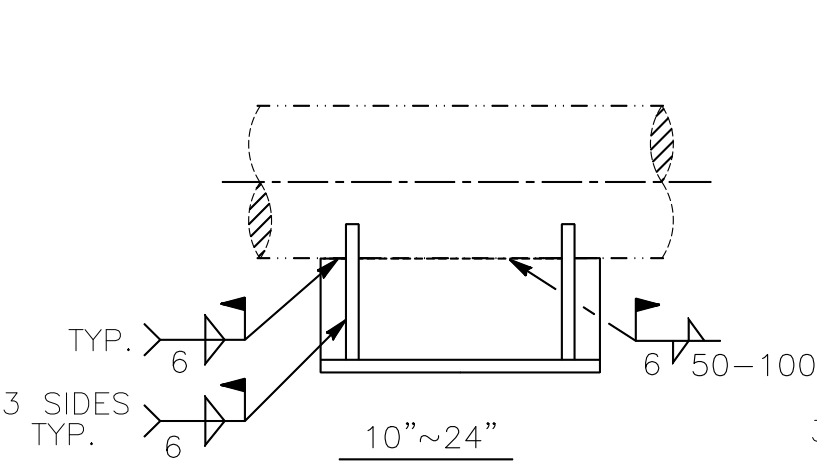

中威工程顧問股份有限公司
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

DETAIL OF PIPE SUPPORT
TYPE-66

ENGINEERING STANDARD

HP6-DSD-A4-500-001

BY	SHIH		CHK.	YANG	
DATE	7/15/'24		APPR.	CHEN	

(2 OF 3)

D-80A

REV.
1