


FOR PIPE SIZE 26"-50"

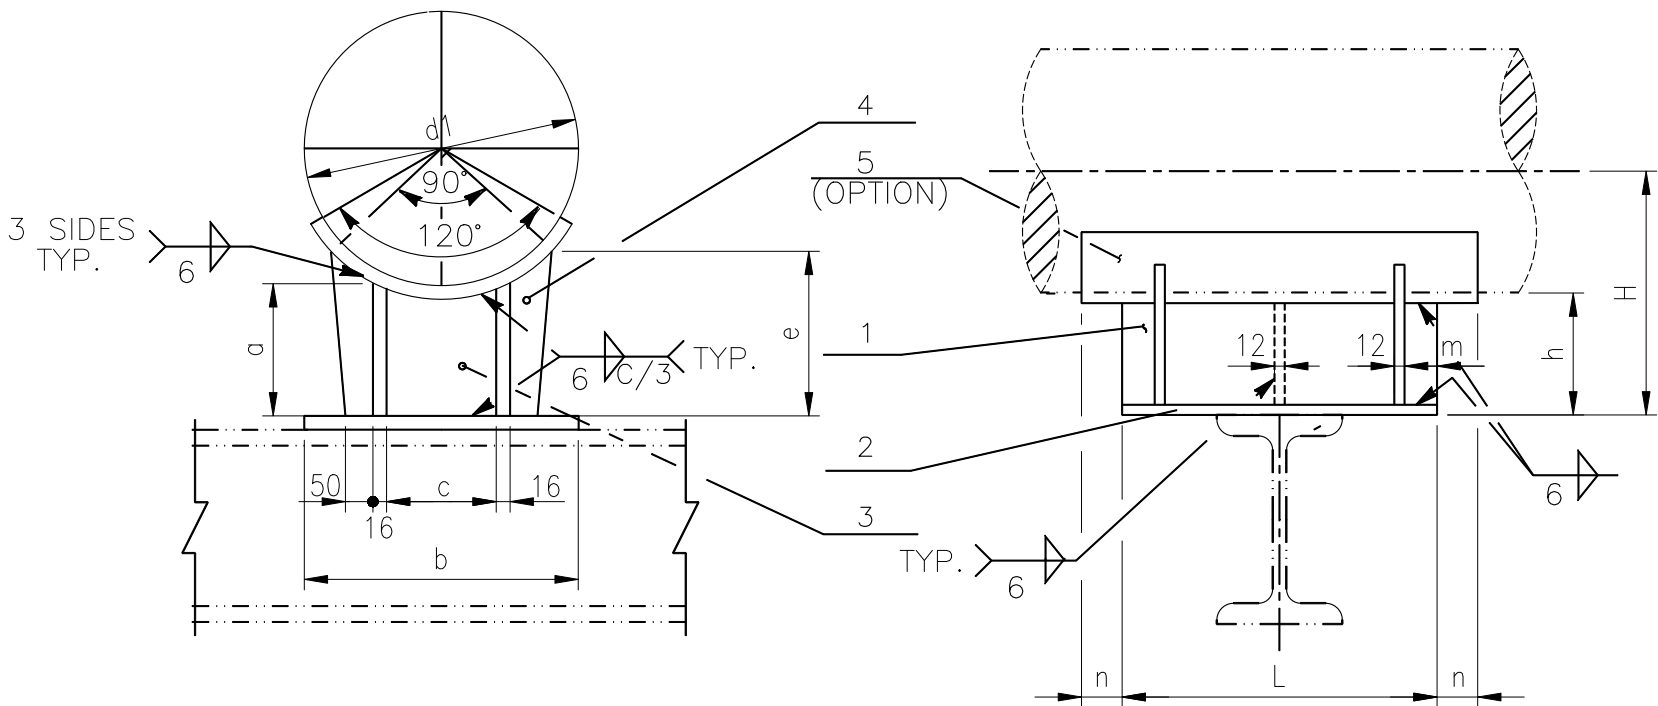

(FOR OTHER WELDS, SEE SH'T D-80A NOTE 7)

DIMENSION (mm)																	
NO	1		2	3	4	5	DIMENSION										
PIECE	2		1	1	4	1											
PIPE SIZE	(NOTE 4) FOOT a		FOOT PLATE	PLATE	PLATE	PAD											
	A	B					b	c	e		h		H		L	m	n
	(NOTE 2)	(NOTE 2)							(NOTE 2,4)		(NOTE 2)		(NOTE 2)				
26"	148	198	16 TH'K	12 TH'K	12 TH'K	12 TH'K (MIN.)	430	230	222	272	150	200	480	530	540	35	75
28"	148	198					440	240	230	280	150	200	506	556	540	35	75
30"	148	198					450	250	237	287	150	200	531	581	540	35	75
32"	148	198					460	260	244	294	150	200	556	606	740	40	75
36"	152	202					500	300	259	309	150	200	607	657	740	40	75
40"	156	206					535	335	274	324	150	200	658	708	740	40	75
42"	156	206					550	350	281	331	150	200	683	733	740	40	75
44"	163	213					594	394	290	340	150	200	710	860	940	45	75
46"	167	217					620	420	297	347	150	200	734	884	940	45	75
48"	171	221					650	450	305	355	150	200	760	910	940	45	75
50"	174	224	690	478	312	362	150	200	785	935	1140	50	75				

NOTES : (FOR SH'T D-80B ONLY)

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-28B-A(A)-130-500

DENOTE TYPE NO. _____ MODIFY LOPS=500 (IN mm) IF ANY
DENOTE LINE SIZE _____ MODIFY HOPS=130 (IN mm) IF ANY
SEE NOTE 2 _____ SEE SH'T D-80A TABLE "B"

2. TYPE-A FOR INSULATION THICKNESS ≤ 100
TYPE-B FOR INSULATION THICKNESS > 100 ≤ 150

3. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F & PRESSURE 300 PSI.

4. DIMENSION "a" & "e" ARE CALCULATED BASE ON PIPE SHOE WITH 12 mm TH'K REINF. PAD.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

FILE: D-80MB.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						DETAIL OF PIPE SUPPORT TYPE-66 (3 OF 3)		ENGINEERING STANDARD	
								HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG				D-80B	REV. 1
DATE	7/15/'24		APPR.	CHEN					