

中威工程顧問股份有限公司
Chung Wei Engineering Consulting CO., LTD

PIPE SUPPORT STANDARD

FOR CONSTRUCTION
2025-12-02

						CERTIFIED	
						PROJ.	
						MGR. _____	DATE _____
						CLIENT _____	
1	FOR CONSTRUCTION	MA	SHIH	CHEN	12/01/'25	DATE _____	
REV.	DESCRIPTION	BY	CHK.	APPR.	DATE	SHEET 1 OF 1	HP6-DSD-A4-500-001

FILE:

<u>TITLE</u>						<u>SHEET NO.</u>	
INDEX						I1~I6	
SELECTION PRACTICE						P1~P5	
LIST OF PIPE SUPPORT						L1~L8	
DETAIL OF PIPE SUPPORT TYPE-01						D-1	
DETAIL OF PIPE SUPPORT TYPE-02						D-2	
DETAIL OF PIPE SUPPORT TYPE-03						D-3	
DETAIL OF PIPE SUPPORT TYPE-04						D-4	
DETAIL OF PIPE SUPPORT TYPE-05						D-5	
DETAIL OF PIPE SUPPORT TYPE-06						D-6	
DETAIL OF PIPE SUPPORT TYPE-07						D-7	
DETAIL OF PIPE SUPPORT TYPE-08						D-8	
DETAIL OF PIPE SUPPORT TYPE-09						D-9	
DETAIL OF PIPE SUPPORT TYPE-10						D-10	
DETAIL OF PIPE SUPPORT TYPE-11						D-11	
DETAIL OF PIPE SUPPORT TYPE-12						D-12	
DETAIL OF PIPE SUPPORT TYPE-13						D-13	
DETAIL OF PIPE SUPPORT TYPE-14						D-14,15	
DETAIL OF PIPE SUPPORT TYPE-15						D-16	
DETAIL OF PIPE SUPPORT TYPE-16						D-18	
DETAIL OF PIPE SUPPORT TYPE-17						D-19	
DETAIL OF PIPE SUPPORT TYPE-18						D-20	
DETAIL OF PIPE SUPPORT TYPE-19						D-21	
DETAIL OF PIPE SUPPORT TYPE-20						D-22	
DETAIL OF PIPE SUPPORT TYPE-21						D-23	
DETAIL OF PIPE SUPPORT TYPE-22						D-24	
DETAIL OF PIPE SUPPORT TYPE-23						D-25	
中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
						I - 1	
						REV. 1	
BY	SHIH		CHK.	YANG		INDEX	
DATE	7/15/'24		APPR.	CHEN			

FILE: I-1M.DWG

TITLE						SHEET NO.	
DETAIL OF PIPE SUPPORT TYPE-24						D-26	
DETAIL OF PIPE SUPPORT TYPE-25						D-27	
DETAIL OF PIPE SUPPORT TYPE-26						D-28,29	
DETAIL OF PIPE SUPPORT TYPE-27						D-30	
DETAIL OF PIPE SUPPORT TYPE-28						D-31	
DETAIL OF PIPE SUPPORT TYPE-30						D-35	
DETAIL OF PIPE SUPPORT TYPE-31						D-36	
DETAIL OF PIPE SUPPORT TYPE-32						D-37	
DETAIL OF PIPE SUPPORT TYPE-33						D-38	
DETAIL OF PIPE SUPPORT TYPE-34						D-39	
DETAIL OF PIPE SUPPORT TYPE-35						D-40	
DETAIL OF PIPE SUPPORT TYPE-36						D-41	
DETAIL OF PIPE SUPPORT TYPE-37						D-42	
DETAIL OF PIPE SUPPORT TYPE-39						D-45	
DETAIL OF PIPE SUPPORT TYPE-41						D-49	
DETAIL OF PIPE SUPPORT TYPE-42						D-50	
DETAIL OF PIPE SUPPORT TYPE-43						D-51,52	
DETAIL OF PIPE SUPPORT TYPE-44						D-53	
DETAIL OF PIPE SUPPORT TYPE-45						D-54,55	
DETAIL OF PIPE SUPPORT TYPE-46						D-56	

FILE: I-2M.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
						I-2	REV. 1
BY	SHIH		CHK.	YANG		INDEX	
DATE	7/15/'24		APPR.	CHEN			



TITLE						SHEET NO.	
DETAIL OF PIPE SUPPORT TYPE-72						D-87	
DETAIL OF PIPE SUPPORT TYPE-73						D-88,88A	
DETAIL OF PIPE SUPPORT TYPE-76						D-91	
DETAIL OF PIPE SUPPORT TYPE-77						D-92	
DETAIL OF PIPE SUPPORT TYPE-78						D-93	
DETAIL OF PIPE SUPPORT TYPE-79						D-94	
DETAIL OF PIPE SUPPORT TYPE-80						D-95,96	
DETAIL OF PIPE SUPPORT TYPE-81						D-97,98	
DETAIL OF PIPE SUPPORT TYPE-82						D-99,100	
DETAIL OF PIPE SUPPORT TYPE-82A						D-100A-1,100A-2	
DETAIL OF PIPE SUPPORT TYPE-83						D-101,102	
DETAIL OF PIPE SUPPORT TYPE-84						D-103,104	
DETAIL OF PIPE SUPPORT TYPE-85						D-105,106	
DETAIL OF PIPE SUPPORT TYPE-86						D-107,108	
DETAIL OF PIPE SUPPORT TYPE-87						D-109	
DETAIL OF PIPE SUPPORT TYPE-101						D-110	
DETAIL OF PIPE SUPPORT TYPE-102						D-111	
DETAIL OF PIPE SUPPORT TYPE-103						D-112	
DETAIL OF PIPE SUPPORT TYPE-104						D-113	
DETAIL OF PIPE SUPPORT TYPE-105						D-114,115	
DETAIL OF PIPE SUPPORT TYPE-108						D-119,120	
DETAIL OF PIPE SUPPORT TYPE-112						D-125	
DETAIL OF PIPE SUPPORT TYPE-115						D-128	
DETAIL OF PIPE SUPPORT TYPE-118						D-131	
DETAIL OF PIPE SUPPORT TYPE-119						D-132	
DETAIL OF PIPE SUPPORT TYPE-120						D-133,134	

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
						I - 4	REV. 1
BY	SHIH		CHK.	YANG		INDEX	
DATE	7/15/'24		APPR.	CHEN			

FILE: I-4M.DWG

TITLE						SHEET NO.	
SPECIAL BASE PLATE						M-1	
ADJUSTABLE CLEVIS						M-3	
PIPE CLAMP TYPE-A						M-4	
PIPE CLAMP TYPE-B						M-5	
PIPE CLAMP TYPE-C						M-6	
PIPE CLAMP TYPE-D						M-7	
PIPE CLAMP TYPE-E						M-8	
PIPE CLAMP TYPE-F						M-9	
PIPE CLAMP TYPE-G						M-10	
RISER CLAMP TYPE-A						M-11	
RISER CLAMP TYPE-B						M-12	
PIPE ROLL TYPE-A						M-13	
TURNBUCKLE						M-21	
MACHINE THREADED ROD						M-22	
WELDED EYE ROD						M-23	
FORGED STEEL CLEVIS						M-24	
WELDLESS EYE NUT						M-25	
U-BOLT						M-26	
ANGLE BRACKET						M-27	
BEAM ATTACHMENT TYPE-A						M-28	
BEAM ATTACHMENT TYPE-B						M-29	
BEAM ATTACHMENT TYPE-C						M-30	
中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						INDEX	
BY	SHIH		CHK.	YANG		ENGINEERING STANDARD	
DATE	7/15/'24		APPR.	CHEN		HP6-DSD-A4-500-001	
						I-5	
						REV. 1	

FILE: I-5M.DWG

<u>TITLE</u>						<u>SHEET NO.</u>															
STEEL WASHER PLATE						M-31															
LUG PLATE TYPE-A						M-32															
LUG PLATE TYPE-B						M-33															
LUG PLATE TYPE-C						M-34															
LUG PLATE TYPE-D						M-35															
LUG PLATE TYPE-E						M-36															
LUG PLATE TYPE-F						M-37															
LUG PLATE TYPE-P						M-41															
LOWER COMPONENT OF BASE SUPPORT						M-42,42A,43															
EXPANSION BOLT						M-45															
COMPRESSED GASKET						M-47															
SPRING WEDGE						M-52															
STRAP TYPE-PUBS2						M-53															
STRAP						M-54															
U-BAND						M-55															
PIPE CLAMP TYPE-H						M-56															
NON-FERROUS PIPE SADDLE						M-57															
U-BOLT TYPE-A						M-58															
U-BAND TYPE-A						M-59															
SLIDE PLATE TYPE-A						M-60															
中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. <table><tr><td>BY</td><td>SHIH</td><td></td><td>CHK.</td><td>YANG</td><td></td></tr><tr><td>DATE</td><td>7/15/'24</td><td></td><td>APPR.</td><td>CHEN</td><td></td></tr></table>						BY	SHIH		CHK.	YANG		DATE	7/15/'24		APPR.	CHEN		INDEX		ENGINEERING STANDARD	
						BY	SHIH		CHK.	YANG											
						DATE	7/15/'24		APPR.	CHEN											
						HP6-DSD-A4-500-001															
I-6	REV. 1																				

FILE: I-6M.DWG

1.0 SCOPE

This engineering standard specification contains specific requirements for selection of material & dimensional data to be used in the fabrication of bare & hot insulation supports. It includes requirements for various types of supports on bare & hot insulated pipe. The standard pipe support consists of the following sections:

- 1.1 List of standard pipe supports and the detail drawings – sheet D-1 to D-134.
- 1.2 List of standard pipe support components and detail drawings-sheets M-1 to M-60.
- 1.3 The pipe support components are used for building up pipe supports. The dimensions and applicable size are shown in the detail drawings.

2.0 DESIGN CRITERIA FOR ALL SUPPORTS

- 2.1 Miscellaneous structure steel is to be designed in accordance with "Manual of Steel Construction" – American Institute of Steel Construction Inc. (AISC) Specification.
- 2.2 All other components of pipe supports shall conform to the latest requirements of ASME B31.3, Code of Process Piping and Manufacturer's Standardization Society (MSS) Standard Practice SP-58 & SP-69.
- 2.3 One assembly to be furnished for each support number unless otherwise specified.
- 2.4 All assemblies to be shop welded unless marked for field welding.
- 2.5 Each assembly to be shipped, completely fabricated and assembled.
- 2.6 All threaded parts are RH unless marked LH.
- 2.7 Field to modify grating or handrails to accommodate hangers and supports where required.
- 2.8 All bolt holes are 3 mm larger than bolt diameter.
- 2.9 All materials are carbon steel unless otherwise specified.
- 2.10 For carbon steel lines 24" and smaller, the reinforcing pad materials are cut from the pipe. for lines 26" and larger, the reinforcing pad are fabricated from plates in field.
- 2.11 The reinforcing pad materials of alloy steel, stainless steel & stress relief lines shall be same materials as main line, and it shall be fabricated together with main lines in shop.
- 2.12 The dimensional tolerences in fabricated pipe hangers and supports shall conform to the requirements in MSS SP-89 SEC. 4.0.

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		SELECTION PRACTICE	
DATE	7/15/'24		APPR.	CHEN			
						P-1	REV. 1

FILE: P1-1M.DWG

3.0 MATERIAL SPECIFICATIONS DESIGNATED AS :

		TEMP. RANGE(°C)		
C.S. Plate	ASTM A283 Grade C	-29	TO	399
C.S. Bar	ASTM A36 Hot Rolled		”	
C.S. Rod	ASTM A36 Hot Rolled		”	
C.S. Forging	ASTM A668 Grade B Annealed		”	
C.S. Bolting	ASTM A307 Grade B/A563 Grade A	-29	TO	260
C.S. Pipe	ASTM A53 Grade B E.R.W	-29	TO	399
Alloy Plate	ASTM A387 Grade 22 Annealed	-29	TO	621
Alloy Bolting	ASTM A193 Grade B7/A194 Grade 2H Nut	-29	TO	538
Alloy Pipe	ASTM A335 Grade P22	-29	TO	621
Stainless Plate	ASTM A240 Grade 304	-254	TO	649
Stainless Bolting	ASTM A193 Grade B8/A194 Grade 8 Nut		”	
Stainless Pipe	ASTM A312 Grade TP304		”	
Bolt for Structure	ASTM A325	-29	TO	343
Steel				
C.S. Plate	ASTM A516 Grade 60 Impact Tested	-45	TO	-29
(COLD SERVICE)				
Structural Steel	ASTM A36 or Equal			

4.0 PIPE SUPPORT DRAFTING PROCEDURE

4.1 The numbering system for pipe supports shall be as follows :

4.1.1 The numbering system for standard pipe supports shall be in accordance with standard type dwgs.

4.1.2 Special pipe support number shall be designated by the following rule :



- * PS – Denotes general special support
- VSH – Denotes variable spring support
- CSH – Denotes constant spring support
- HSN – Denotes hydraulic snubber support
- MSN – Denotes mechanical snubber support
- STR – Denotes strut support
- SWB – Denotes sway brace support
- TPS – Denotes temporary special support


中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG		P-2	
DATE	7/15/'24		APPR.	CHEN			
SELECTION PRACTICE						REV.	
						1	

FILE: P1-2M.DWG


4.0 PIPE SUPPORT DRAFTING PROCEDURE (Cont'd)

4.2 Support symbols shall be designated as


4.2.1 Pipe Support for Horizontal Pipe:

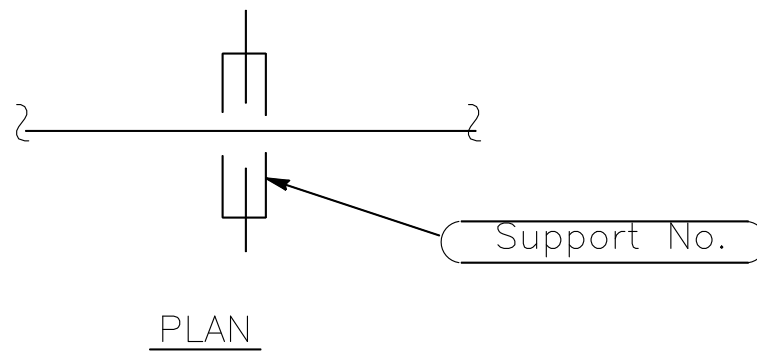


4.2.2 Common Pipe Support for Horizontal Pipes:

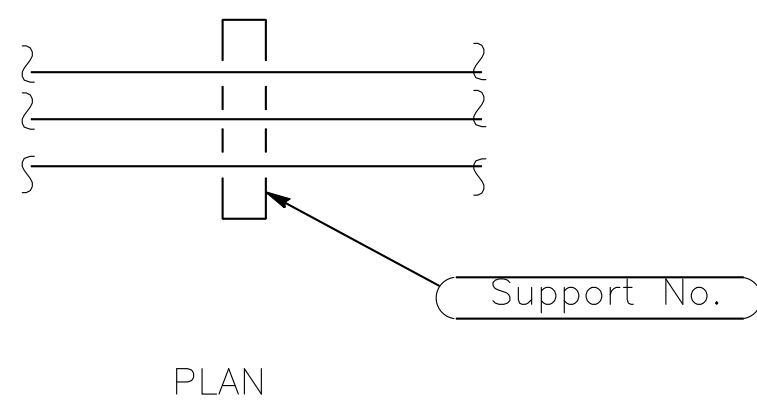

4.2.3 Pipe Support for Vertical Pipe:

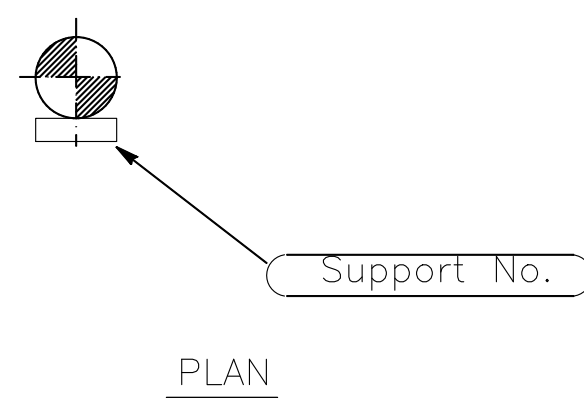


4.2.4 Common Pipe Support for Vertical Pipes:

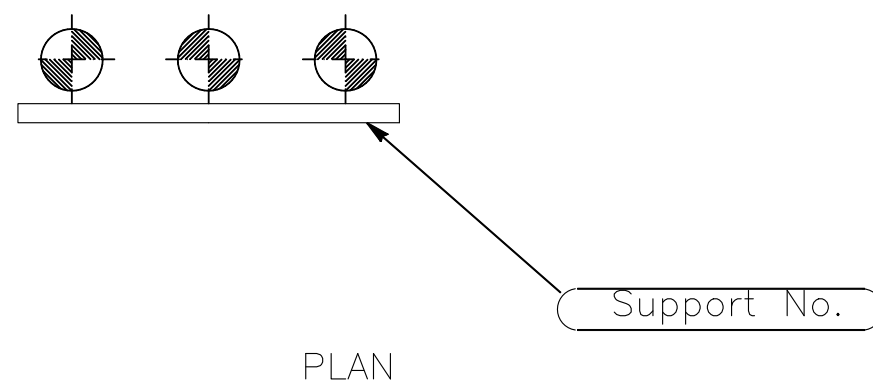


中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						SELECTION PRACTICE		ENGINEERING STANDARD	
								HP6-DSD-A4-500-001	
BY	SHIH		CHK.	YANG				P-3	REV. 1
DATE	7/15/'24		APPR.	CHEN					

4.0 PIPE SUPPORT DRAFTING PROCEDURE (Cont'd)


4.2.5 Pipe Support at Elbow

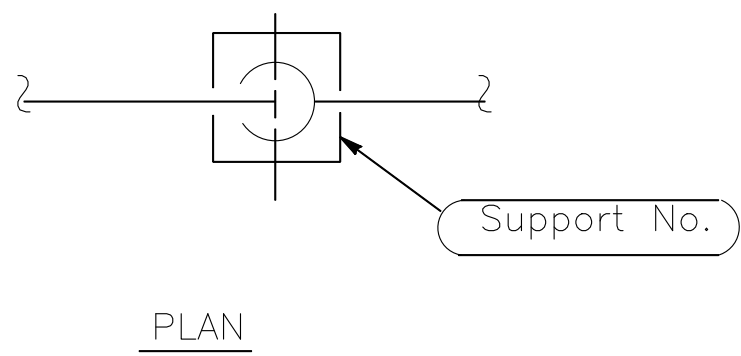

4.2.6 Trunnion for Vertical Pipe

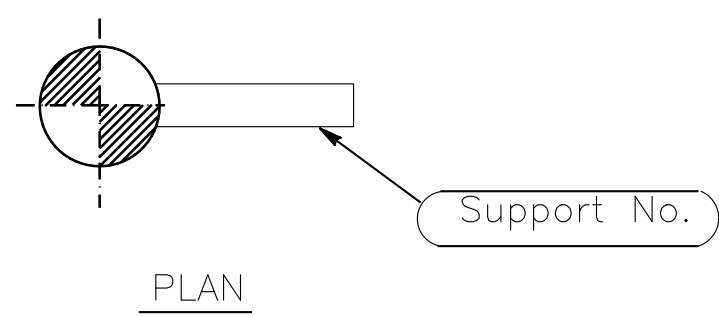

4.2.7 Trunnion at Elbow

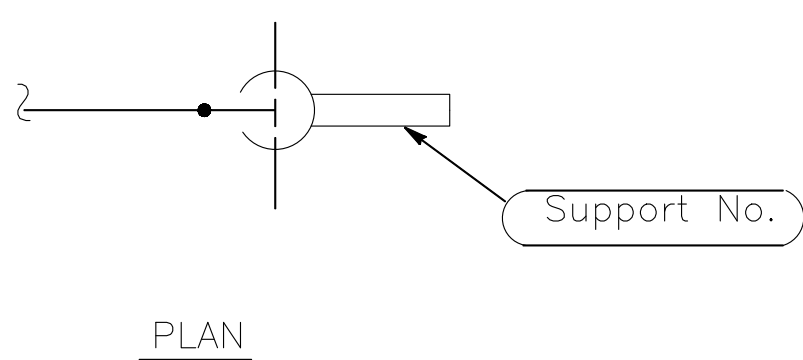


4.3 Elevation of pipe support shall be shown on piping support location plan. The indicated elevation shall be the top elevation of the supporting beam.

FILE: P1-4M.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
BY	SHIH		CHK.	YANG		HP6-DSD-A4-500-001	
DATE	7/15/'24		APPR.	CHEN			
SELECTION PRACTICE						P-4	
						REV. 1	

4.4 View Definition

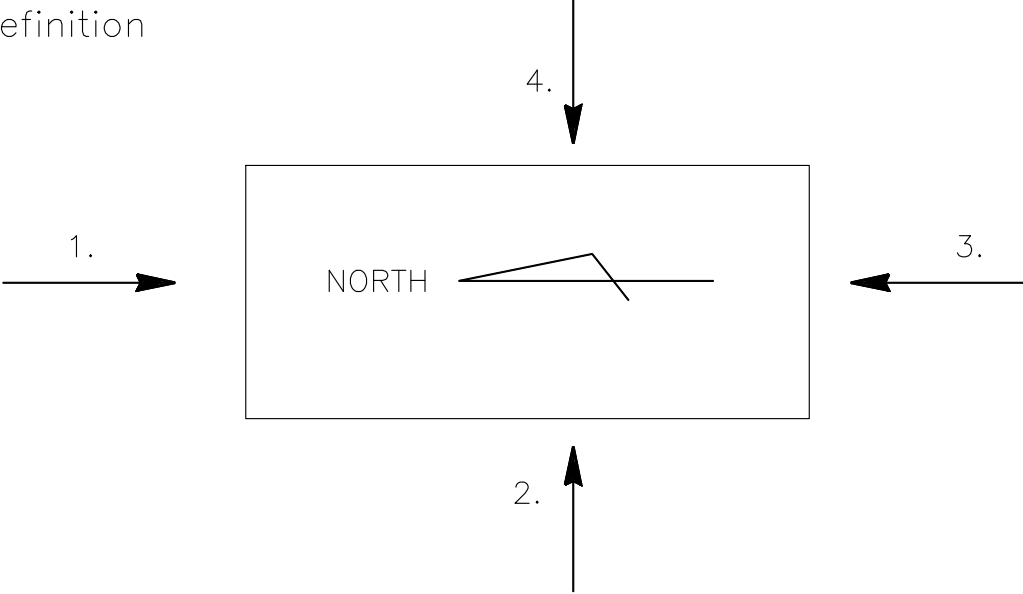

- 1 : LOOKING SOUTH
- 2 : LOOKING EAST
- 3 : LOOKING NORTH
- 4 : LOOKING WEST


4.5 ABBREVIATION OF THE SUPPLEMENTARY EXPLANATIONS

- E-W : EAST-WEST DIRECTION
- N-S : NORTH-SOUTH DIRECTION
- HOPS : HEIGHT OF PIPE SHOE
- LOPS : LENGTH OF PIPE SHOE
- MOD. : MODIFIED
- DIR. : DIRECTION
- EXP. : EXPANSION
- REQ'D : REQUIRED
- LH : LEFT HAND
- RH : RIGHT HAND
- EB : EXPANSION BOLT
- MB : MACHINE BOLT
- REINF. : REINFORCING
- STR'L : STRUCTURAL
- SQ : SQUARE

FILE: P1-5M.DWG

中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD.						ENGINEERING STANDARD	
						HP6-DSD-A4-500-001	
						P-5	REV. 1
BY	SHIH		CHK.	YANG		SELECTION PRACTICE	
DATE	7/15/'24		APPR.	CHEN			

4.5 View Definition




















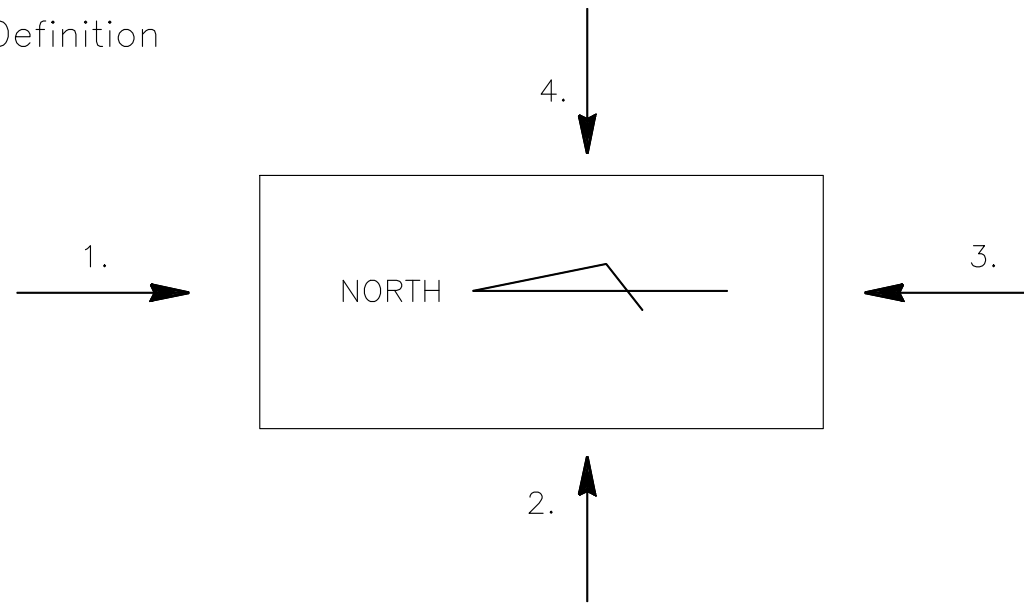


- ```
1 : LOOKING SOUTH
2 : LOOKING EAST
3 : LOOKING NORTH
4 : LOOKING WEST
```





















## 5. ABBREVIATION OF THE SUPPLEMENTARY EXPLANATIONS

- |        |   |                       |
|--------|---|-----------------------|
| E-W    | : | EAST-WEST DIRECTION   |
| N-S    | : | NORTH-SOUTH DIRECTION |
| HOPS   | : | HEIGHT OF PIPE SHOE   |
| LOPS   | : | LENGTH OF PIPE SHOE   |
| MOD.   | : | MODIFIED              |
| DIR.   | : | DIRECTION             |
| EXP.   | : | EXPANSION             |
| REQ'D  | : | REQUIRED              |
| LH     | : | LEFT HAND             |
| RH     | : | RIGHT HAND            |
| EB     | : | EXPANSION BOLT        |
| MB     | : | MACHINE BOLT          |
| REINF. | : | REINFORCING           |
| STR'L  | : | STRUCTURAL            |
| SQ     | : | SQUARE                |




















|                                                                               |          |  |       |      |  |                    |  |                      |           |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|--------------------|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | SELECTION PRACTICE |  | ENGINEERING STANDARD |           |
|                                                                               |          |  |       |      |  |                    |  | HP6-DSD-A4-500-001   |           |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                    |  | P-5                  | REV.<br>1 |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                    |  |                      |           |
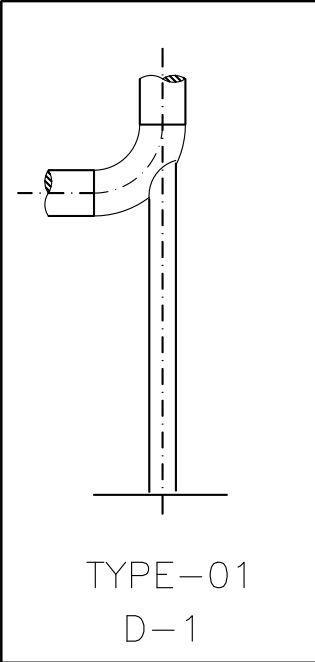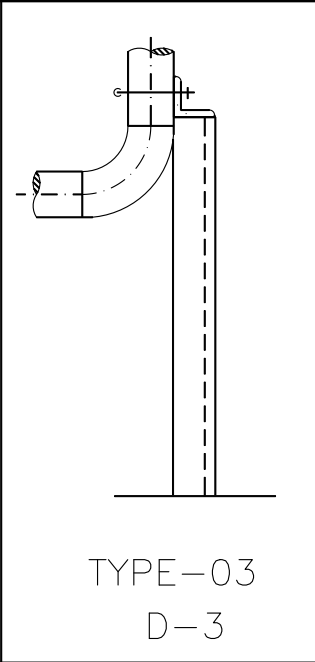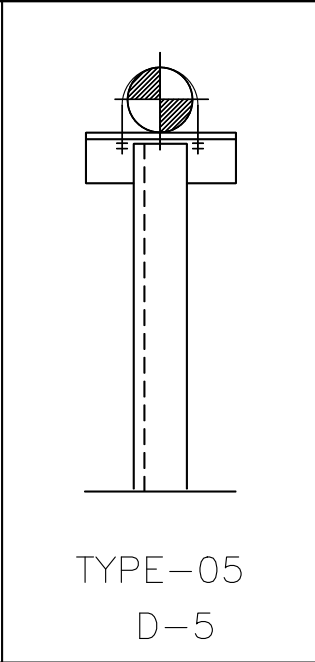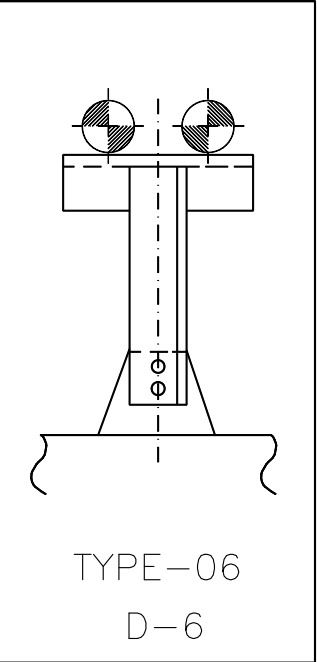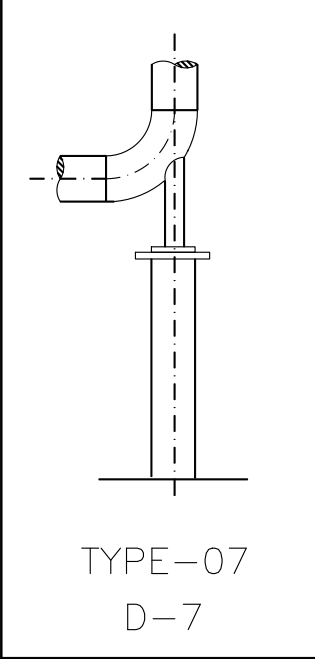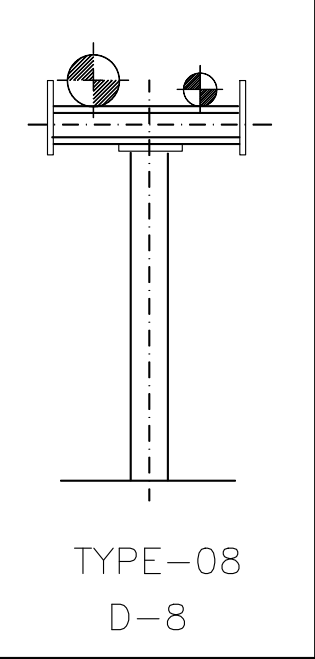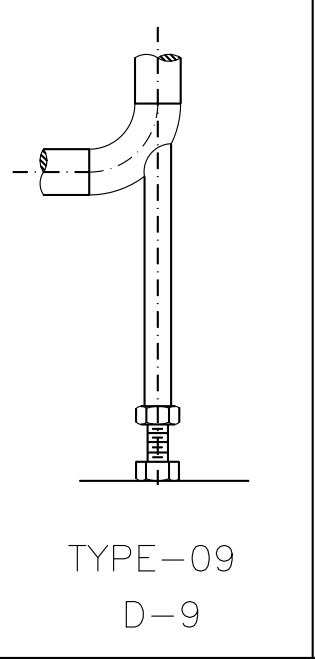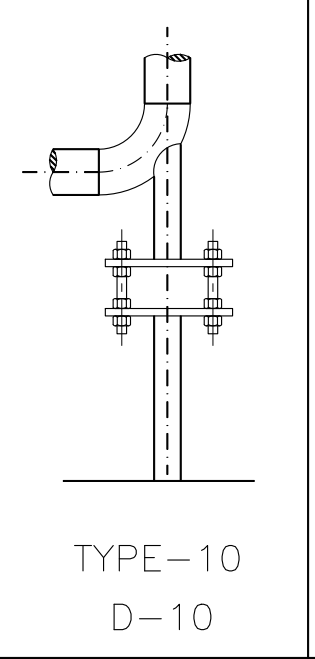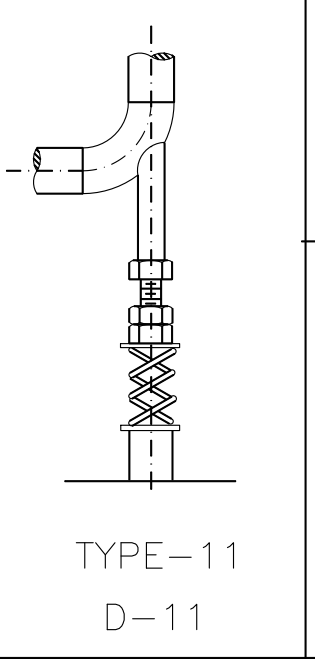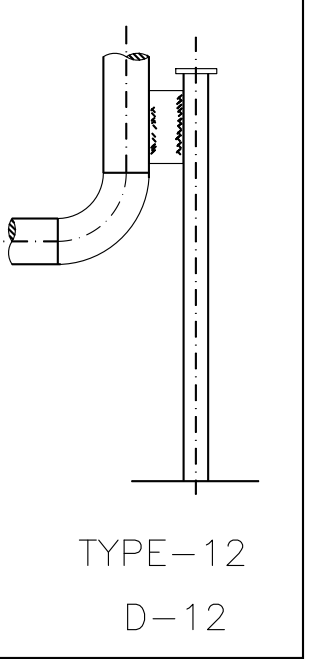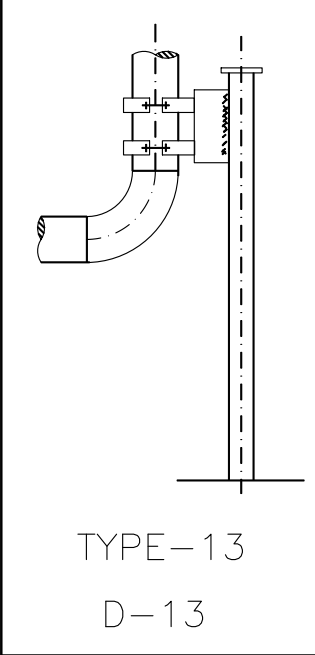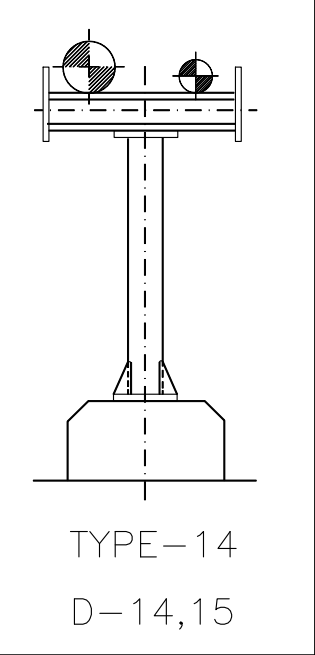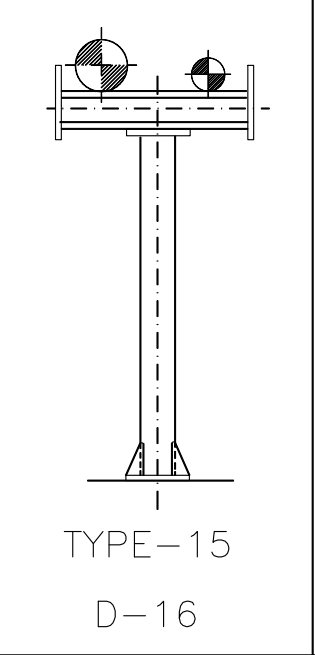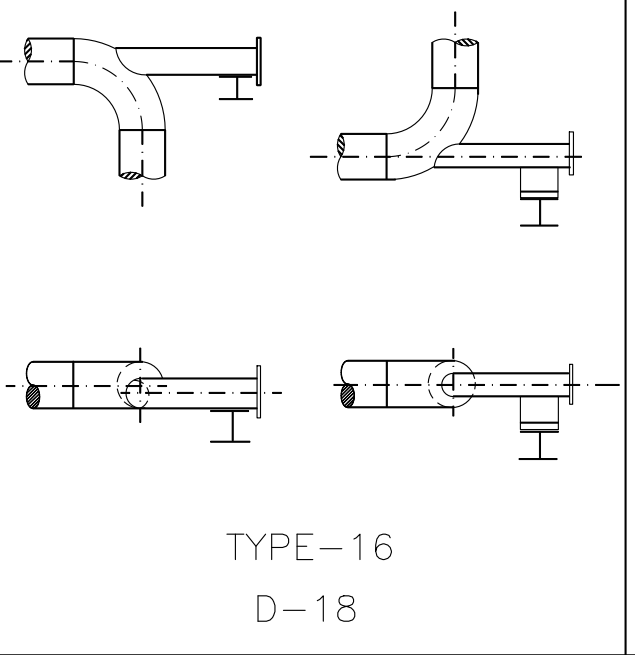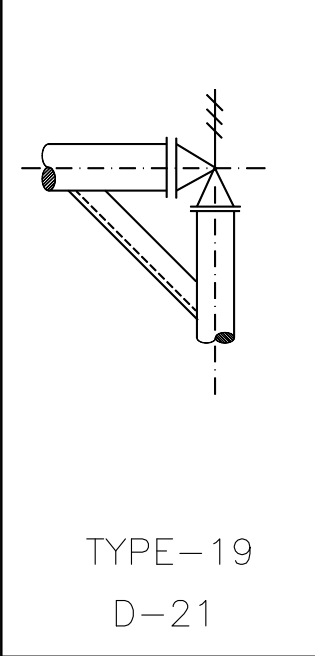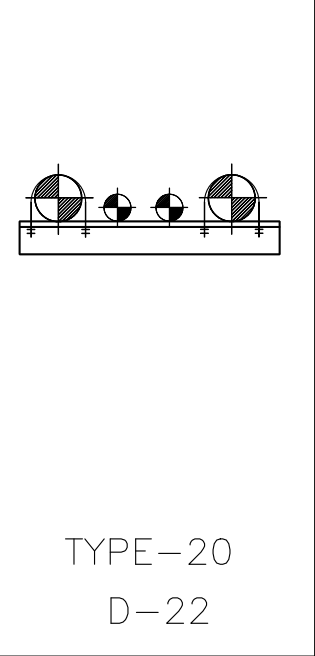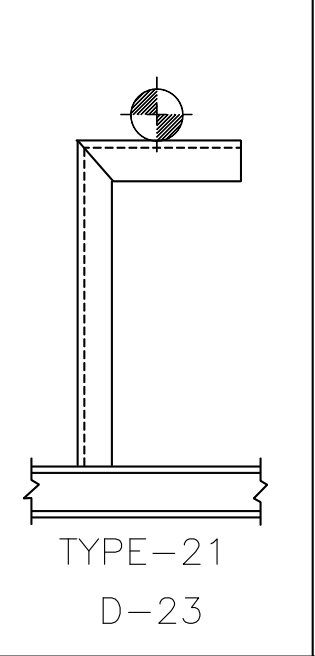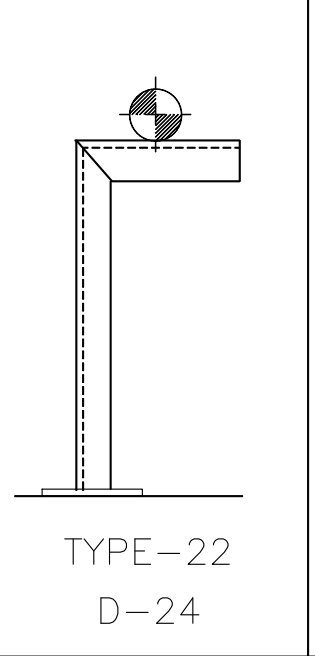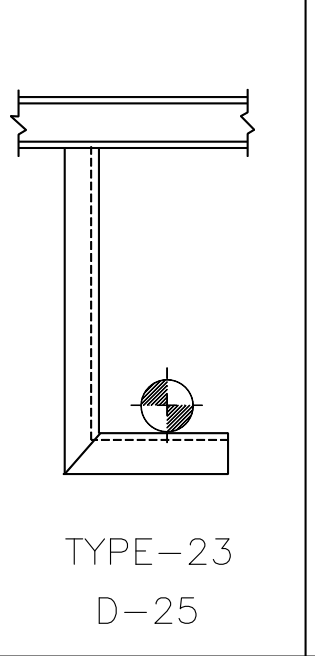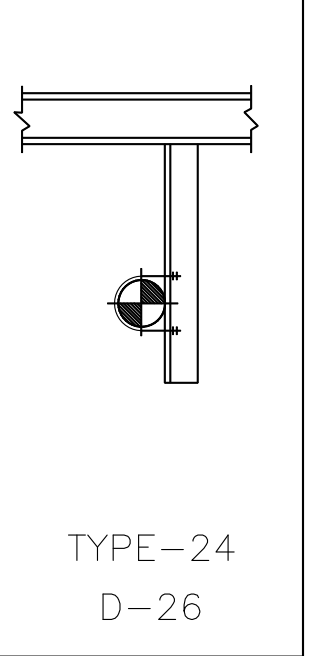
|                                                                                                             |                                                                                                                |                                                                                                              |                                                                                                               |                                                                                                               |                                                                                                               |
|-------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|
|  <p>TYPE-01<br/>D-1</p>    |                                                                                                                |  <p>TYPE-03<br/>D-3</p>    |                                                                                                               |  <p>TYPE-05<br/>D-5</p>    |  <p>TYPE-06<br/>D-6</p>    |
|  <p>TYPE-07<br/>D-7</p>   |  <p>TYPE-08<br/>D-8</p>      |  <p>TYPE-09<br/>D-9</p>   |  <p>TYPE-10<br/>D-10</p>  |  <p>TYPE-11<br/>D-11</p>  |  <p>TYPE-12<br/>D-12</p>  |
|  <p>TYPE-13<br/>D-13</p> |  <p>TYPE-14<br/>D-14,15</p> |  <p>TYPE-15<br/>D-16</p> |  <p>TYPE-16<br/>D-18</p> |                                                                                                               |                                                                                                               |
|  <p>TYPE-19<br/>D-21</p> |  <p>TYPE-20<br/>D-22</p>    |  <p>TYPE-21<br/>D-23</p> |  <p>TYPE-22<br/>D-24</p> |  <p>TYPE-23<br/>D-25</p> |  <p>TYPE-24<br/>D-26</p> |
| <p>中威工程顧問股份有限公司<br/>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</p>                                          |                                                                                                                |                                                                                                              | <p>LIST OF PIPE SUPPORT</p>                                                                                   |                                                                                                               | <p>ENGINEERING STANDARD</p>                                                                                   |
| BY                                                                                                          | SHIH                                                                                                           |                                                                                                              | CHK.                                                                                                          | YANG                                                                                                          |                                                                                                               |
| DATE                                                                                                        | 7/15/'24                                                                                                       |                                                                                                              | APPR.                                                                                                         | CHEN                                                                                                          |                                                                                                               |
|                                                                                                             |                                                                                                                |                                                                                                              |                                                                                                               |                                                                                                               | <p>HP6-DSD-A4-500-001</p>                                                                                     |
|                                                                                                             |                                                                                                                |                                                                                                              |                                                                                                               |                                                                                                               | <p>L-1</p>                                                                                                    |
|                                                                                                             |                                                                                                                |                                                                                                              |                                                                                                               |                                                                                                               | <p>REV. 1</p>                                                                                                 |

FILE: L-1M.DWG




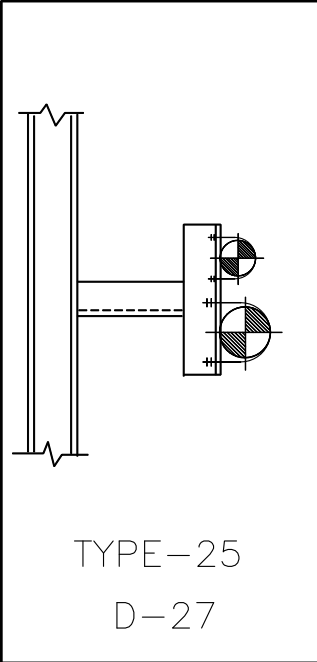
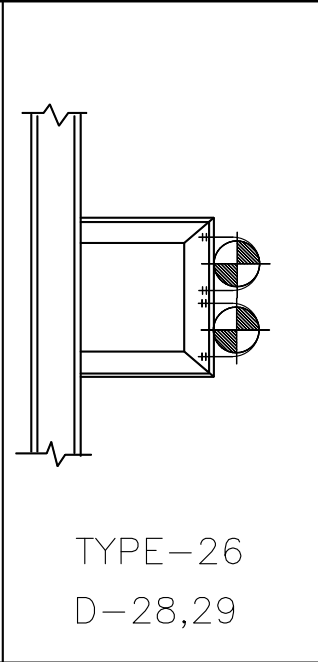
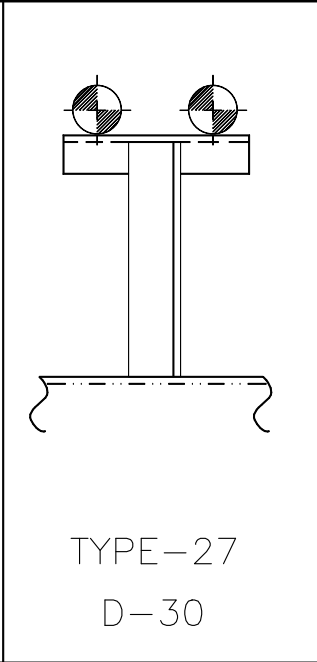
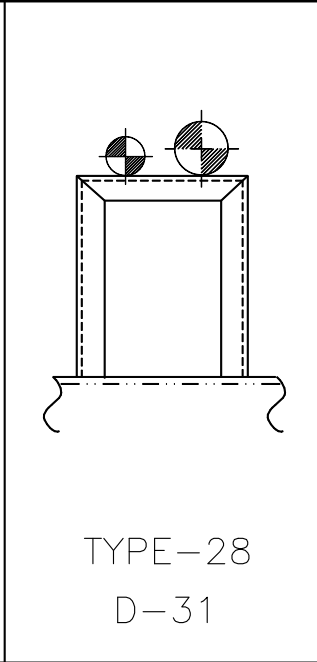
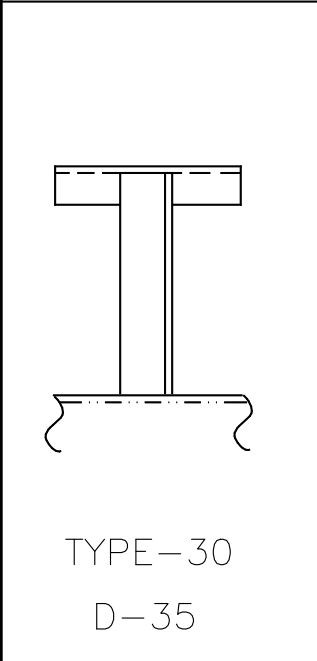
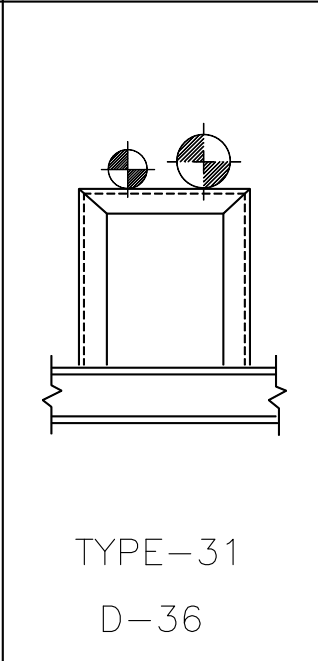
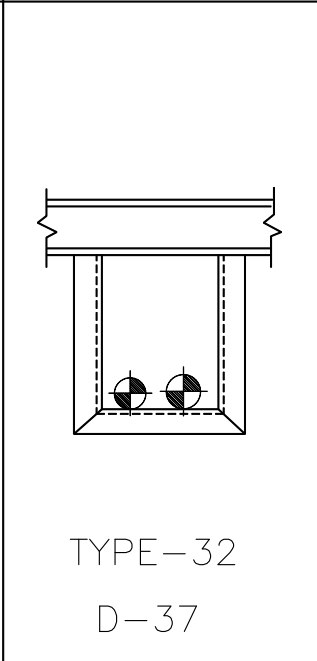
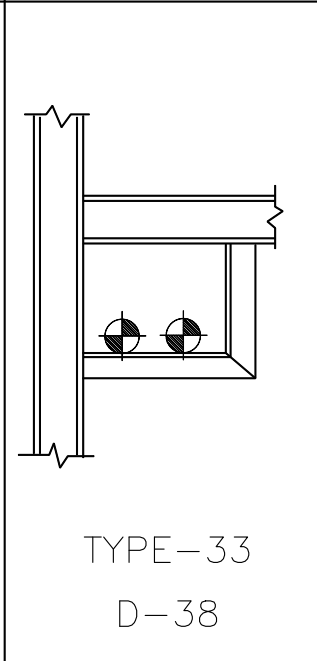
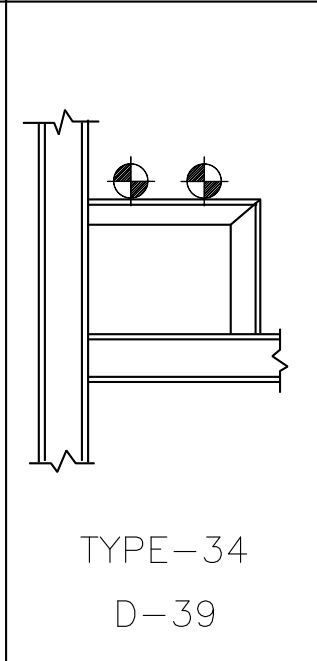
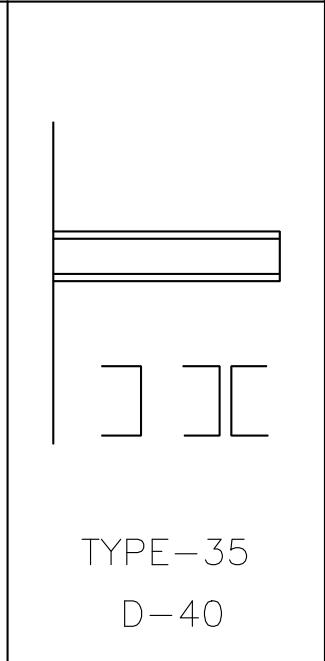
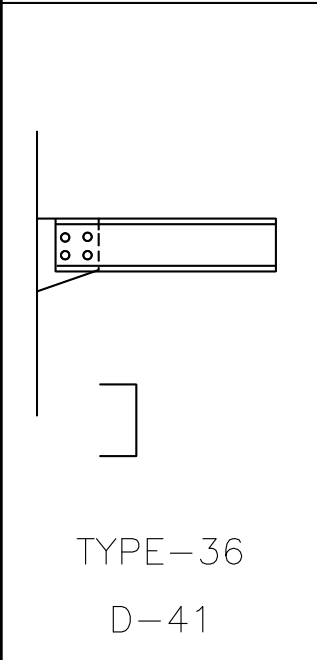
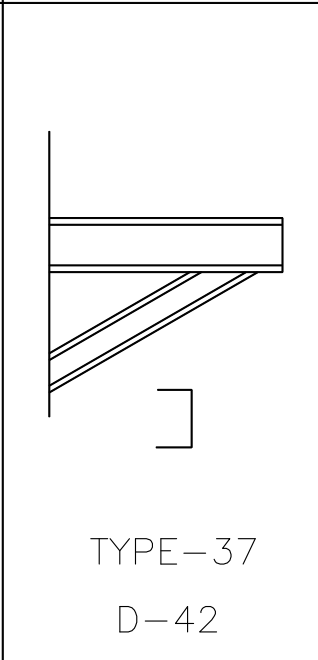
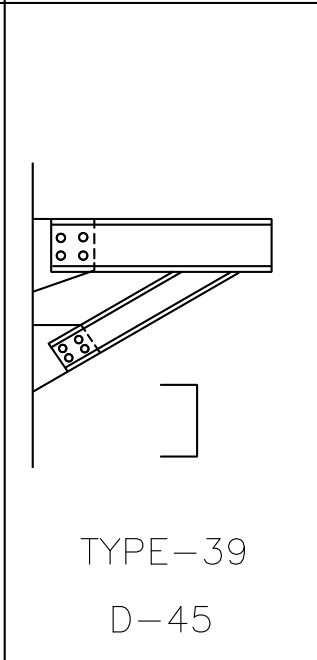
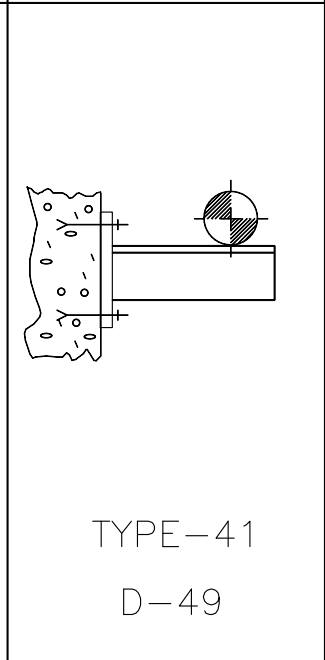
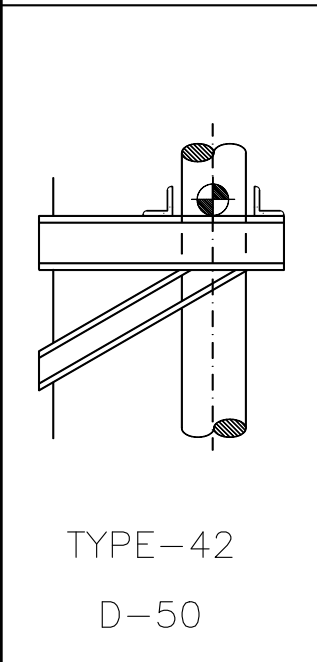
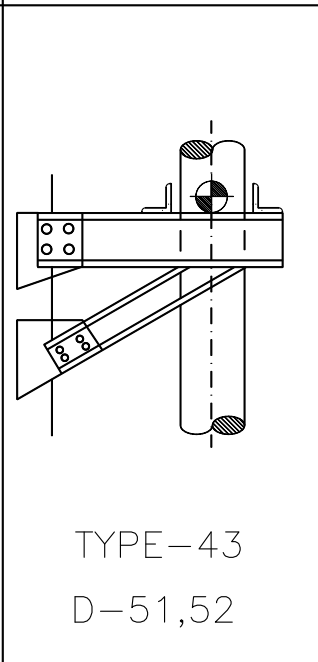
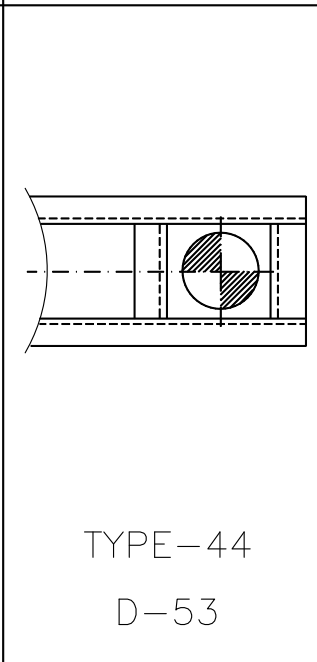
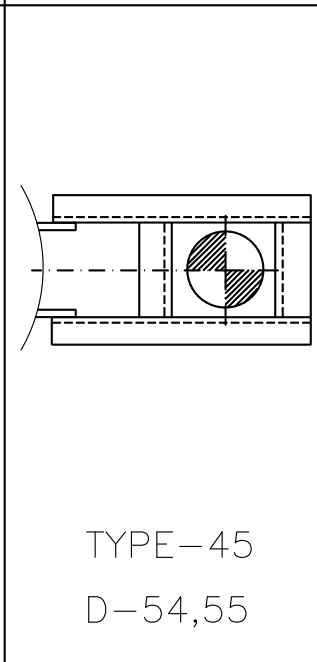
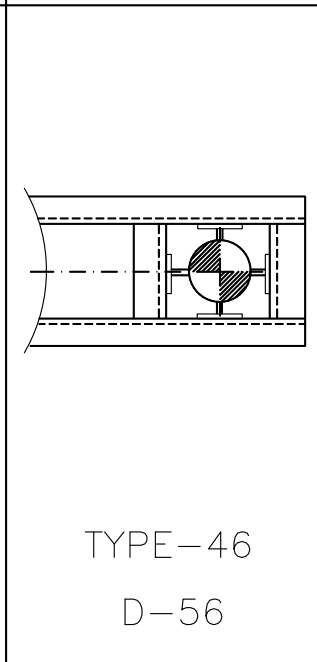
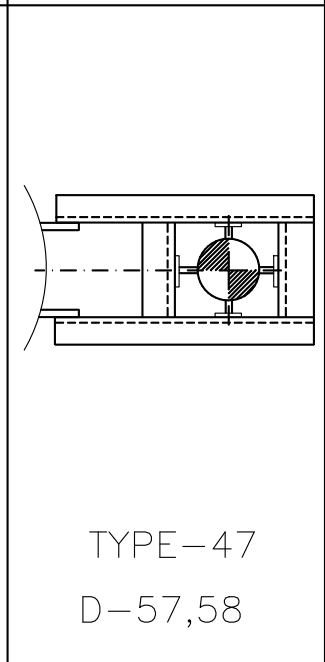
|                                                                                                             |                                                                                                                |                                                                                                              |                                                                                                                  |                                                                                                               |                                                                                                                  |
|-------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------|
|  <p>TYPE-25<br/>D-27</p>   |  <p>TYPE-26<br/>D-28,29</p>   |  <p>TYPE-27<br/>D-30</p>   |  <p>TYPE-28<br/>D-31</p>      |                                                                                                               |                                                                                                                  |
|  <p>TYPE-30<br/>D-35</p>  |  <p>TYPE-31<br/>D-36</p>     |  <p>TYPE-32<br/>D-37</p>  |  <p>TYPE-33<br/>D-38</p>     |  <p>TYPE-34<br/>D-39</p>  |  <p>TYPE-35<br/>D-40</p>     |
|  <p>TYPE-36<br/>D-41</p> |  <p>TYPE-37<br/>D-42</p>    |                                                                                                              |  <p>TYPE-39<br/>D-45</p>    |                                                                                                               |  <p>TYPE-41<br/>D-49</p>    |
|  <p>TYPE-42<br/>D-50</p> |  <p>TYPE-43<br/>D-51,52</p> |  <p>TYPE-44<br/>D-53</p> |  <p>TYPE-45<br/>D-54,55</p> |  <p>TYPE-46<br/>D-56</p> |  <p>TYPE-47<br/>D-57,58</p> |
| <p>中威工程顧問股份有限公司<br/>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</p>                                          |                                                                                                                |                                                                                                              | <p>LIST OF PIPE SUPPORT</p>                                                                                      |                                                                                                               | ENGINEERING STANDARD                                                                                             |
| BY                                                                                                          | SHIH                                                                                                           |                                                                                                              |                                                                                                                  |                                                                                                               | HP6-DSD-A4-500-001                                                                                               |
| DATE                                                                                                        | 7/15/'24                                                                                                       |                                                                                                              |                                                                                                                  |                                                                                                               | REV.<br>1                                                                                                        |
| CHK.                                                                                                        | YANG                                                                                                           |                                                                                                              |                                                                                                                  |                                                                                                               |                                                                                                                  |
| APPR.                                                                                                       | CHEN                                                                                                           |                                                                                                              |                                                                                                                  |                                                                                                               |                                                                                                                  |

FILE: L-2M.DWG
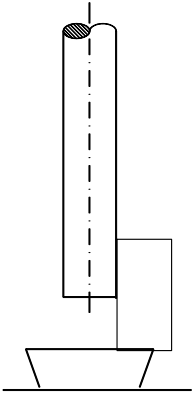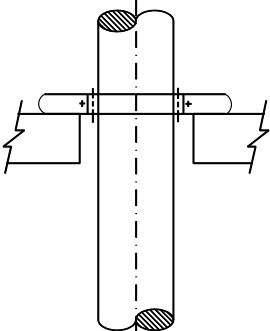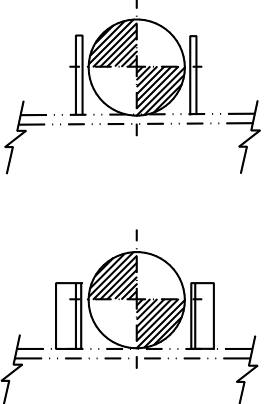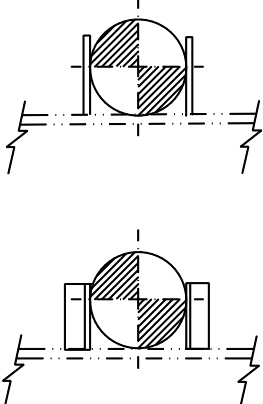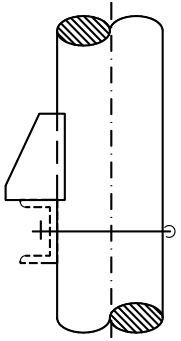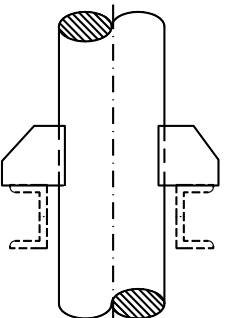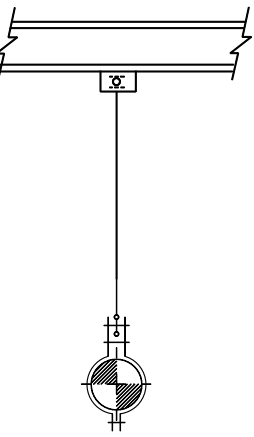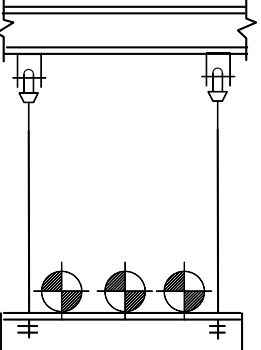
|                                                                                                                     |                                                                                                                   |                                                                                                                 |                                                                                                                       |                                                                                                               |                                                                                                                 |
|---------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------|
|  <p>TYPE-48<br/>D-59</p>           |  <p>TYPE-49<br/>D-60</p>         |  <p>TYPE-51<br/>D-62,62A</p>  |  <p>TYPE-51A<br/>D-62A-1,62A-2</p> |  <p>TYPE-52<br/>D-63</p>   |  <p>TYPE-53<br/>D-64,64A</p> |
|  <p>TYPE-54<br/>D-65</p>          |  <p>TYPE-55<br/>D-66,66A</p>    |  <p>TYPE-56<br/>D-67,67A</p> |  <p>TYPE-57<br/>D-68</p>          |  <p>TYPE-58<br/>D-69</p>  |  <p>TYPE-59<br/>D-70</p>    |
|  <p>TYPE-60<br/>D-71</p>         |  <p>TYPE-61<br/>D-72,73,74</p> |  <p>TYPE-62<br/>D-75,76</p> |                                                                                                                       |  <p>TYPE-64<br/>D-78</p> |  <p>TYPE-65<br/>D-79</p>   |
|  <p>TYPE-66<br/>D-80,80A,80B</p> |  <p>TYPE-67<br/>D-81,81A</p>   |                                                                                                                 |                                                                                                                       |                                                                                                               |                                                                                                                 |

|                                                                               |                      |                      |        |
|-------------------------------------------------------------------------------|----------------------|----------------------|--------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> | LIST OF PIPE SUPPORT | ENGINEERING STANDARD |        |
|                                                                               |                      | HP6-DSD-A4-500-001   |        |
|                                                                               |                      | L-3                  | REV. 1 |
| BY                                                                            | SHIH                 | CHK.                 | YANG   |
| DATE                                                                          | 7/15/'24             | APPR.                | CHEN   |

FILE: L-3M.DWG

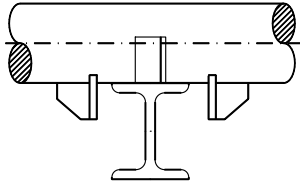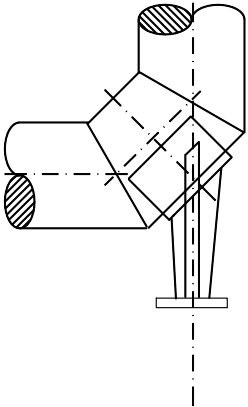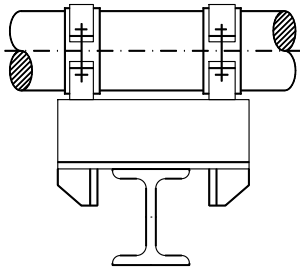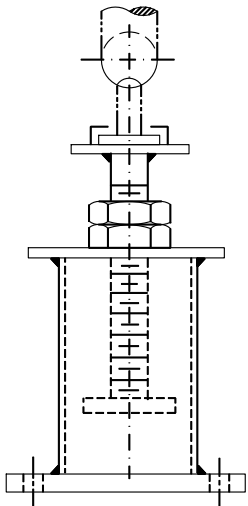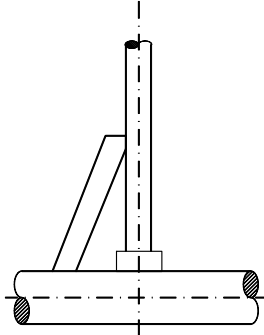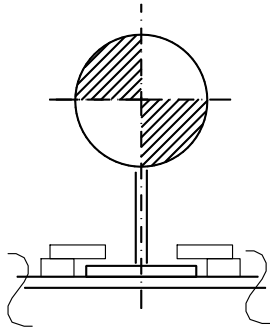
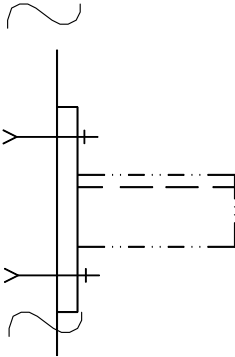
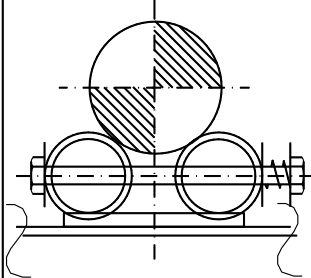

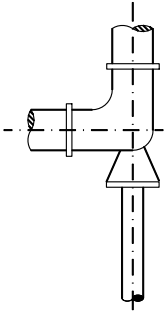


|                                                                                     |                                                                                     |                                                                                      |                                                                                       |                                                                                       |                                                                                       |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
|    |    |                                                                                      |    |    |    |
| TYPE-72<br>D-87                                                                     | TYPE-73<br>D-88,88A                                                                 |                                                                                      | TYPE-82A<br>D-100A-1,100A-2                                                           | TYPE-76<br>D-91                                                                       | TYPE-77<br>D-92                                                                       |
|   |   |   |   |   |   |
| TYPE-78<br>D-93                                                                     | TYPE-79<br>D-94                                                                     | TYPE-80<br>D-95,96                                                                   | TYPE-81<br>D-97,98                                                                    | TYPE-82<br>D-99,100                                                                   | TYPE-83<br>D-101,102                                                                  |
|  |  |  |  |  |  |
| TYPE-84<br>D-103,104                                                                | TYPE-85<br>D-105,106                                                                | TYPE-86<br>D-107,108                                                                 | TYPE-87<br>D-109                                                                      | TYPE-101<br>D-110                                                                     | TYPE-102<br>D-111                                                                     |
|  |  |  |  |  |  |
| TYPE-103<br>D-112                                                                   | TYPE-104<br>D-113                                                                   | TYPE-105<br>D-114,115                                                                | TYPE-108<br>D-119,120                                                                 | TYPE-112<br>D-125                                                                     | TYPE-115<br>D-128                                                                     |

FILE: L-4M.DWG

|                                            |          |  |       |      |  |                      |           |
|--------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司                               |          |  |       |      |  | ENGINEERING STANDARD |           |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                         | SHIH     |  | CHK.  | YANG |  | L-4                  | REV.<br>1 |
| DATE                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |





















LIST OF PIPE SUPPORT

FILE: L-4M.DWG

|                                                                                    |                                                                                    |                                                                                     |                                                                                      |                      |        |
|------------------------------------------------------------------------------------|------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|----------------------|--------|
|   |   |   |                                                                                      |                      |        |
| TYPE-118<br>D-131                                                                  | TYPE-119<br>D-132                                                                  | TYPE-120<br>D-133,134                                                               |                                                                                      |                      |        |
|  |  |  |  |                      |        |
| TYPE-125<br>D-135                                                                  | TYPE-126<br>D-136                                                                  | TYPE-127<br>D-137                                                                   | TYPE-128<br>D-138                                                                    |                      |        |
|                                                                                    |                                                                                    |                                                                                     |                                                                                      |                      |        |
|                                                                                    |                                                                                    |                                                                                     |                                                                                      |                      |        |
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div>      |                                                                                    | LIST OF PIPE SUPPORT                                                                |                                                                                      | ENGINEERING STANDARD |        |
| BY                                                                                 | SHIH                                                                               |                                                                                     |                                                                                      | HP6-DSD-A4-500-001   |        |
| DATE                                                                               | 7/15/'24                                                                           |                                                                                     |                                                                                      | L-5                  | REV. 1 |
|                                                                                    | CHK.                                                                               | YANG                                                                                |                                                                                      |                      |        |
|                                                                                    | APPR.                                                                              | CHEN                                                                                |                                                                                      |                      |        |



















FILE: L-5M.DWG

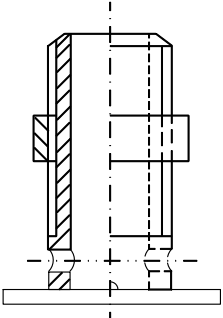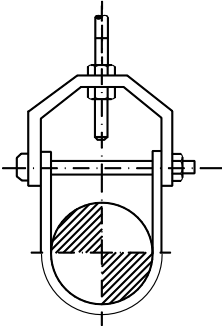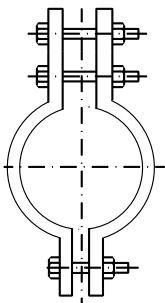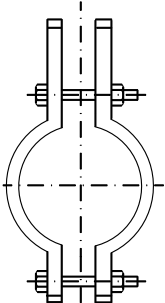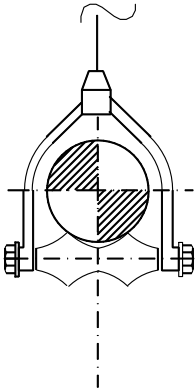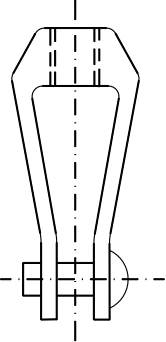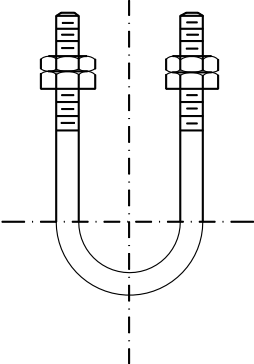

|                                                                                     |                                                                                     |                                                                                      |                                                                                       |                                                                                       |                                                                                       |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|
|    |                                                                                     |    |    |    |    |
| SBP<br>M-1                                                                          |                                                                                     | ADC<br>M-3                                                                           | PCL-A<br>M-4                                                                          | PCL-B<br>M-5                                                                          | PCL-C<br>M-6                                                                          |
|   |   |   |   |   |   |
| PCL-D<br>M-7                                                                        | PCL-E<br>M-8                                                                        | PCL-F<br>M-9                                                                         | PCL-G<br>M-10                                                                         | RCL-A<br>M-11                                                                         | RCL-B<br>M-12                                                                         |
|  |                                                                                     |                                                                                      |  |  |  |
| PR-A<br>M-13                                                                        |                                                                                     |                                                                                      | TUB<br>M-21                                                                           | MTR<br>M-22                                                                           | WER<br>M-23                                                                           |
|  |  |  |  |  |  |
| FSC<br>M-24                                                                         | WEN<br>M-25                                                                         | UB<br>M-26                                                                           | ABR<br>M-27                                                                           | BA-A<br>M-28                                                                          | BA-B<br>M-29                                                                          |


FILE: L-6M.DWG

|                                                                                                      |          |  |       |      |  |                      |           |
|------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div><div>  </div><div>中威工程顧問股份有限公司</div><div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div></div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                      |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
|                                                                                                      |          |  |       |      |  | L-6                  | REV.<br>1 |
| BY                                                                                                   | SHIH     |  | CHK.  | YANG |  | LIST OF PIPE SUPPORT |           |
| DATE                                                                                                 | 7/15/'24 |  | APPR. | CHEN |  |                      |           |
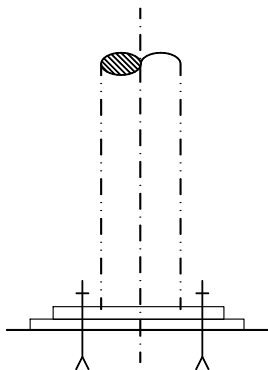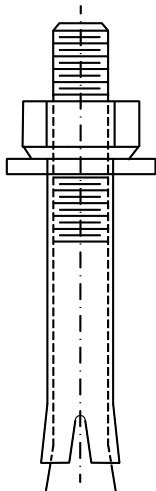
|                                                                                     |                                                                                     |                                                                                      |                                                                                       |                                                                                       |                                                                                       |     |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------|-----|
|    |    |    |    |    |    |     |
| BA-C<br>M-30                                                                        | SWP<br>M-31                                                                         | LGP-A<br>M-32                                                                        | LGP-B<br>M-33                                                                         | LGP-C<br>M-34                                                                         | LGP-D<br>M-35                                                                         |     |
|   |   |                                                                                      |                                                                                       |   |   |     |
| LGP-E<br>M-36                                                                       | LGP-F<br>M-37                                                                       |                                                                                      |                                                                                       | LGP-P<br>M-41                                                                         | LOWER COMP.<br>OF BASE SUPT.<br>M-42,42A,43                                           |     |
|                                                                                     |  |                                                                                      |  |                                                                                       |                                                                                       |     |
|                                                                                     | EB<br>M-45                                                                          |                                                                                      | ASB<br>M-47                                                                           |                                                                                       |                                                                                       |     |
|  |  |  |  |  |  |     |
| SPRW<br>M-52                                                                        | STRAP<br>M-54                                                                       | U-BAND<br>M-55                                                                       | PCL-H<br>M-56                                                                         | SADD<br>M-57                                                                          | UB-A<br>M-58                                                                          |     |
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD.                          |                                                                                     | LIST OF PIPE SUPPORT                                                                 |                                                                                       |                                                                                       | ENGINEERING STANDARD                                                                  |     |
|                                                                                     |                                                                                     |                                                                                      |                                                                                       |                                                                                       | HP6-DSD-A4-500-001                                                                    |     |
| BY                                                                                  | SHIH                                                                                |                                                                                      |                                                                                       |                                                                                       |                                                                                       |     |
| DATE                                                                                | 7/15/'24                                                                            |                                                                                      | APPR.                                                                                 | CHEN                                                                                  |                                                                                       | L-7 |


FILE: L-7M.DWG





SLP-A  
M-60

|     |           |
|-----|-----------|
| L-8 | REV.<br>1 |
|-----|-----------|

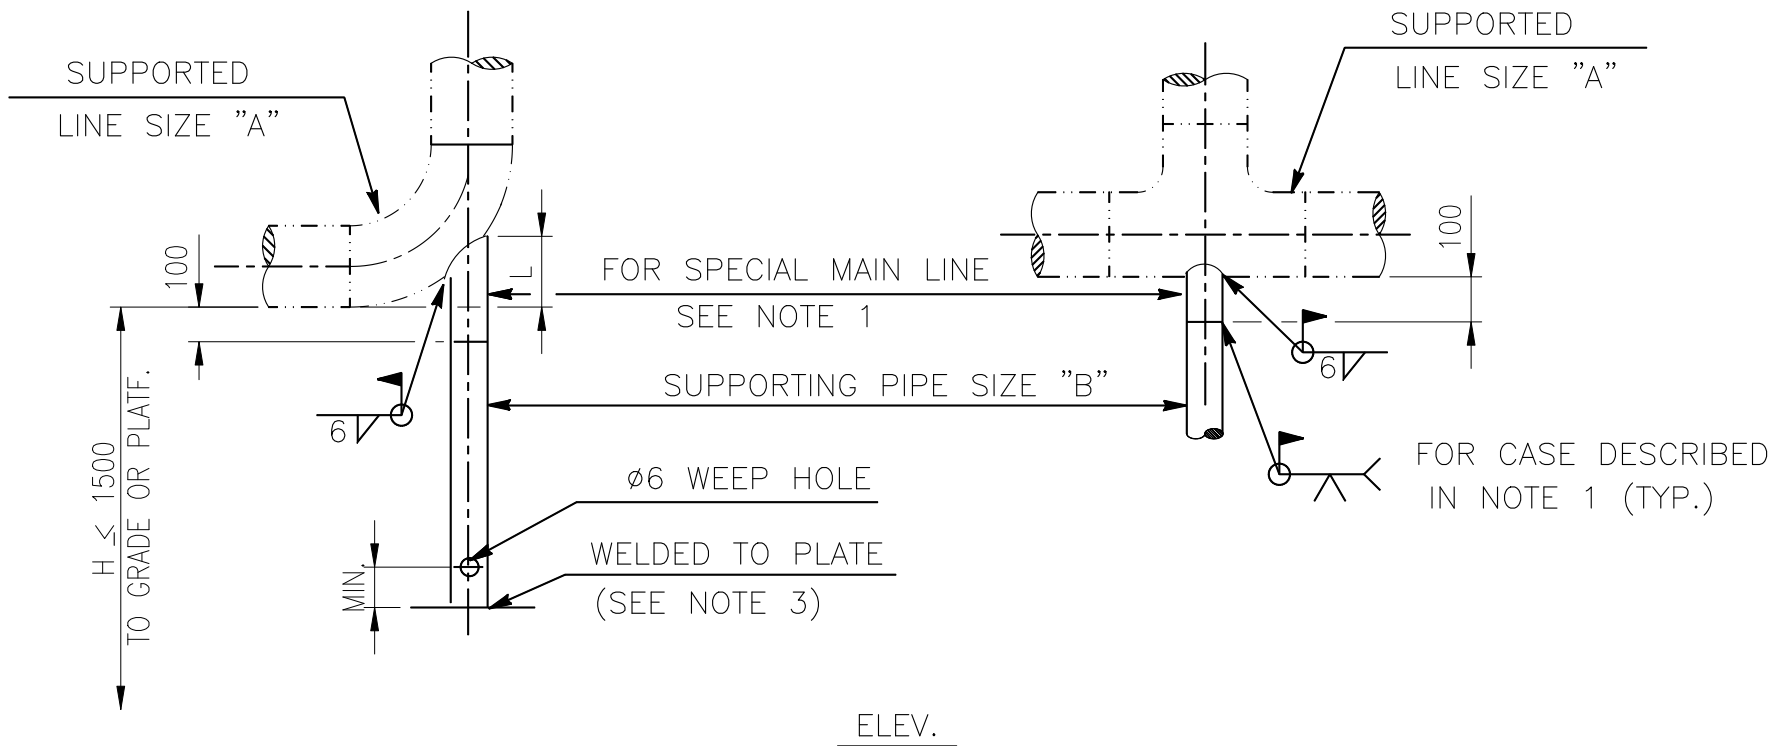

| LINE SIZE<br>"A" | PIPE SIZE<br>"B" | L<br>(NOTE 5) | LINE SIZE<br>"A" | PIPE SIZE<br>"B" | L<br>(NOTE 5) |
|------------------|------------------|---------------|------------------|------------------|---------------|
| 2"               | 1 1/2" SCH.80    | 71            | 30"              | 18"STD.WT        | 859           |
| 3"               | 2"SCH.40         | 93            | 32"              | 24"STD.WT        | 1060          |
| 4"               | 3"SCH.40         | 139           | 34"              | 24"STD.WT        | 1077          |
| 6"               | 4"SCH.40         | 186           | 36"              | 24"STD.WT        | 1099          |
| 8"               | 6"SCH.40         | 271           | 38"              | 24"STD.WT        | 1099          |
| 10"              | 8"SCH.40         | 353           | 40"              | 24"STD.WT        | 1147          |
| 12"              | 8"SCH.40         | 370           | 42"              | 24"STD.WT        | 1173          |
| 14"              | 10"SCH.40        | 473           | 44"              | 24"STD.WT        | 1200          |
| 16"              | 10"SCH.40        | 491           | 46"              | 28"STD.WT        | 1329          |
| 18"              | 12"STD.WT        | 572           | 48"              | 28"STD.WT        | 1355          |
| 20"              | 12"STD.WT        | 594           | 50"              | 28"STD.WT        | 1382          |
| 22"              | 14"STD.WT        | 652           |                  |                  |               |
| 24"              | 14"STD.WT        | 677           |                  |                  |               |
| 26"              | 16"STD.WT        | 756           |                  |                  |               |
| 28"              | 16"STD.WT        | 782           |                  |                  |               |

NOTES :

1. FOR ALLOY STEEL STAINLESS STEEL & STRESS RELIEF LINES, THE MATERIALS SHALL BE THE SAME AS MAIN LINES.

2. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .

3. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE .

4. DESIGNATION NUMBER DENOTE AS FOLLOWS:

01-2B-05B

DENOTE THE LOWER COMPONENT TYPE SEE M-42

DENOTE DIMENSION "H" (IN 100mm) (SEE NOTE 6)

DENOTE SUPPORTED LINE SIZE "A"


DENOTE TYPE NO.

5. DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.

6. IF ONE OF THE LOWER COMPONENT TYPE-A,B,E,G IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-1                  |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-01                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

FILE: D-1M.DWG

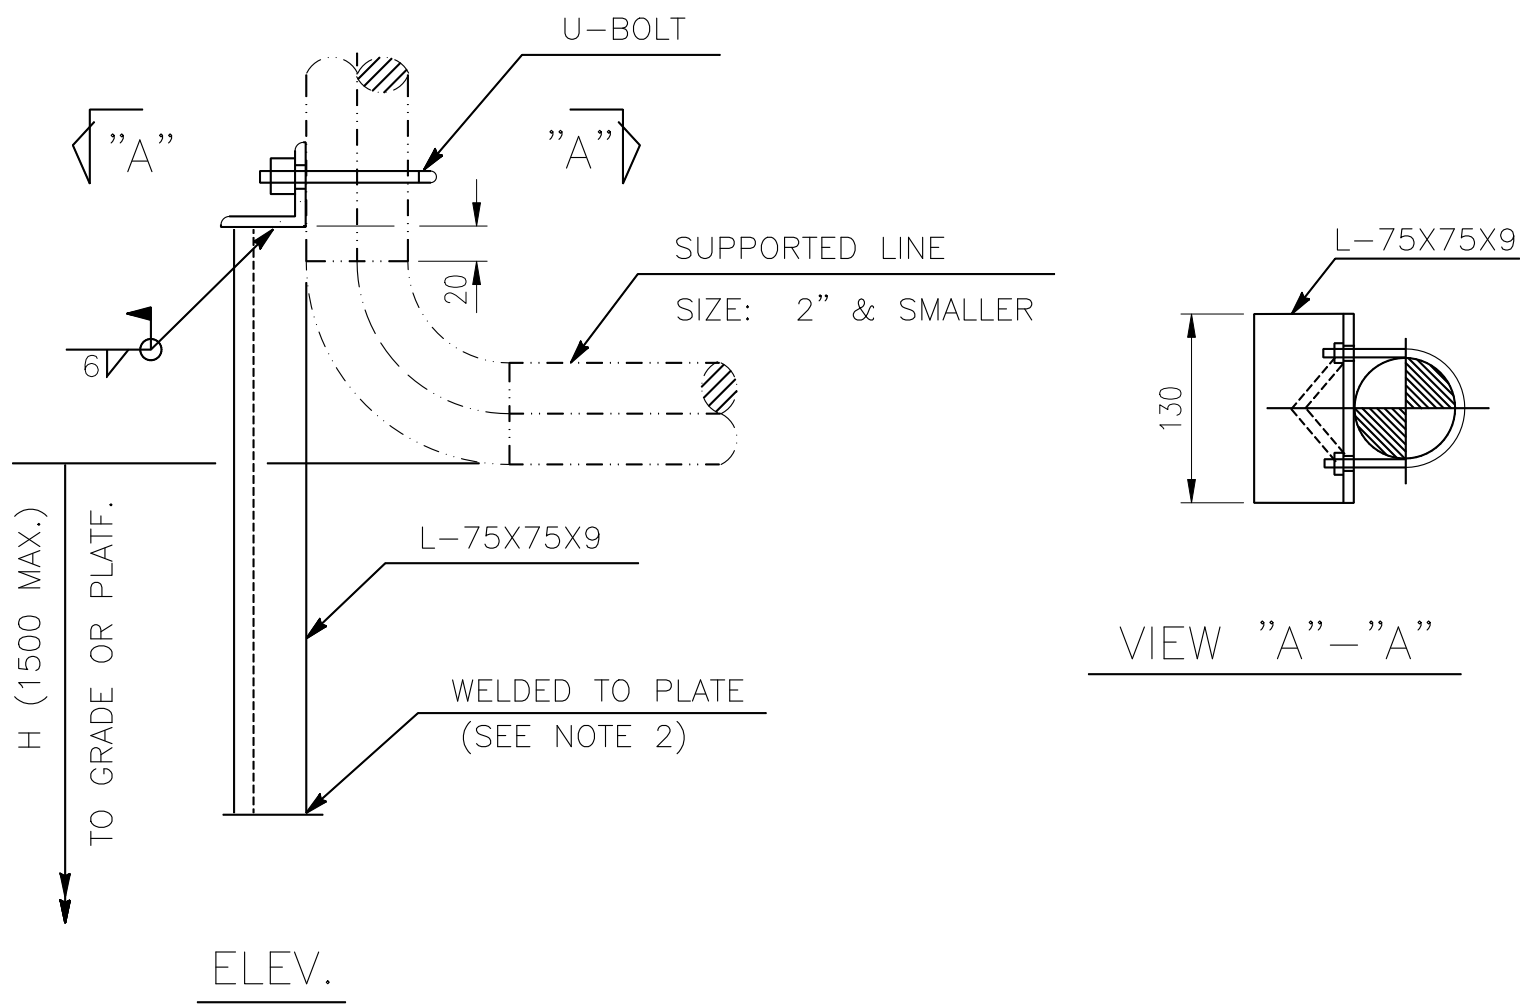

NOTES :

- DIMENSION "H" SHALL BE SUITED IN FIELD.
- THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE- D,L,M,N,P & R ONLY.
- DESIGNATION NUMBER, DENOTE AS FOLLOWS :  
03-1B-05N  
DENOTE THE LOWER COMPONENT TYPE SEE M-42  
DENOTE DIMENSION "H" (IN 100 mm) (SEE NOTE 4)  
DENOTE SUPPORTED LINE SIZE  
DENOTE TYPE NO.
- IF ONE OF THE LOWER COMPONENT TYPE-L, M IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

FILE: D-3M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-3                  |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-03                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |



1. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .
2. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE-D,L,P,&R ONLY.
3. DESIGNATION NUMBER DENOTE AS FOLLOWS :  

05-L50-05L


DENOTE THE LOWER COMPONENT TYPE SEE M-42

DENOTE DIMENSION "H" (IN 100mm) (SEE NOTE 4)



DENOTE MEMBER "M"

DENOTE TYPE NO.
4. IF THE LOWER COMPONENT TYPE-L IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.


|                                                                               |          |  |       |      |  |                                                      |  |  |  |  |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------------|--|--|--|--|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-05</div> |  |  |  |  |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |                                                      |  |  |  |  |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                                      |  |  |  |  |  | D-5                  |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                      |  |  |  |  |  |                      |  |

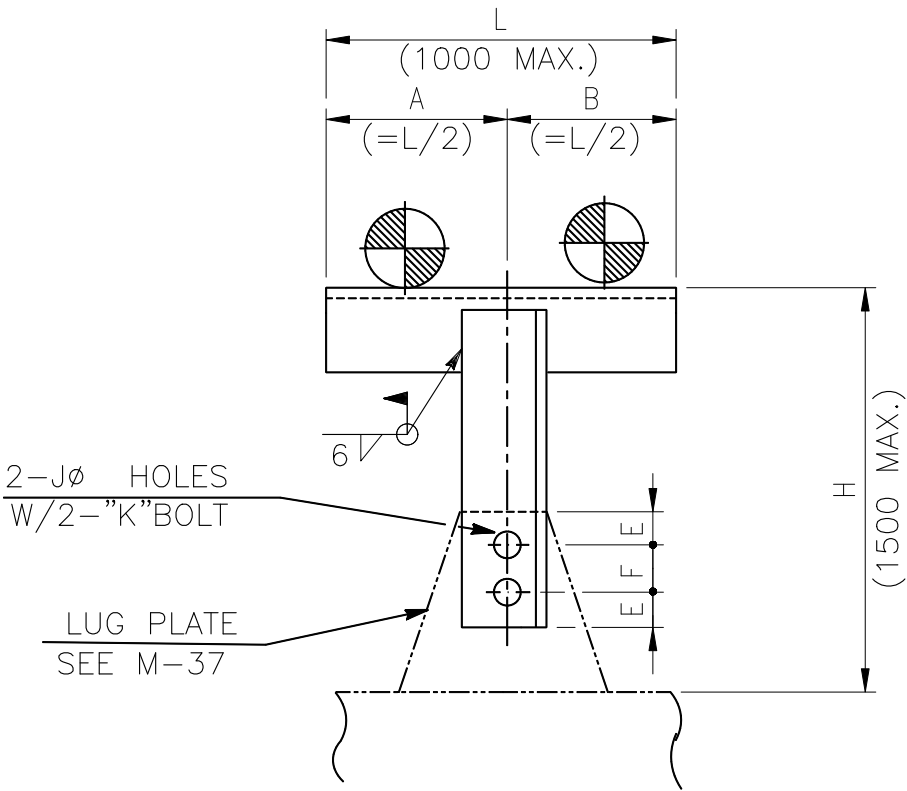

ELEV.

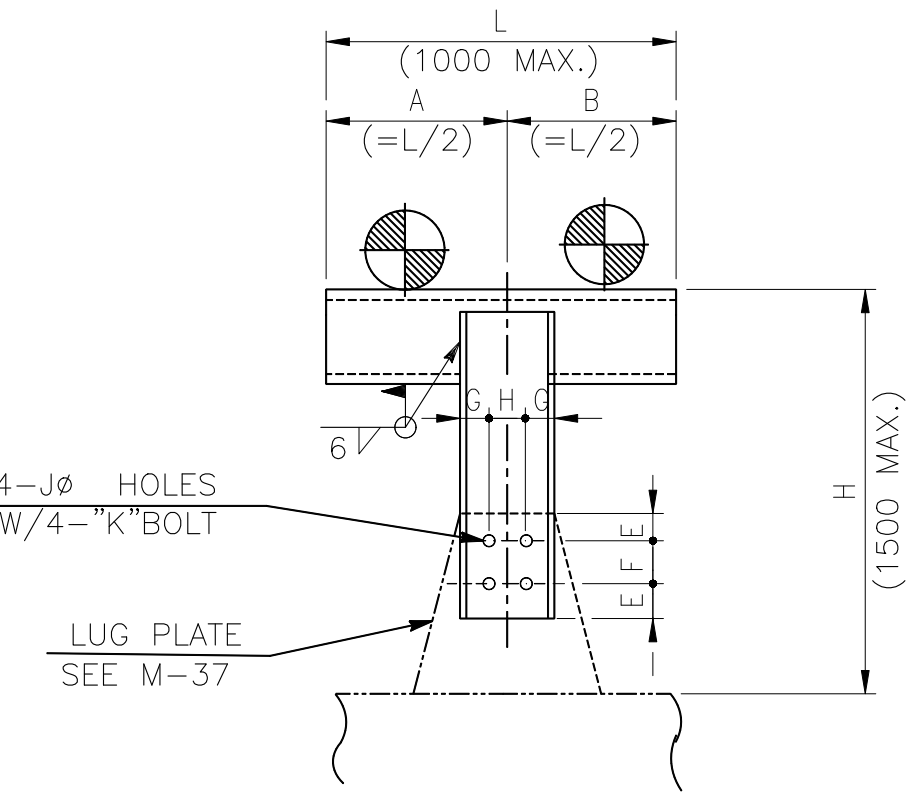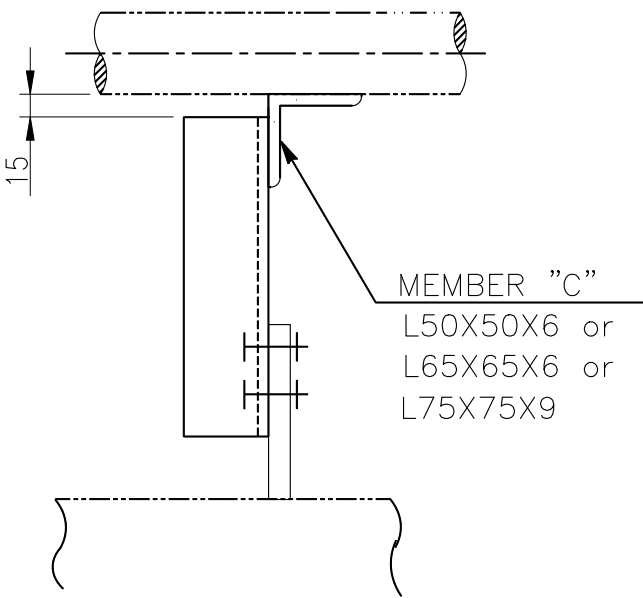

ELEV.

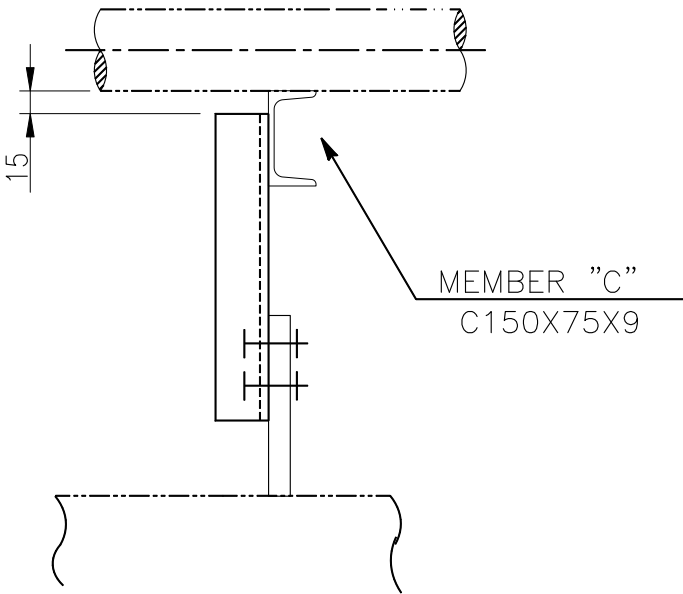


DIMENSIONS (mm)

| MEMBER "C" | E  | F   | G  | H  | J  | K       |
|------------|----|-----|----|----|----|---------|
| L50X50X6   | 30 | 60  | -  | -  | 19 | 5/8"X40 |
| L65X65X6   | 30 | 70  | -  | -  | 22 | 3/4"X50 |
| L75X75X9   | 30 | 70  | -  | -  | 22 | 3/4"X50 |
| C150X75X9  | 30 | 100 | 40 | 70 | 22 | 3/4"X50 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

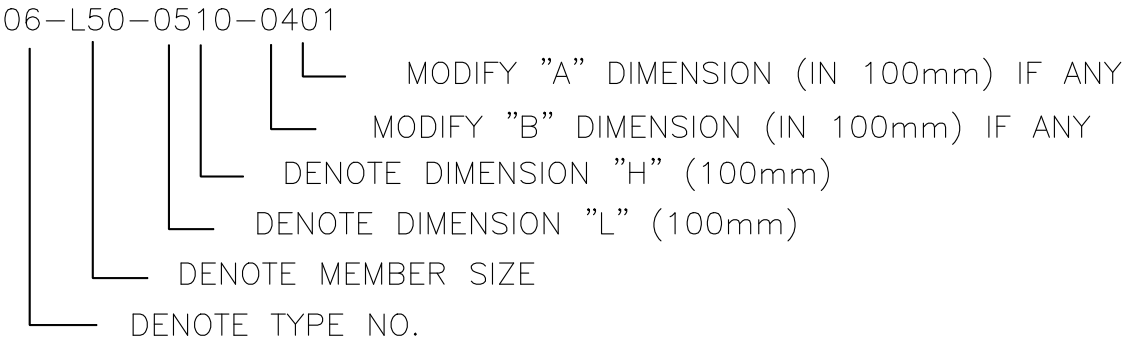


2. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD

FILE: D-6M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-6                  | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-06

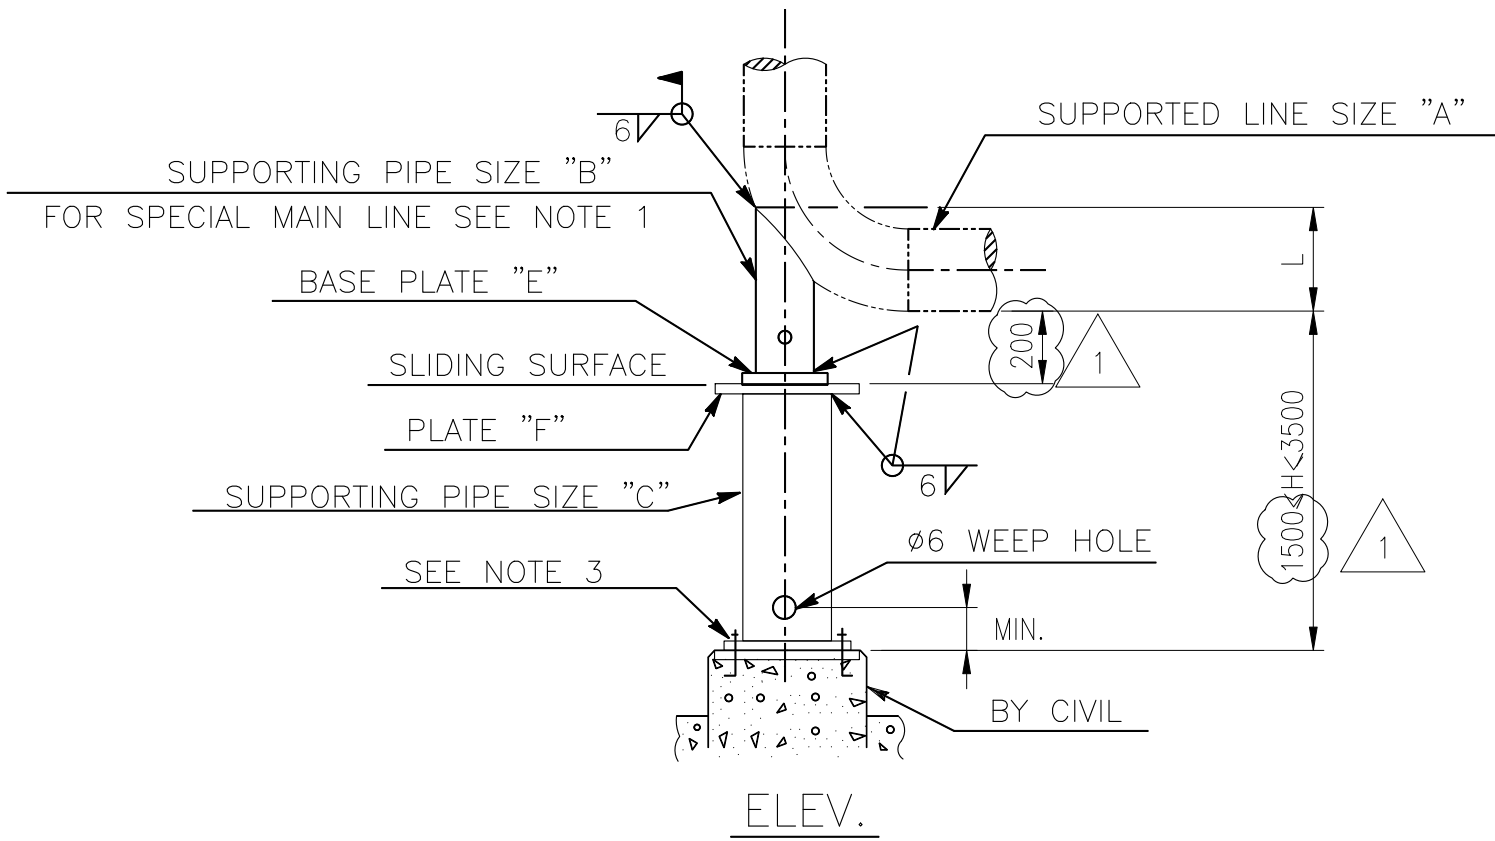

DIMENSIONS (mm)

| LINE SIZE "A" | PIPE SIZE "B" | PIPE SIZE "C" | E          | F          | L<br>NOTE 4 |
|---------------|---------------|---------------|------------|------------|-------------|
| 2"            | 1 1/2" SCH.80 | 3" SCH.40     | 200X200X9  | 200X200X9  | 71          |
| 3"            | 2" SCH.40     | 4" SCH.40     | 200X200X9  | 250X250X9  | 93          |
| 4"            | 3" SCH.40     | 4" SCH.40     | 200X200X9  | 250X250X9  | 137         |
| 6"            | 4" SCH.40     | 8" SCH.40     | 250X250X9  | 300X300X12 | 186         |
| 8"            | 6" SCH.40     | 12" STD.WT    | 250X250X9  | 400X400X16 | 271         |
| 10"           | 8" SCH.40     | 12" STD.WT    | 350X350X12 | 400X400X16 | 353         |
| 12"           | 8" SCH.40     | 12" STD.WT    | 350X350X12 | 400X400X16 | 370         |

- NOTES :
- 1. FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES, THE MATERIALS SHALL BE THE SAME AS MAIN LINES
  - 2. DIMENSION "H" SHALL BE SUITED IN FIELD.
  - 3. THIS TYPE SHALL BE USED WITH M-42 TYPE-J.
  - 4. DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.
  - 5. DESIGNATION NUMBER DENOTE AS FOLLOWS :

07-2B-20J

DENOTE TYPE NO.

DENOTE SUPPORTED LINE SIZE "A"

DENOTE THE LOWER COMPONENT TYPE  
SEE M-42


DENOTE DIMENSION "H" (IN 100mm)

FILE: D-7M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-7                  | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-07



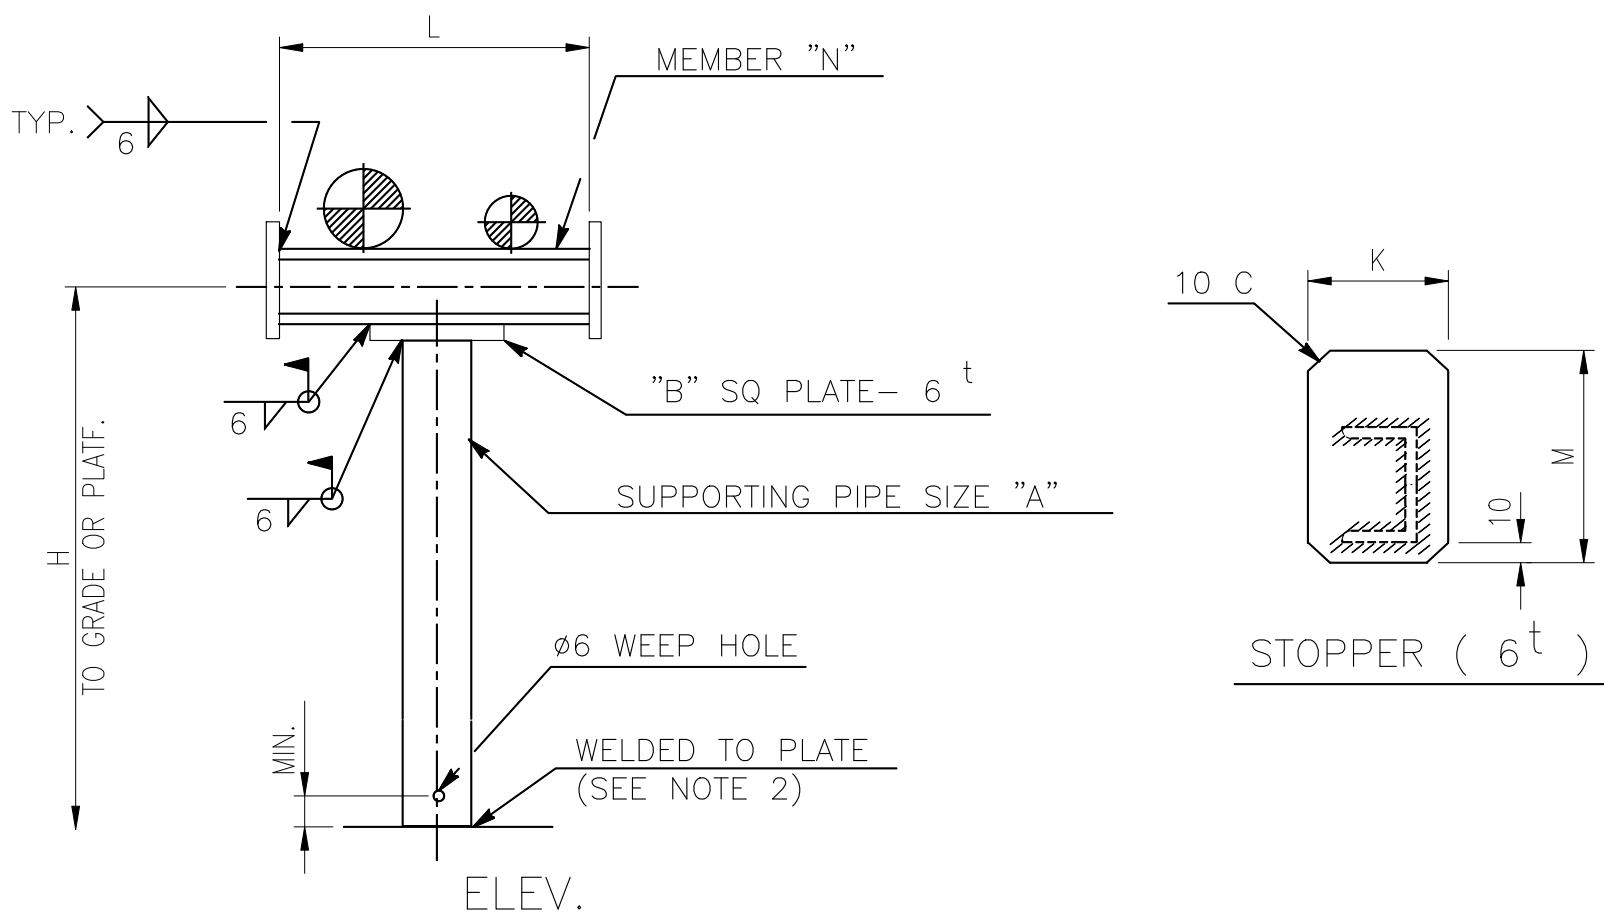

DIMENSIONS (mm)

| PIPE SIZE<br>"A" | L<br>(MAX.) | H<br>(MAX.) | K  | M   | B   | MEMBER "N" |
|------------------|-------------|-------------|----|-----|-----|------------|
| 2"SCH.40         | 1000        | 1500        | 70 | 160 | 80  | C100X50X5  |
| 3"SCH.40         | 1000        | 1500        | 70 | 160 | 110 | C100X50X5  |
| 4"SCH.40         | 1000        | 1500        | 85 | 185 | 135 | C125X65X6  |

NOTES:

1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.
2. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE-G & J ONLY.
3. DESIGNATION NUMBER DENOTE AS FOLLOWS:

08-2B-1005G

DENOTE THE LOWER COMPONENT TYPE SEE M-42

DENOTE DIMENSION "H" (IN 100mm) (SEE NOTE 4)


DENOTE DIMENSION "L" (IN 100 mm)

DENOTE SUPPORTING PIPE SIZE "A"

DENOTE TYPE NO.
4. IF THE LOWER COMPONENT TYPE-G IS USED. DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

FILE: D-8M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-8                  |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-08                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

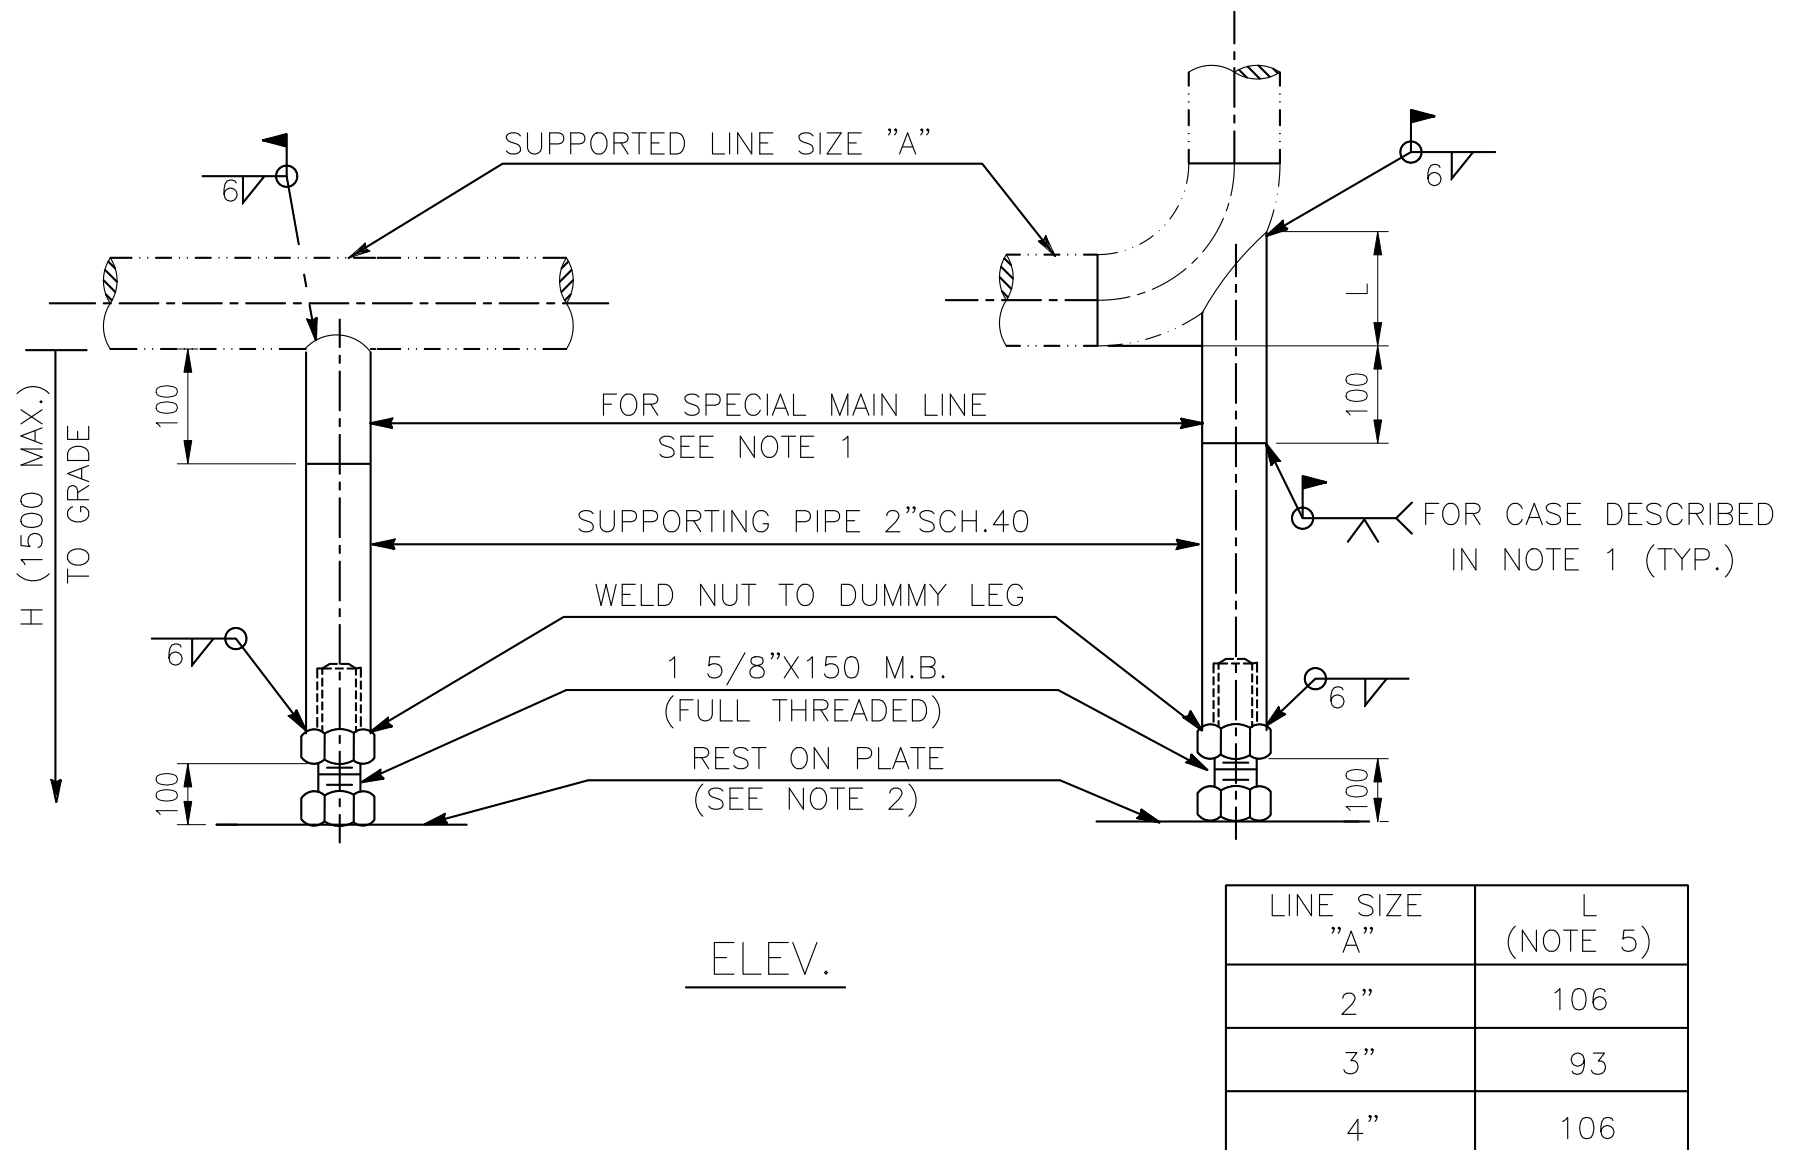


NOTES :


1. FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES,  
THE MATERIALS SHALL BE THE SAME AS MAIN LINES.
2. THIS TYPE SHALL BE USED WITH M-42 TO  
DETERMINE THE LOWER COMPONENT TYPE.  
IN THIS DETAIL, USE TYPE-B & H ONLY.
3. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
  
09-2B-05B  
  - 09-2B-05B
  - └─┬─┬─┬─┐
  - └─┬─┬─┬─┐ DENOTE THE LOWER COMPONENT TYPE SEE M-42
  - └─┬─┬─┬─┐ DENOTE DIMENSION "H" (IN 100mm) (SEE NOTE 6)
  - └─┬─┬─┬─┐ DENOTE SUPPORTED LINE SIZE "A"
  - └─┬─┬─┬─┐ DENOTE TYPE NO.
4. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .
5. DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.
6. IF THE LOWER COMPONENT TYPE-B IS USED, DIMENSION "H" SHALL BE COUNTED  
FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

|                                                                                                                                         |          |  |       |      |  |                      |           |
|-----------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-09 </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                                                         |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                                                                      | SHIH     |  | CHK.  | YANG |  | D-9                  | REV.<br>1 |
| DATE                                                                                                                                    | 7/15/'24 |  | APPR. | CHEN |  |                      |           |



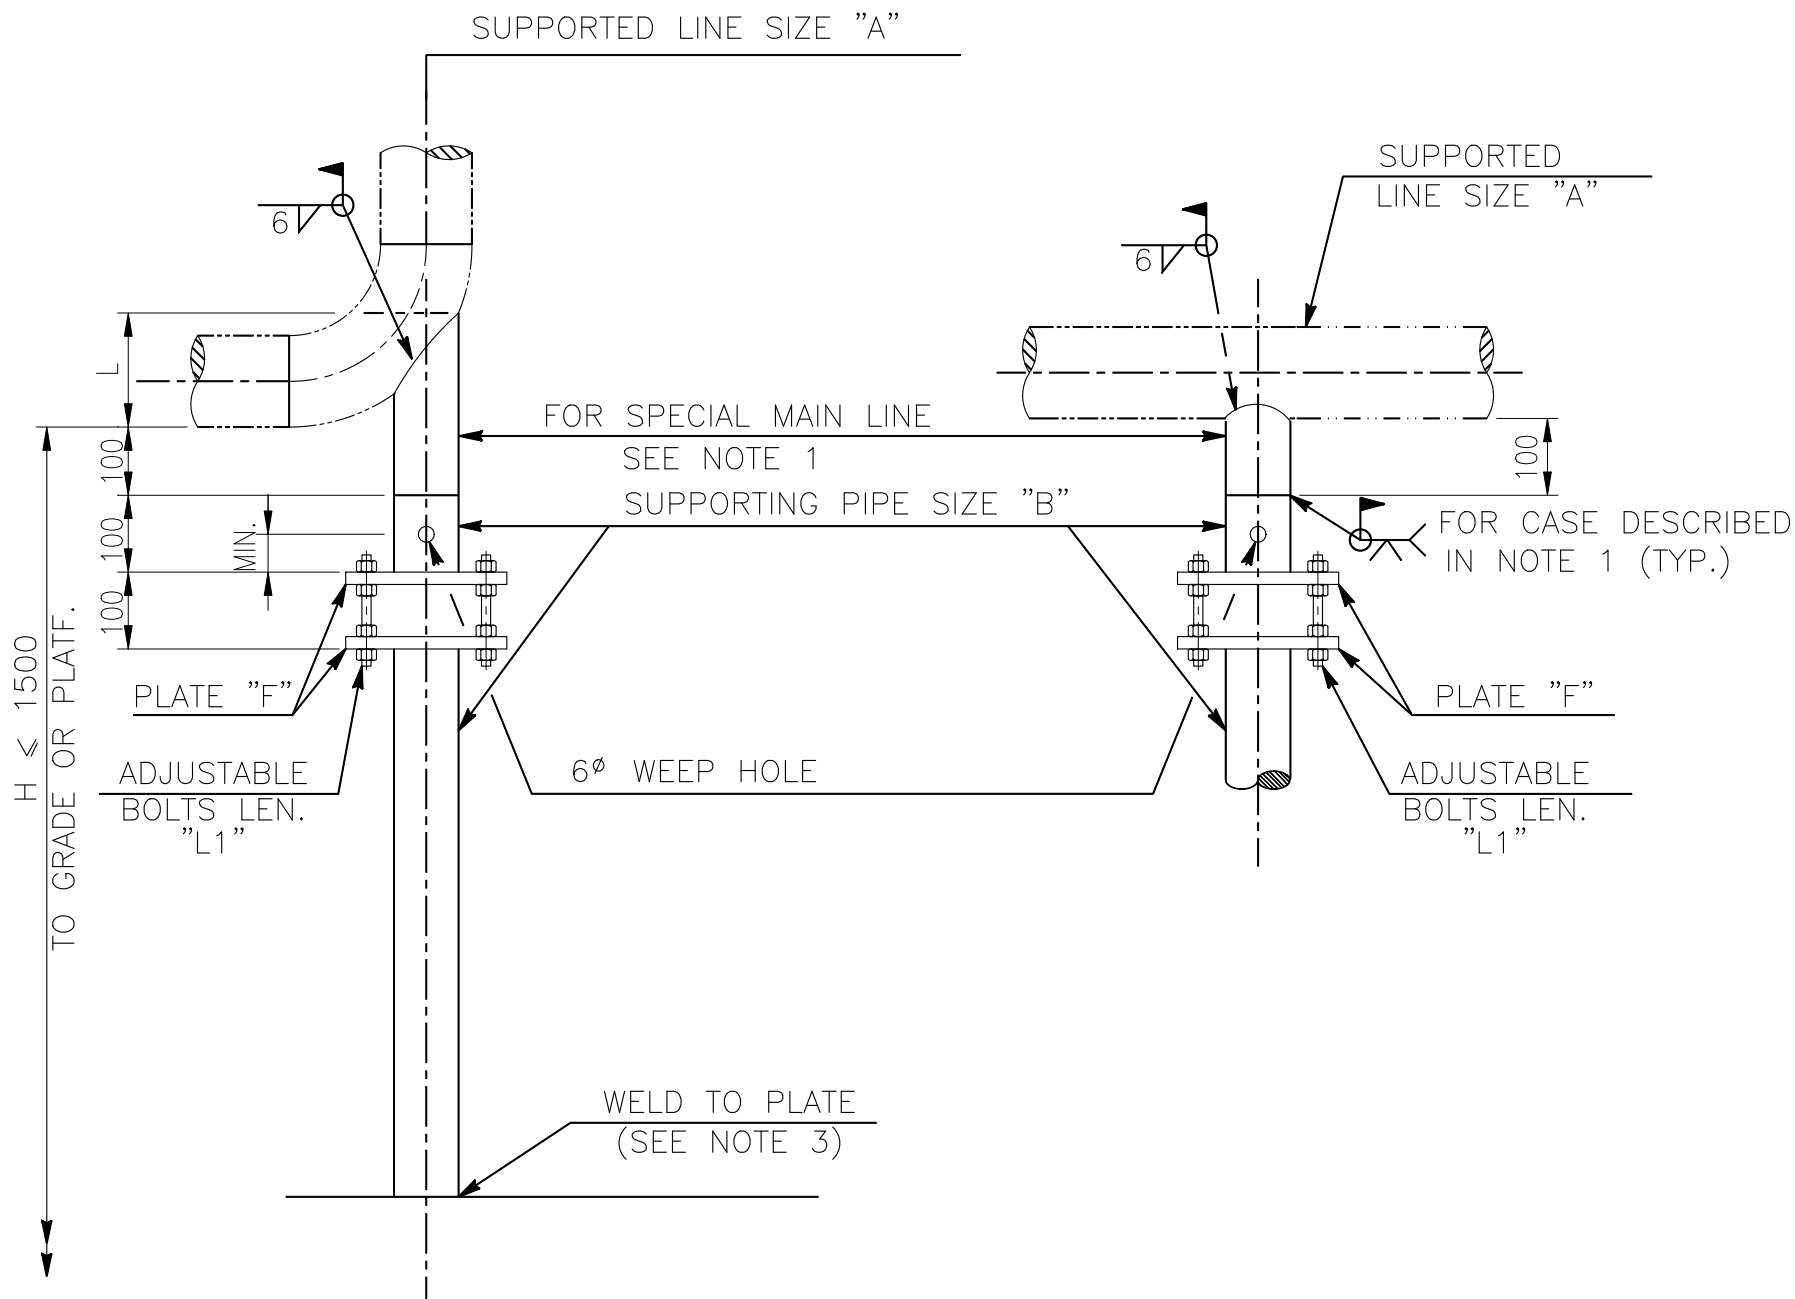

ELEV.

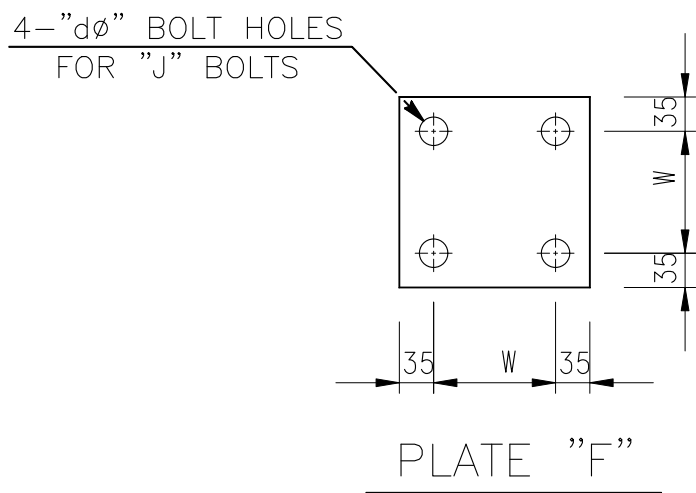

FILE: D-10M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-10                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-10

DIMENSION (mm)


| LINE SIZE<br>"A" | PIPE SIZE<br>"B" | L<br>(NOTE 5) | PLATE<br>F   | ADJ. BOLT<br>J x L1 | W   | dø |
|------------------|------------------|---------------|--------------|---------------------|-----|----|
| 1.1/2"           | 1.1/2" SCH.80    | 81            | ϕ9tx170x170  | M12x160L            | 100 | 15 |
| 2"               | 1.1/2" SCH.80    | 71            | ϕ9tx170x170  | M12x160L            | 100 | 15 |
| 2.1/2"           | 2" SCH.40        | 91            | ϕ9tx200x200  | M12x160L            | 130 | 15 |
| 3"               | 2" SCH.40        | 93            | ϕ9tx200x200  | M12x160L            | 130 | 15 |
| 4"               | 3" SCH.40        | 138           | ϕ12tx230x230 | M16x180L            | 160 | 19 |
| 5"               | 4" SCH.40        | 178           | ϕ12tx260x260 | M16x180L            | 190 | 19 |
| 6"               | 4" SCH.40        | 186           | ϕ12tx260x260 | M16x180L            | 190 | 19 |
| 8"               | 6" SCH.40        | 272           | ϕ12tx330x330 | M16x180L            | 260 | 19 |
| 10"              | 6" SCH.40        | 291           | ϕ12tx330x330 | M16x180L            | 260 | 19 |
| 12"              | 8" SCH.40        | 370           | ϕ16tx400x400 | M16x180L            | 330 | 19 |
| 14"              | 8" SCH.40        | 407           | ϕ16tx400x400 | M16x180L            | 330 | 19 |
| 16"              | 8" SCH.40        | 434           | ϕ16tx400x400 | M16x180L            | 330 | 19 |
| 18"              | 10" SCH.40       | 515           | ϕ16tx440x440 | M16x180L            | 370 | 19 |
| 20"              | 10" SCH.40       | 542           | ϕ16tx440x440 | M16x180L            | 370 | 19 |
| 22"              | 14" SCH.40       | 652           | ϕ16tx520x520 | M16x180L            | 370 | 19 |
| 24"              | 14" SCH.40       | 677           | ϕ16tx520x520 | M16x180L            | 370 | 19 |
| 26"              | 18" STD.WT       | 813           | ϕ19tx520x520 | M20x180L            | 450 | 23 |
| 28"              | 18" STD.WT       | 835           | ϕ19tx520x520 | M20x180L            | 450 | 23 |
| 30"              | 18" STD.WT       | 859           | ϕ19tx520x520 | M20x180L            | 450 | 23 |
| 32"              | 18" STD.WT       | 886           | ϕ19tx520x520 | M20x180L            | 450 | 23 |
| 34"              | 24" STD.WT       | 1077          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 36"              | 24" STD.WT       | 1098          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 38"              | 24" STD.WT       | 1122          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 40"              | 24" STD.WT       | 1147          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 42"              | 24" STD.WT       | 1173          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 44"              | 24" STD.WT       | 1200          | ϕ19tx670x670 | M20x180L            | 600 | 23 |
| 46"              | 28" STD.WT       | 1329          | ϕ22tx820x820 | M24x180L            | 750 | 27 |
| 48"              | 28" STD.WT       | 1355          | ϕ22tx820x820 | M24x180L            | 750 | 27 |
| 50"              | 28" STD.WT       | 1382          | ϕ22tx820x820 | M24x180L            | 750 | 27 |

NOTES :

1. FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES,  
THE MATERIALS SHALL BE THE SAME AS MAIN LINES.
2. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD.
3. THIS TYPE SHALL BE USED WITH M-42 TO  
DETERMINE THE LOWER COMPONENT TYPE.
4. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
10-6B-05B  
└──┬──┬──┬──  
  └──┬──┬──┬── DENOTE THE LOWER COMPONENT TYPE SEE M-42  
     └──┬──┬──┬── DENOTE DIMENSION "H" (IN 100mm)  
        └──┬──┬──┬── DENOTE SUPPORTED LINE SIZE "A"  
            └──┬──┬──┬── DENOTE TYPE NO.
5. DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.
6. THIS SUPPORT SHALL NOT BE USED IN THE FOLLOWING CONDITIONS:  
A. DESIGN TEMPERATURE ≤10° OR ≥400°  
B. DESIGN PRESSURE≥70Kg/꜒m G

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-10A                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-10                          |          |  |       |      |  | REV.<br>1            |  |

FILE: D-10MA.DWG

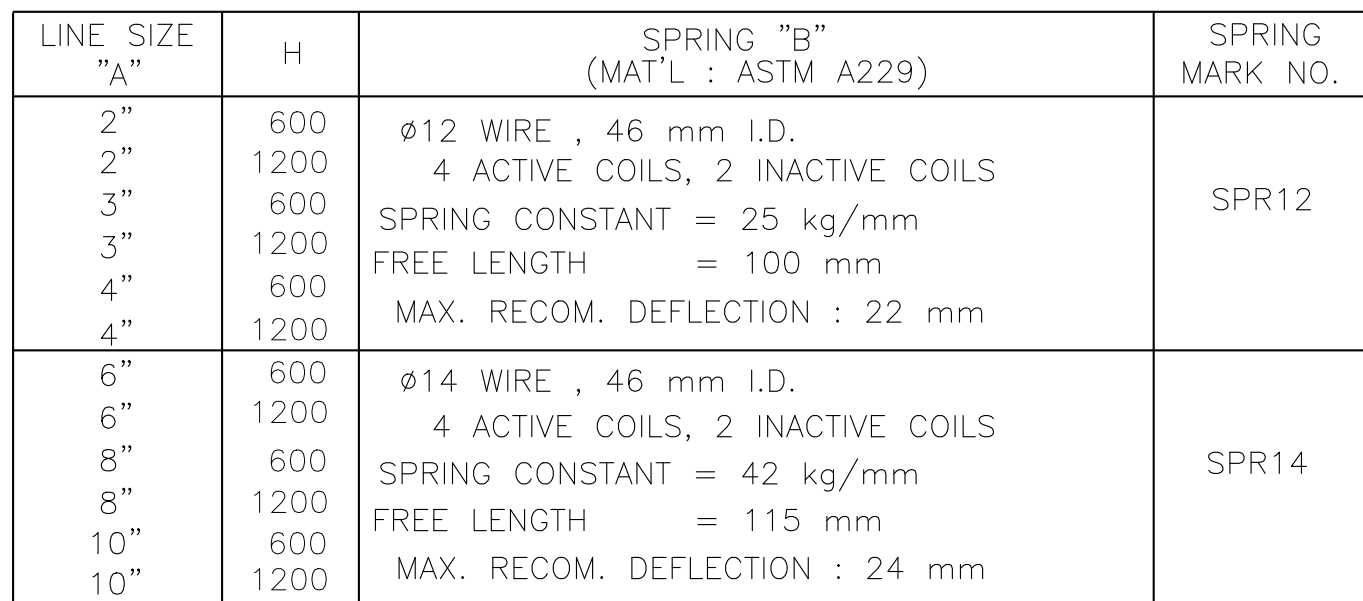

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:

2. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE.  
IN THIS DETAIL , USE TYPE-G & J ONLY.

4. DIMENSION SHALL BE CUT TO SUIT IN FIELD.


6. DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.

中威工程顧問股份有限公司  
UNG WEI ENGINEERING CONSULTING CO., LTD.

ENGINEERING STANDARD

D-11

REV.  
1

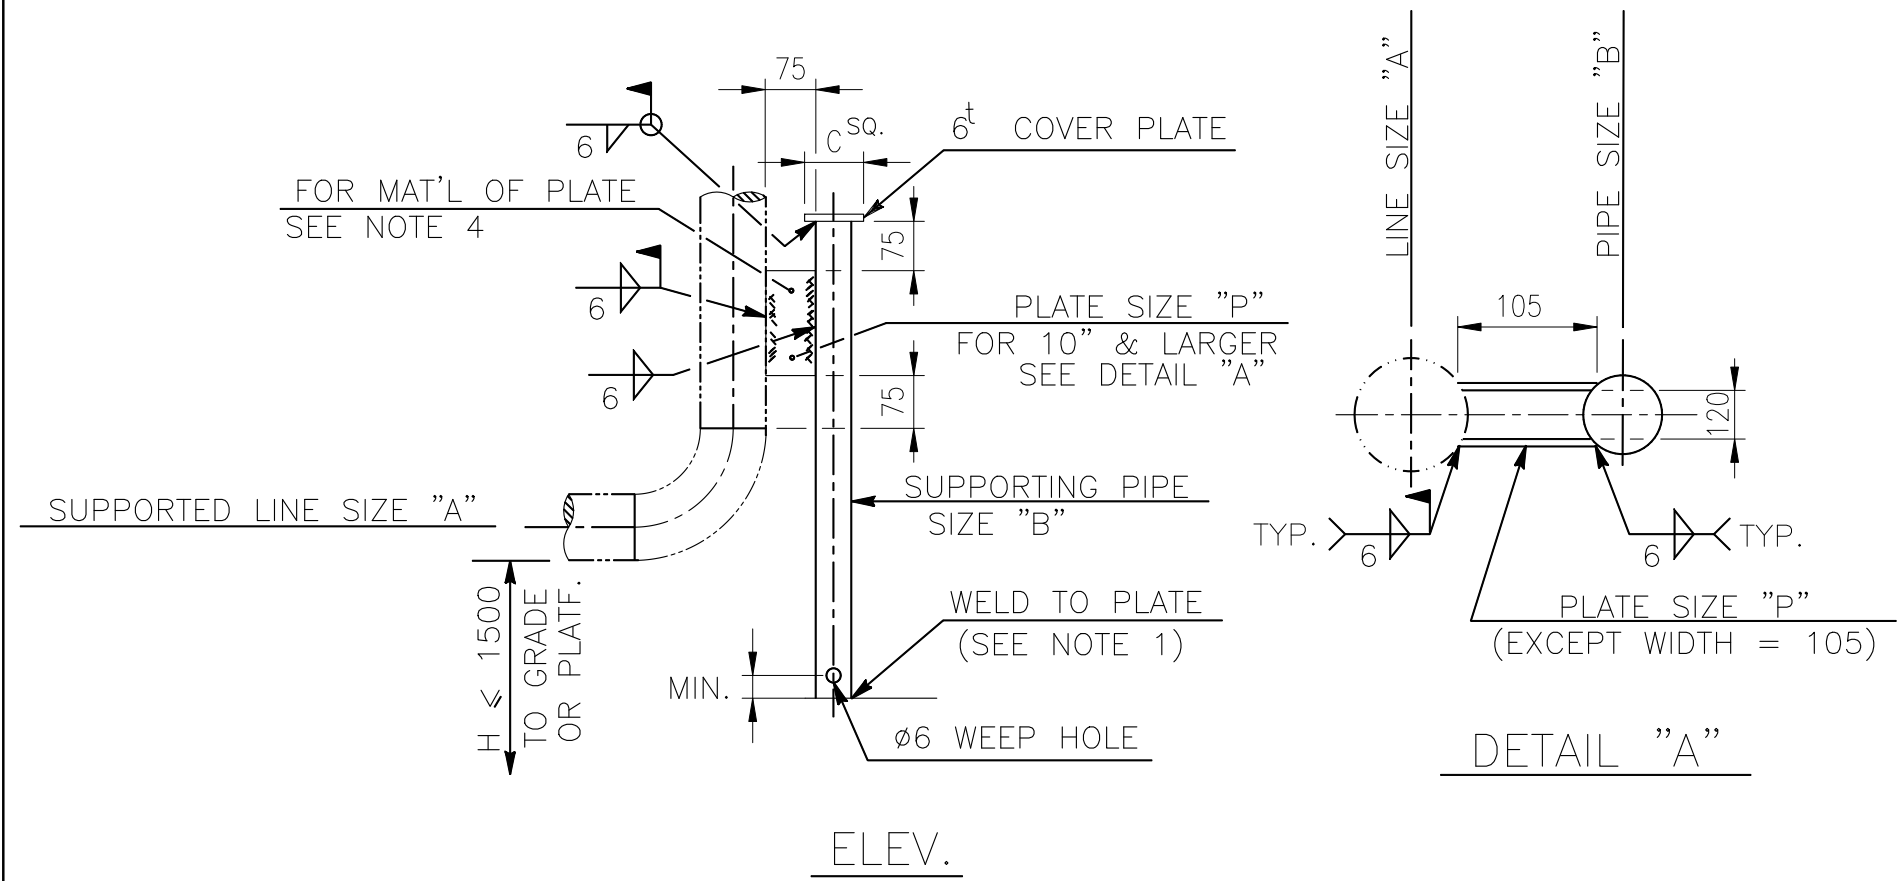


DIMENSIONS (mm)

| A   | B             | C   | P          |
|-----|---------------|-----|------------|
| 2"  | 1 1/2" SCH.80 | 70  | 150X75X9   |
| 3"  | 2" SCH.40     | 80  | 150X75X9   |
| 4"  | 3" SCH.40     | 110 | 150X75X9   |
| 6"  | 4" SCH.40     | 140 | 150X75X9   |
| 8"  | 6" SCH.40     | 190 | 250X75X12  |
| 10" | 8" SCH.40     | 240 | 250X105X12 |
| 12" | 8" SCH.40     | 240 | 350X105X12 |
| 14" | 10" SCH.40    | 290 | 350X105X12 |
| 16" | 10" SCH.40    | 290 | 350X105X12 |

NOTES:

1. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS:

12-6B-05B(A)

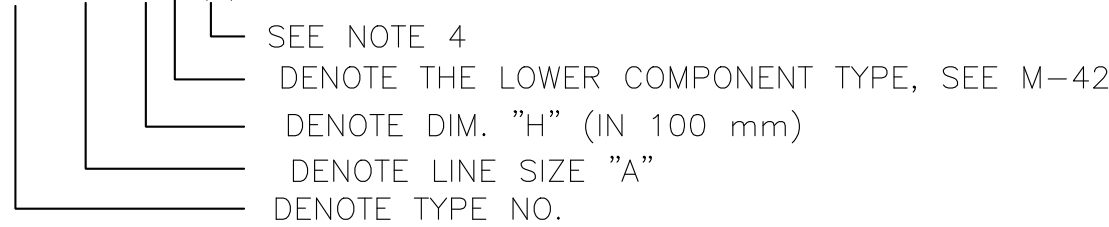

3. DIMENSION SHALL BE CUT TO SUIT IN FIELD.

4.


|                 |        |
|-----------------|--------|
| MAT'L OF PLATE  | SYMBOL |
| CARBON STEEL    | NONE   |
| ALLOY STEEL     | (A)    |
| STAINLESS STEEL | (S)    |

5. IF ONE OF THE LOWER COMPONENT TYPE-A,B,E,G IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

FILE: D-12M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-12                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-12

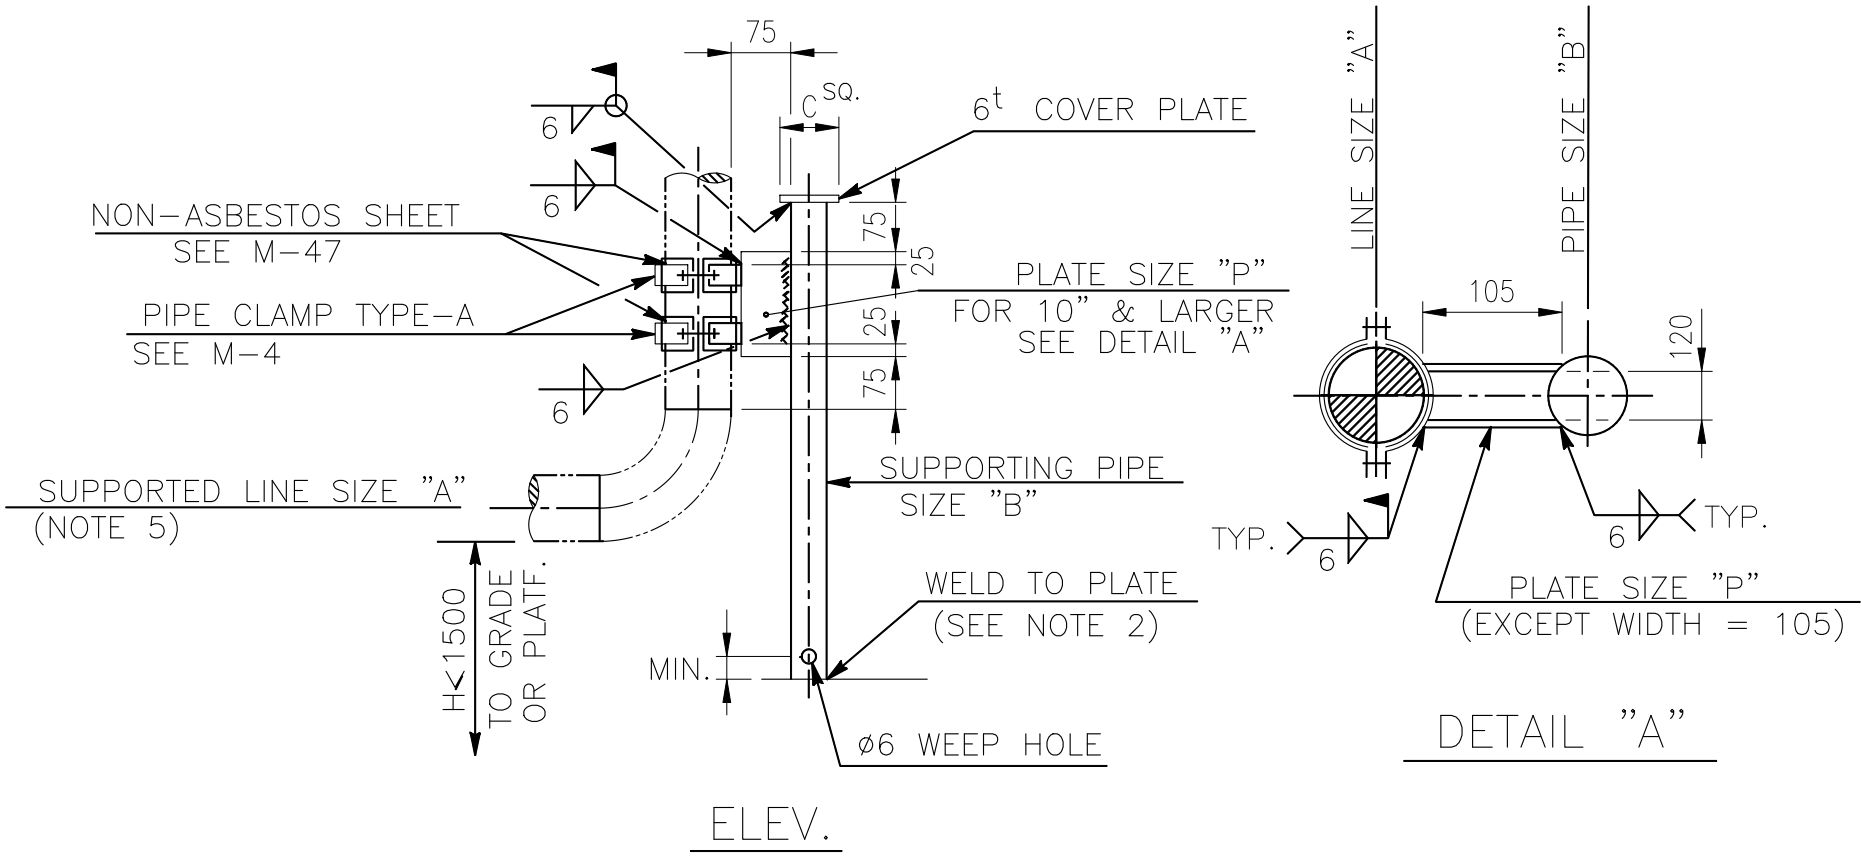

| DIMENSION (mm) |               |     |            |
|----------------|---------------|-----|------------|
| A              | B             | C   | P          |
| 2"             | 1 1/2" SCH.80 | 70  | 150X75X9   |
| 3"             | 2" SCH.40     | 80  | 150X75X9   |
| 4"             | 3" SCH.40     | 110 | 150X75X9   |
| 6"             | 4" SCH.40     | 140 | 150X75X9   |
| 8"             | 6" SCH.40     | 190 | 250X75X12  |
| 10"            | 8" SCH.40     | 240 | 250X105X12 |
| 12"            | 8" SCH.40     | 240 | 350X105X12 |
| 14"            | 10" SCH.40    | 290 | 350X105X12 |
| 16"            | 10" SCH.40    | 290 | 350X105X12 |

NOTES:

1. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES.
2. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE.
3. DESIGNATION NUMBER DENOTE AS FOLLOWS:

13-6B-05B

DENOTE THE LOWER COMPONENT TYPE, SEE M-42


DENOTE DIMENSION "H" (IN 100 mm)

DENOTE SUPPORTED LINE SIZE "A"

DENOTE TYPE NO.
4. DIMENSION SHALL BE CUT TO SUIT IN FIELD.
5. MAX. LINE TEMP. : 750°F
6. IF ONE OF LOWER COMPONENT TYPE-A,B,E,G IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-13                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-13                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

FILE: D-13M.DWG

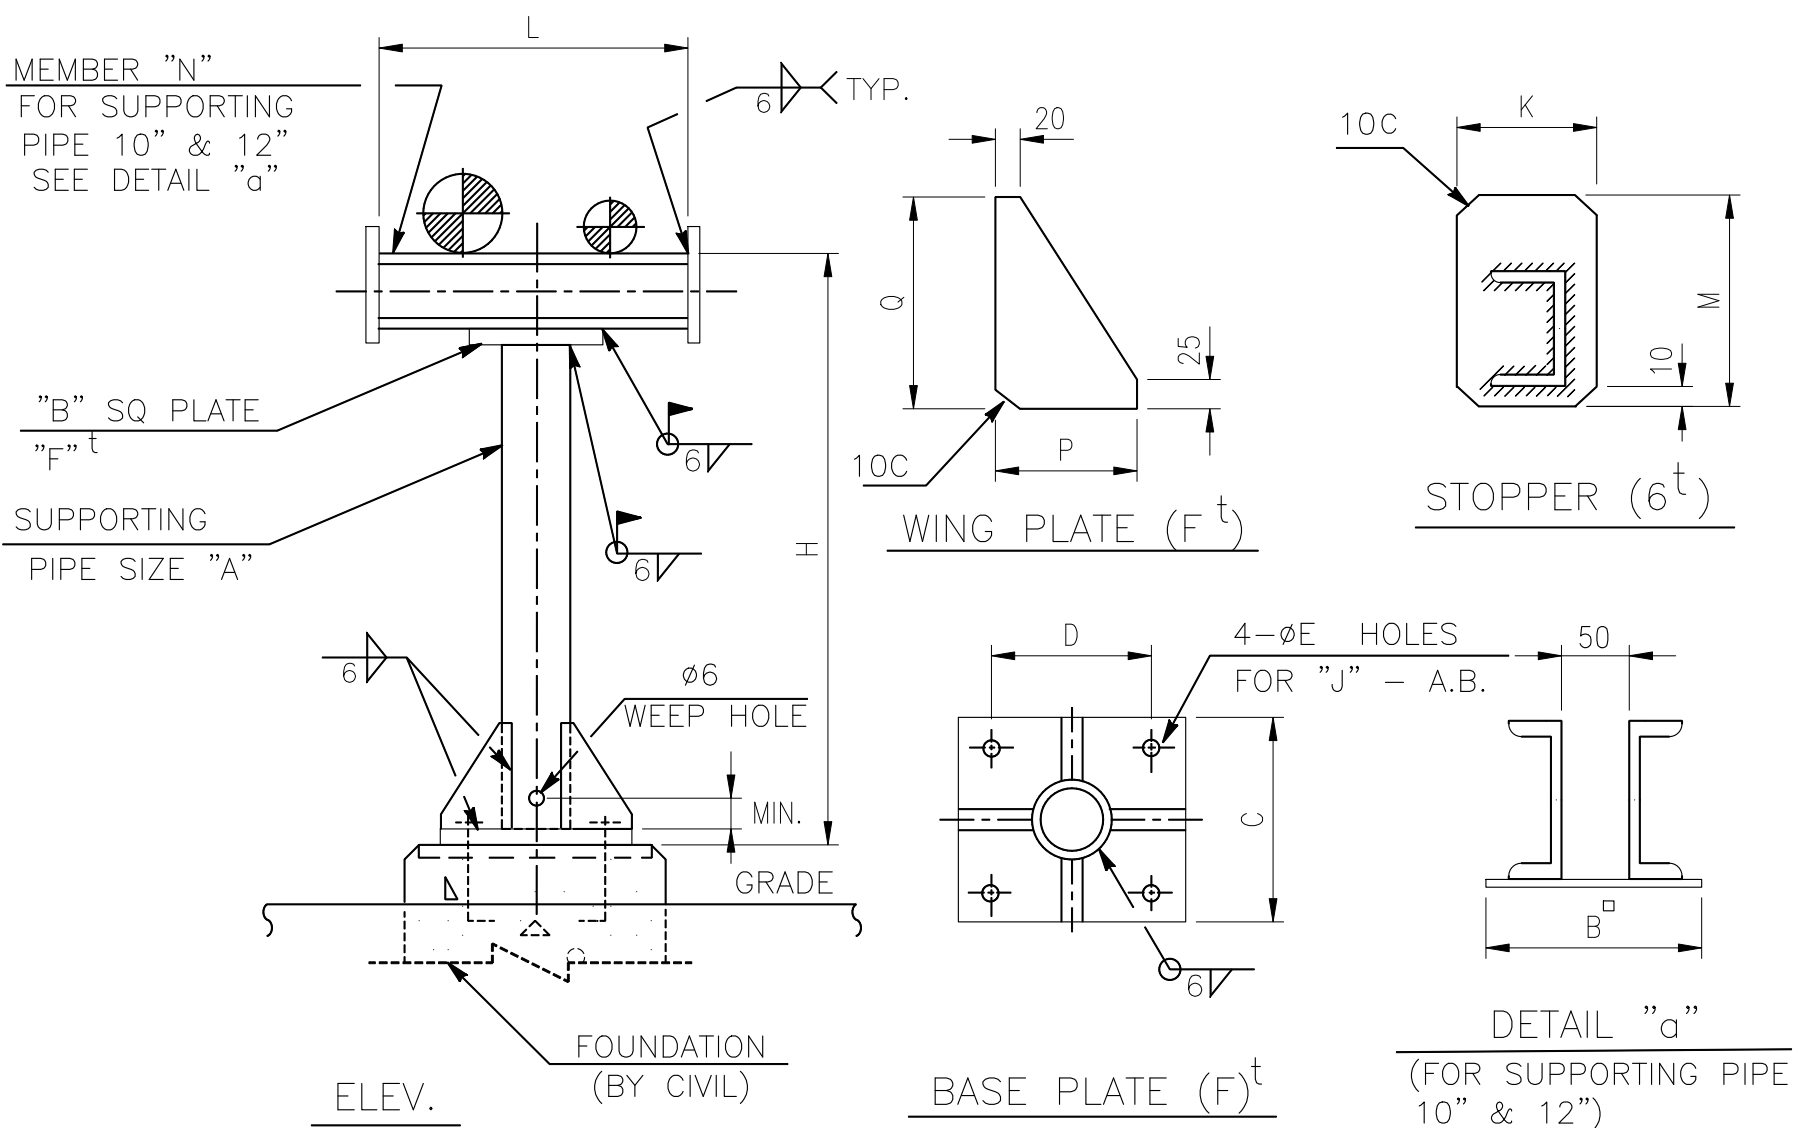

DIMENSIONS (mm)

| STANDARD DIMENSION LIST |     |     |    |    |     |     |     |     |      |     |            |
|-------------------------|-----|-----|----|----|-----|-----|-----|-----|------|-----|------------|
| A                       | C   | D   | E  | F  | K   | M   | P   | Q   | J    | B   | MEMBER "N" |
| 2"                      | 190 | 110 | 19 | 9  | 70  | 160 | 65  | 150 | 5/8" | 80  | C100X50X5  |
| 3"                      | 260 | 190 | 19 | 12 | 70  | 160 | 85  | 160 | 5/8" | 110 | C100X50X5  |
| 4"                      | 260 | 190 | 19 | 12 | 85  | 185 | 73  | 170 | 5/8" | 135 | C125X65X6  |
| 6"                      | 380 | 300 | 22 | 16 | 95  | 210 | 105 | 190 | 3/4" | 190 | C150X75X9  |
| 8"                      | 380 | 300 | 22 | 16 | 110 | 260 | 80  | 210 | 3/4" | 240 | C200X90X8  |
| 10"                     | 450 | 360 | 28 | 16 | 250 | 260 | 88  | 220 | 1"   | 295 | C200X90X8  |
| 12"                     | 500 | 410 | 28 | 19 | 250 | 260 | 88  | 240 | 1"   | 345 | C200X90X8  |

NOTES :

1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

14-2B-1005

DENOTE DIM. "H" (IN 100mm)

DENOTE DIM. "L" (IN 100mm)

DENOTE SUPPORTING SIZE "A"

DENOTE TYPE NO.
3. DIMENSION "P" SHALL BE CUT TO SUIT IN FIELD.

FILE: D-14M.DWG

|                                                            |          |  |       |      |  |                                               |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-14<br>(1 OF 2) |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                               |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                               |  | D-14                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |  |                      |           |



| PIPE<br>SIZE<br>"A" | L<br>(MAX.) | H<br>(MAX.) |
|---------------------|-------------|-------------|
| 2" SCH.40           | 500         | 1000        |
| 2" SCH.40           | 1000        | 500         |
| 3" SCH.40           | 500         | 2000        |
| 3" SCH.40           | 1000        | 1000        |
| 4" SCH.40           | 500         | 3000        |
| 4" SCH.40           | 1000        | 1500        |
| 6" SCH.40           | 500         | 4000        |
| 6" SCH.40           | 1000        | 3500        |
| 8" SCH.40           | 500         | 5000        |
| 8" SCH.40           | 1000        | 4500        |
| 10" SCH.40          | 1000        | 5000        |
| 12" STD.WT          | 1000        | 5000        |

|                                                                               |          |  |       |      |  |                                                                          |  |                                   |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|--------------------------------------------------------------------------|--|-----------------------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-14</div> <div>(2 OF 2)</div> |  | ENGINEERING STANDARD              |  |
|                                                                               |          |  |       |      |  |                                                                          |  | HP6-DSD-A4-500-001                |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                                                          |  |                                   |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                                          |  | <div>D-15</div> <div>REV. 1</div> |  |

FILE: D-15M.DWG




NOTES :

1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

15-2B-1005

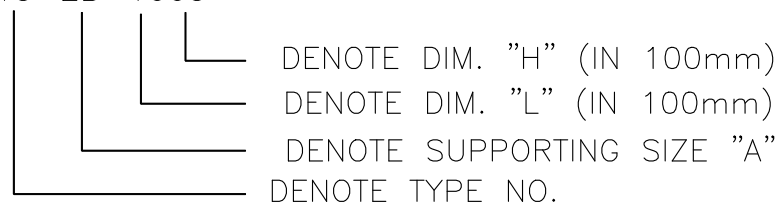

3. DIMENSION "P" SHALL BE CUT TO SUIT IN FIELD.

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

## DETAIL OF PIPE SUPPORT


TYPE-15

ENGINEERING STANDARD

HP6-DSD-A4-500-001


REV.  
1



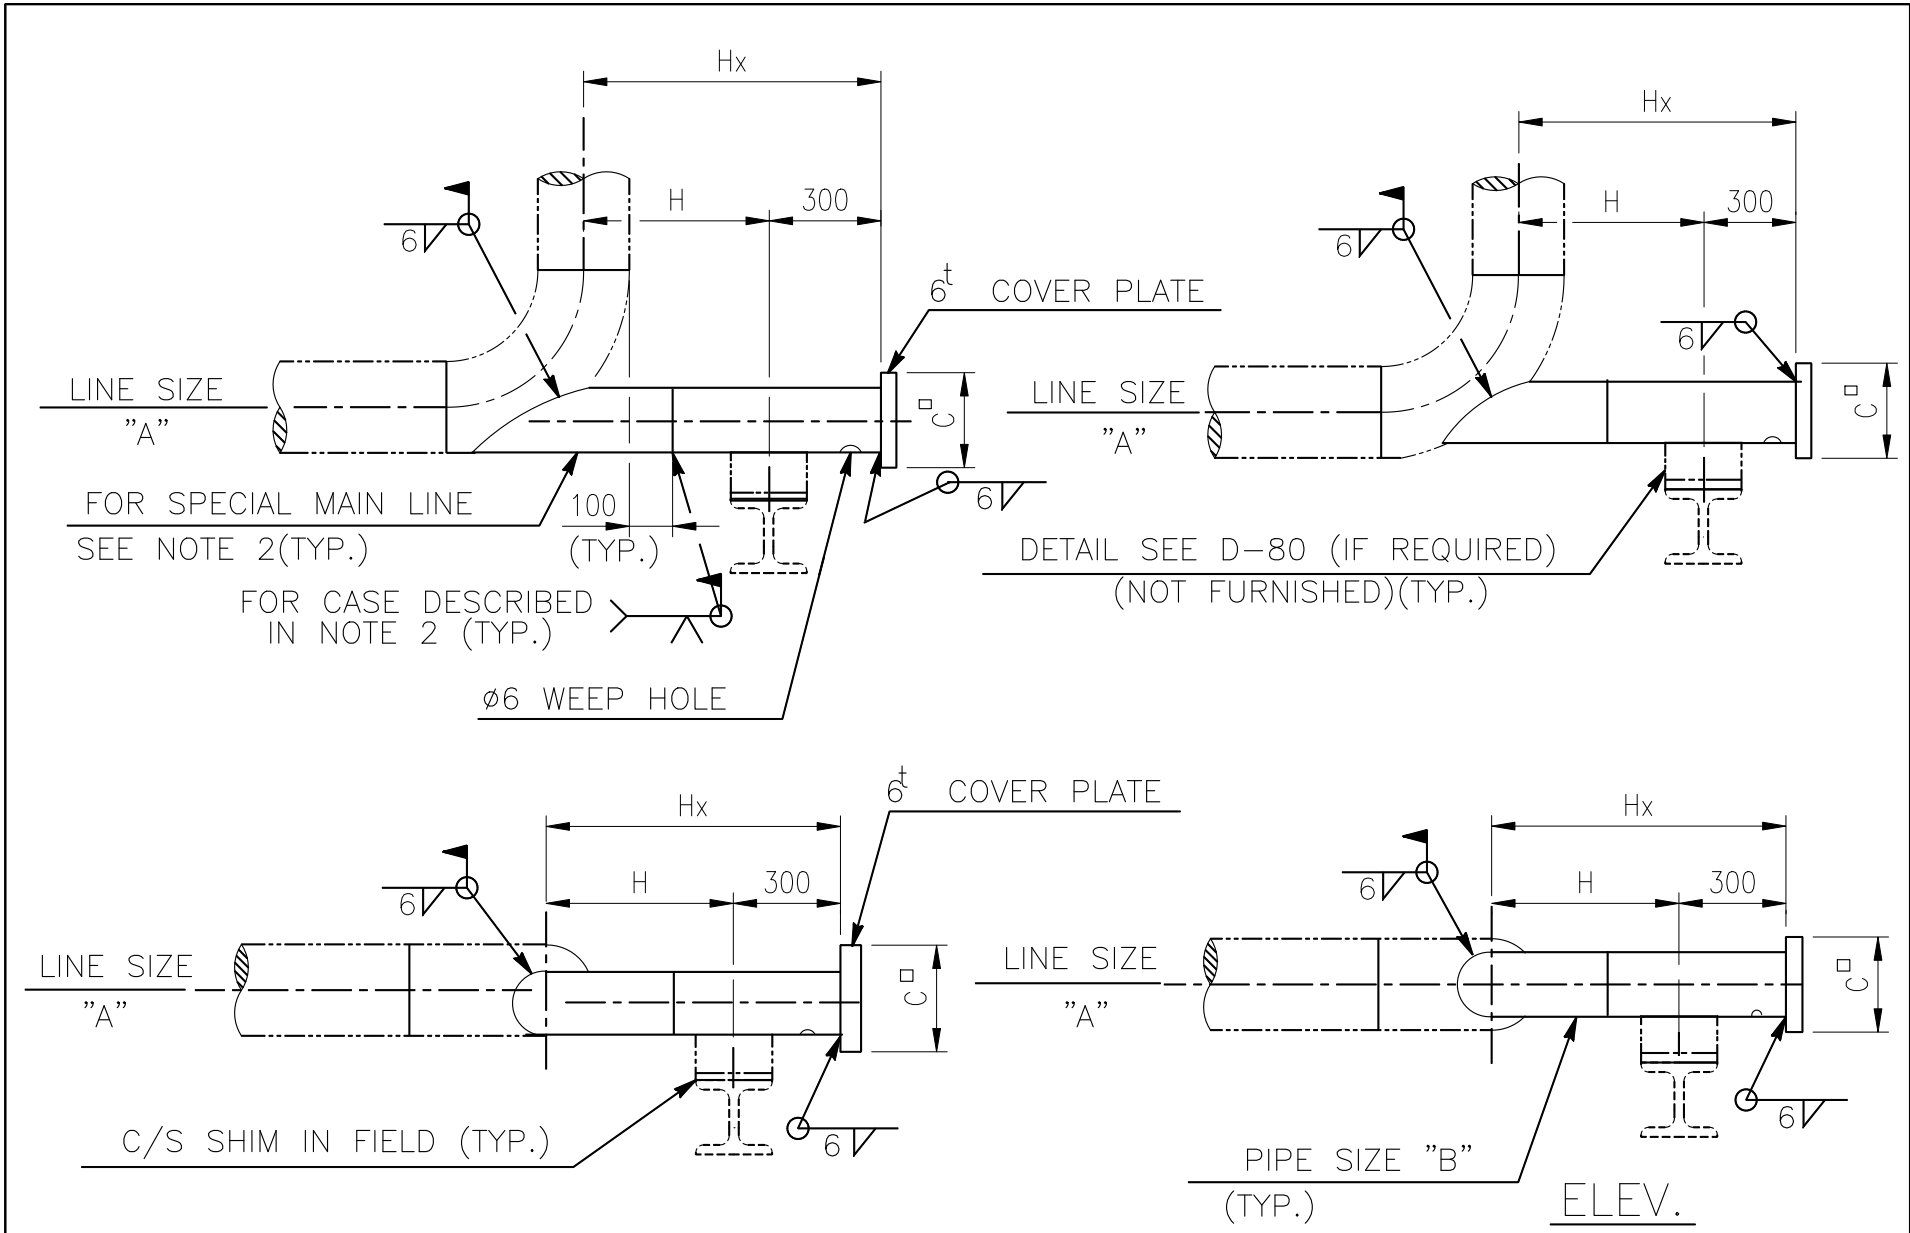

| LINE SIZE "A" | PIPE SIZE "B" | C (mm) |
|---------------|---------------|--------|
| 2"            | 1 1/2" SCH.80 | 70     |
| 3"            | 2" SCH.40     | 80     |
| 4"            | 3" SCH.40     | 110    |
| 6"            | 4" SCH.40     | 140    |
| 8"            | 6" SCH.40     | 190    |
| 10"           | 8" SCH.40     | 240    |
| 12"           | 10" SCH.40    | 290    |
| 14"           | 12" STD.WT    | 340    |
| 16"           | 12" STD.WT    | 340    |
| 18"           | 14" STD.WT    | 380    |
| 20"           | 14" STD.WT    | 380    |
| 24"           | 16" STD.WT    | 430    |

NOTES : 1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

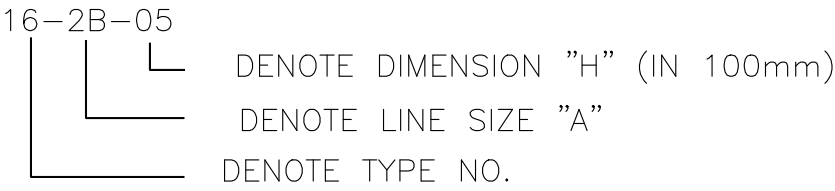


2. FOR ALLOY STEEL,STAINLESS STEEL & STRESS RELIEF LINES,THE MATERIALS SHALL BE THE SAME AS MAIN LINES.


3. DIMENSION "Hx" SHALL BE CUT TO SUIT IN FIELD.

FILE: D-18M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-18                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-16                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

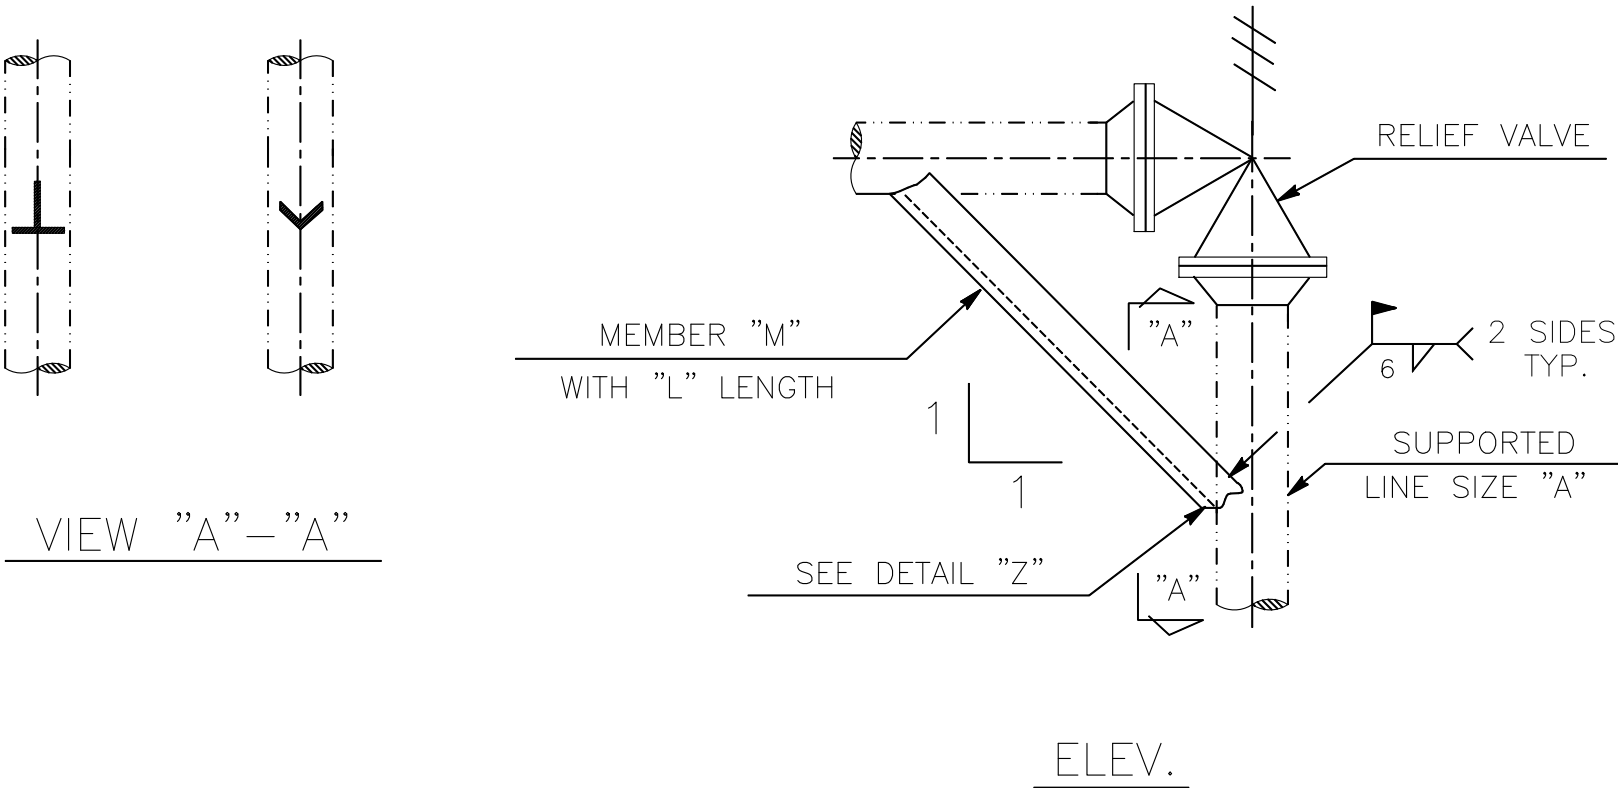

| LINE SIZE<br>"A" | M                        | L    |
|------------------|--------------------------|------|
| 1"               | L40X40X5                 | 600  |
| 1 1/2"           | L40X40X5                 | 600  |
| 2"               | L50X50X6                 | 600  |
| 3"               | L50X50X6                 | 600  |
| 4"               | L75X75X9                 | 600  |
| 6"               | L75X75X9                 | 1200 |
| 8"               | CUT FROM<br>H194X150X6X9 | 1200 |
| 10"              |                          | 1200 |
| 12"              |                          | 1200 |

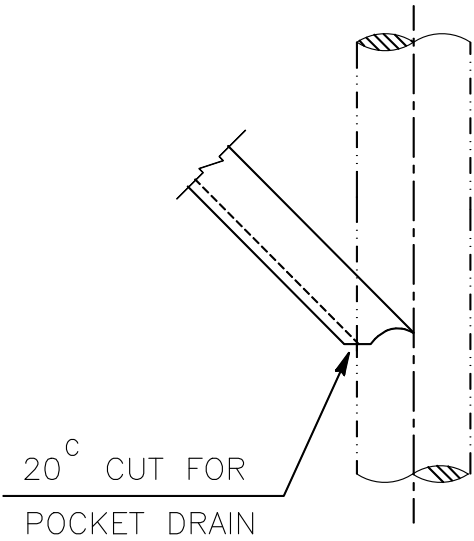

DETAIL "Z"  
(FOR L-ANGLE ONLY)

NOTES :



1. DIMENSION "L" SHALL BE CUT TO SUIT IN FIELD .
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :



FILE: D-21M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-21                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-19

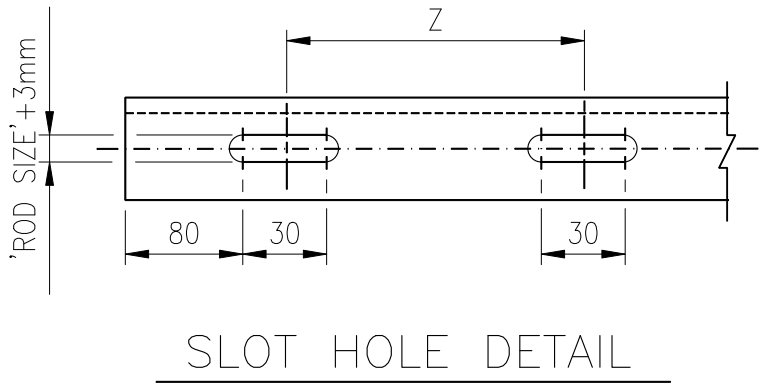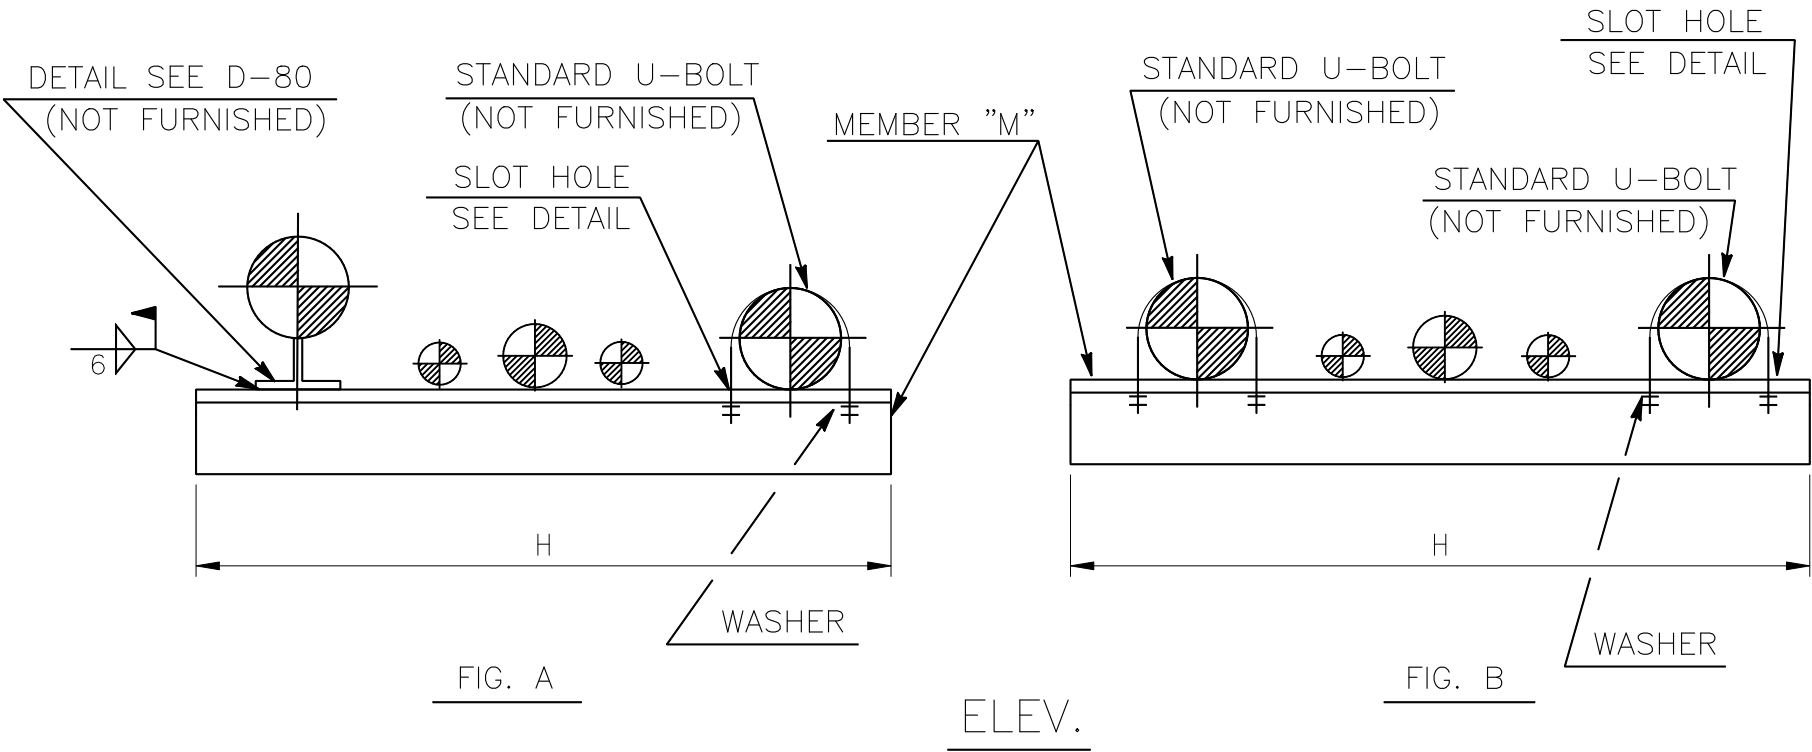


| LINE<br>SIZE | Z<br>(mm) |
|--------------|-----------|
| 2"           | 76        |
| 3"           | 104       |
| 4"           | 130       |
| 6"           | 184       |
| 8"           | 235       |
| 10"          | 286       |
| 12"          | 340       |

| MEMBER "M" | H<br>(MAX.) |
|------------|-------------|
| L50X50X6   | 1500        |
| L65X65X6   | 1500        |
| L75X75X9   | 2000        |
| C100X50X5  | 3000        |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

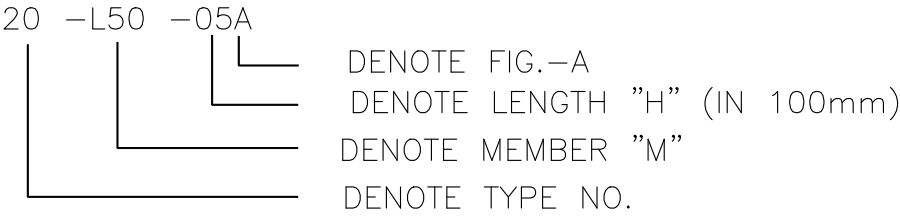

2. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .

FILE: D-22M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-22                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-20




NOTES :

- 21-L50-05A-07

DENOTE TYPE NO.

2. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .

|                                                                               |          |  |       |      |  |                                                      |  |                      |           |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------------|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-21</div> |  | ENGINEERING STANDARD |           |
|                                                                               |          |  |       |      |  |                                                      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                                      |  | D-23                 | REV.<br>1 |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                      |  |                      |           |

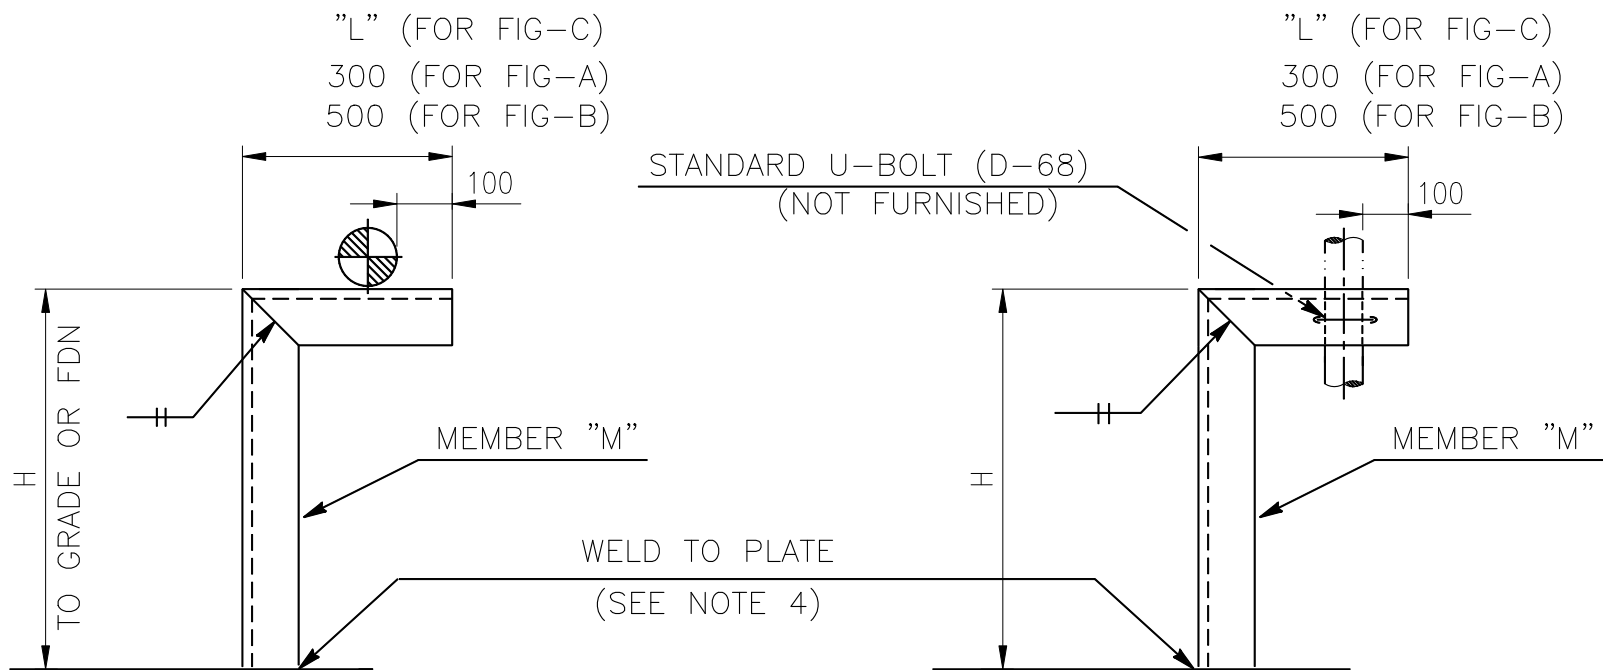


ELEV.

| MEMBER "M" | H<br>(MAX.) |
|------------|-------------|
| L50X50X6   | 1000        |
| L65X65X6   | 1000        |
| L75X75X9   | 1500        |
| C100X50X5  | 2000        |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

22-L50-05(A)L-07

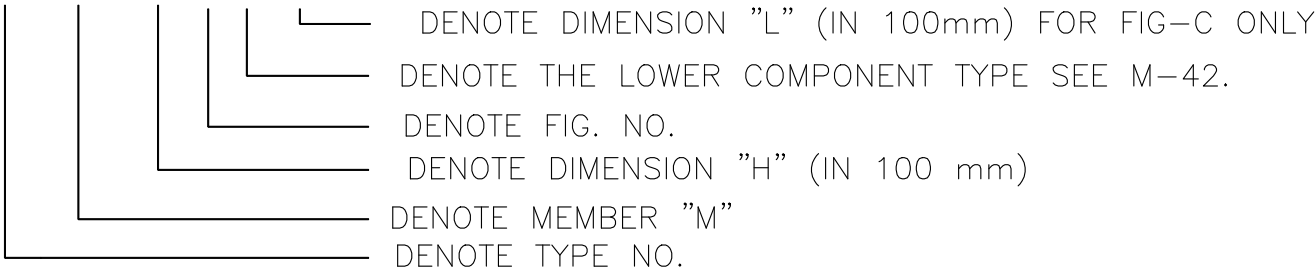


2. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .

3. IF THE FOUNDATION IS NOT USED IN THIS DETAIL, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

4. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE L & P ONLY.

FILE: D-24M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-24                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-22                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

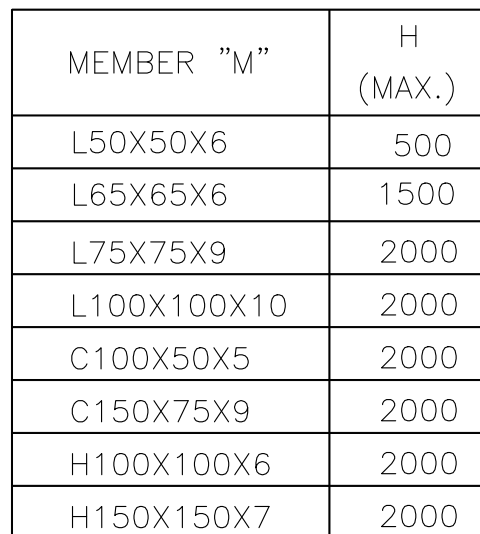

1. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS:

DENOTE DIMENSION "L" (IN 100mm) FOR FIG.C ONLY

DENOTE FIG. NO.


DENOTE DIMENSION "H" (IN 100 mm)

DENOTE MEMBER "M"

DENOTE TYPE NO.

|                                                                               |  |  |  |  |  |                      |           |
|-------------------------------------------------------------------------------|--|--|--|--|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |  |  |  |  |  | ENGINEERING STANDARD |           |
|                                                                               |  |  |  |  |  |                      |           |
| <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-23</div>                          |  |  |  |  |  | HP6-DSD-A4-500-001   |           |
|                                                                               |  |  |  |  |  | D-25                 | REV.<br>1 |



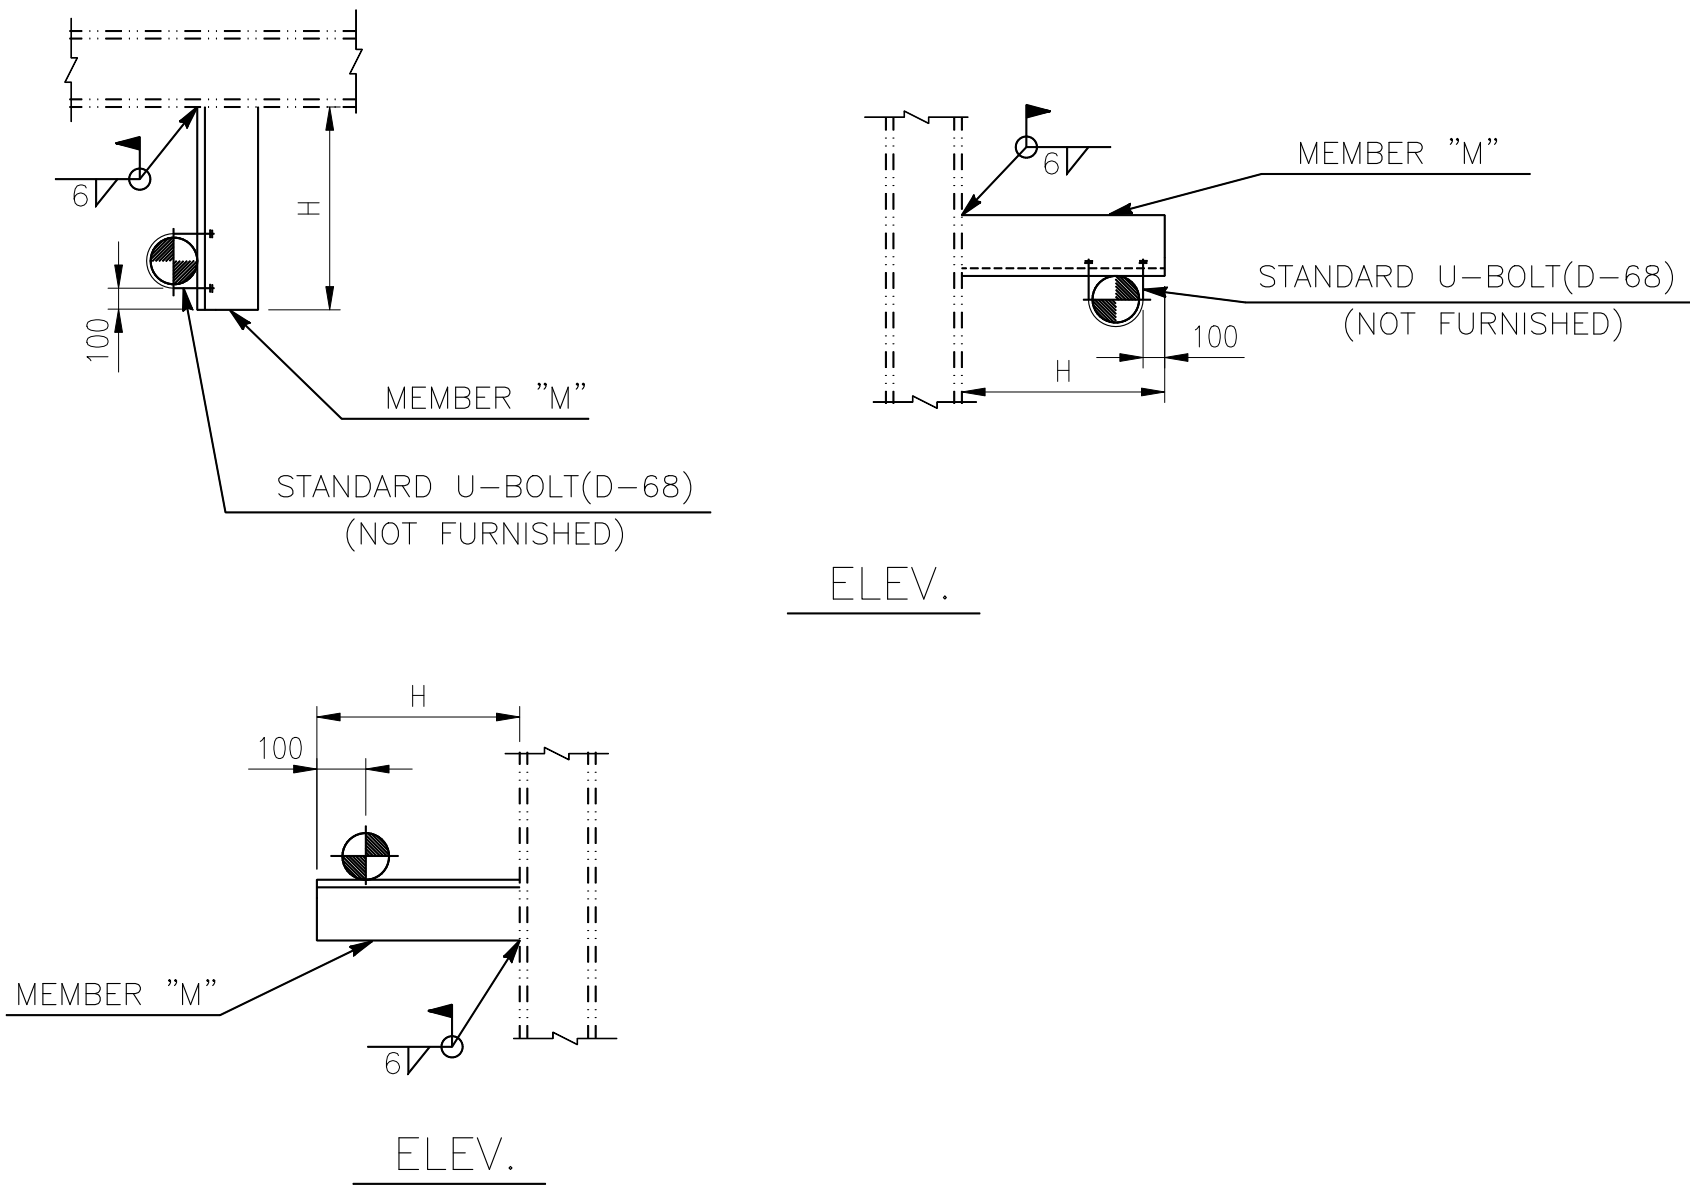


DIMENSIONS (mm)

| MEMBER "M" | H<br>(MAX.) |
|------------|-------------|
| L50X50X6   | 1000        |
| L75X75X9   | 1500        |


NOTES :

- 1. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD .
- 2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

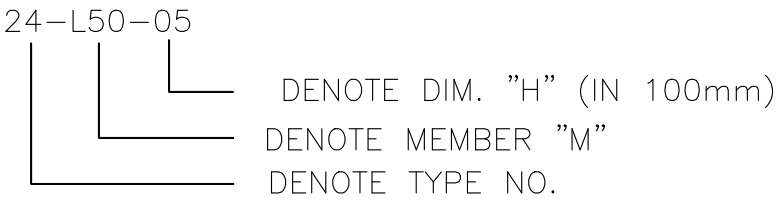

FILE: D-26M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-26                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-24                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

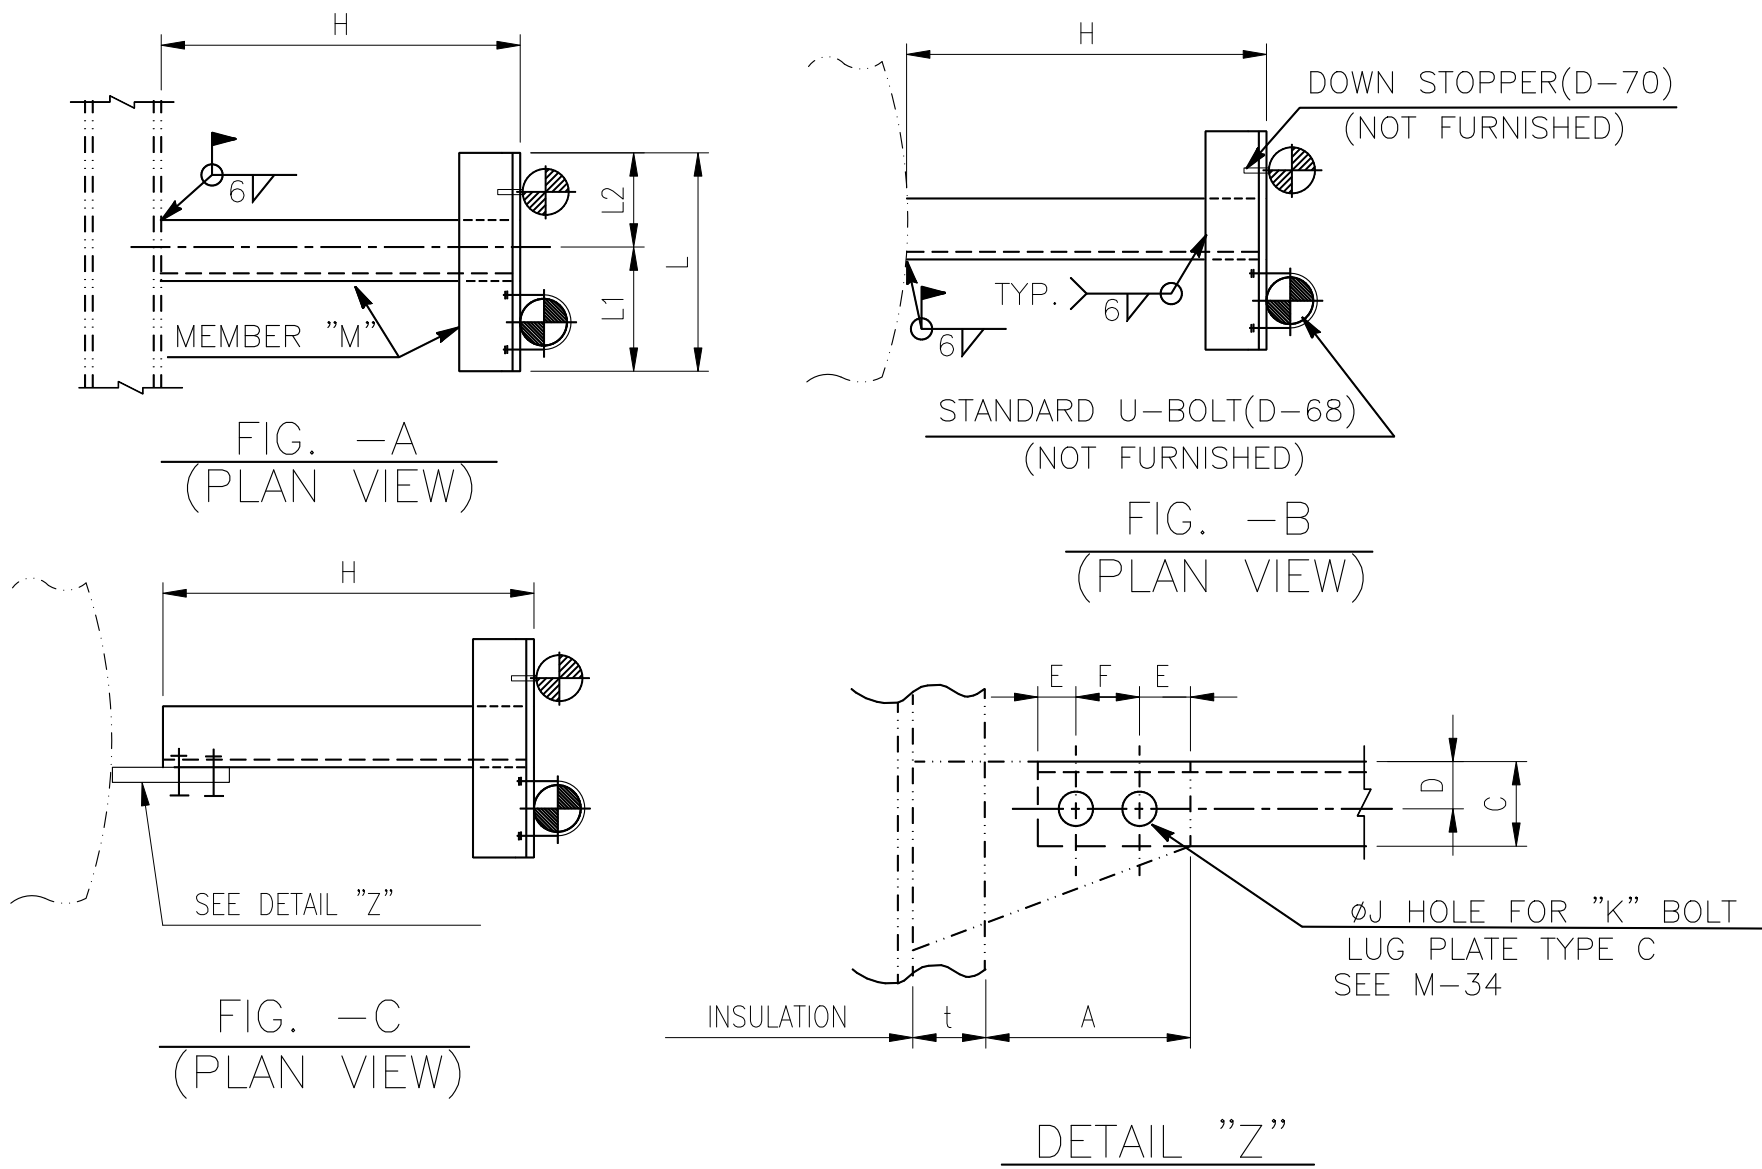


DIMENSIONS (mm)

| MEMBER "M" | A   | C  | D  | E  | F  | øJ | K       | L<br>(MAX.) | H<br>(MAX.) |
|------------|-----|----|----|----|----|----|---------|-------------|-------------|
| L50X50X6   | 150 | 50 | 30 | 30 | 60 | 19 | 5/8"X40 | 1000        | 500         |
| L65X65X6   | 160 | 65 | 35 | 30 | 70 | 22 | 3/4"X50 | 1000        | 500         |
| L75X75X9   | 160 | 75 | 40 | 30 | 70 | 22 | 3/4"X50 | 1000        | 2000        |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

25-L50-0505A-0401

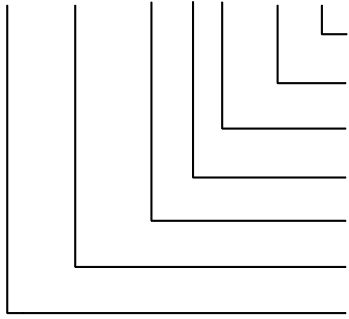

- MODIFY DIMENSION "L2" (IN 100mm) IF ANY
- MODIFY DIMENSION "L1" (IN 100mm) IF ANY
- DENOTE FIG. NO.
- DENOTE DIM. "H" (IN 100mm)
- DENOTE DIM. "L" (IN 100mm)
- DENOTE MEMBER "M"
- DENOTE TYPE NO.

2. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.

FILE: D-27M.DWG

|                                                            |          |  |       |      |  |                                   |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD              |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-25 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                   | 1    |



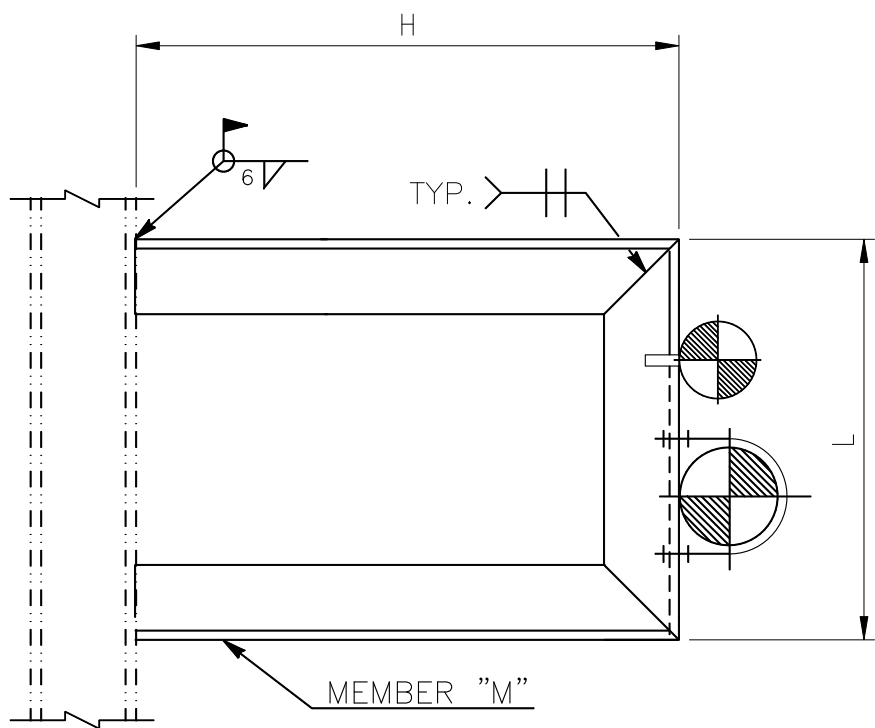


FIG. -A  
(PLAN VIEW)

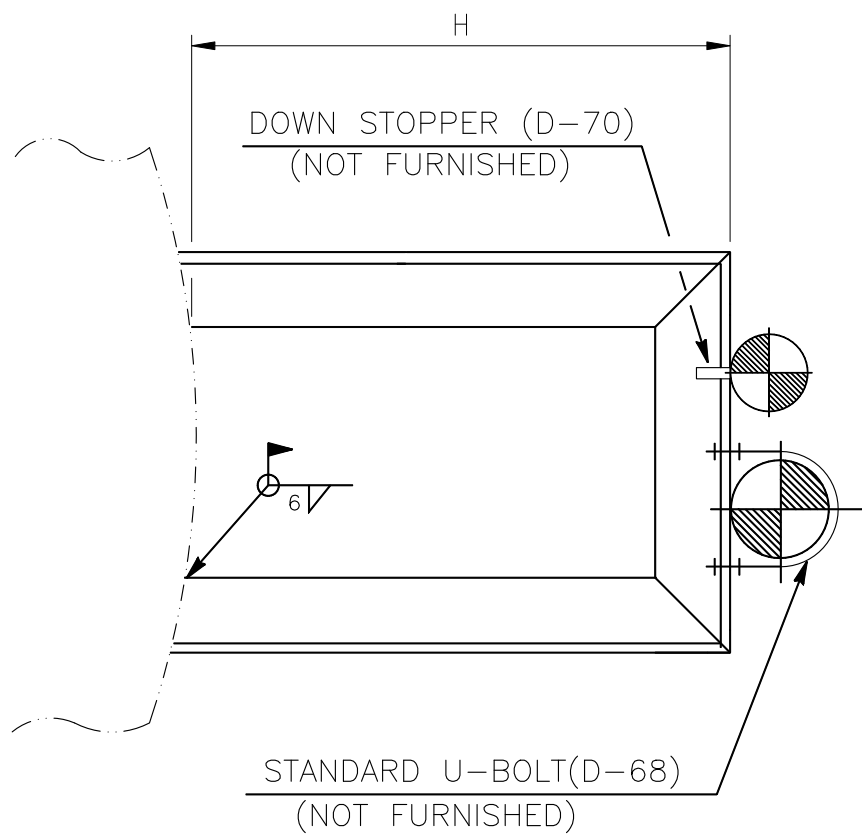


FIG. -B  
(PLAN VIEW)


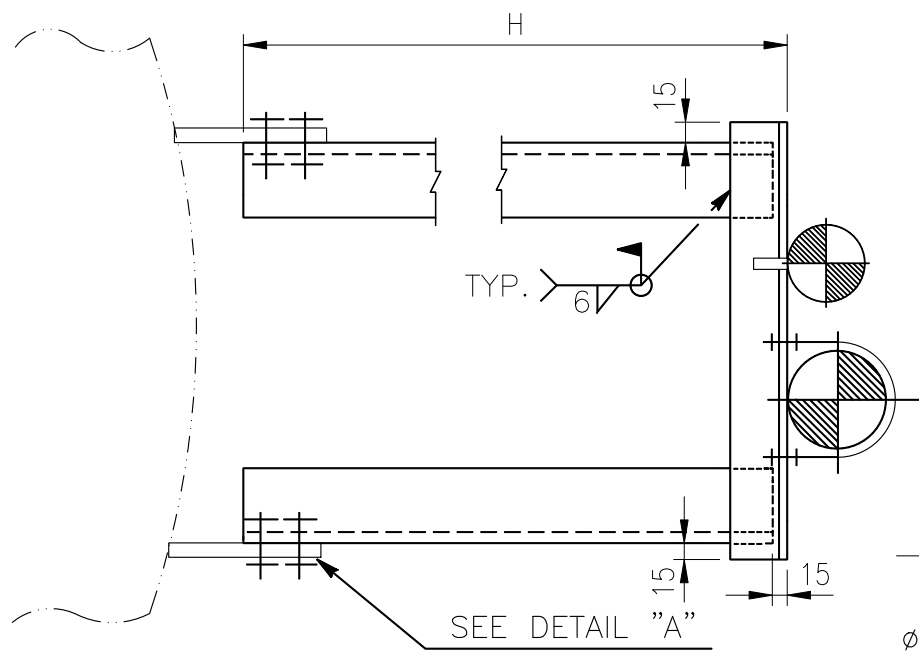


FIG. -C  
(PLAN VIEW)

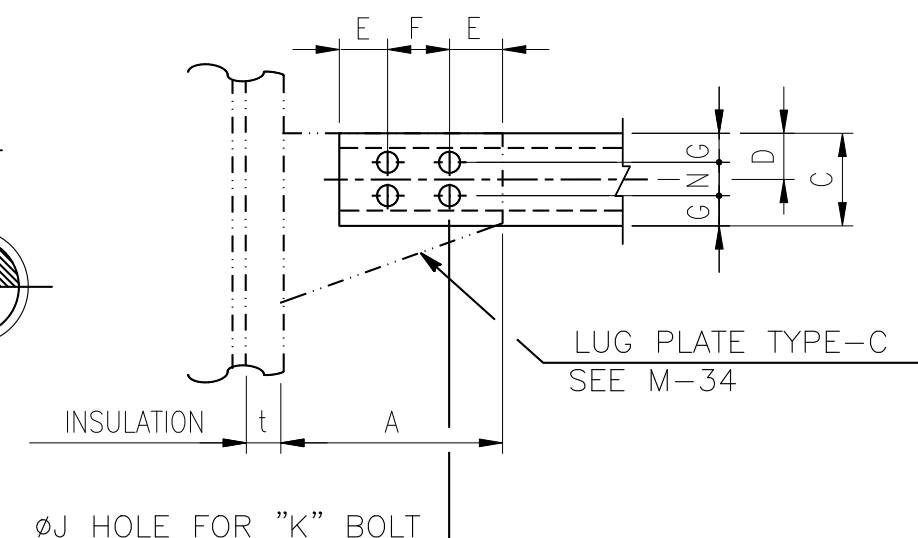

DETAIL "A"

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:

26-L50-1005A

- DENOTE FIG. NO.
- DENOTE DIM. "H" (IN 100mm)
- DENOTE DIM. "L" (IN 100mm)
- DENOTE MEMBER "M"
- DENOTE TYPE NO.

2. DIMENSIONS "L" & "H" SHALL BE CUT TO SUIT IN FIELD.

3. FOR DIMENSIONAL DATA, SEE SH'T D-29.

FILE: D-28M.DWG


|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
| DETAIL OF PIPE SUPPORT<br>TYPE-26<br>(1 OF 2)              |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | D-28                 | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                      |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

| MEMBER "M" | L<br>(MAX.) | H<br>(MAX.) |
|------------|-------------|-------------|
| L50X50X6   | 1000        | 1000        |
| L65X65X6   | 1000        | 1000        |
| L75X75X9   | 1000        | 2500        |
| C125X65X6  | 1500        | 1500        |

| DIMENSION (mm) |     |     |    |    |    |    |    |    |         |
|----------------|-----|-----|----|----|----|----|----|----|---------|
| MEMBER "M"     | A   | C   | D  | E  | F  | G  | N  | øJ | K       |
| L 50X50X6      | 150 | 50  | 30 | 30 | 60 | —  | —  | 19 | 5/8"X40 |
| L 65X65X6      | 160 | 65  | 35 | 30 | 70 | —  | —  | 22 | 3/4"X50 |
| L 75X75X9      | 160 | 75  | 40 | 30 | 70 | —  | —  | 22 | 3/4"X50 |
| C125X65X6      | 170 | 125 | —  | 30 | 80 | 35 | 55 | 22 | 3/4"X50 |


|                                                                               |          |  |       |      |  |                                                                          |  |                      |           |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|--------------------------------------------------------------------------|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-26</div> <div>(2 OF 2)</div> |  | ENGINEERING STANDARD |           |
|                                                                               |          |  |       |      |  |                                                                          |  | HP6-DSD-A4-500-001   |           |
|                                                                               |          |  |       |      |  |                                                                          |  | D-29                 | REV.<br>1 |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                                                          |  |                      |           |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                                          |  |                      |           |

FILE: D-29M.DWG

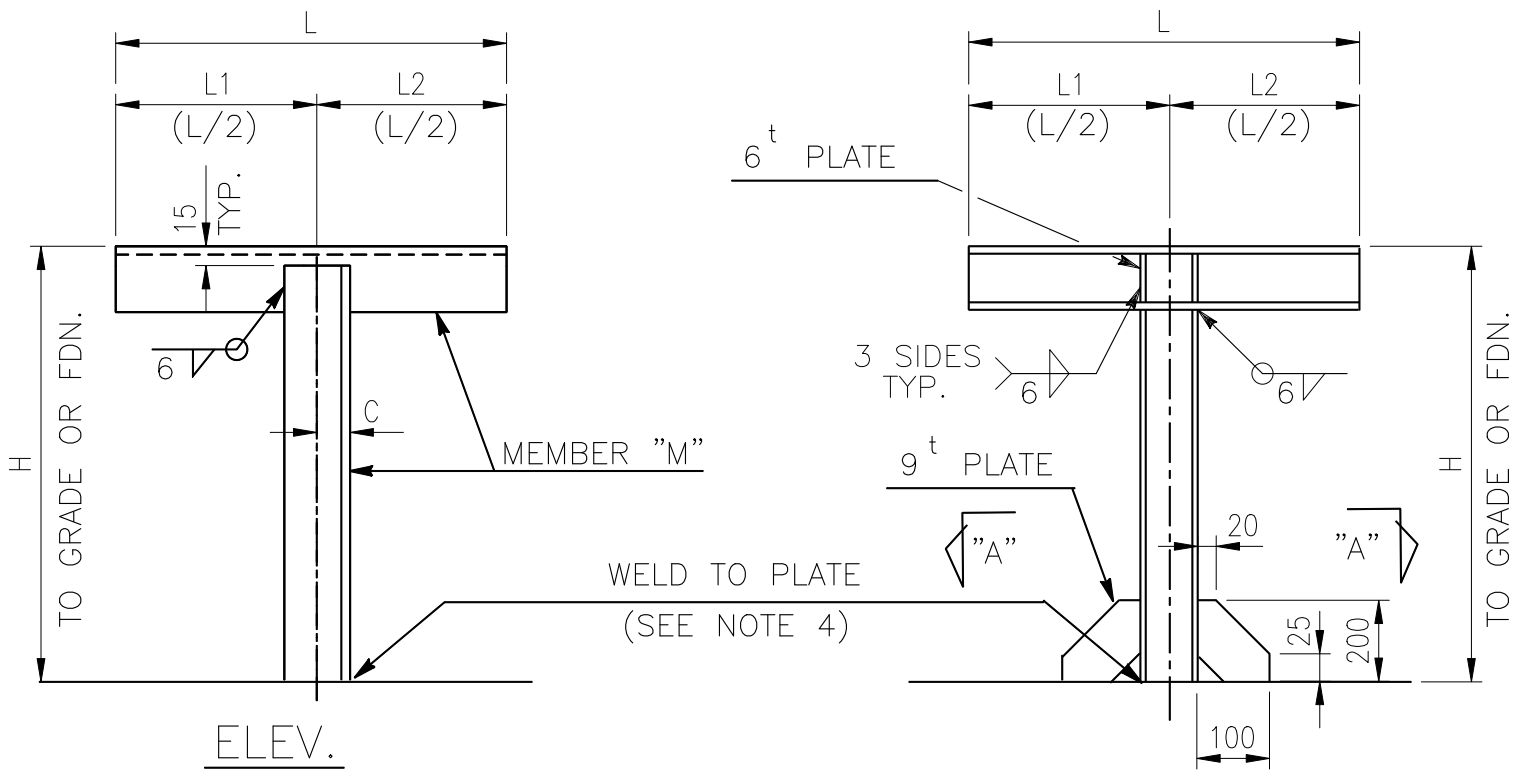

DIMENSION (mm)


| MEMBER "M"  | L<br>(MAX.) | H<br>(MAX.) | C  |
|-------------|-------------|-------------|----|
| L50X50X6    | 300         | 500         | 30 |
| L75X75X9    | 500         | 500         | 35 |
| L100X100X10 | 700         | 1000        | 50 |
| H150X150X10 | 600         | 2500        | —  |

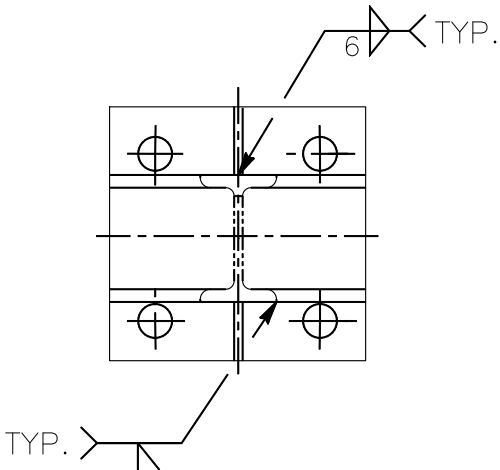

NOTES:

1. DESIGNATION DENOTE AS FOLLOWS:

27-L75-0505L-0401

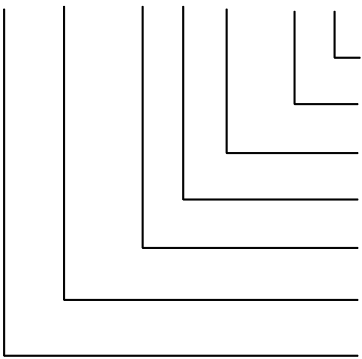

- MODIFY DIMENSION "L2" (IN 100mm) IF ANY
- MODIFY DIMENSION "L1" (IN 100mm) IF ANY
- DENOTE THE LOWER COMPONENT TYPE SEE M-42
- DENOTE DIM. "H" (IN 100 mm)
- DENOTE DIM. "L" (IN 100 mm)
- DENOTE MEMBER "M"
- DENOTE TYPE NO.

2. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.


3. IF THE FOUNDATION IS NOT USED IN THIS DETAIL, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

4. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE-L & P ONLY.

FILE: D-30M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-30                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-27

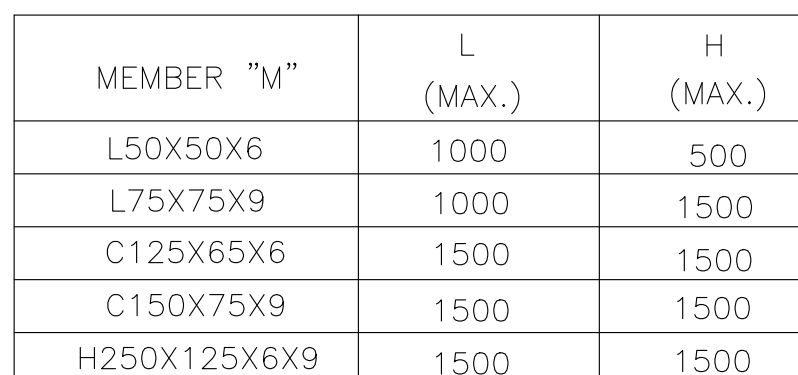

4. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE-L & P ONLY.

|                                                                               |  |  |  |  |  |                      |  |
|-------------------------------------------------------------------------------|--|--|--|--|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |  |  |  |  |  | ENGINEERING STANDARD |  |
|                                                                               |  |  |  |  |  |                      |  |
| <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-28</div>                          |  |  |  |  |  | D-31                 |  |
|                                                                               |  |  |  |  |  | REV.<br>1            |  |

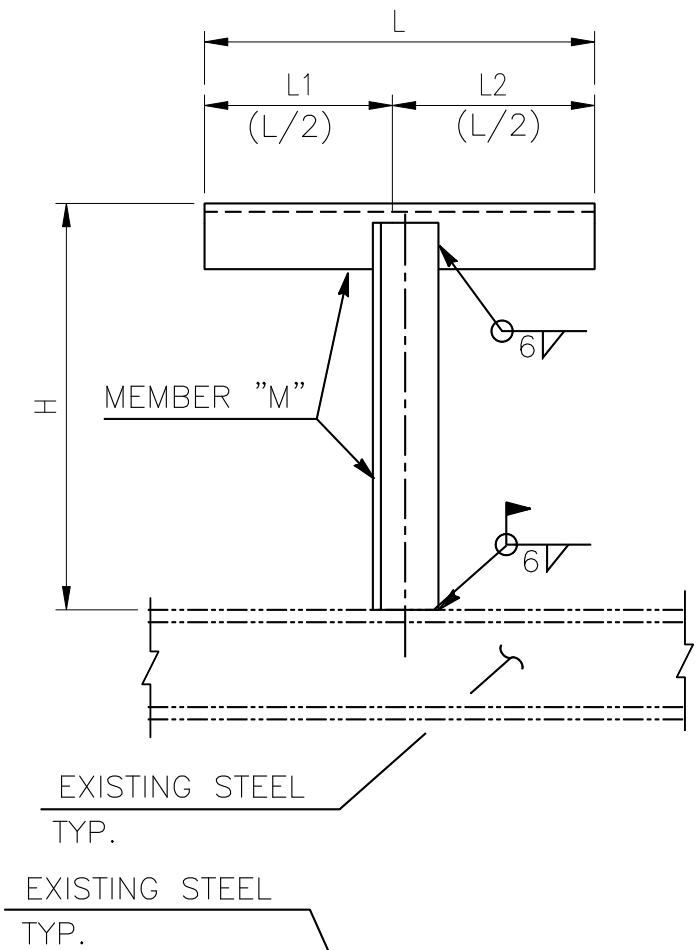


FIG.-A  
(ELEV.)



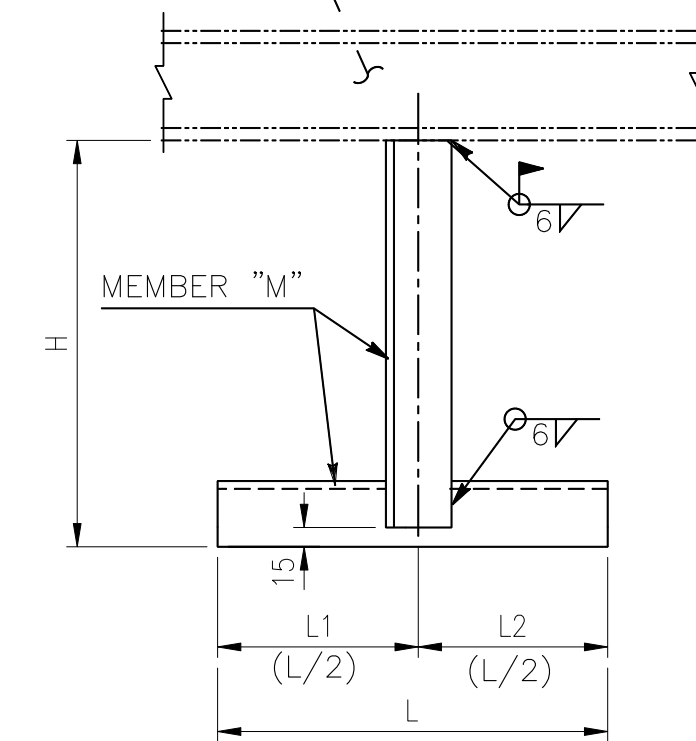



FIG.-B  
(ELEV.)

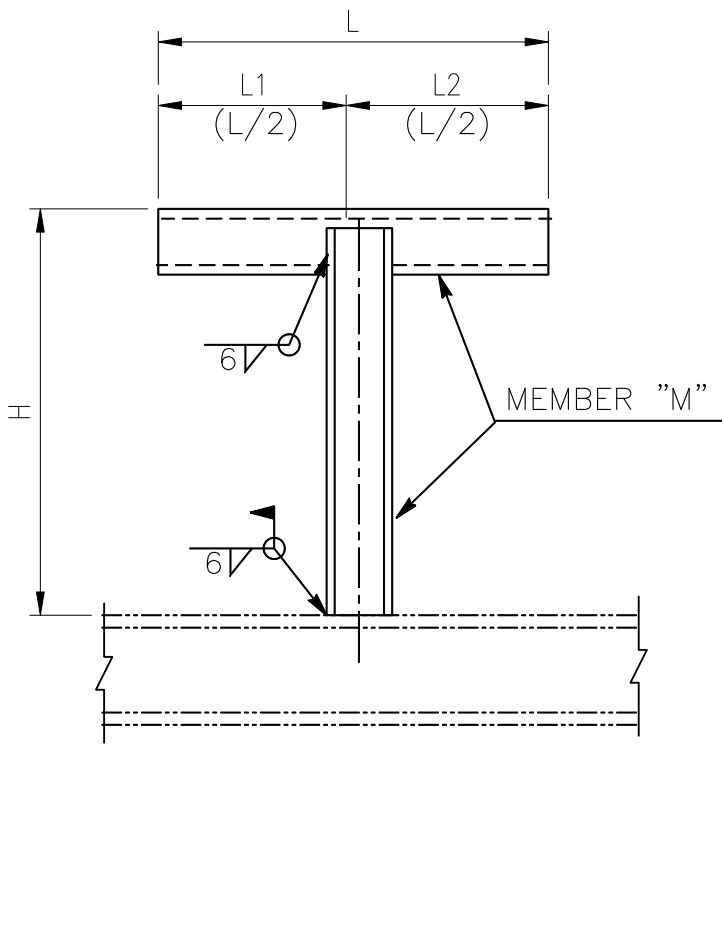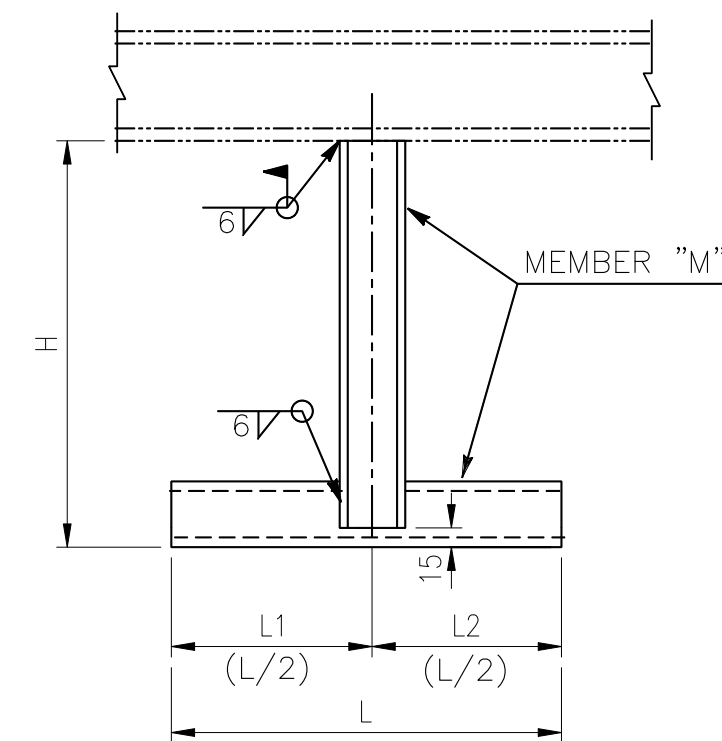

| MEMBER "M" | L<br>(MAX.) | H<br>(MAX.) |
|------------|-------------|-------------|
| L50X50X6   | 300         | 600         |
| L75X75X9   | 700         | 1000        |
| C125X65X6  | 1000        | 2000        |
| C150X75X9  | 1000        | 2000        |

NOTES: 1. DESIGNATION NUMBER DENOTE AS FOLLOWS:


30-L75-0505A-0401

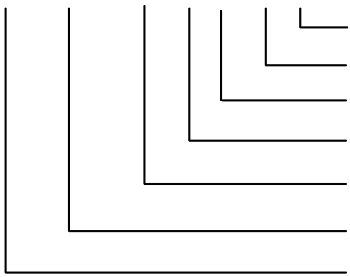

MODIFY DIMENSION "L2" (IN 100mm) IF ANY  
MODIFY DIMENSION "L1" (IN 100mm) IF ANY  
DENOTE FIG. NO.  
DENOTE DIMENSION "H" (IN 100mm)  
DENOTE DIMENSION "L" (IN 100mm)  
DENOTE MEMBER "M"  
DENOTE TYPE NO.

2. DIMENSION "H" & "L" SHALL BE CUT SUIT IN FIELD.

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-35                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-30                          |          |  |       |      |  | REV.<br>1            |  |
|                                                            |          |  |       |      |  |                      |  |

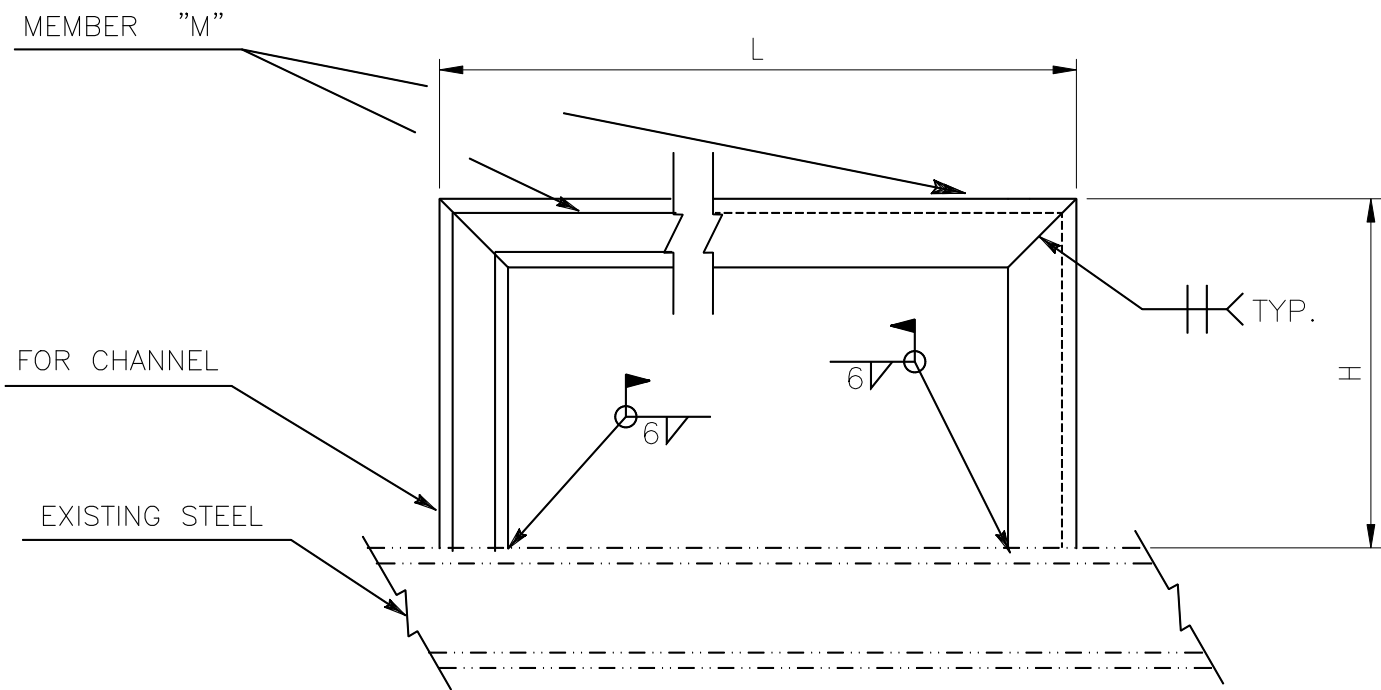


ELEV.

| MEMBER "M"   | L<br>(MAX.) | H<br>(MAX.) |
|--------------|-------------|-------------|
| L50X50X6     | 1000        | 1000        |
| L75X75X9     | 1000        | 1500        |
| C125X65X6    | 1500        | 1500        |
| C150X75X9    | 1500        | 1500        |
| H250X125X6X9 | 1500        | 1500        |

NOTES : 1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD .

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :


31-L50-1005

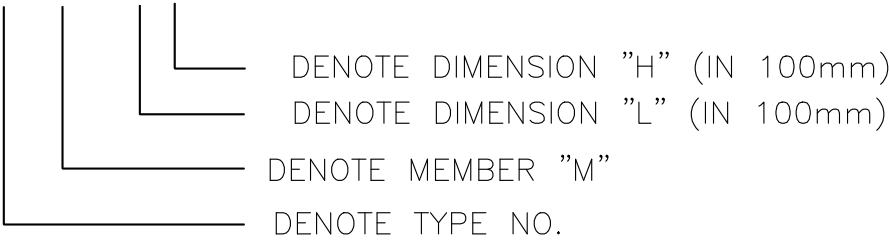

FILE: D-36M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-36                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-31                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |



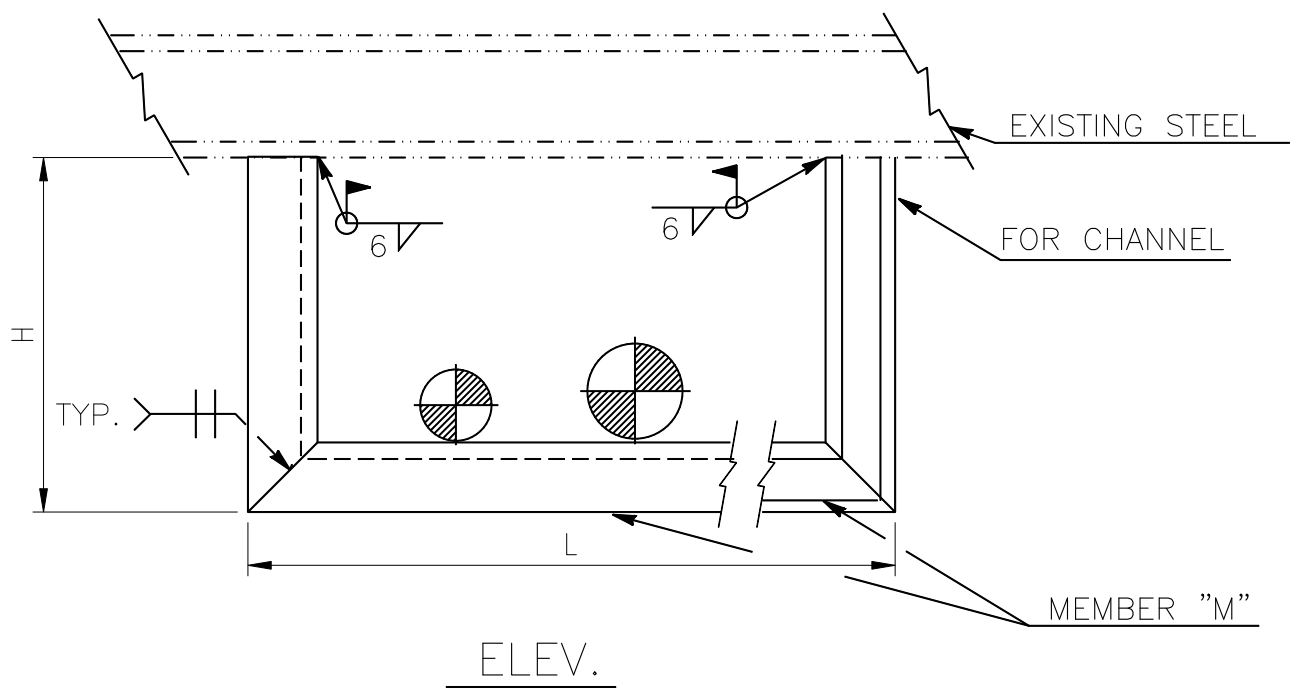


| MEMBER "M"   | L<br>(MAX.) | H<br>(MAX.) |
|--------------|-------------|-------------|
| L50X50X6     | 1000        | 1000        |
| L75X75X9     | 1000        | 1500        |
| C125X65X6    | 1500        | 1500        |
| C150X75X9    | 1500        | 1500        |
| H250X125X6X9 | 1500        | 1500        |

- NOTES :
- 1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD .
  - 2. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
32-L50-1005
    - DENOTE DIMENSION "H" (IN 100mm)
    - DENOTE DIMENSION "L" (IN 100mm)
    - DENOTE MEMBER "M"
    - DENOTE TYPE NO.

FILE: D-37M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-37                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-32

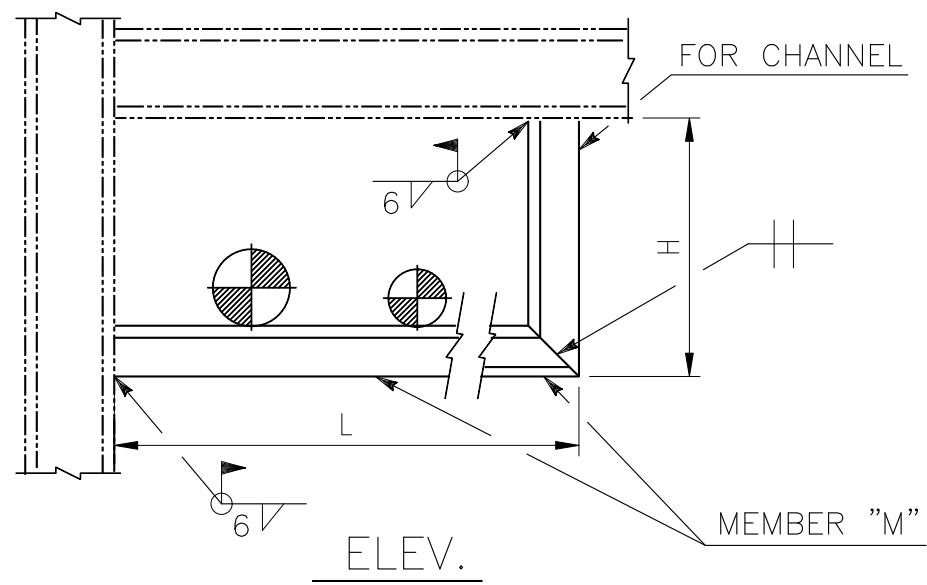

| MEMBER "M"   | L<br>(MAX.) | H<br>(MAX.) |
|--------------|-------------|-------------|
| L50X50X6     | 1000        | 1000        |
| L75X75X9     | 1000        | 1500        |
| C125X65X6    | 1500        | 1500        |
| C150X75X9    | 1500        | 1500        |
| H250X125X6X9 | 1500        | 1500        |

- NOTES :
1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

33-L50-1005

DENOTE DIMENSION "H" (IN 100mm)

DENOTE DIMENSION "L" (IN 100mm)


DENOTE MEMBER "M"

DENOTE TYPE NO.

FILE: D-38M.DWG

|                                                            |          |  |       |      |  |                                   |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD              |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-33 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                   | 1    |



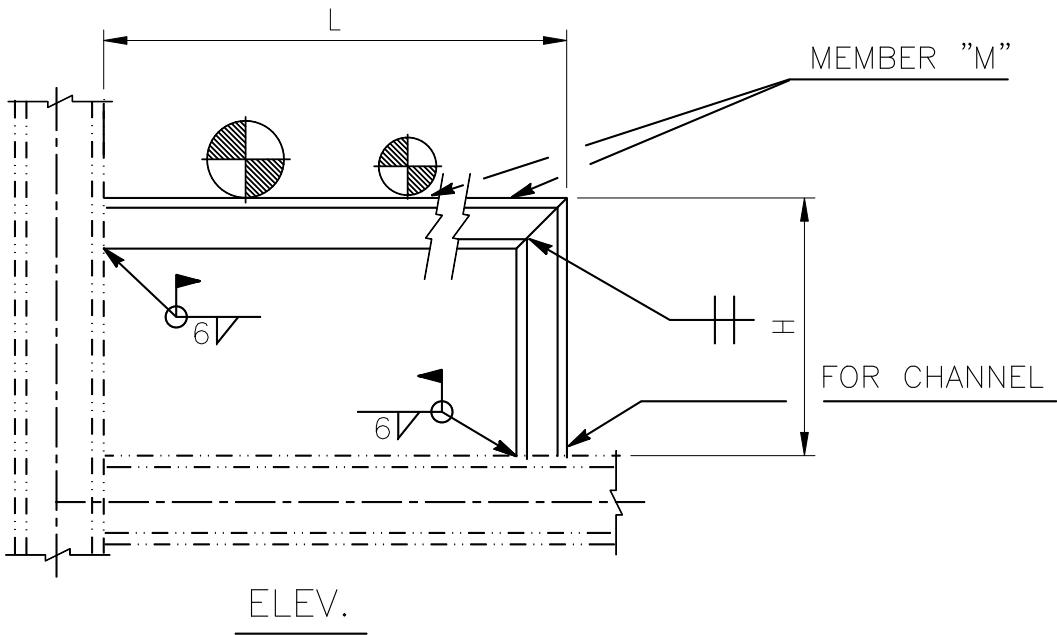

| MEMBER "M"   | L<br>(MAX.) | H<br>(MAX.) |
|--------------|-------------|-------------|
| L50X50X6     | 1000        | 1000        |
| L75X75X9     | 1000        | 1500        |
| C125X65X6    | 1500        | 1500        |
| C150X75X9    | 1500        | 1500        |
| H250X125X6X9 | 1500        | 1500        |

- NOTES :
- 1. DIMENSION "H" & "L" SHALL BE CUT TO SUIT IN FIELD .
  - 2. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
34-L50-1005
    - DENOTE DIMENSION "H" (IN 100mm)
    - DENOTE DIMENSION "L" (IN 100mm)
    - DENOTE MEMBER "M"
    - DENOTE TYPE NO.

FILE: D-39M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-39                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-34



G — A



FIG — B

DIMENSIONS (mm)

| MEMBER "M" | H (FOR FIG-A)<br>(MAX.) | H (FOR FIG-B)<br>(MAX.) |
|------------|-------------------------|-------------------------|
| L50X50X6   | 600                     | (NOTE 2)                |
| L75X75X9   | 800                     | 900                     |
| C100X50X5  | 1400                    | 900                     |
| C125X65X6  | 1400                    | 900                     |
| C150X75X9  | 1400                    | (NOTE 2)                |
| H100X100X6 | 1400                    |                         |
| H150X150X7 | 1400                    |                         |

NOTE :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

35-C125-05A

DENOTE FIG-A


DENOTE LENGTH "H" (IN 100mm)

DENOTE MEMBER "M"

DENOTE TYPE NO.

2. FOR MEMBER "L50X50X6","C150X75X9" USE FIG-A ONLY.

|                                                                                                                                                                                                             |          |  |        |      |  |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|--------|------|--|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/><br/> TYPE-35 </div> <div> ENGINEERING STANDARD<br/><br/> HP6-DSD-A4-500-001 </div> </div> |          |  |        |      |  |
| BY                                                                                                                                                                                                          | SHIH     |  | CHK.   | YANG |  |
| DATE                                                                                                                                                                                                        | 7/15/'24 |  | APPR.  | CHEN |  |
| D-40                                                                                                                                                                                                        |          |  | REV. 1 |      |  |

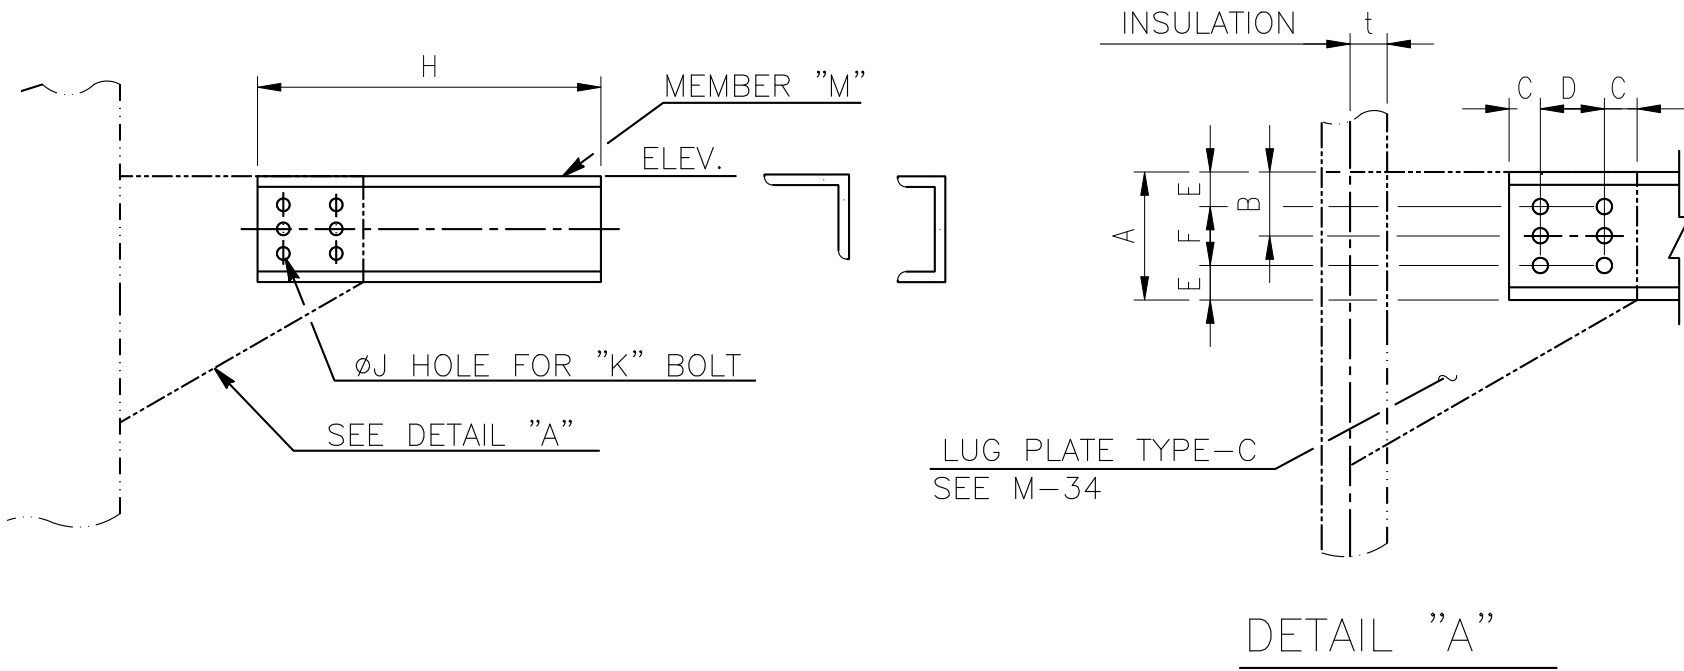


DIMENSIONS (mm)

| MEMBER "M" | A   | B  | C  | D   | E  | F  | J  | K       | H<br>(MAX.) |
|------------|-----|----|----|-----|----|----|----|---------|-------------|
| L50X50X6   | 50  | 30 | 30 | 60  | —  | —  | 19 | 5/8"x40 | 600         |
| L75X75X9   | 75  | 40 | 30 | 70  | —  | —  | 22 | 3/4"x50 | 800         |
| C100X50X5  | 100 | 50 | 30 | 80  | —  | —  | 22 | 3/4"x50 | 1400        |
| C125X65X6  | 125 | —  | 30 | 80  | 35 | 35 | 22 | 3/4"x50 | 1400        |
| C150X75X9  | 150 | —  | 30 | 100 | 40 | 70 | 22 | 3/4"x50 | 1400        |


NOTES :

1. THE DESIGNATION NUMBER DENOTE AS FOLLOWS :

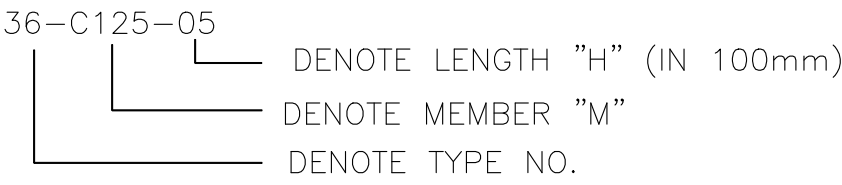


FILE: D-41M.DWG

|                                                            |          |  |       |      |  |                                   |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-36 |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  |                                   |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                   |  | D-41                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                   |  |                      | 1    |

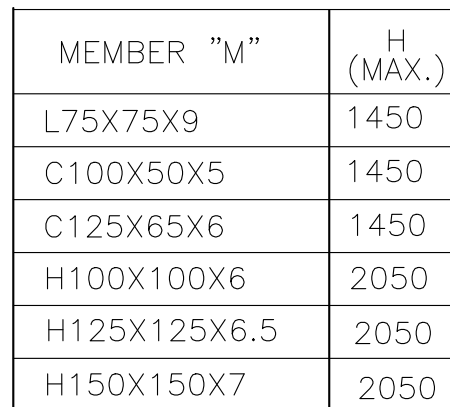


B: FOR  $\theta = 45^\circ$

|                                                            |  |  |  |  |  |                      |  |                    |
|------------------------------------------------------------|--|--|--|--|--|----------------------|--|--------------------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |  |  |  |  |  | ENGINEERING STANDARD |  |                    |
|                                                            |  |  |  |  |  |                      |  | HP6-DSD-A4-500-001 |
| DETAIL OF PIPE SUPPORT<br><br>TYPE-37                      |  |  |  |  |  | D-42                 |  | REV.<br>1          |
|                                                            |  |  |  |  |  |                      |  |                    |

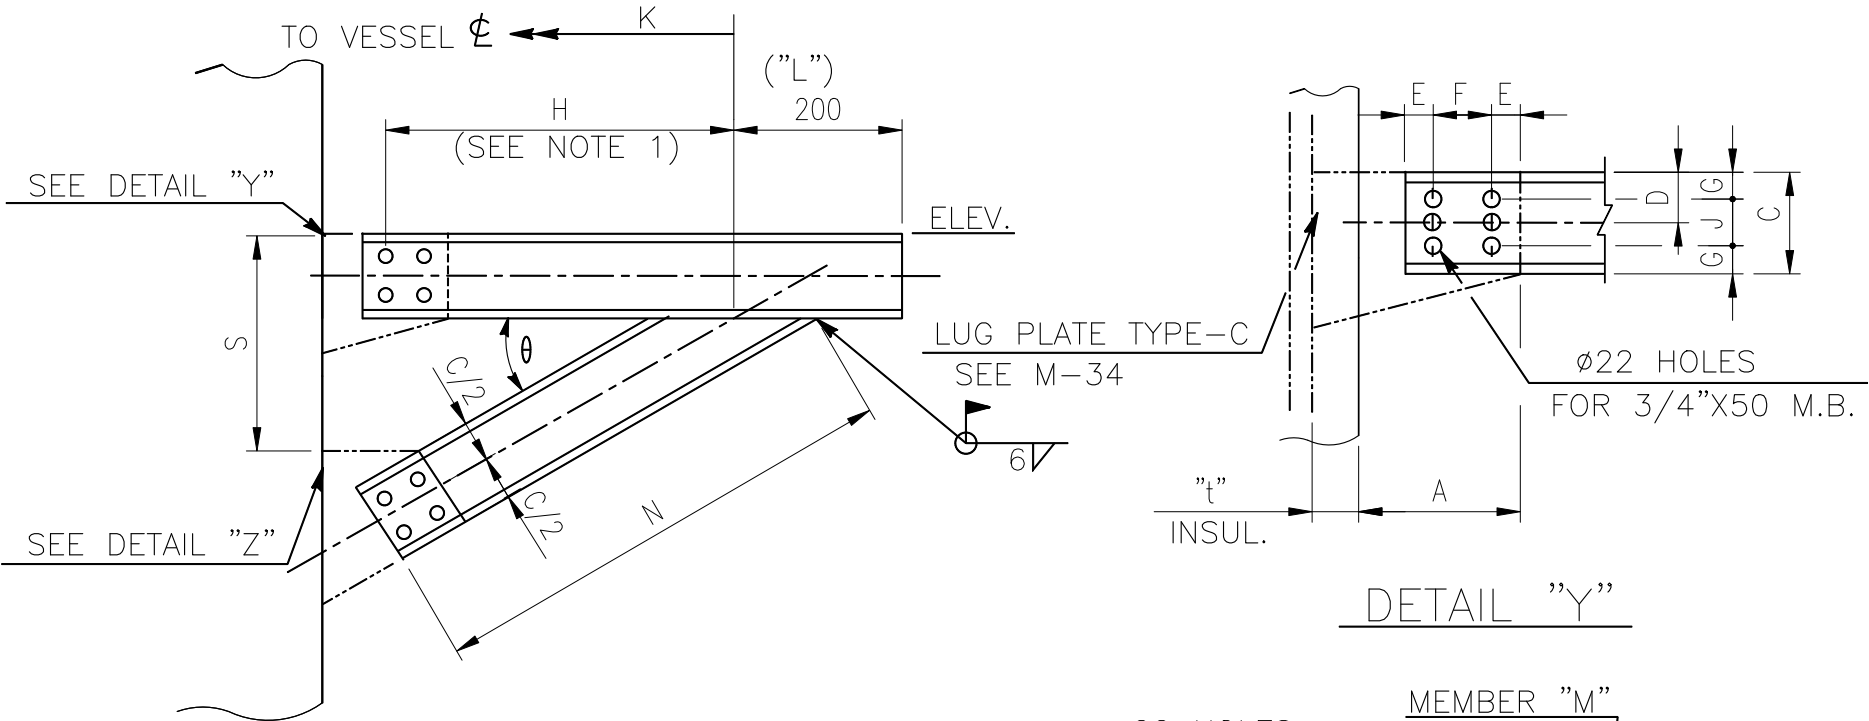

DIMENSIONS (mm)

| MEMBER "M" | A   | C   | D  | E  | F   | G  | J   | H (MAX.) |
|------------|-----|-----|----|----|-----|----|-----|----------|
| L75X75X9   | 160 | 75  | 40 | 30 | 70  | —  | —   | 1450     |
| C100X50X5  | 170 | 100 | 50 | 30 | 80  | —  | —   | 1450     |
| C125X65X6  | 170 | 125 | —  | 30 | 80  | 35 | 55  | 1450     |
| C150X75X9  | 190 | 150 | —  | 30 | 100 | 40 | 70  | 2000     |
| C180X75X7  | 210 | 180 | —  | 35 | 110 | 45 | 90  | 2000     |
| C200X90X8  | 220 | 200 | —  | 35 | 120 | 50 | 100 | 2000     |

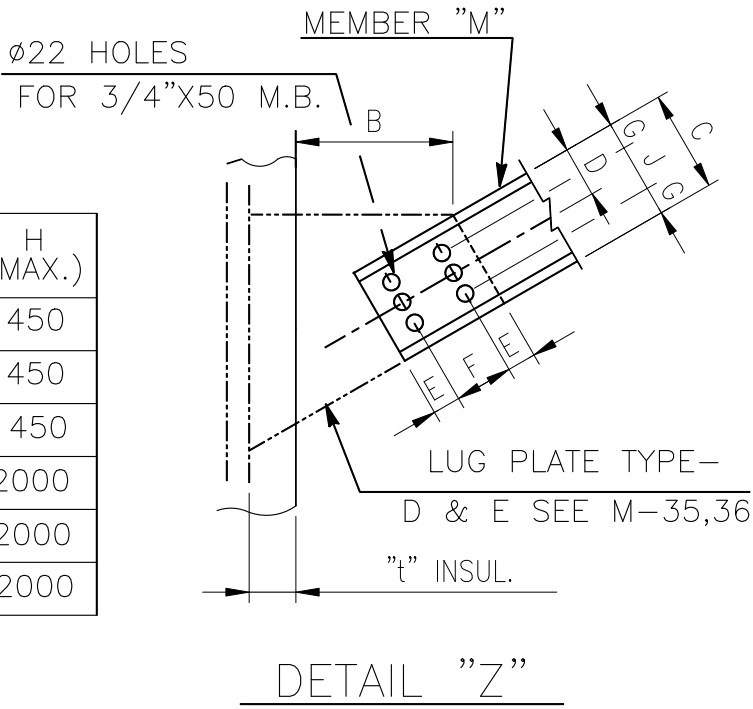


DIMENSIONS (mm)

| MEMBER "M" | $\theta = 30^\circ$ |          |            | $\theta = 45^\circ$ |        |           |
|------------|---------------------|----------|------------|---------------------|--------|-----------|
|            | B                   | S        | N          | B                   | S      | N         |
| L75X75X9   | 135                 | 0.577H-8 | 1.155H+ 92 | 115                 | H - 30 | 1.414H+57 |
| C100X50X5  | 145                 | 0.577H-7 | 1.155H+100 | 120                 | H - 31 | 1.414H+55 |
| C125X65X6  | 145                 | 0.577H+4 | 1.155H+114 | 130                 | H - 33 | 1.414H+41 |
| C150X75X9  | 165                 | 0.577H+3 | 1.155H+125 | 140                 | H - 36 | 1.414H+47 |
| C180X75X7  | 185                 | 0.577H+7 | 1.155H+145 | 150                 | H - 32 | 1.414H+60 |
| C200X90X8  | 195                 | 0.577H+9 | 1.155H+155 | 160                 | H - 36 | 1.414H+56 |

NOTES :

1.  $H=K-R-t-E-30$  WHERE "R" IS RADIUS OF VESSEL
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

39-C100-500 A OR B-05


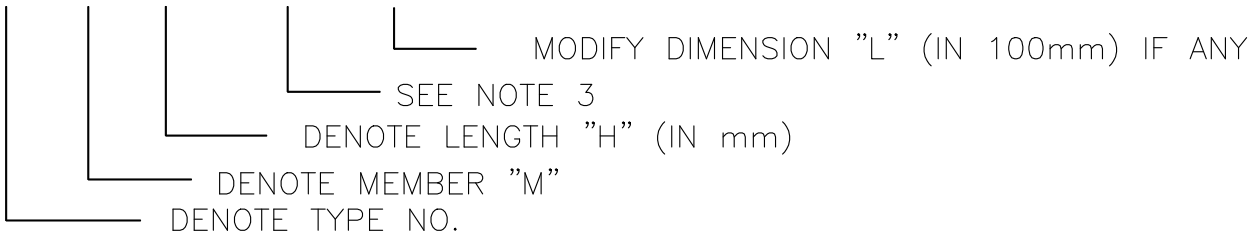


3. A: FOR  $\theta = 30^\circ$
- B: FOR  $\theta = 45^\circ$

FILE: D-45M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-45                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-39



| SUPPORT NO. | DISTANCE L | MEMBER      |             | BASE PLATE TH'K (MM) | EXP. BOLT  |                | WELD SIZE (MM) | b (MM) |
|-------------|------------|-------------|-------------|----------------------|------------|----------------|----------------|--------|
|             |            | 1           | 2           |                      | DIA. (IN.) | DIST. "d" (MM) |                |        |
| 41-1        | 230        | L50X50X6    |             | 16                   | 1/2"       | 150            | 5              | 25     |
| -2          | 460        | L75X75X9    |             | ↓                    | 5/8"       | 200            | 6              | 30     |
| -3          | 610        | L100X100X10 |             | 19                   | 3/4"       | 230            | ↓              | 35     |
| -4          | 915        | H150X150X7  |             | ↓                    | ↓          | 250            |                | ↓      |
| -5          | 610        | ↓           |             | ↓                    | ↓          | ↓              | ↓              | ↓      |
| -6          | 915        |             | L75X75X9    | 16                   | 5/8"       |                |                | 30     |
| -7          | 1220       |             | ↓           | ↓                    | ↓          |                |                | ↓      |
| -8          | 915        |             | L100X100X10 | 19                   | 3/4"       |                |                | 35     |
| -9          | 1220       |             | ↓           | ↓                    | ↓          |                |                | ↓      |

1. MATERIAL OF PLATE- A283 GR. C  
MATERIAL OF SHAPE STEEL- A36


41-1

SERIES NO.


DENOTE TYPE NO.

|                                                                               |          |  |       |      |  |                                       |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|---------------------------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD                  |  |
|                                                                               |          |  |       |      |  |                                       |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-41 |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                       |  |




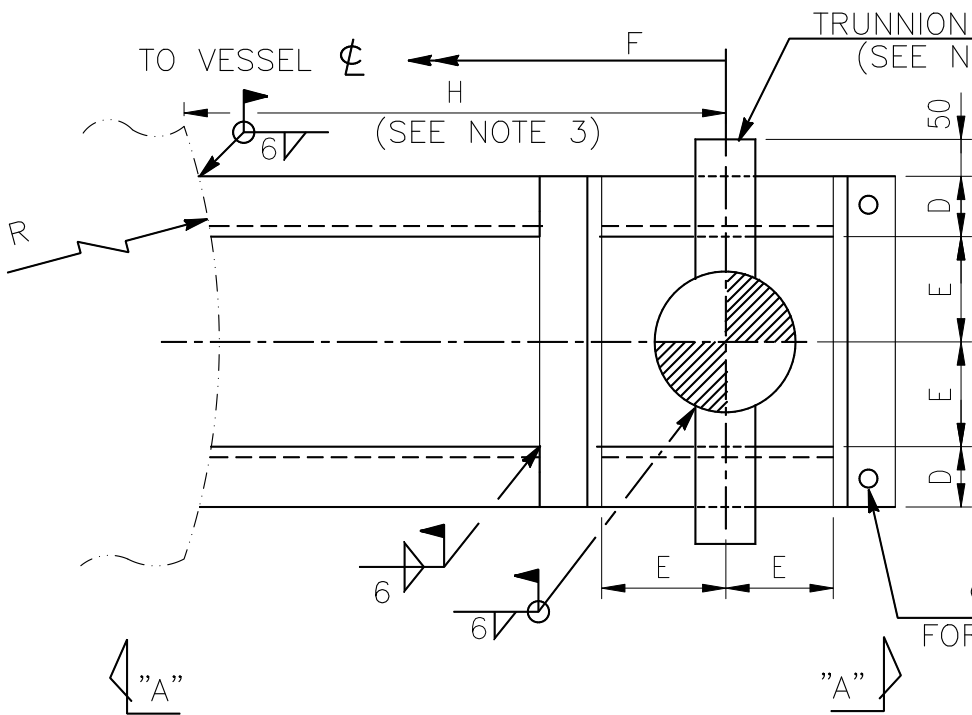

PLAN

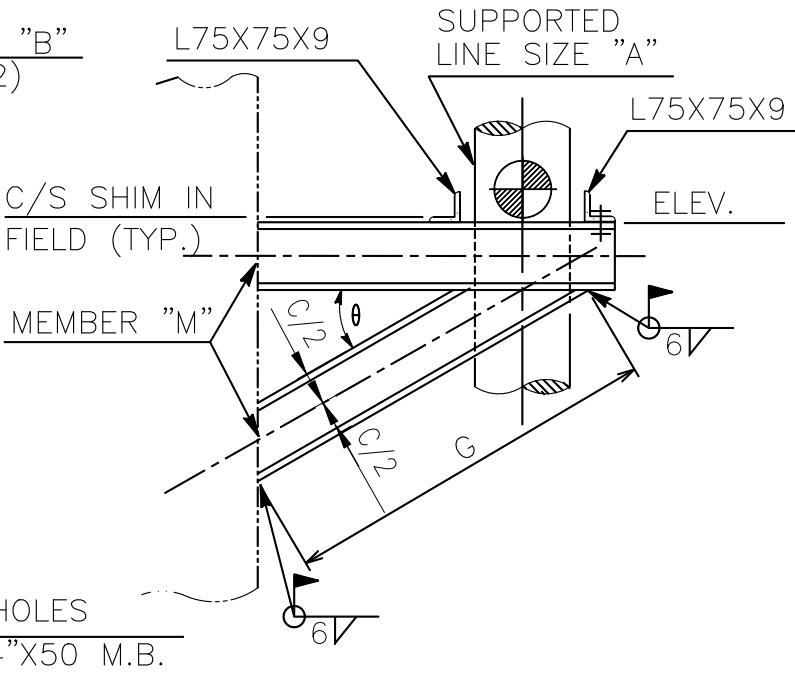

VIEW "A-A"

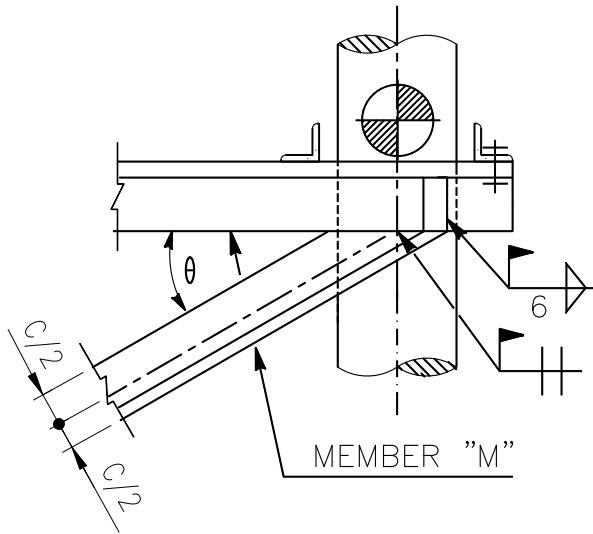

FOR ANGLE


| MEMBER<br>"M" | C   | D  | H<br>(MAX.) | $\theta = 30^\circ$ | $\theta = 45^\circ$ |
|---------------|-----|----|-------------|---------------------|---------------------|
|               |     |    |             | G                   | G                   |
| L75X75X9      | 75  | 75 | 950         | 1.155H+ 92          | 1.414H+ 80          |
| C100X50X5     | 100 | 50 | 950         | 1.155H+115          | 1.414H+100          |
| C125X65X6     | 125 | 65 | 1750        | 1.155H+144          | 1.414H+125          |
| C150X75X9     | 150 | 75 | 1750        | 1.155H+173          | 1.414H+150          |
| C180X75X7     | 180 | 75 | 1750        | 1.155H+208          | 1.414H+180          |
| C200X90X8     | 200 | 90 | 1750        | 1.155H+231          | 1.414H+200          |

| LINE SIZE<br>"A" | E   | TRUNNION<br>SIZE "B" |
|------------------|-----|----------------------|
| 2"               | 85  | 1 1/2"               |
| 3"               | 100 | 2"                   |
| 4"               | 113 | 2"                   |
| 6"               | 140 | 3"                   |
| 8"               | 165 | 4"                   |
| 10"              | 195 | 6"                   |
| 12"              | 215 | 8"                   |
| 14"              | 230 | 10"                  |
| 16"              | 255 | 10"                  |
| 18"              | 280 | 12"                  |
| 20"              | 305 | 12"                  |
| 24"              | 355 | 14"                  |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

42-2B-L75-520 A OR B -200

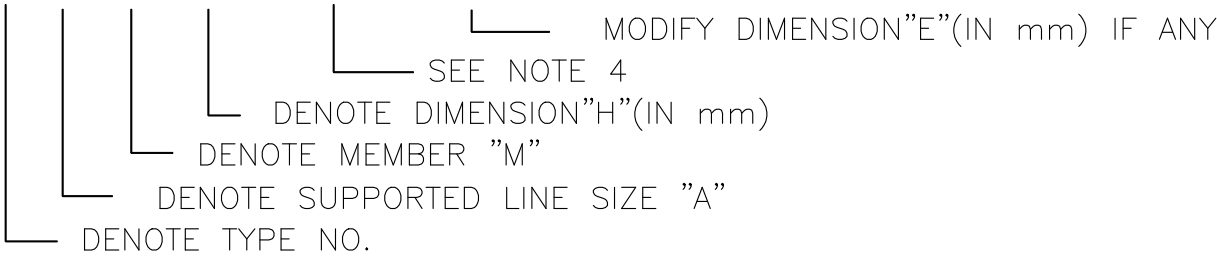

2. THE TRUNNION SIZE SHALL BE CHECKED BY SH'TS D-72,73 & 74.


3.  $H = F - \sqrt{R^2 - E^2}$

4. A: FOR  $\theta = 30^\circ$ , B: FOR  $\theta = 45^\circ$

FILE: D-50M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-50                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-42

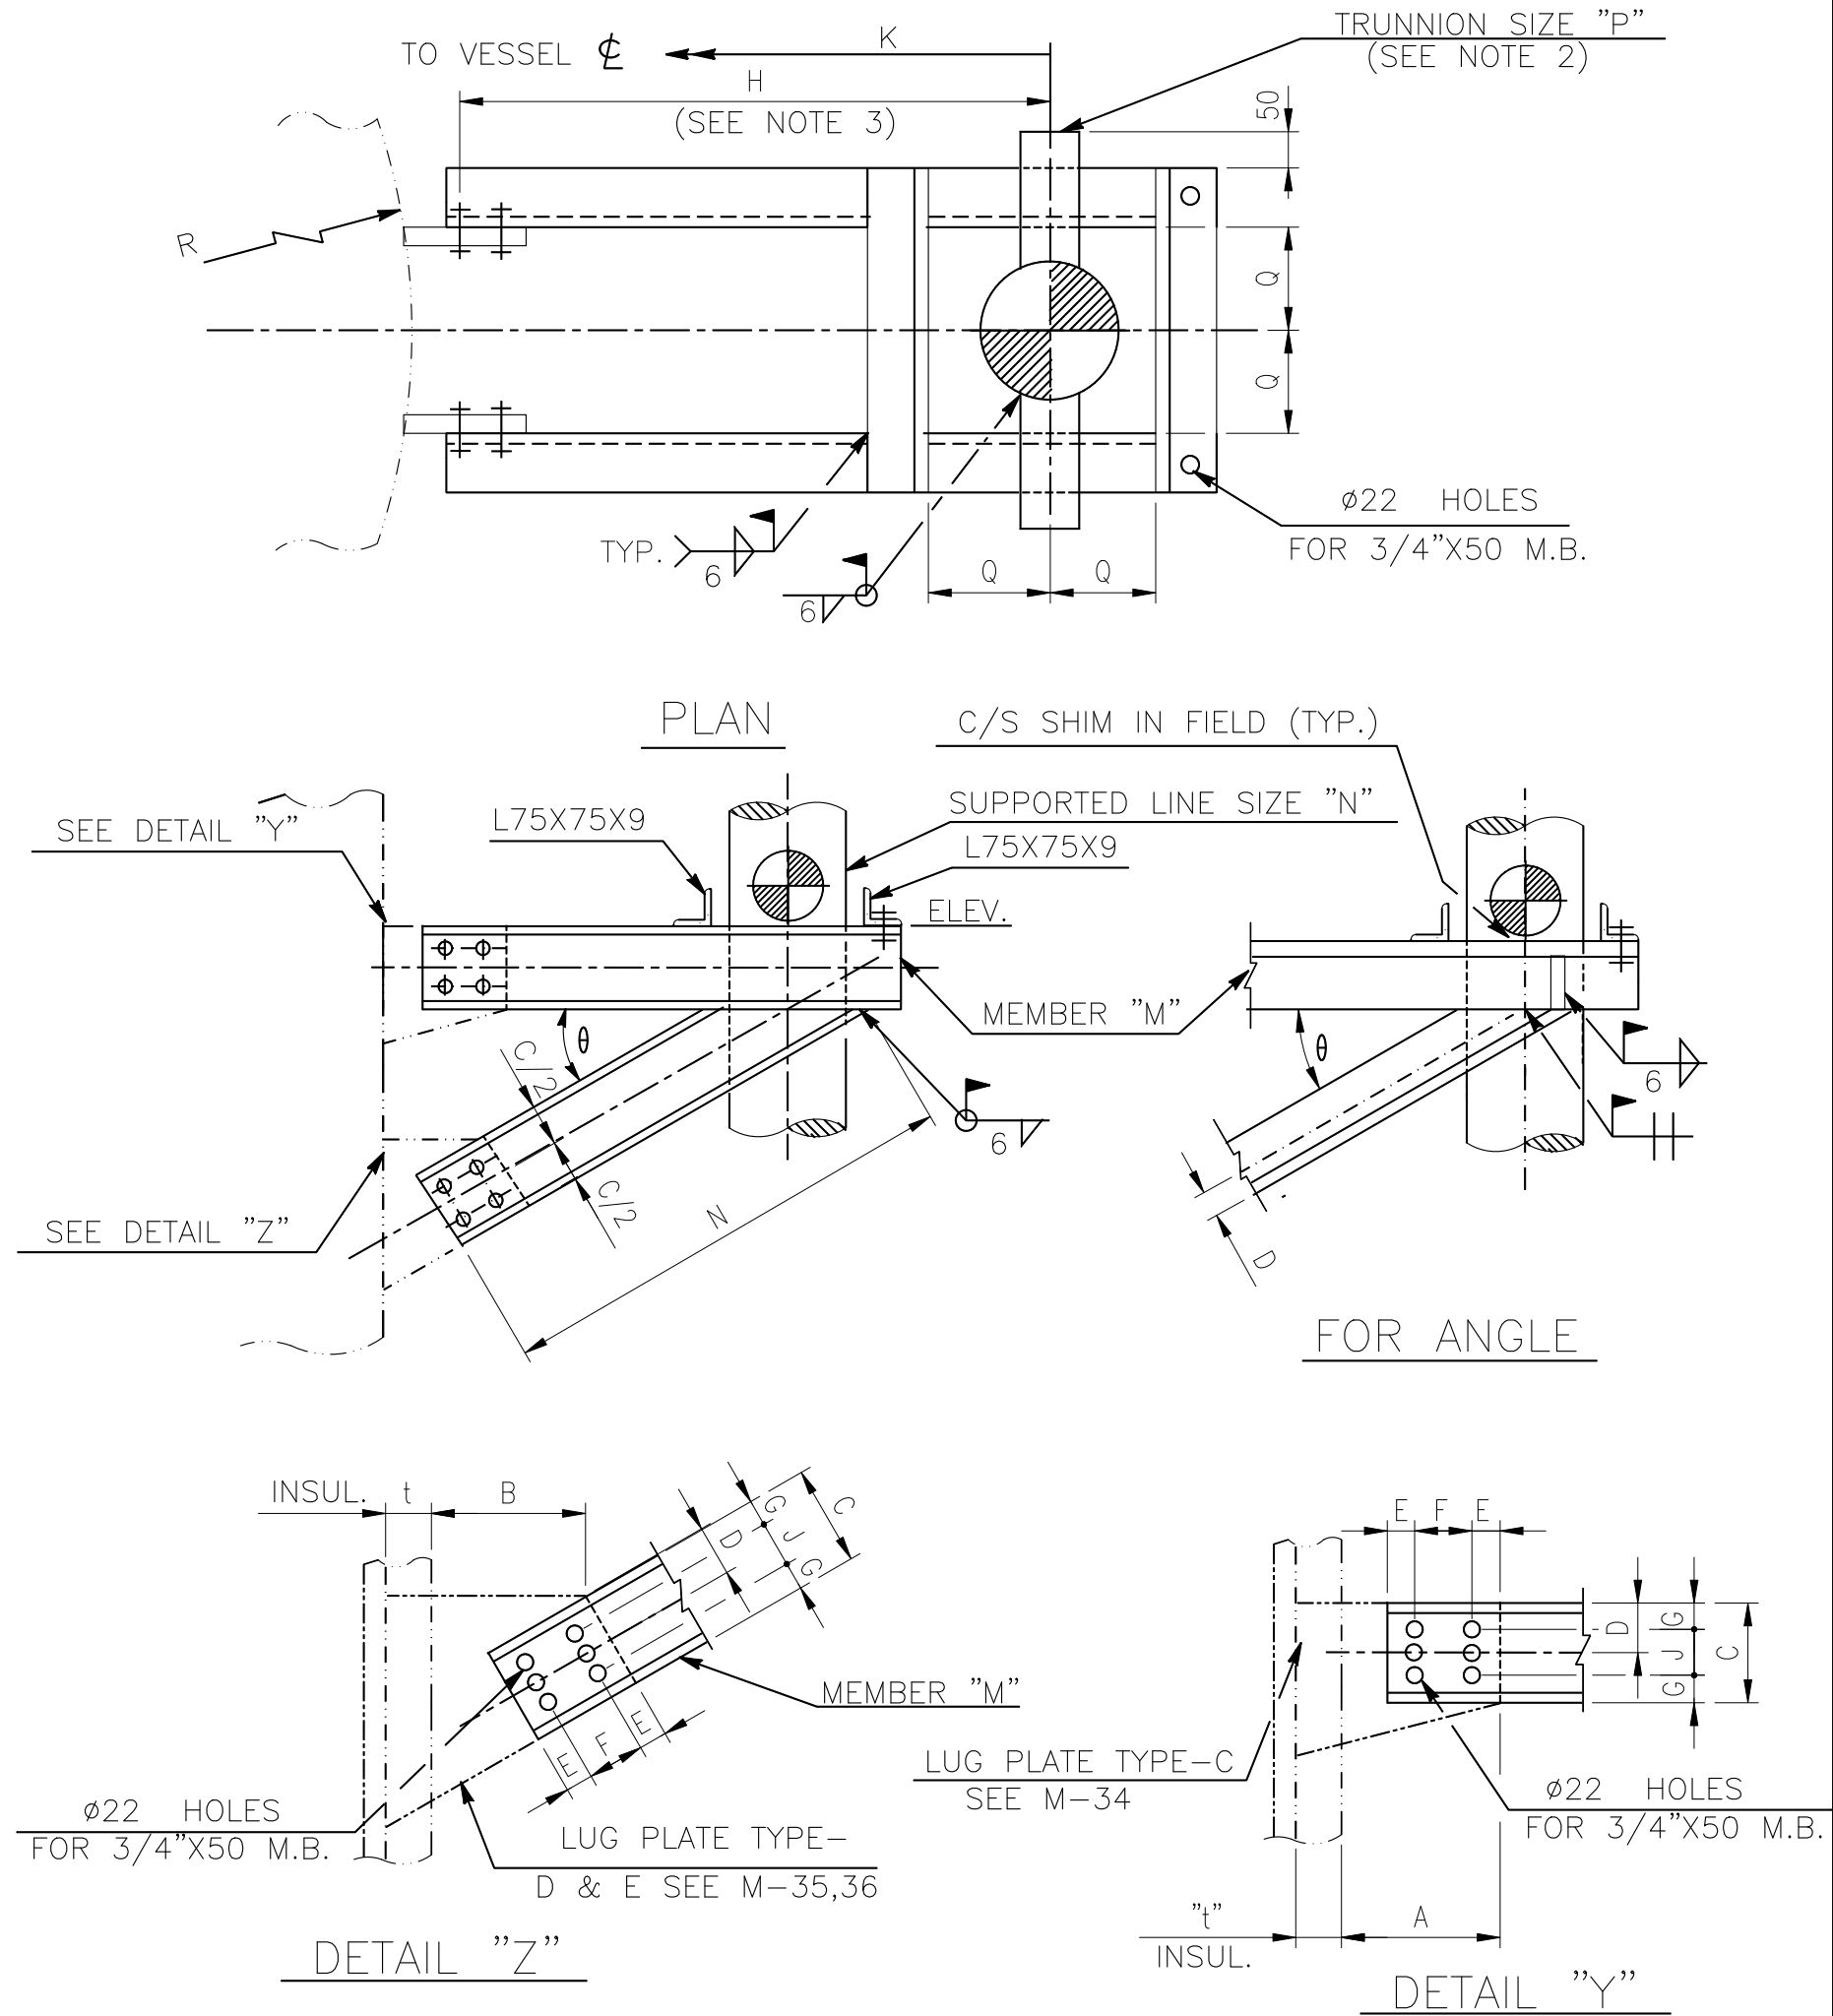

| DIMENSION (mm) |     |     |    |    |     |    |     |
|----------------|-----|-----|----|----|-----|----|-----|
| MEMBER "M"     | A   | C   | D  | E  | F   | G  | J   |
| L75X75X9       | 160 | 75  | 40 | 30 | 70  | —  | —   |
| C100X50X5      | 170 | 100 | 50 | 30 | 80  | —  | —   |
| C125X65X6      | 170 | 125 | —  | 30 | 80  | 35 | 55  |
| C150X75X9      | 190 | 150 | —  | 30 | 100 | 40 | 70  |
| C180X75X7      | 210 | 180 | —  | 35 | 110 | 45 | 90  |
| C200X90X8      | 220 | 200 | —  | 35 | 120 | 50 | 100 |

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-51                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-43  
(1 OF 2)




DIMENSION (mm)

| MEMBER "M" | H<br>(MAX.) | $\theta = 30^\circ$ |          |            | $\theta = 45^\circ$ |        |           |
|------------|-------------|---------------------|----------|------------|---------------------|--------|-----------|
|            |             | B                   | S        | N          | B                   | S      | N         |
| L75X75X9   | 950         | 135                 | 0.577H-8 | 1.155H+92  | 115                 | H - 30 | 1.414H+57 |
| C100X50X5  | 950         | 145                 | 0.577H-7 | 1.155H+100 | 120                 | H - 31 | 1.414H+55 |
| C125X65X6  | 1750        | 145                 | 0.577H+4 | 1.155H+114 | 130                 | H - 33 | 1.414H+41 |
| C150X75X9  | 1750        | 165                 | 0.577H+3 | 1.155H+125 | 140                 | H - 36 | 1.414H+47 |
| C180X75X7  | 1750        | 185                 | 0.577H+7 | 1.155H+145 | 150                 | H - 32 | 1.414H+60 |
| C200X90X8  | 1750        | 195                 | 0.577H+9 | 1.155H+155 | 160                 | H - 36 | 1.414H+56 |

|                      |        |     |     |     |     |     |     |     |     |     |     |     |
|----------------------|--------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| LINE SIZE<br>"N"     | 2"     | 3"  | 4"  | 6"  | 8"  | 10" | 12" | 14" | 16" | 18" | 20" | 24" |
| TRUNNION<br>SIZE "P" | 1 1/2" | 2"  | 2"  | 3"  | 4"  | 6"  | 8"  | 10" | 10" | 12" | 12" | 14" |
| Q (mm)               | 85     | 100 | 113 | 140 | 165 | 195 | 215 | 230 | 255 | 280 | 305 | 355 |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

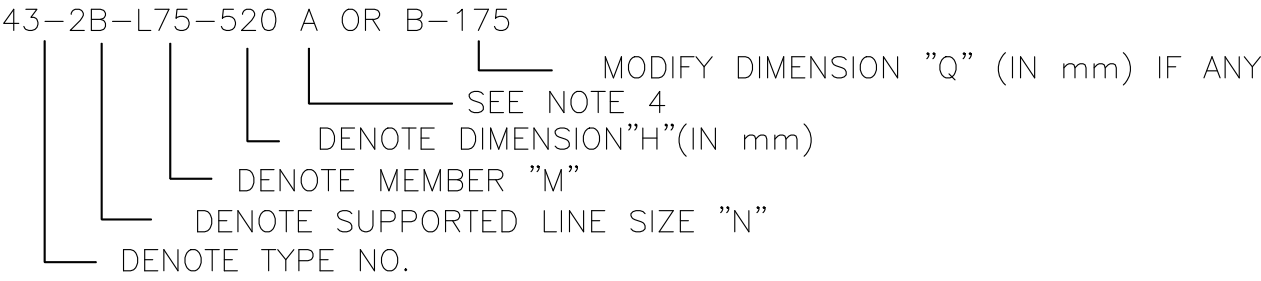



2. THE TRUNNION SIZE MUST BE CHECKED BY SH'T D-72,73 & 74.

3. WHERE  $H=K-\sqrt{R^2-Q^2}-t-E-30$


4. A: FOR  $\theta = 30^\circ$ , B: FOR  $\theta = 45^\circ$

FILE: D-52M.DWG

|                                                            |          |  |       |      |  |                                               |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                          |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                            |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-43<br>(2 OF 2) | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |           |

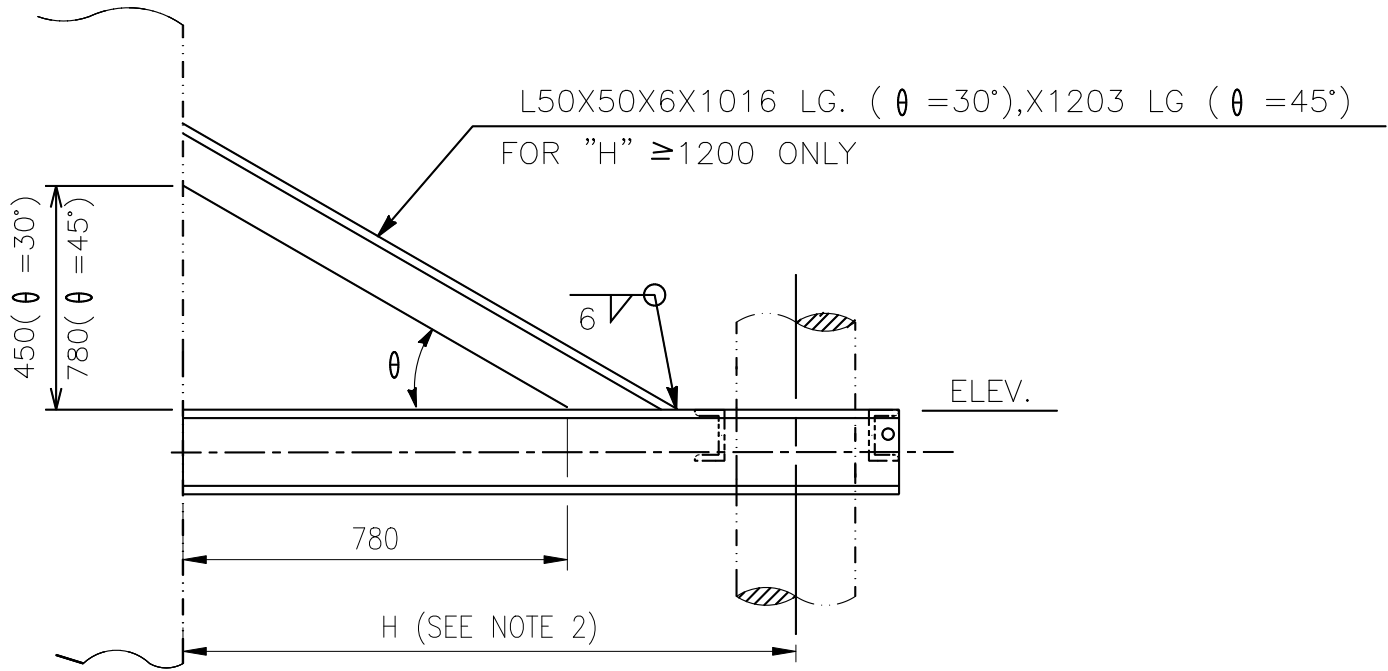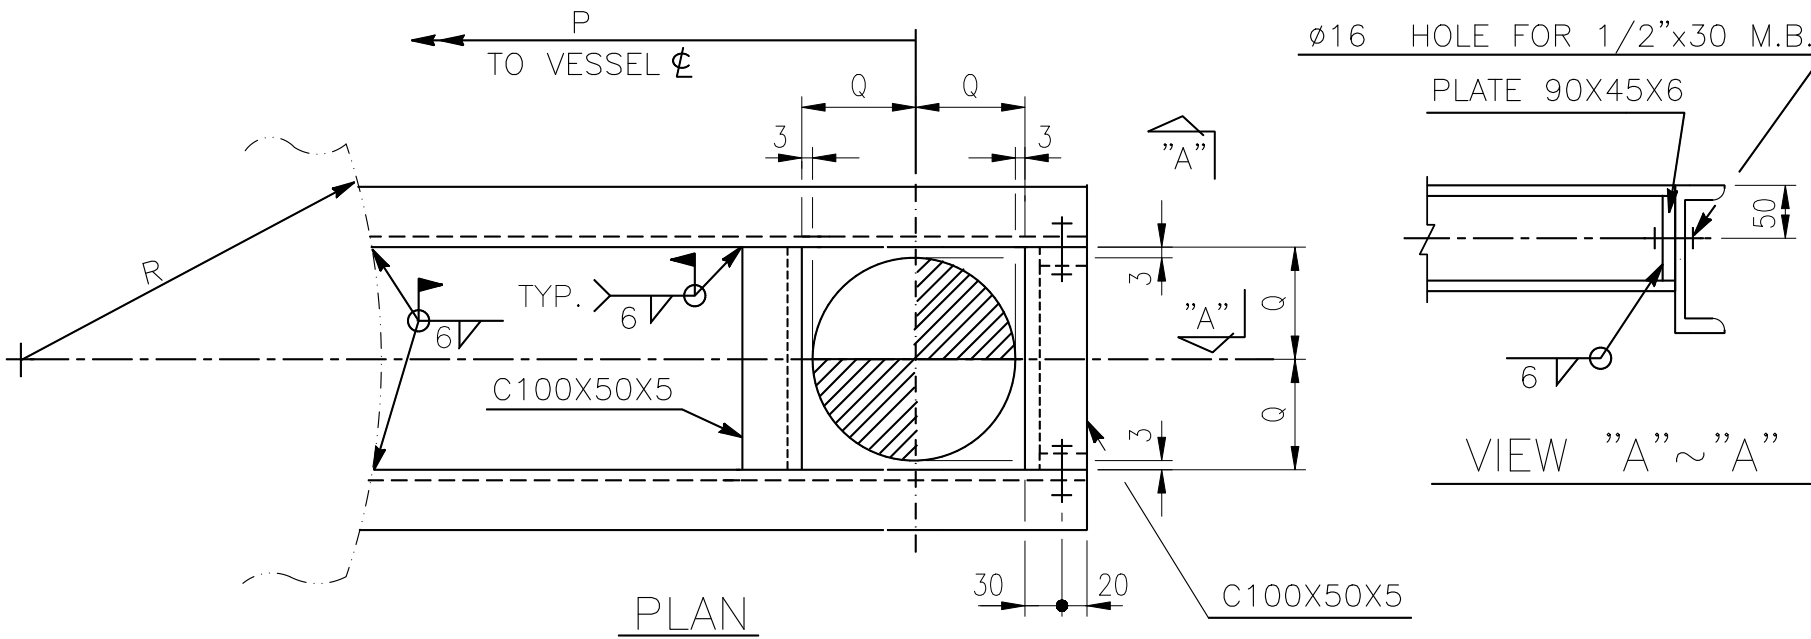


|           |     |     |     |     |
|-----------|-----|-----|-----|-----|
| LINE SIZE | 8"  | 10" | 12" | 14" |
| Q (mm)    | 113 | 140 | 165 | 181 |

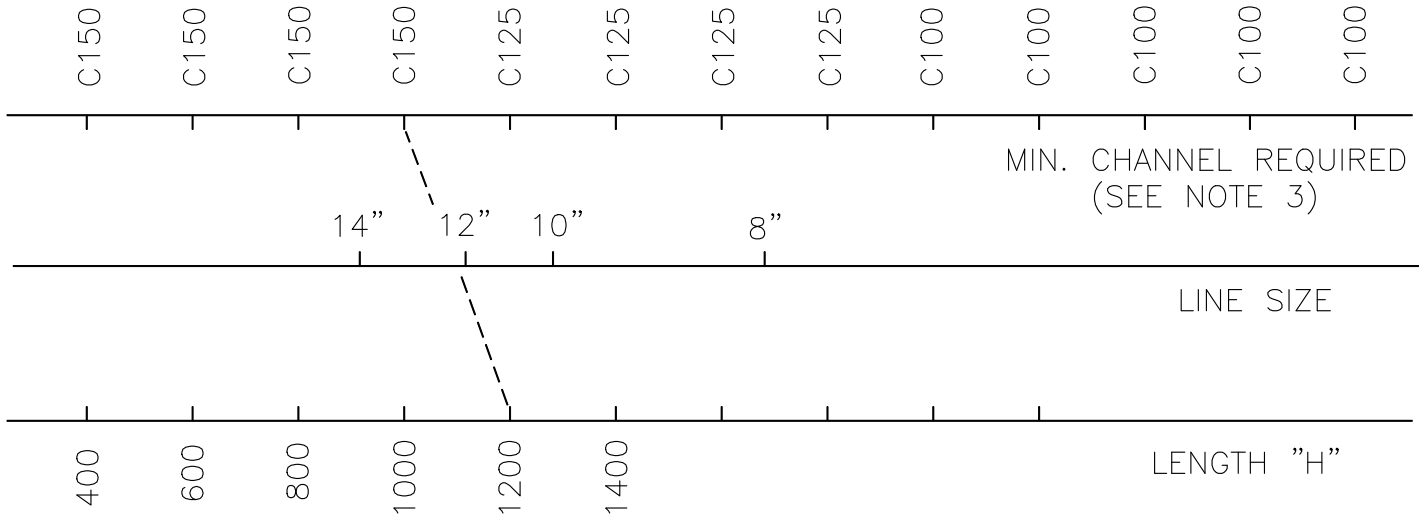



- NOTES:
1. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 44-8B-C100-800 A OR B-175
- DENOTE TYPE NO. J
- DENOTE SUPPORTED LINE SIZE
- MODIFY DIMENSION "Q" (IN mm) IF ANY
- SEE NOTE 4
- DENOTE LENGTH "H" (IN mm)
- DENOTE MEMBER SIZE
2.  $H = P - \sqrt{R^2 - Q^2}$
3. C100 DENOTE MEMBER C100X50X5  
C125 DENOTE MEMBER C125X65X6  
C150 DENOTE MEMBER C150X75X9
4. A: FOR  $\theta = 30^\circ$ , B: FOR  $\theta = 45^\circ$

FILE: D-53M.DWG

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  |                      |        |
| DETAIL OF PIPE SUPPORT<br>TYPE-44                          |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | D-53                 | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                      |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

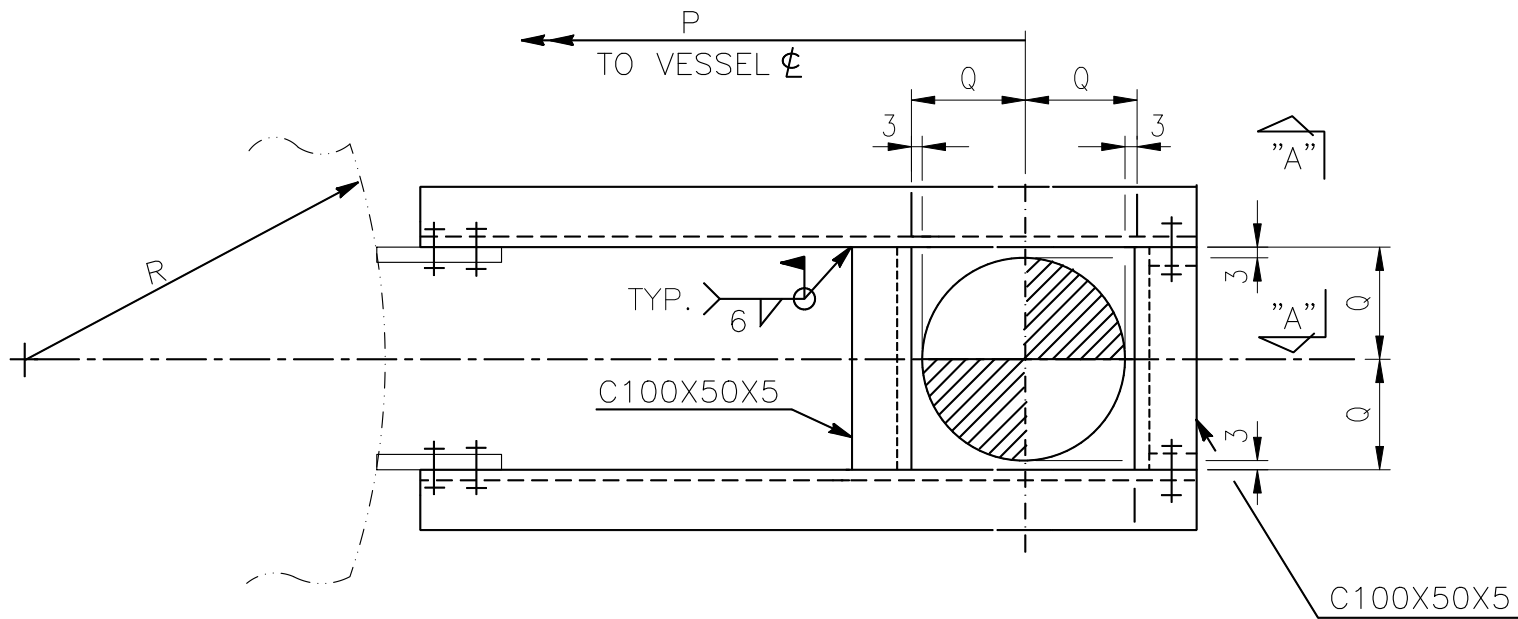


PLAN

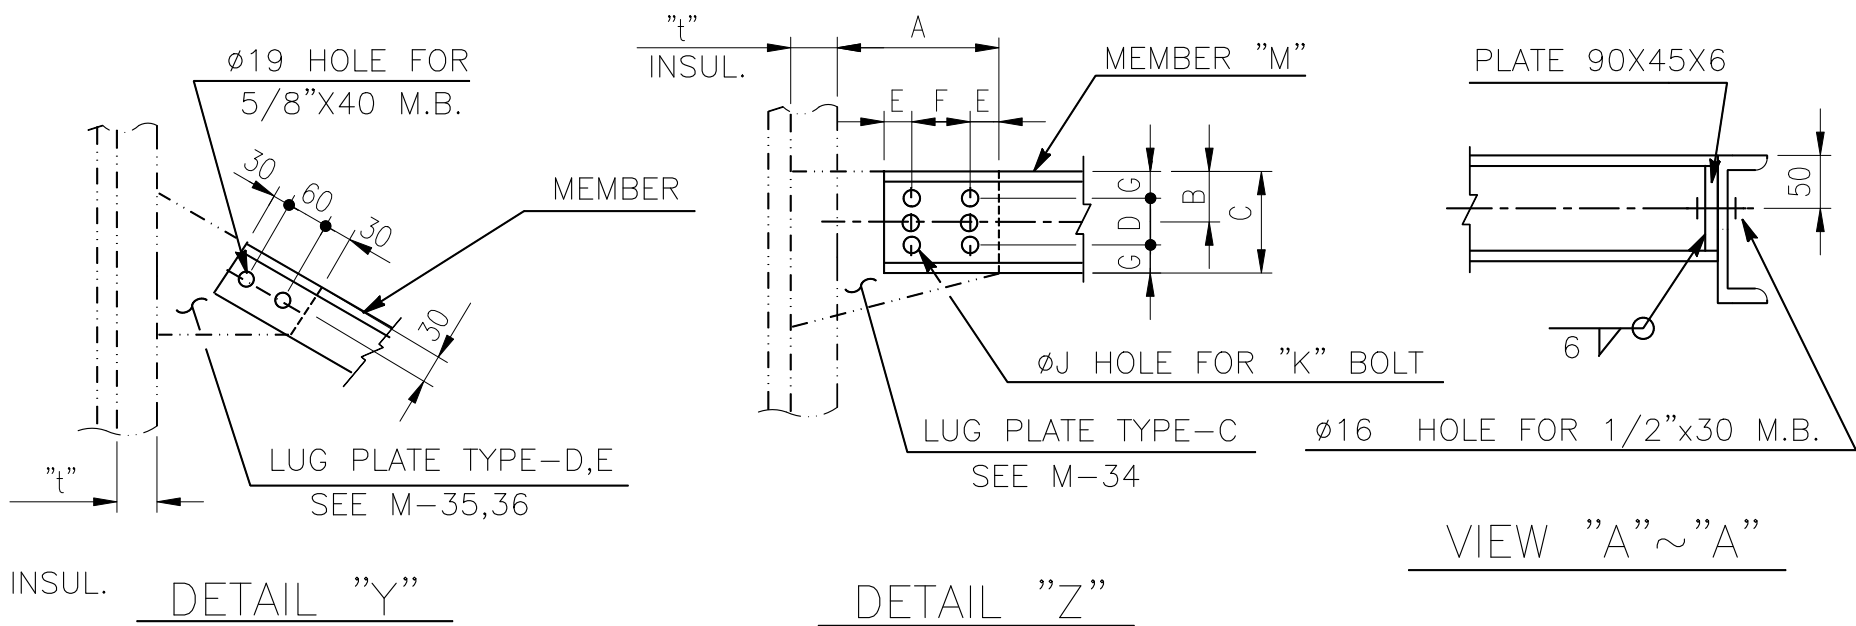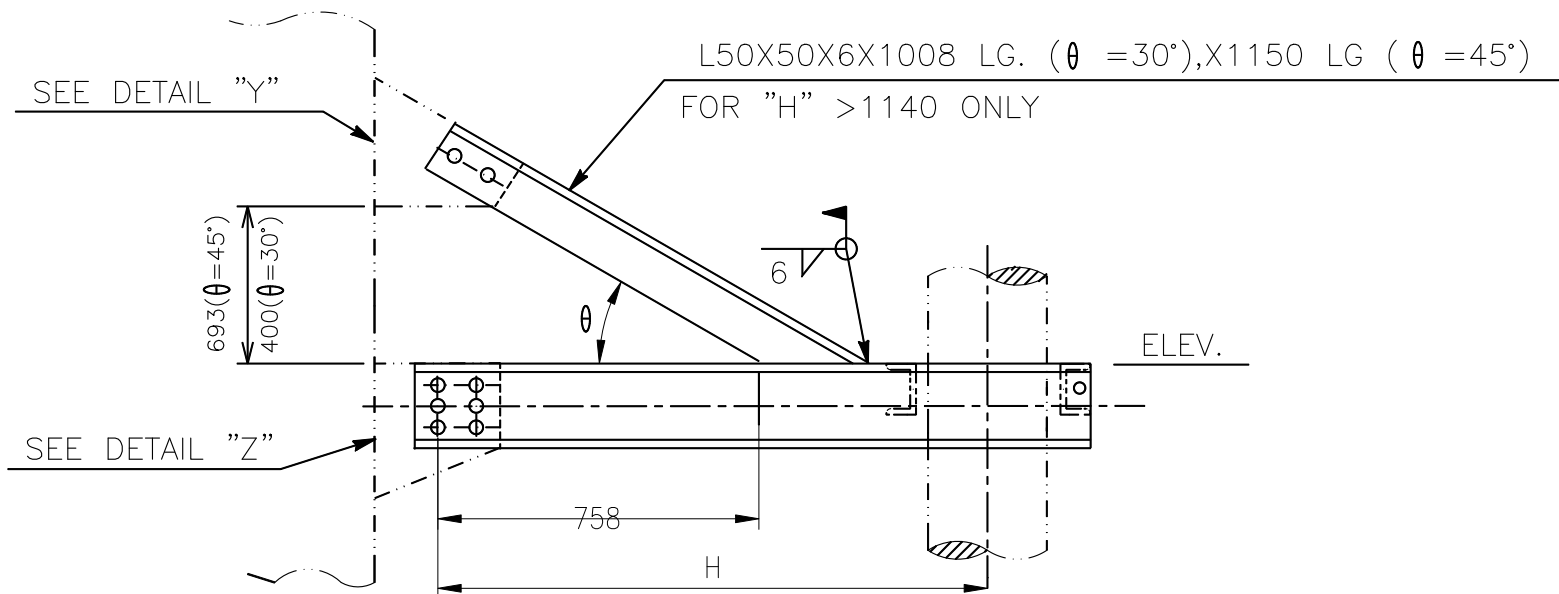

|           |     |     |     |     |
|-----------|-----|-----|-----|-----|
| LINE SIZE | 8"  | 10" | 12" | 14" |
| Q (mm)    | 113 | 140 | 165 | 181 |

FILE: D-54M.DWG

|                                                            |          |  |       |      |  |                                                       |      |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|------|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-45<br><br>(1 OF 2) |      | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                                       |      | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                                       |      |                      | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                       | D-54 |                      |           |

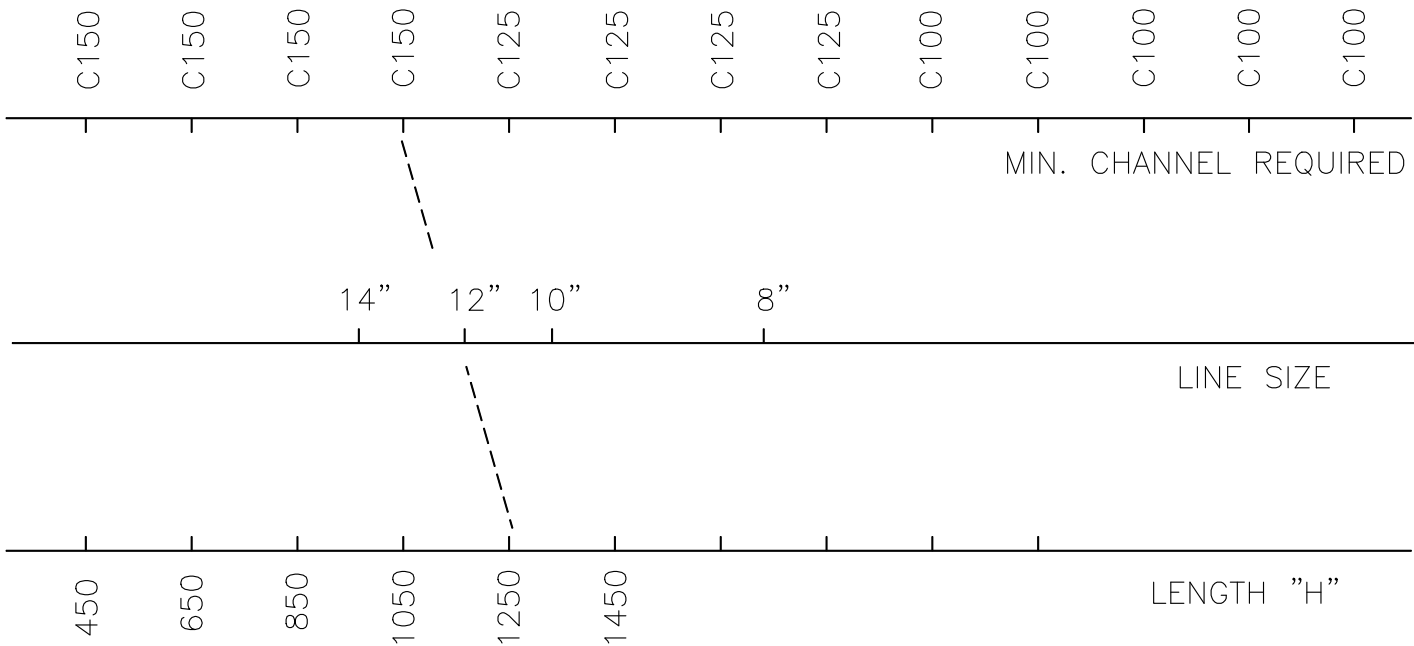


DIMENSION (mm)

| MEMBER "M" | A   | B  | C   | D  | E  | F   | G  | J  | K       | H                         |
|------------|-----|----|-----|----|----|-----|----|----|---------|---------------------------|
| C100X50X5  | 170 | 50 | 100 | —  | 30 | 80  | —  | 22 | 3/4"X50 | $H=P-\sqrt{R^2-Q^2}-60-t$ |
| C125X65X6  | 170 | —  | 125 | 55 | 30 | 80  | 35 | 22 | 3/4"X50 |                           |
| C150X75X9  | 190 | —  | 150 | 70 | 30 | 100 | 40 | 22 | 3/4"X50 |                           |

NOTES :


1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

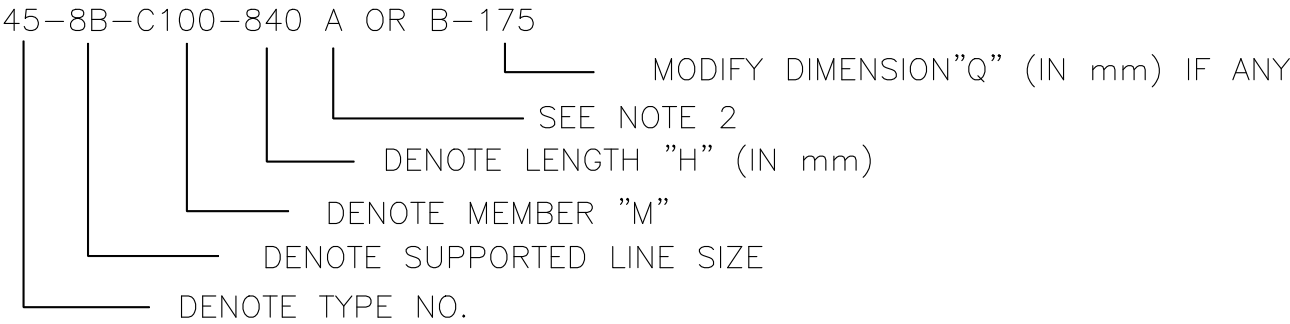

2. A: FOR  $\theta = 30^\circ$   
B: FOR  $\theta = 45^\circ$

FILE: D-55M.DWG

|                                                            |          |  |       |      |  |                                               |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-45<br>(2 OF 2) |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                               |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                               |  | D-55                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |  |                      |           |

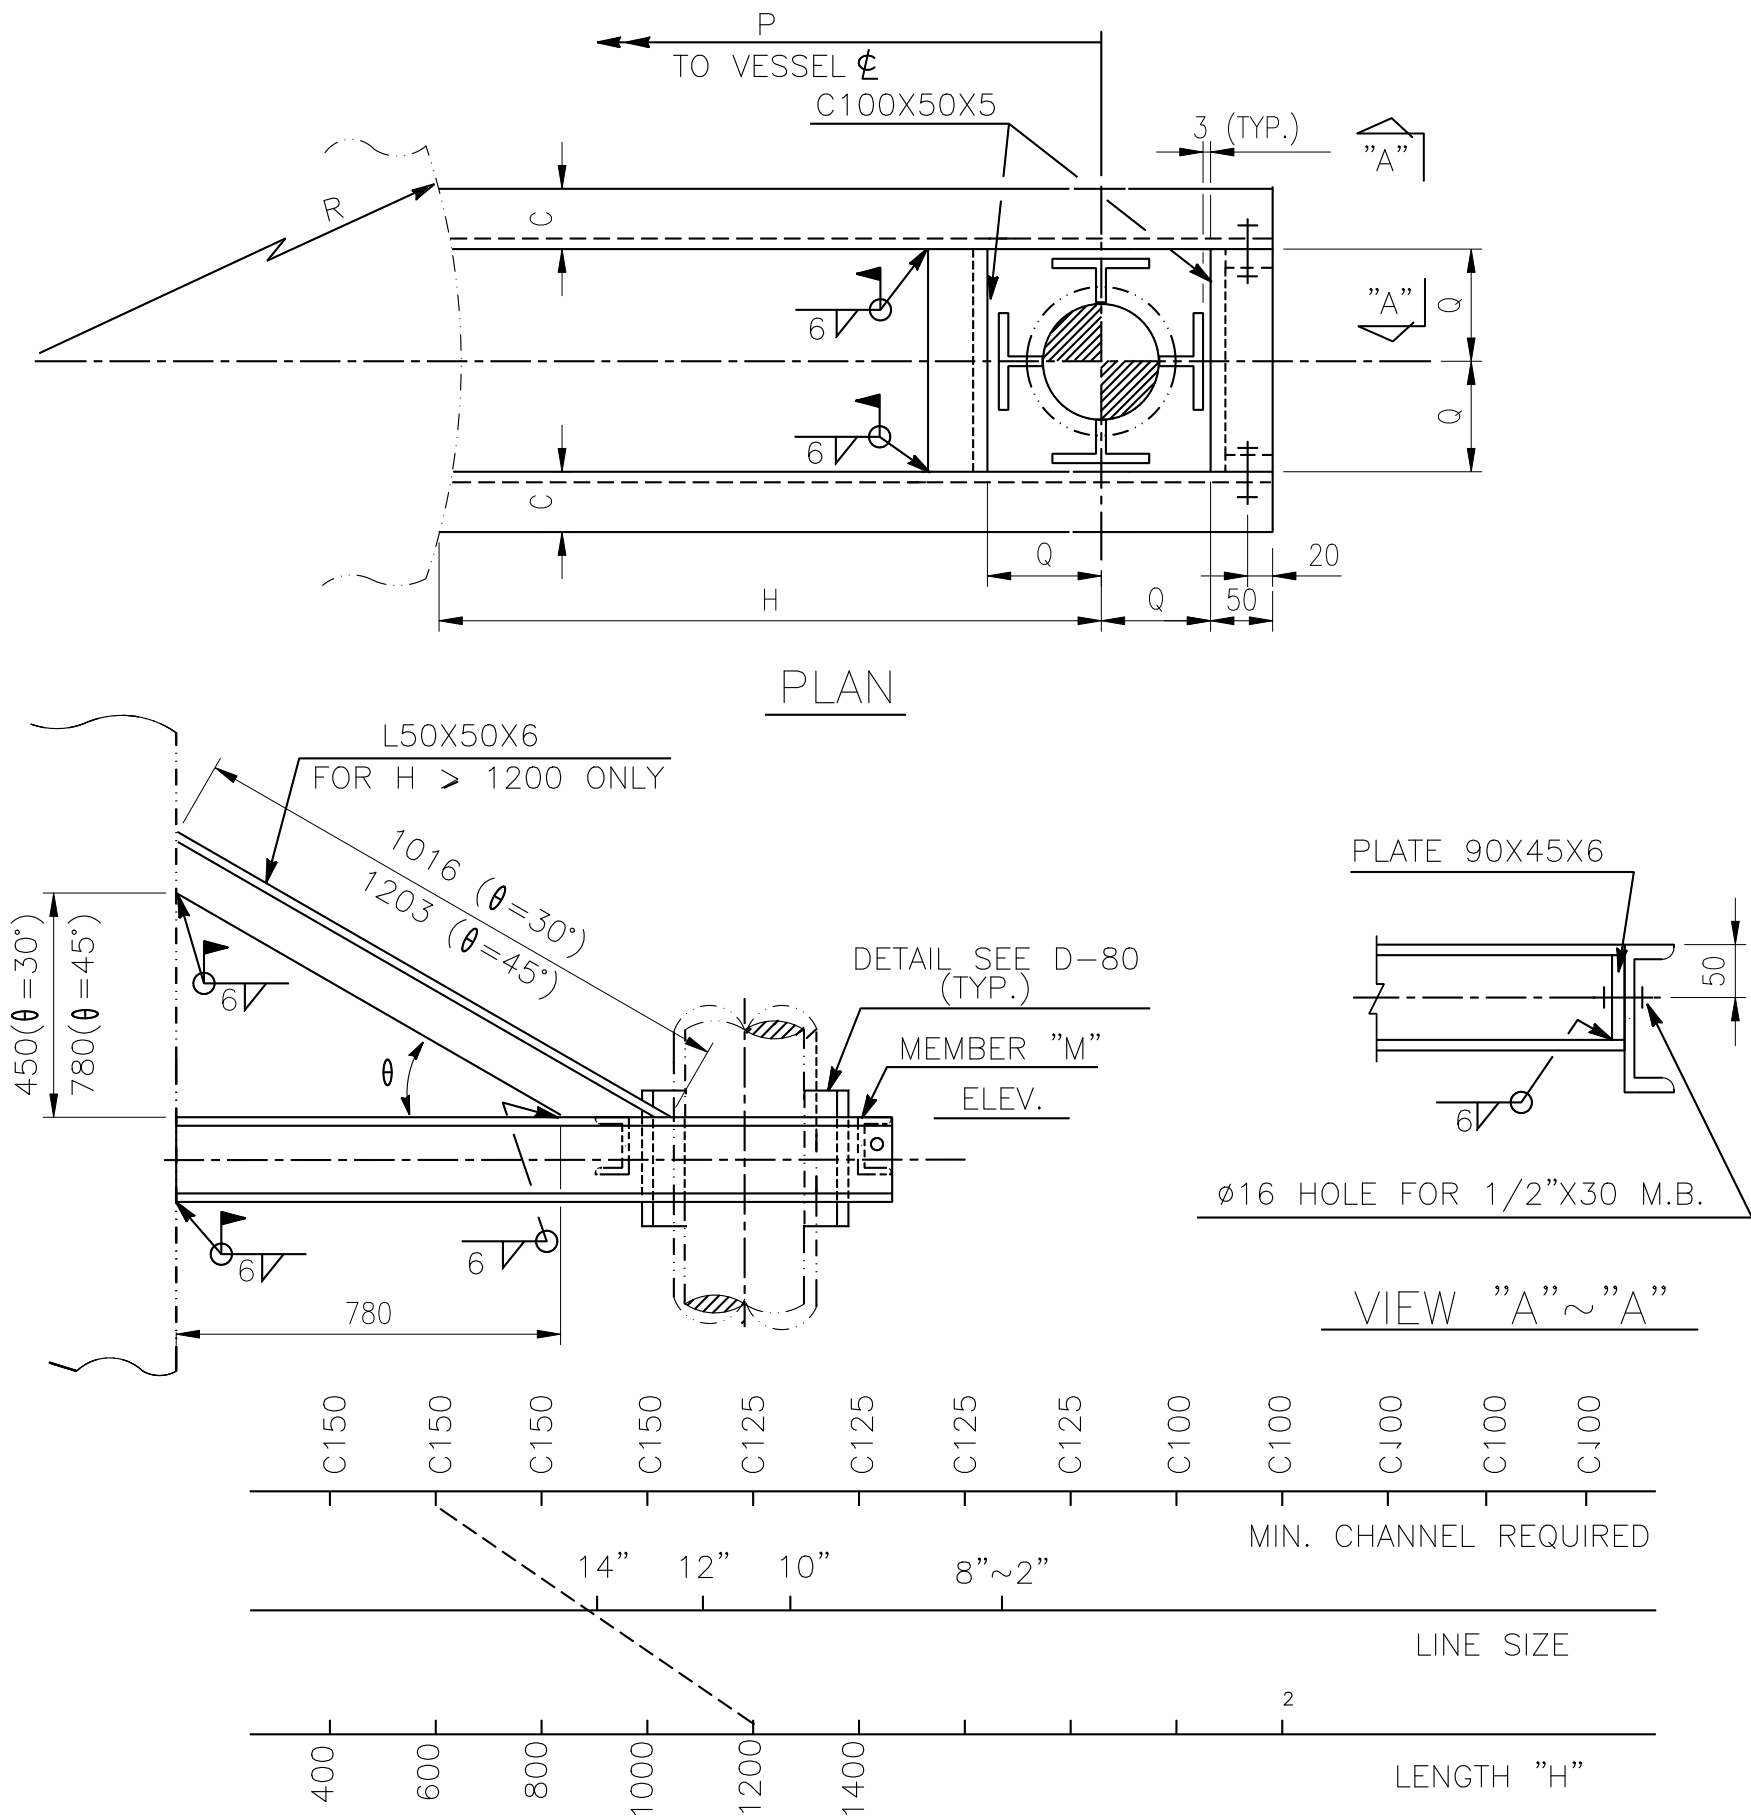

NOTES : 1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

46-8B-C100-840 A OR B-175

DENOTE TYPE NO. DENOTE SUPPORTED LINE SIZE

MODIFY DIMENSION "Q" (IN mm) IF ANY

SEE NOTE 2 DENOTE LENGTH "H" (IN mm)

DENOTE MEMBER "M"

2. A: FOR  $\theta = 30^\circ$ , B: FOR  $\theta = 45^\circ$

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.


DETAIL OF PIPE SUPPORT  
TYPE-46

ENGINEERING STANDARD



HP6-DSD-A4-500-001

|      |          |  |       |      |  |
|------|----------|--|-------|------|--|
| BY   | SHIH     |  | CHK.  | YANG |  |
| DATE | 7/15/'24 |  | APPR. | CHEN |  |

|      |           |
|------|-----------|
| D-56 | REV.<br>1 |
|------|-----------|

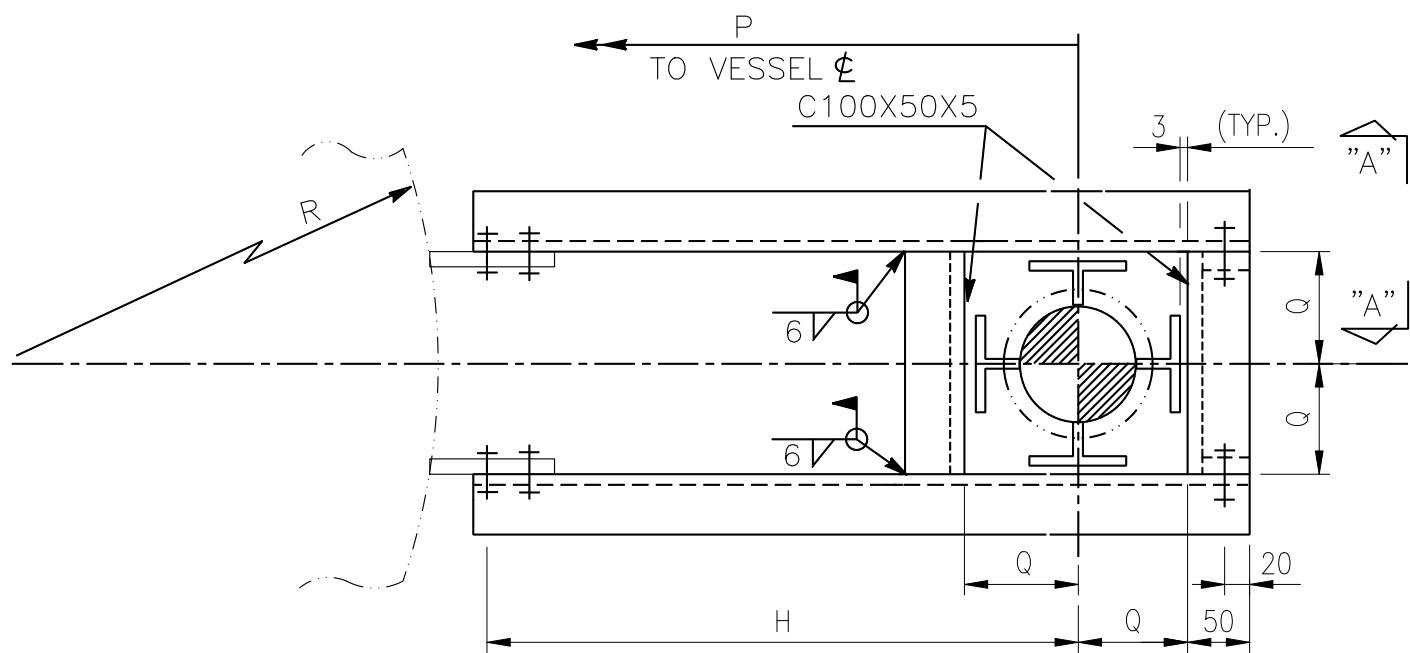

PLAN

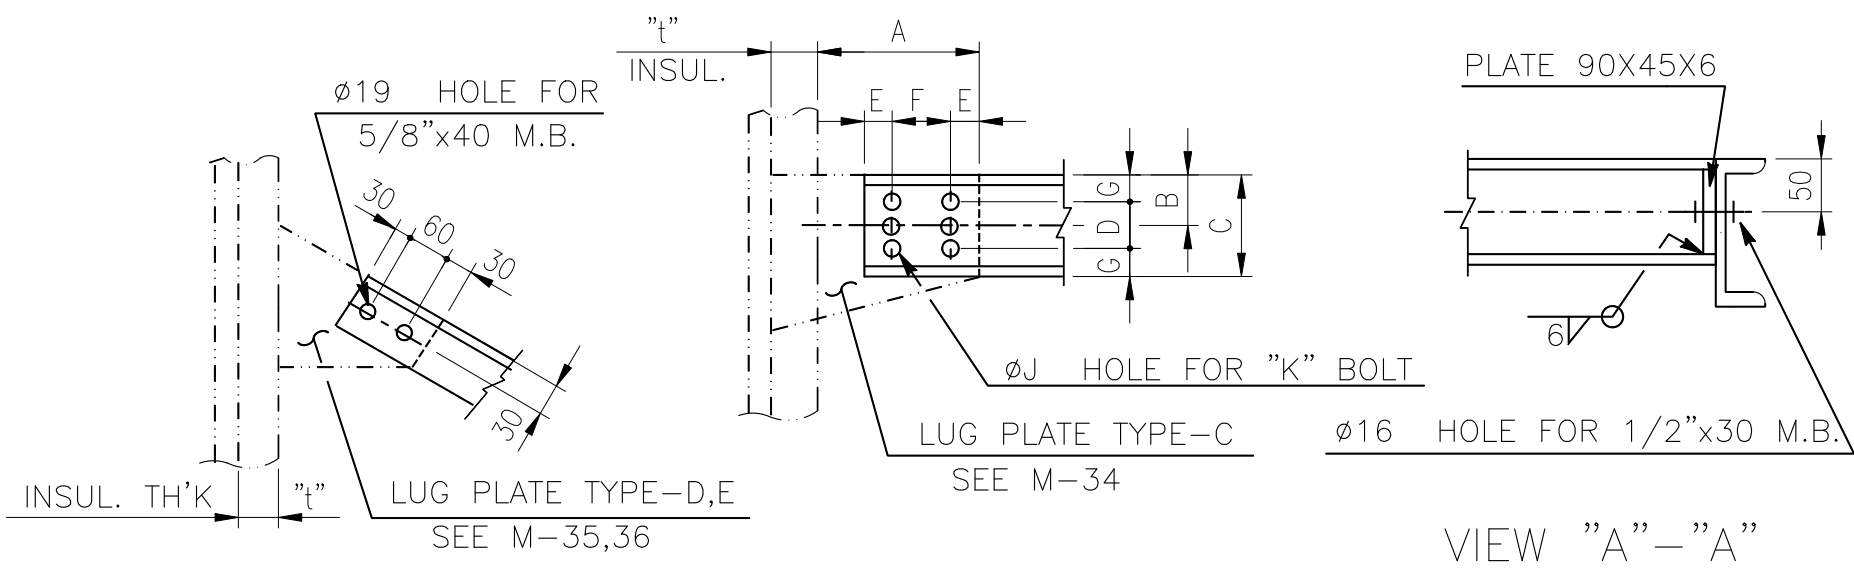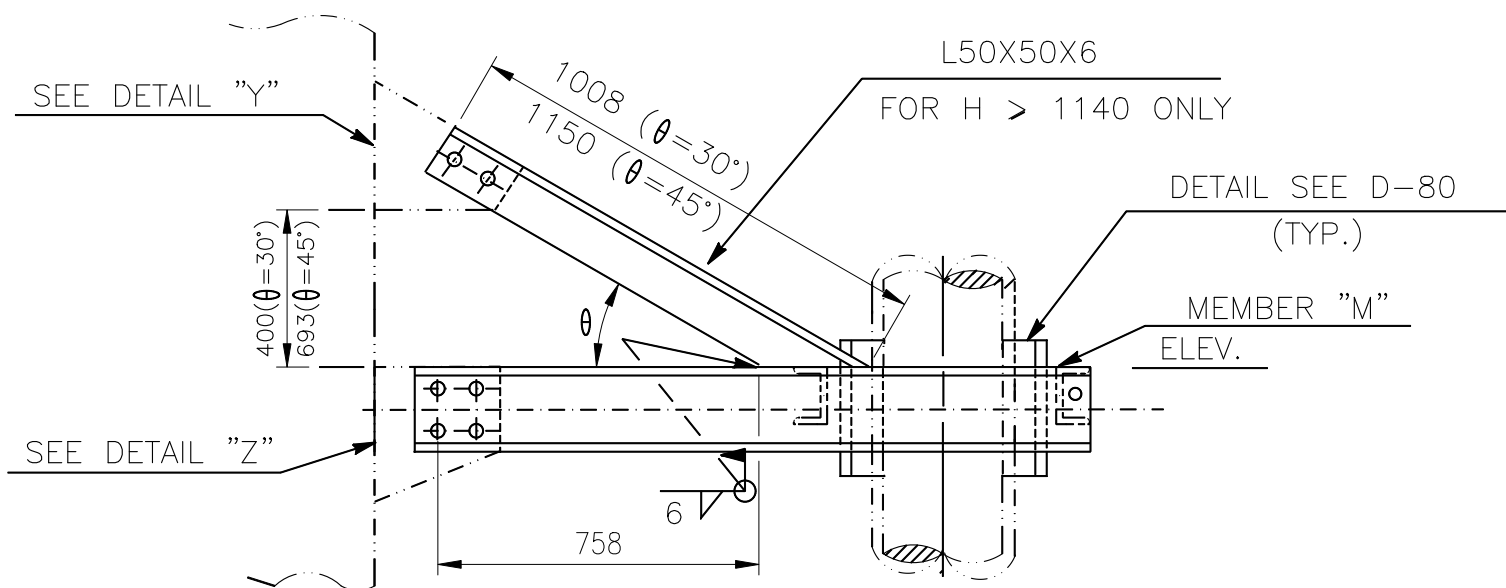

DETAIL "Y"

DETAIL "Z"

VIEW "A" - "A"

| LINE SIZE | 2"  | 3"  | 4"  | 6"  | 8"  | 10" | 12" | 14" |
|-----------|-----|-----|-----|-----|-----|-----|-----|-----|
| Q (mm)    | 133 | 148 | 160 | 187 | 213 | 240 | 265 | 281 |


中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

DETAIL OF PIPE SUPPORT  
TYPE-47

ENGINEERING STANDARD  
HP6-DSD-A4-500-001  
D-57  
REV. 1

|      |          |       |      |
|------|----------|-------|------|
| BY   | SHIH     | CHK.  | YANG |
| DATE | 7/15/'24 | APPR. | CHEN |



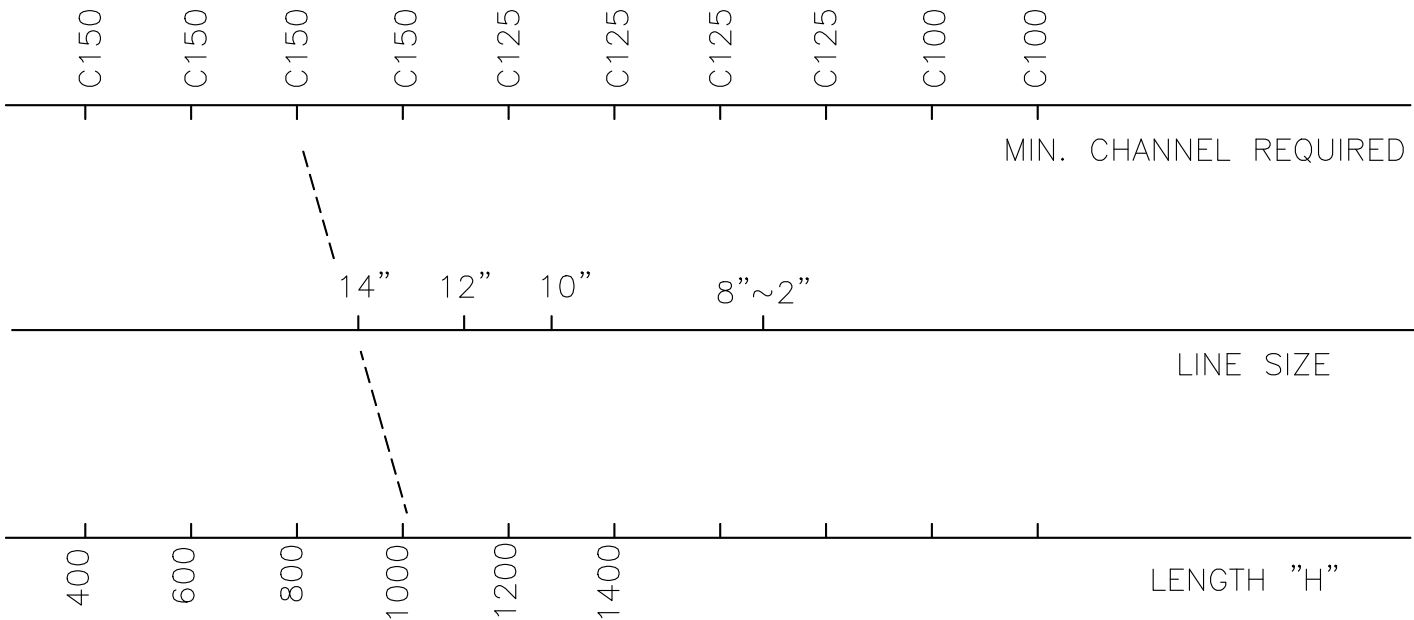


DIMENSION (IN mm)

| MEMBER "M" | A   | B  | C   | D  | E  | F   | G  | J  | K       | H                                   |
|------------|-----|----|-----|----|----|-----|----|----|---------|-------------------------------------|
| C100X50X5  | 170 | 50 | 100 | —  | 30 | 80  | —  | 22 | 3/4"X50 | $H = P - \sqrt{R^2 - Q^2} - 60 - t$ |
| C125X65X6  | 170 | —  | 125 | 55 | 30 | 80  | 35 | 22 | 3/4"X50 |                                     |
| C150X75X9  | 190 | —  | 150 | 70 | 30 | 100 | 40 | 22 | 3/4"X50 |                                     |

NOTES :


1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

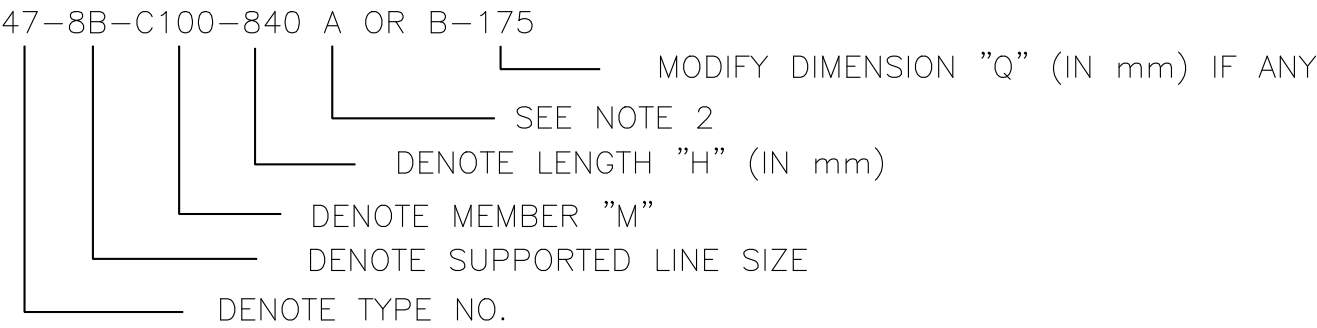

2. A: FOR  $\theta = 30^\circ$   
B: FOR  $\theta = 45^\circ$

FILE: D-58M.DWG

|                                                            |          |  |       |      |  |                                               |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-47<br>(2 OF 2) |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                               |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                               |  | D-58                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |  |                      |           |

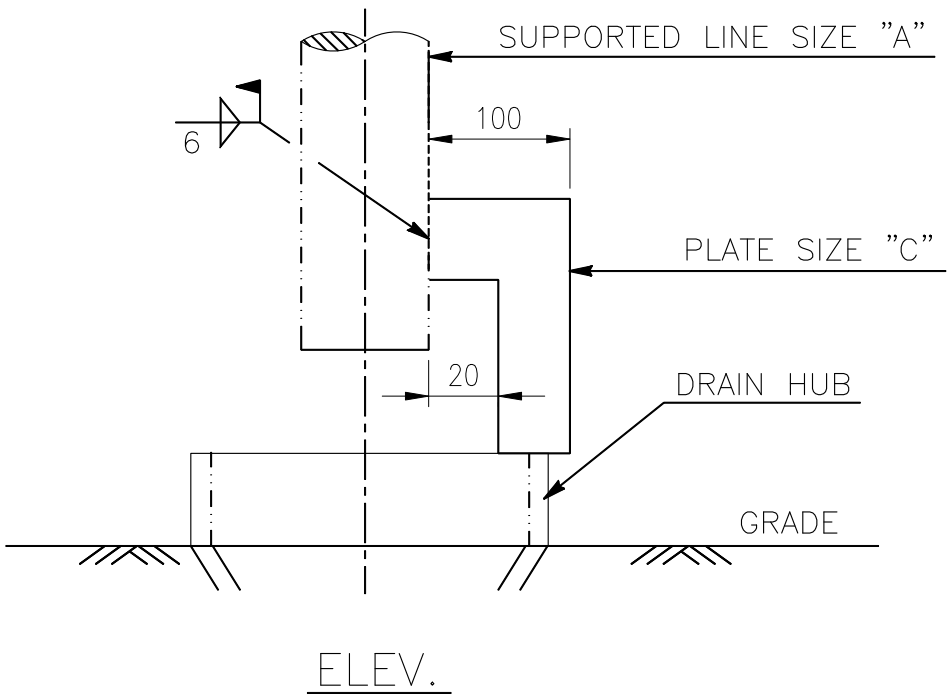

| A      | C         |
|--------|-----------|
| 1/2"   | 150X100X6 |
| 3/4"   | 150X100X6 |
| 1"     | 150X100X6 |
| 1 1/2" | 150X100X6 |
| 2"     | 150X100X6 |
| 3"     | 150X100X9 |
| 4"     | 150X100X9 |
| 6"     | 150X100X9 |


TABLE "B"

| MAT'L OF PLATES | SYMBOL |
|-----------------|--------|
| CARBON STEEL    | NONE   |
| ALLOY STEEL     | (A)    |
| STAINLESS STEEL | (B)    |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

48-1/2B(A)

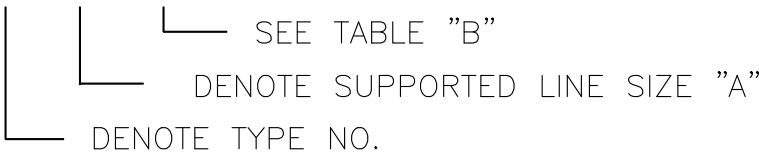

FILE: D-59M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-59                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-48                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |



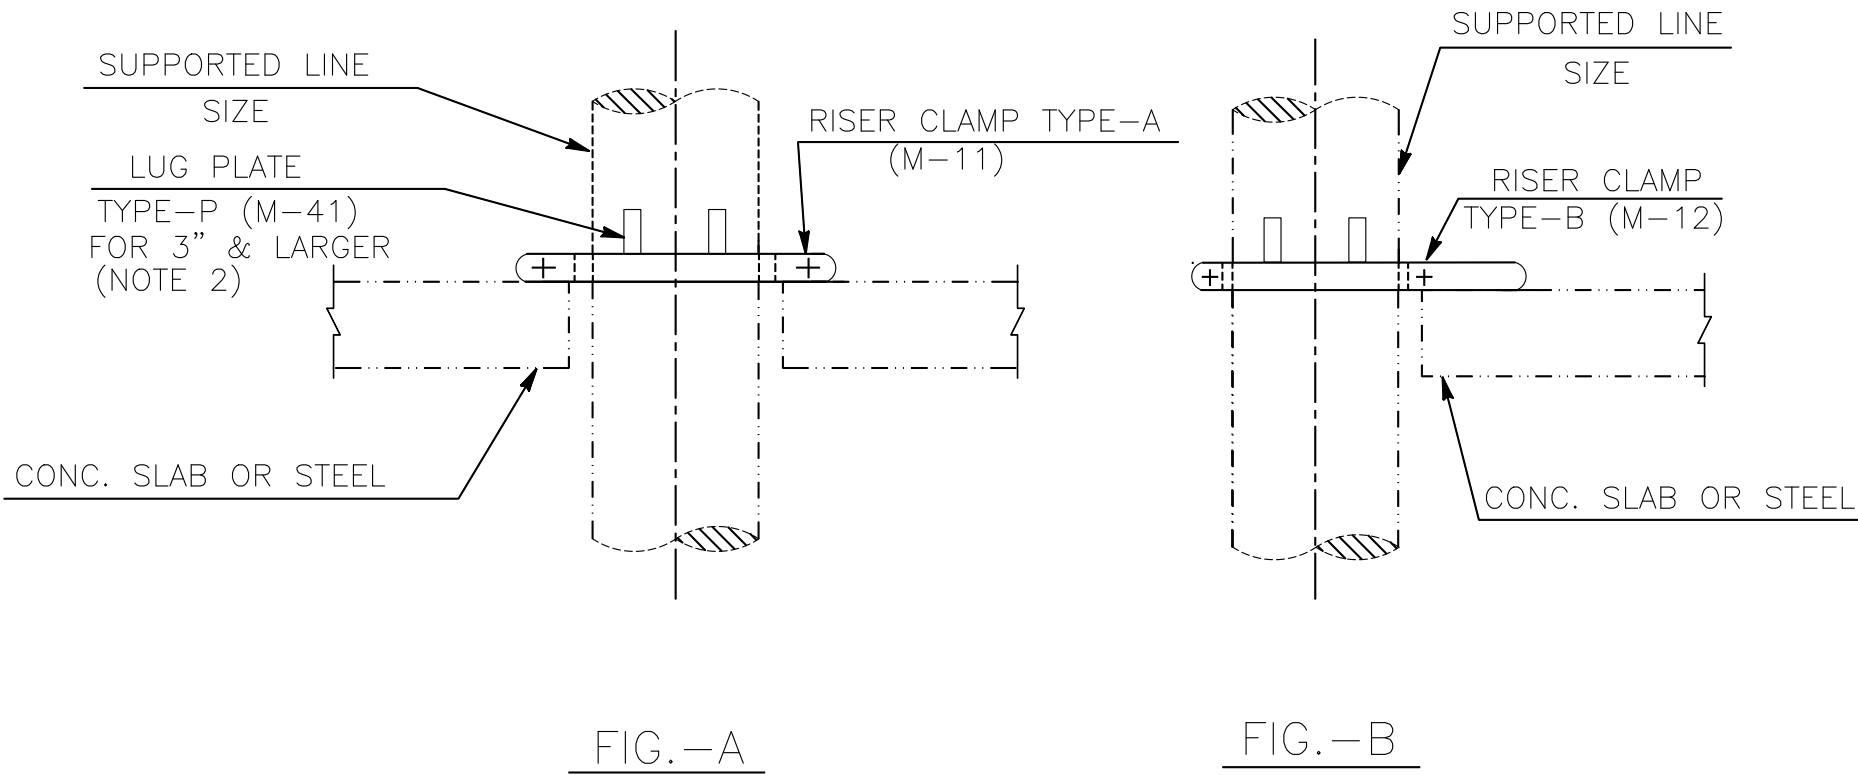


TABLE "A"

| MAT'L OF PLATES | SYMBOL |
|-----------------|--------|
| CARBON STEEL    | NONE   |
| ALLOY STEEL     | (A)    |
| STAINLESS STEEL | (B)    |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
49-3/4B-A(A)

SEE TABLE "A"

DENOTE FIG. NO.


DENOTE SUPPORTED LINE SIZE

DENOTE TYPE NO.


FILE: D-60M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-60                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-49

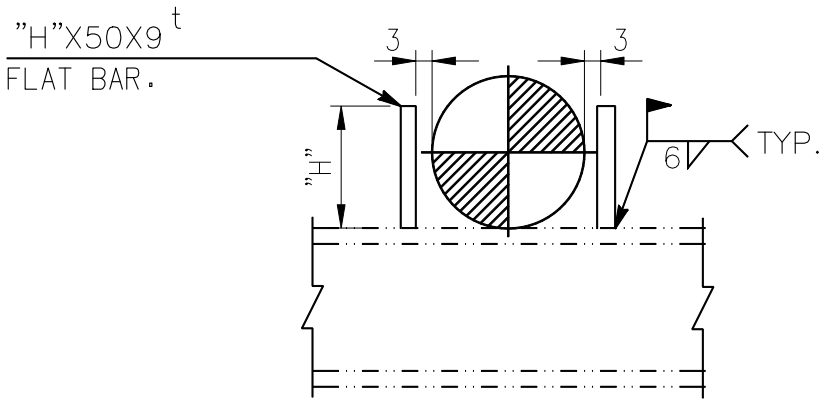

(3" & SMALLER)

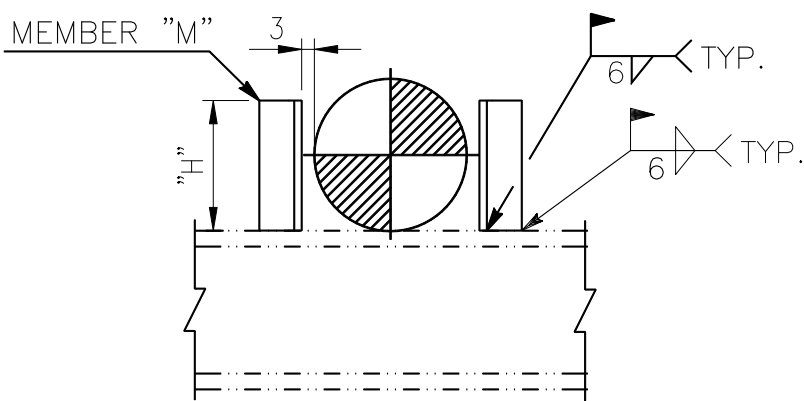

(4" TO 24")

ELEV.

| LINE SIZE | MEMBER "M" | H   |
|-----------|------------|-----|
| 3/4"      | —          | 25  |
| 1"        | —          | 30  |
| 1 1/2"    | —          | 45  |
| 2"        | —          | 60  |
| 2 1/2"    | —          | 70  |
| 3"        | —          | 80  |
| 4"        | L50X50X6   | 125 |
| 5"        | L50X50X6   | 125 |
| 6"        | L50X50X6   | 125 |
| 8"        | L65X65X6   | 150 |
| 10"       | L65X65X6   | 150 |
| 12"       | L65X65X6   | 200 |
| 14"       | L65X65X6   | 200 |
| 16"       | L65X65X6   | 250 |
| 18"       | L65X65X6   | 300 |
| 20"       | L65X65X6   | 300 |
| 24"       | L65X65X6   | 300 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM .

FILE: D-62M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-62                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-51

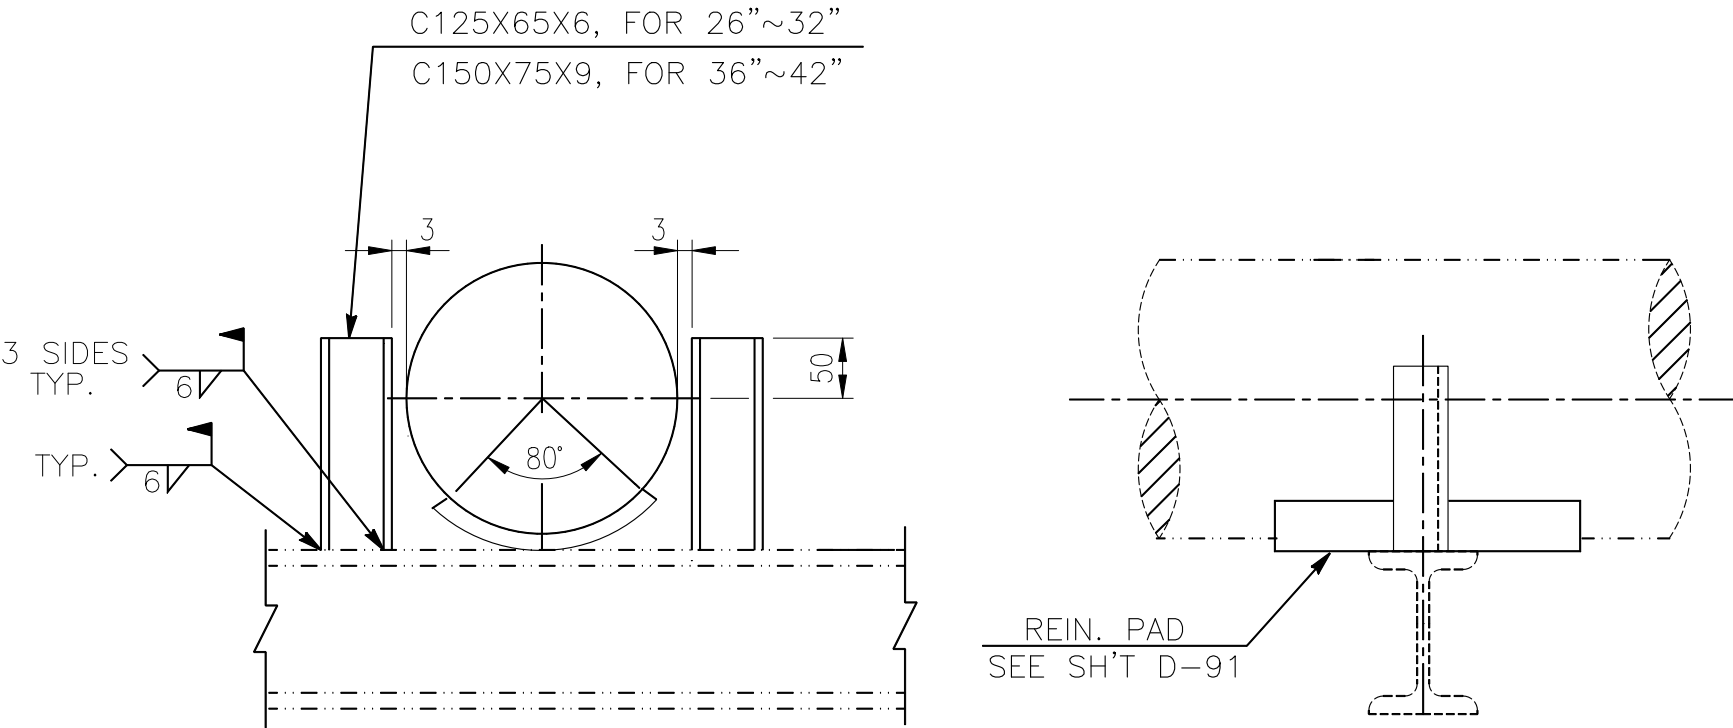

ELEV.


NOTES:

1. FOR DESIGNATION NUMBER OF SUPPORT SEE SH'T D-62.


FILE: D-62MA.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-62A                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-51  
(2 OF 2)

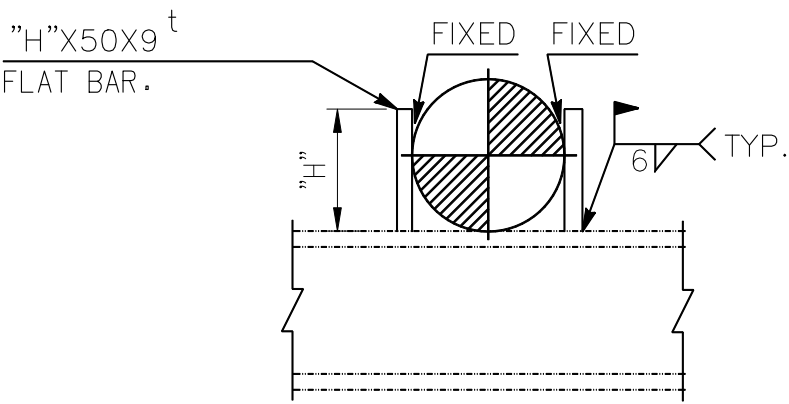

(3" & SMALLER)

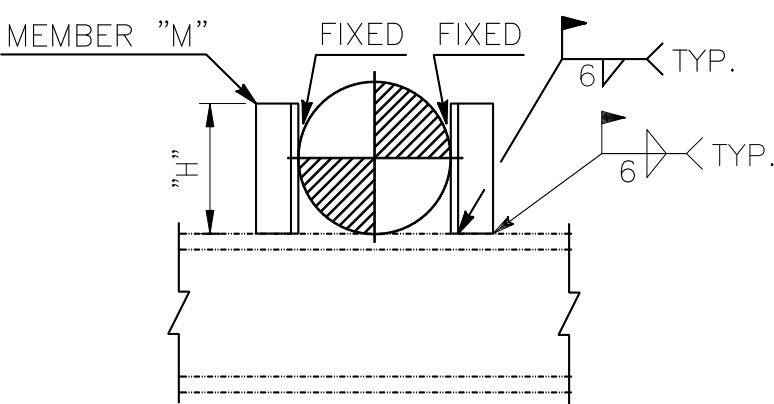

(4" TO 24")

ELEV.

| LINE SIZE | MEMBER "M" | H   |
|-----------|------------|-----|
| 3/4"      | —          | 25  |
| 1"        | —          | 30  |
| 1 1/2"    | —          | 45  |
| 2"        | —          | 60  |
| 2 1/2"    | —          | 70  |
| 3"        | —          | 80  |
| 4"        | L50X50X6   | 125 |
| 5"        | L50X50X6   | 125 |
| 6"        | L50X50X6   | 125 |
| 8"        | L65X65X6   | 150 |
| 10"       | L65X65X6   | 150 |
| 12"       | L65X65X6   | 200 |
| 14"       | L65X65X6   | 200 |
| 16"       | L65X65X6   | 250 |
| 18"       | L65X65X6   | 300 |
| 20"       | L65X65X6   | 300 |
| 24"       | L65X65X6   | 300 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM .

FILE: D-62M1.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-62A-1              | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-51A


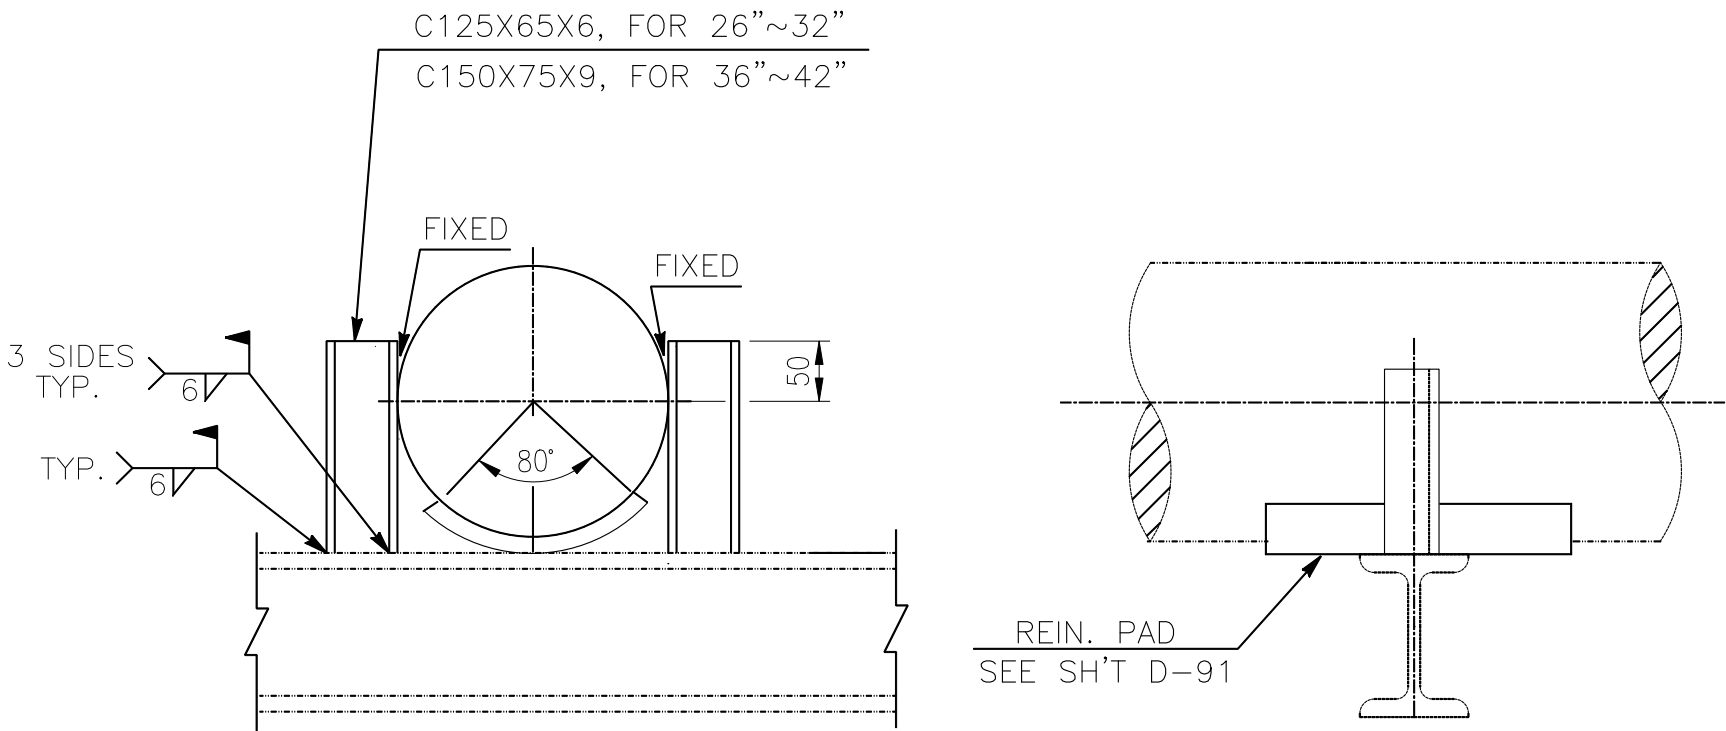


NOTES:



1. FOR DESIGNATION NUMBER OF SUPPORT SEE SH'T D-62.

FILE: D-62MA1.DWG

|                                                            |          |  |       |      |  |                                                |      |
|------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                           |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                             |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-51A<br>(2 OF 2) | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                | 1    |

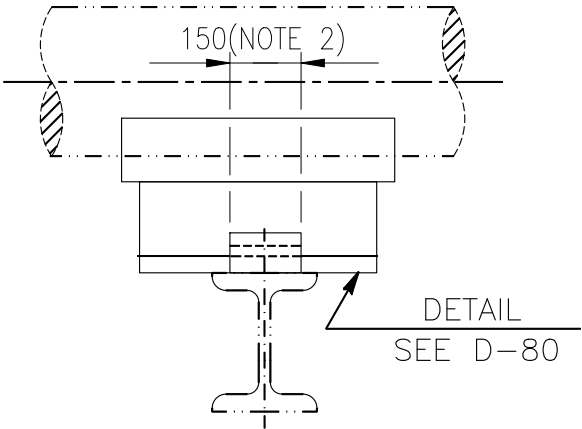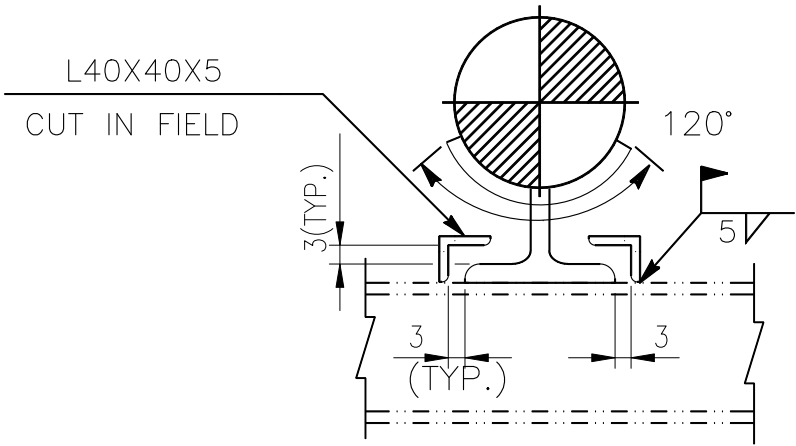

(8" & SMALLER)

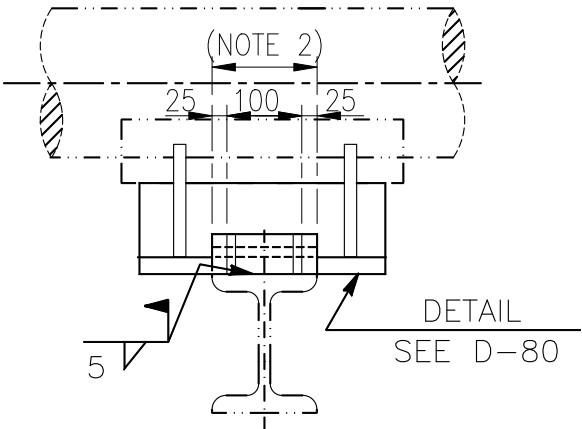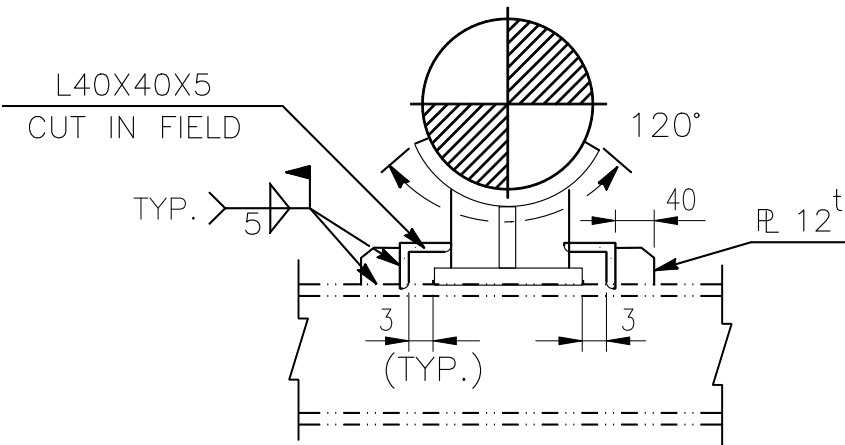


(10" TO 24")

ELEV.

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

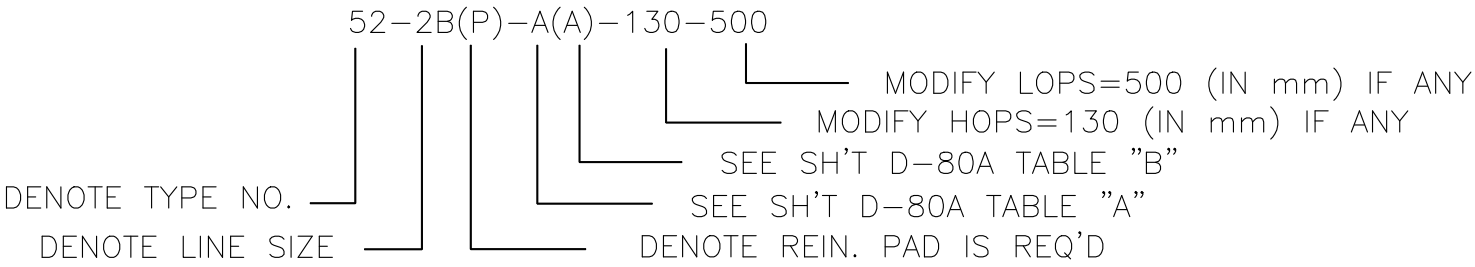

2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.


3. HOPS=HEIGHT OF PIPE SHOE  
LOPS=LENGTH OF PIPE SHOE

FILE: D-63M.DWG


|                                                            |          |  |       |      |  |                                   |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD              |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-52 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                   | 1    |



FOR PIPE SIZE 3/4"-24"

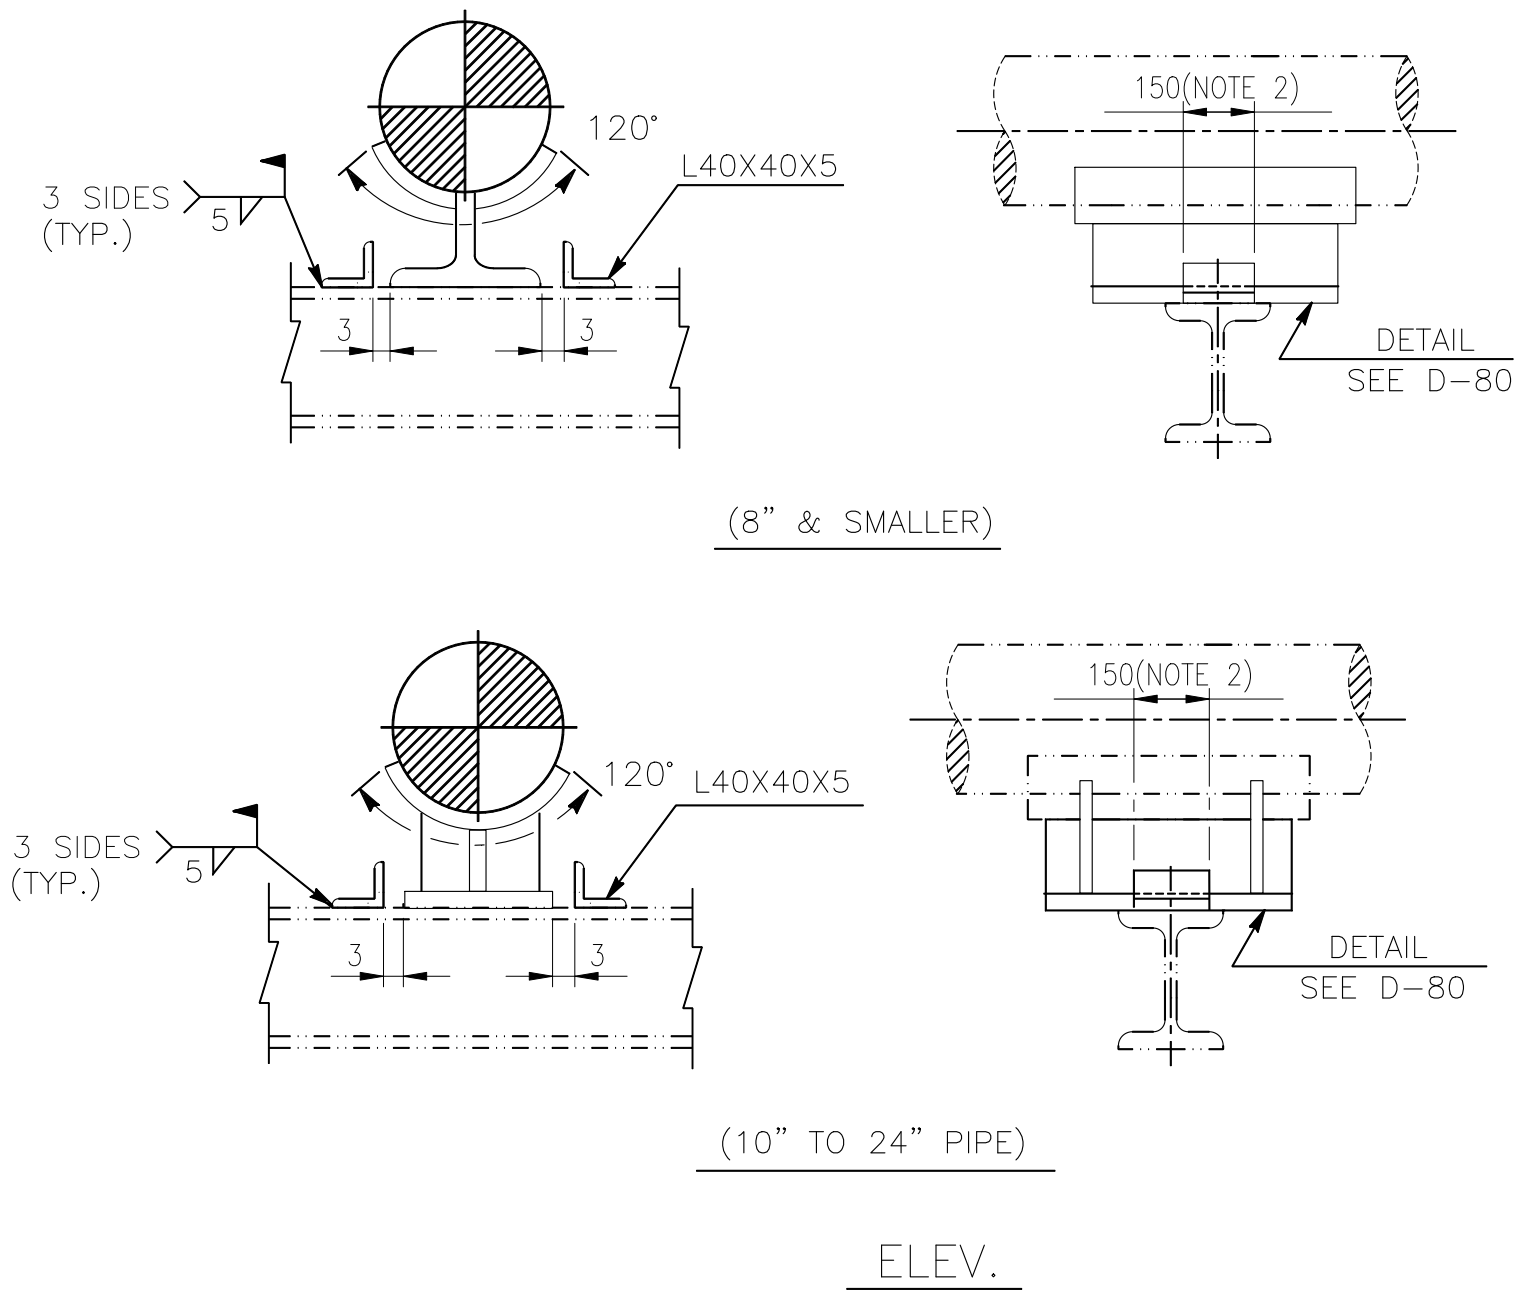

FOR PIPE SIZE 26"-50"

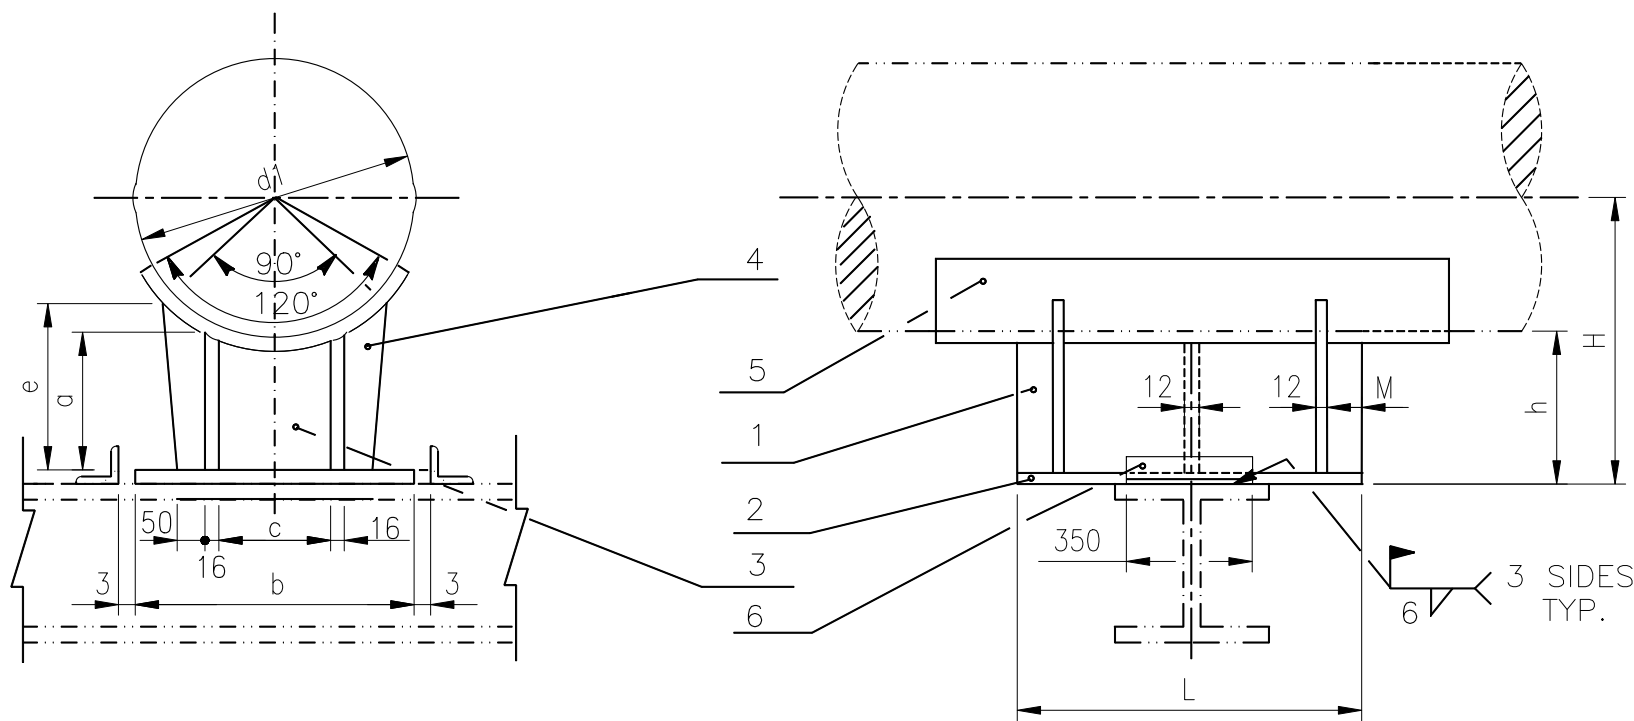

ELEV.

|           |          |
|-----------|----------|
| NO.       | 6        |
| PIECE     | 2        |
| PIPE SIZE | GUIDE    |
| 26"       | L50X50X6 |
| 28"       |          |
| 30"       |          |
| 32"       |          |
| 36"       |          |
| 40"       |          |
| 42"       |          |
| 44"       |          |
| 46"       | L75X75X9 |
| 48"       |          |
| 50"       |          |

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

53-30B-A(A)-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

SEE NOTE 3

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"
3. TYPE-A FOR INSULATION THICKNESS ≤ 100  
TYPE-B FOR INSULATION THICKNESS > 100 ≤ 150
4. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F & PRESSURE 300 PSI .
5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FILE: D-64MA.DGN

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-64A                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-53                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  | (2 OF 2)             |  |





- 54-2B-A-130-500


└─ MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY


SEE SH'T D-80A TABLE "A"

- |      |          |       |      |
|------|----------|-------|------|
| DATE | 7/15/'24 | APPR. | CHEN |
|------|----------|-------|------|

FOR PIPE SIZE 3/4" - 24"

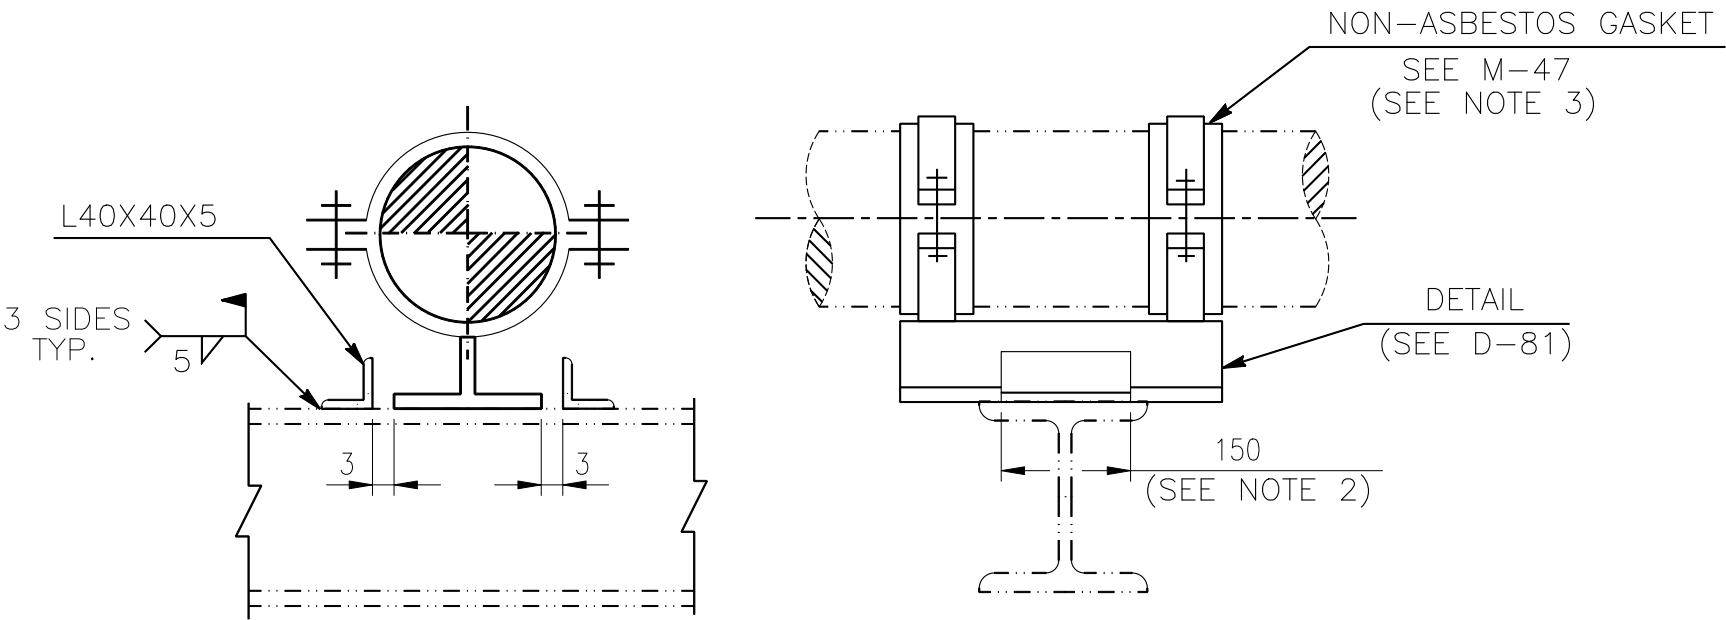

(8" & SMALLER)

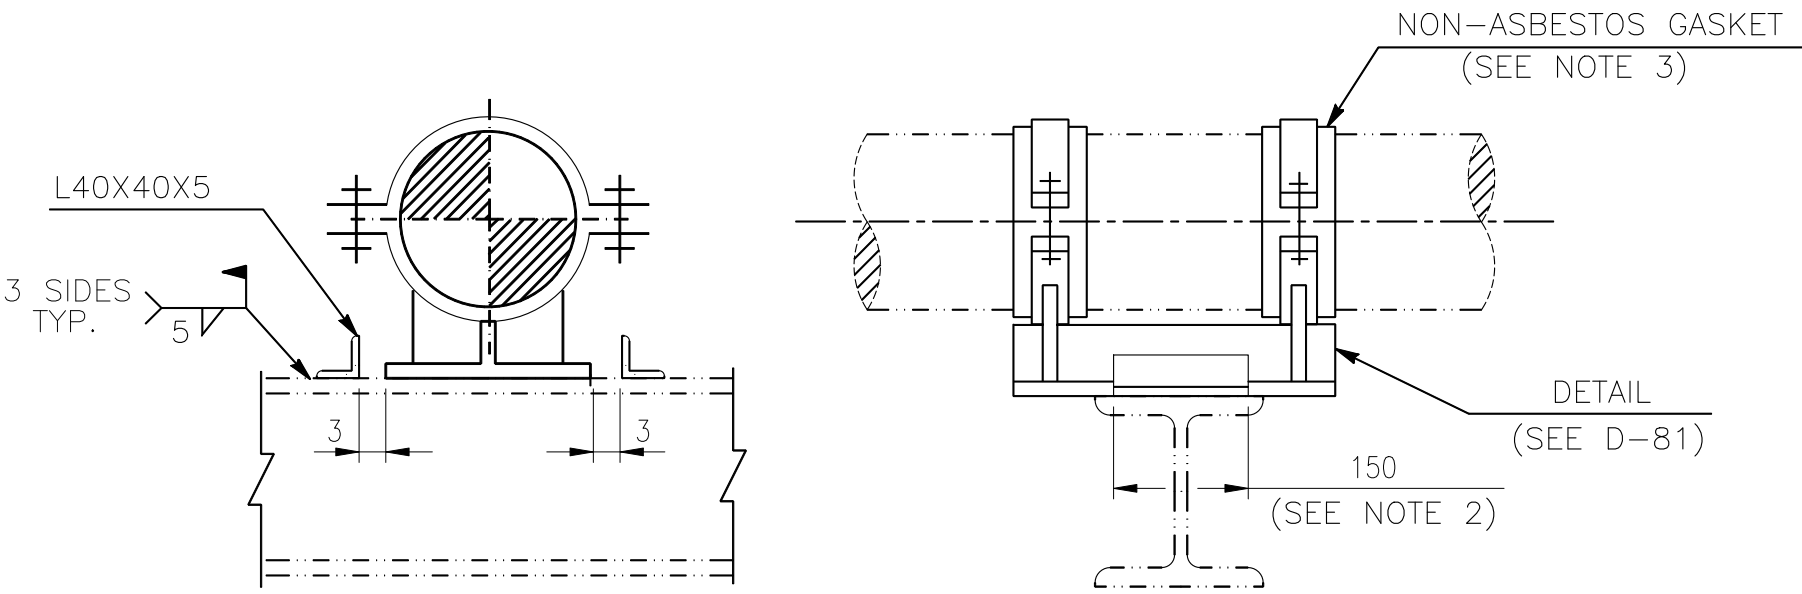

(10" TO 24" PIPE)

ELEV.

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

55-2B-A-130-500  
DENOTE TYPE NO.      DENOTE LINE SIZE  
MODIFY LOPS=500 (IN mm) IF ANY  
MODIFY HOPS=130 (IN mm) IF ANY  
SEE SH'T D-80A TABLE "A"


2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.

3. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES (MAX. LINE TEMP. : 750°F)

4. HOPS=HEIGHT OF SHOE, LOPS=LENGTH OF SHOE.

FILE: D-66M.DWG

|                                                            |          |  |       |      |  |                                               |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                          |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                            |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-55<br>(1 OF 2) | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               | 1    |

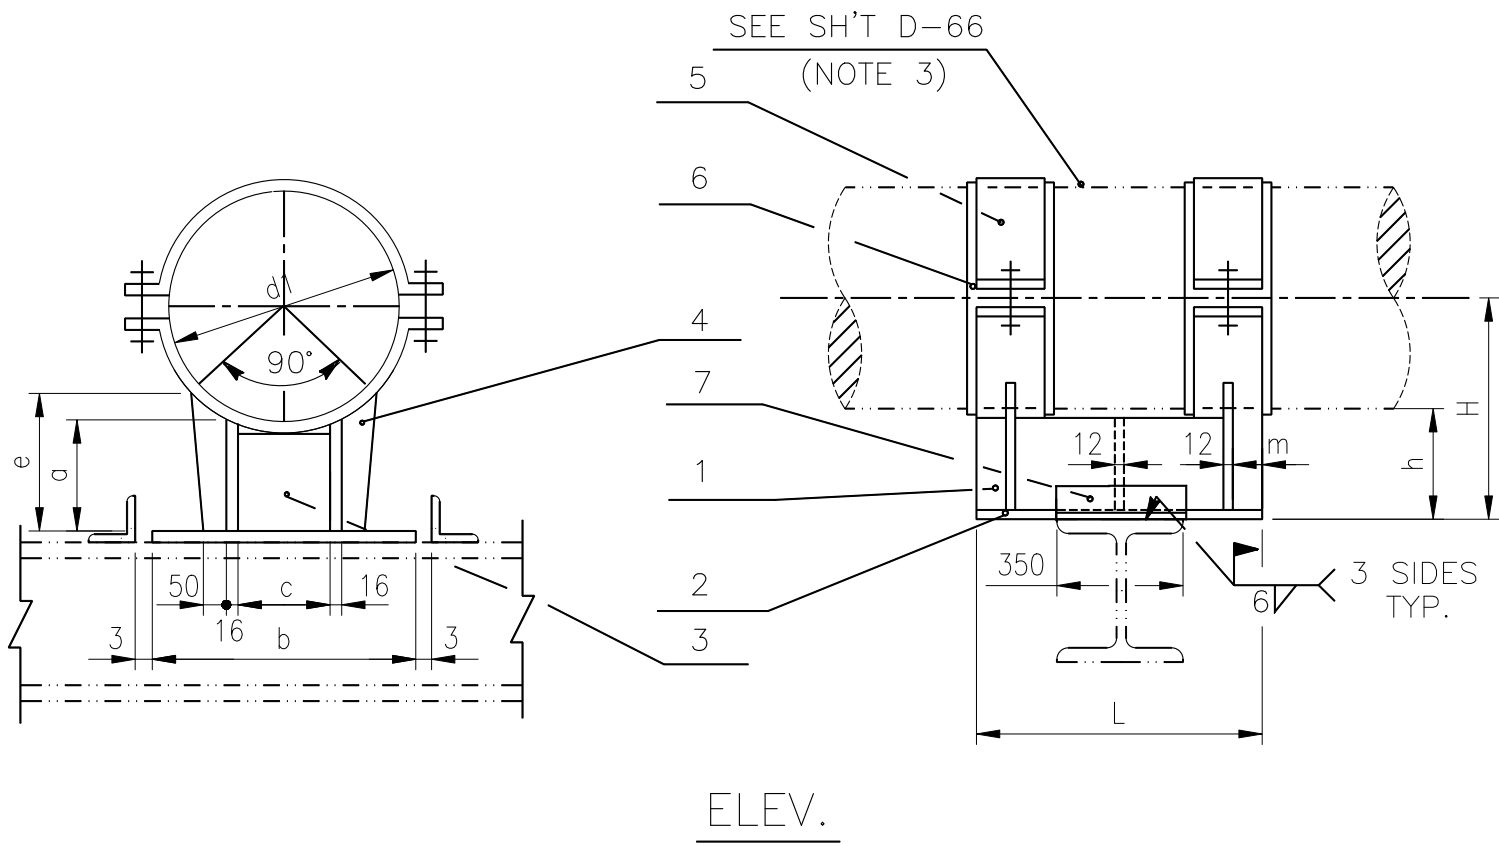

|           |          |
|-----------|----------|
| NO.       | 7        |
| PIECE     | 2        |
| PIPE SIZE | GUIDE    |
| 26"       | L50X50X6 |
| 28"       |          |
| 30"       |          |
| 32"       |          |
| 36"       |          |
| 40"       |          |
| 42"       |          |

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-81A.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

55-30B-A-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

MODIFY LOPS=500 (IN mm) IF ANY


MODIFY HOPS=130 (IN mm) IF ANY

SEE NOTE 3
3. TYPE-A FOR INSULATION THICKNESS  $\leq 100$   
TYPE-B FOR INSULATION THICKNESS  $>100 \leq 150$
4. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F.
5. HOPS=HEIGHT OF SHOE, LOPS=LENGTH OF SHOE.

FILE: D-66MA.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-66A                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-55  
(2 OF 2)

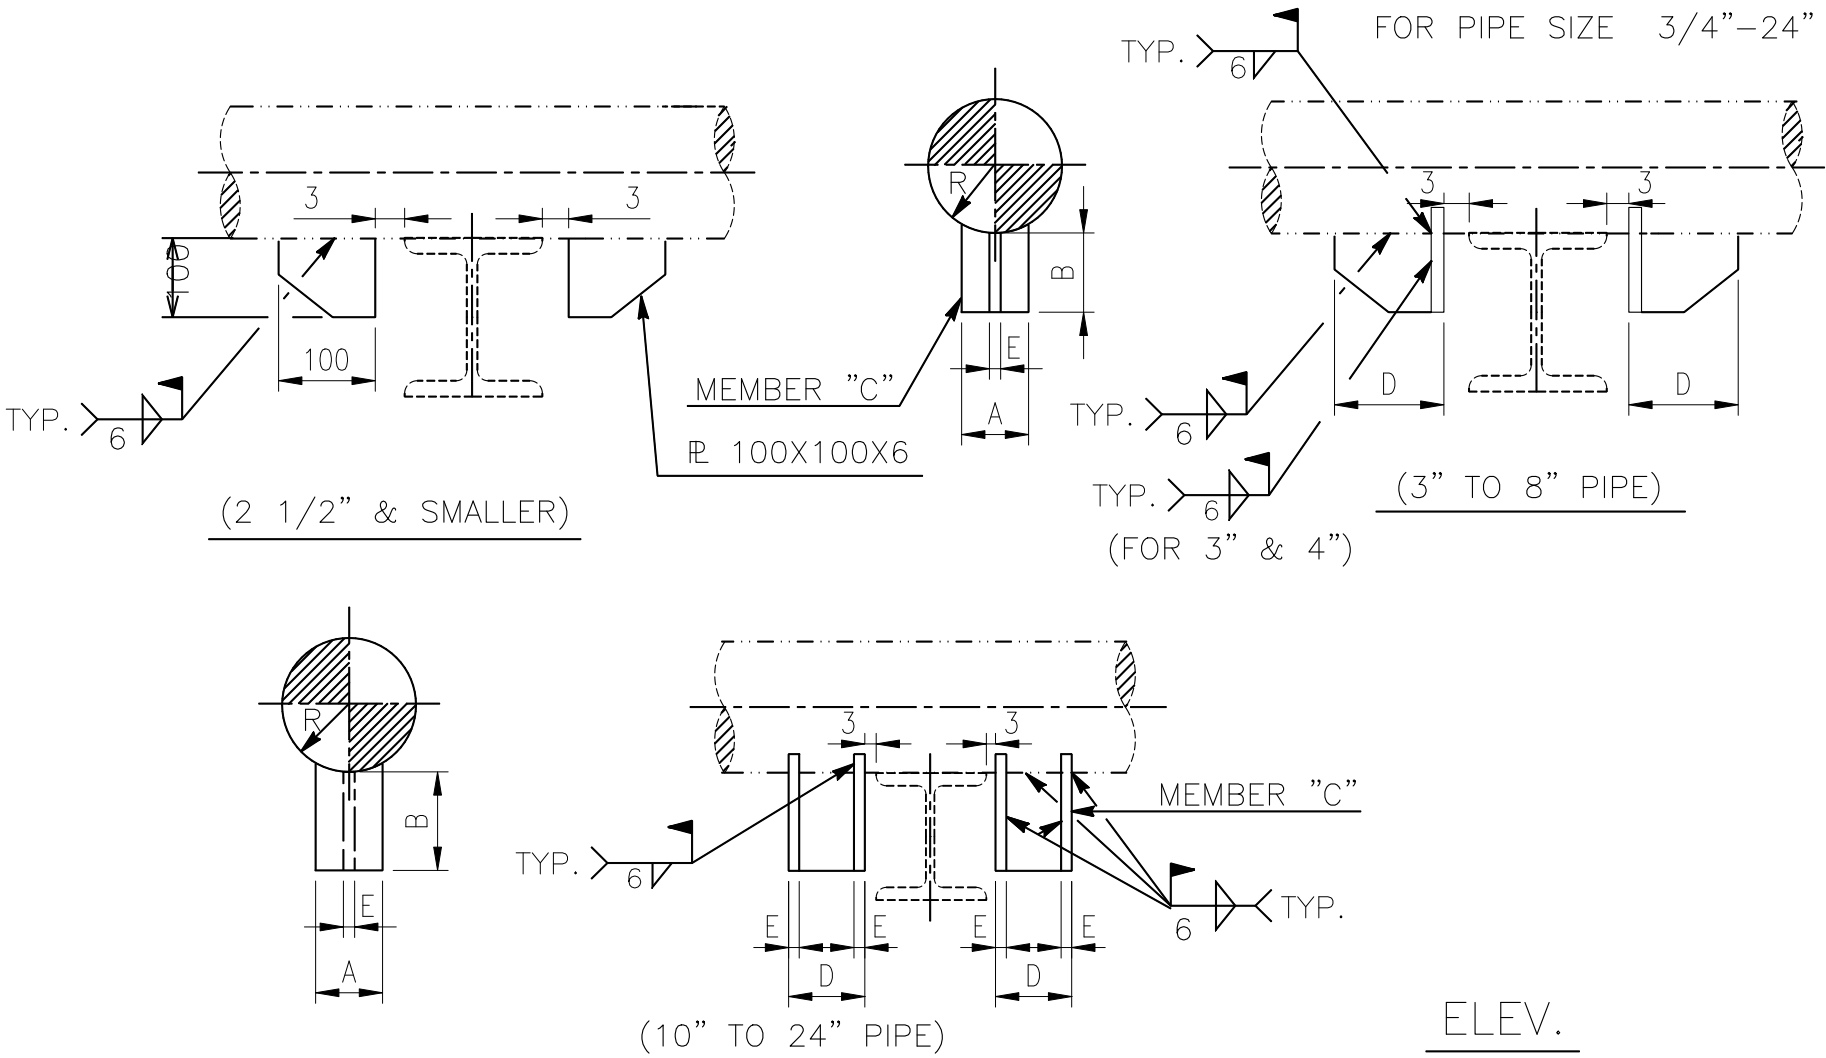

DIMENSION (mm)

| LINE SIZE | A   | B   | C                                  | D   | E  | R   |
|-----------|-----|-----|------------------------------------|-----|----|-----|
| 3/4"      | —   | —   | —                                  | —   | —  | —   |
| 1"        | —   | —   | —                                  | —   | —  | —   |
| 1 1/2"    | —   | —   | —                                  | —   | —  | —   |
| 2"        | —   | —   | —                                  | —   | —  | —   |
| 2 1/2"    | —   | —   | —                                  | —   | —  | —   |
| 3"        | 75  | 100 | FAB. FROM<br>6 <sup>t</sup> PLATE  | 75  | 6  | 45  |
| 4"        | 75  | 100 |                                    | 75  | 6  | 57  |
| 5"        | 100 | 100 | CUT FROM H200X100X5.5X8            | 100 | —  | 70  |
| 6"        | 150 | 150 | CUT FROM<br>H194X150X6X9           | 100 | —  | 84  |
| 8"        | 150 | 150 |                                    | 100 | —  | 110 |
| 10"       | 200 | 200 | CUT FROM<br>H200X200X8X12          | 200 | —  | 137 |
| 12"       | 200 | 200 |                                    | 200 | —  | 162 |
| 14"       | 200 | 200 |                                    | 200 | —  | 178 |
| 16"       | 300 | 250 | FAB. FROM<br>12 <sup>t</sup> PLATE | 300 | 12 | 203 |
| 18"       | 300 | 250 |                                    | 300 | 12 | 229 |
| 20"       | 300 | 250 |                                    | 300 | 12 | 254 |
| 24"       | 350 | 250 |                                    | 350 | 12 | 305 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

56 - 2B  
DENOTE TYPE NO.      DENOTE LINE SIZE

FILE: D-67M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-67                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-56

(1 OF 2)



| LINE<br>SIZE | A   | B   | C   | D   | E  | R   |
|--------------|-----|-----|-----|-----|----|-----|
| 26"          | 350 | 250 | 250 | 350 | 12 | 330 |
| 28"          | 350 | 250 | 250 | 350 | 12 | 356 |
| 30"          | 350 | 250 | 250 | 350 | 12 | 381 |
| 32"          | 450 | 300 | 350 | 400 | 12 | 406 |
| 36"          | 450 | 300 | 350 | 400 | 12 | 457 |
| 40"          | 450 | 300 | 350 | 400 | 12 | 508 |
| 42"          | 450 | 300 | 350 | 400 | 12 | 533 |

2. LOADING CONDITION: CARBON STEEL STOPS WITH MAX. PIPE TEMPERATURE 700°F & 300 PSI.

|                                                                                                                                                       |          |  |       |      |  |                      |           |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-56<br/> (2 OF 2) </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                                                                       |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                                                                                    | SHIH     |  | CHK.  | YANG |  | D-67A                | REV.<br>1 |
| DATE                                                                                                                                                  | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

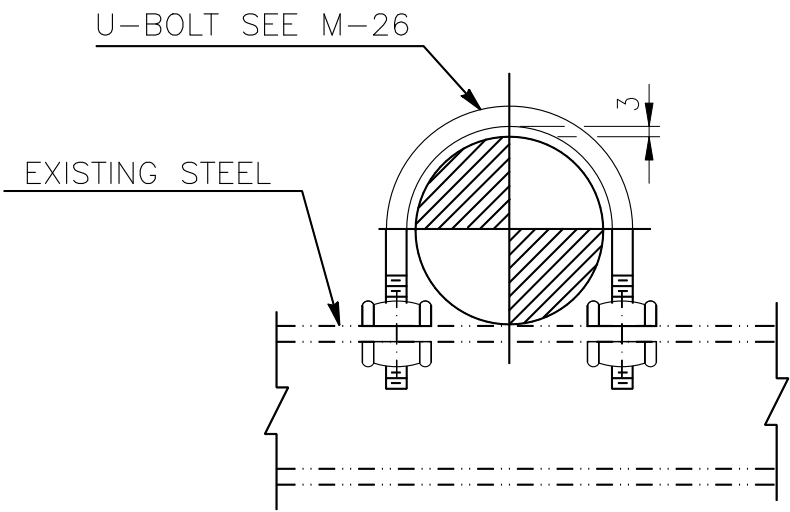


FIG.-A  
(SLIDE)

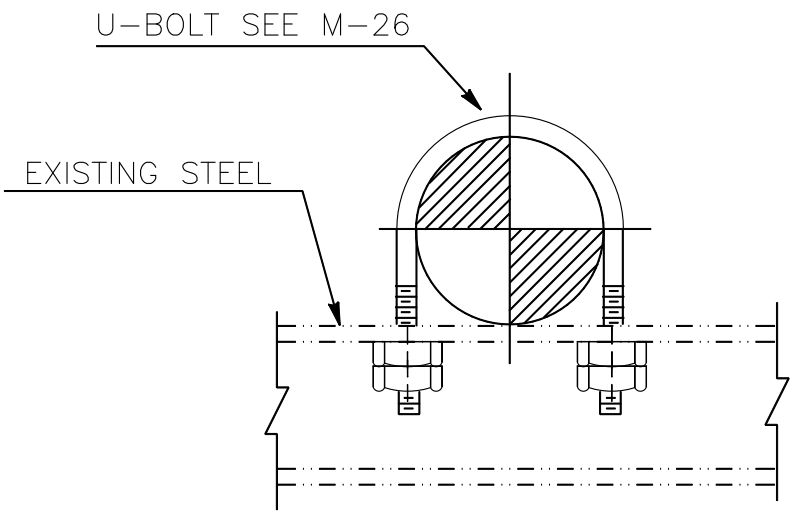



FIG.-B  
(FIXED)

ELEV.

| LINE SIZE | ROD SIZE | U-BOLT SEE M-26 |
|-----------|----------|-----------------|
| 1/4"      | 1/4"     | UB - 1/4B       |
| 1/2"      | 1/4"     | UB - 1/2B       |
| 3/4"      | 1/4"     | UB - 3/4B       |
| 1"        | 1/4"     | UB - 1B         |
| 1 1/4"    | 3/8"     | UB - 1 1/4B     |
| 1 1/2"    | 3/8"     | UB - 1 1/2B     |
| 2"        | 3/8"     | UB - 2B         |
| 2 1/2"    | 1/2"     | UB - 2 1/2B     |
| 3"        | 1/2"     | UB - 3B         |
| 3 1/2"    | 1/2"     | UB - 3 1/2B     |
| 4"        | 1/2"     | UB - 4B         |
| 5"        | 1/2"     | UB - 5B         |
| 6"        | 5/8"     | UB - 6B         |
| 8"        | 5/8"     | UB - 8B         |
| 10"       | 3/4"     | UB - 10B        |
| 12"       | 7/8"     | UB - 12B        |
| 14"       | 7/8"     | UB - 14B        |
| 16"       | 7/8"     | UB - 16B        |
| 18"       | 1"       | UB - 18B        |
| 20"       | 1"       | UB - 20B        |
| 24"       | 1"       | UB - 24B        |
| 30"       | 1"       | UB - 30B        |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

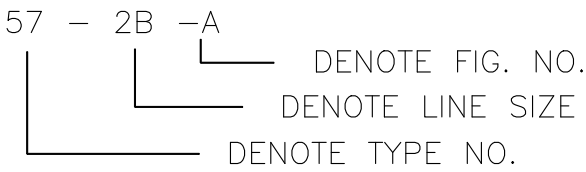


FILE: D-68M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-68                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |


DETAIL OF PIPE SUPPORT  
TYPE-57



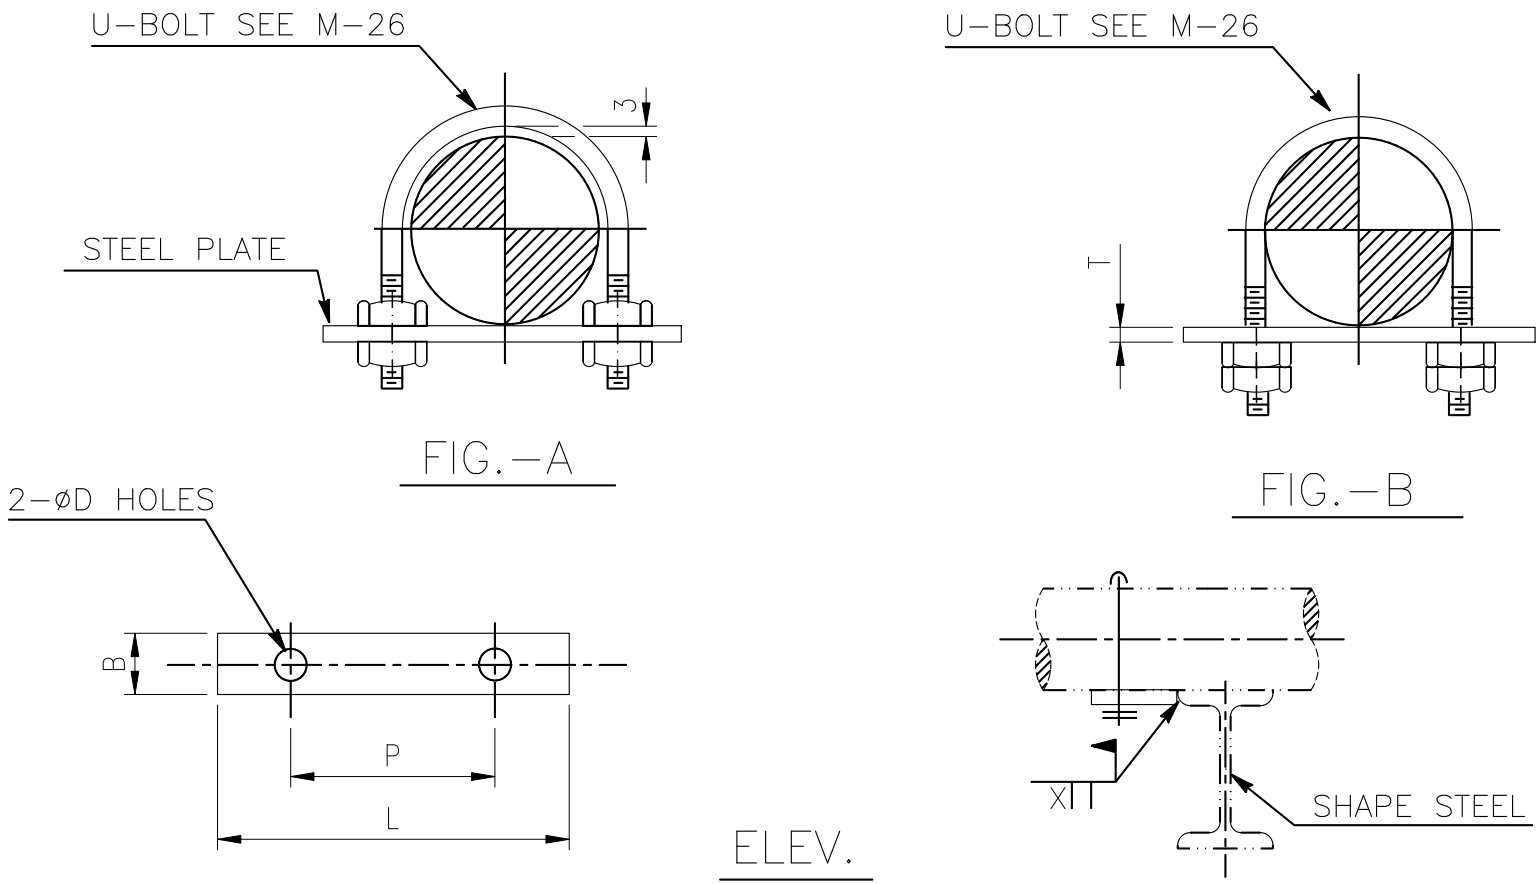

| DIMENSION (mm) |          |    |     |            |   |
|----------------|----------|----|-----|------------|---|
| LINE SIZE      | ROD SIZE | D  | P   | LxBxT      | X |
| 1/4"           | 1/4"     | 8  | 30  | 90X 50X 6  | 4 |
| 1/2"           | 1/4"     | 8  | 30  | 90X 50X 6  | 4 |
| 3/4"           | 1/4"     | 8  | 35  | 90X 50X 6  | 4 |
| 1"             | 1/4"     | 8  | 41  | 90X 50X 6  | 4 |
| 1 1/4"         | 3/8"     | 11 | 52  | 90X 50X 6  | 4 |
| 1 1/2"         | 3/8"     | 11 | 60  | 120X 50X 6 | 4 |
| 2"             | 3/8"     | 11 | 71  | 120X 50X 6 | 4 |
| 2 1/2"         | 1/2"     | 14 | 87  | 150X 50X 6 | 4 |
| 3"             | 1/2"     | 14 | 103 | 180X 50X 6 | 4 |
| 3 1/2"         | 1/2"     | 14 | 116 | 180X 50X 6 | 4 |
| 4"             | 1/2"     | 14 | 129 | 200X 65X 9 | 5 |
| 5"             | 1/2"     | 14 | 156 | 230X 65X 9 | 5 |
| 6"             | 5/8"     | 17 | 187 | 250X 65X 9 | 5 |
| 8"             | 5/8"     | 17 | 238 | 320X 65X 9 | 5 |
| 10"            | 3/4"     | 21 | 295 | 370X 65X 9 | 5 |
| 12"            | 7/8"     | 24 | 349 | 450X90X 12 | 6 |
| 14"            | 7/8"     | 24 | 381 | 550X90X 12 | 6 |
| 16"            | 7/8"     | 24 | 432 | 550X90X 12 | 6 |
| 18"            | 1"       | 27 | 486 | 600X90X 12 | 6 |
| 20"            | 1"       | 27 | 537 | 650X100X16 | 6 |
| 24"            | 1"       | 27 | 638 | 750X100X16 | 6 |
| 30"            | 1"       | 27 | 791 | 800X100X16 | 6 |

NOTES: DESIGNATION NUMBER DENOTE AS FOLLOWS :

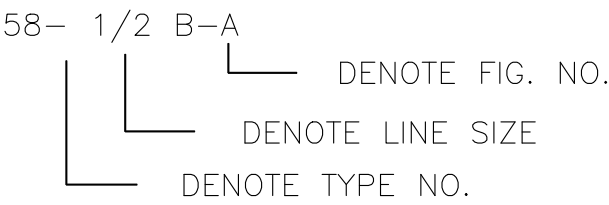

FILE: D-69M.DWG

|                                                                               |          |  |       |      |  |                      |           |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-58</div>                          |          |  |       |      |  | D-69                 | REV.<br>1 |
|                                                                               |          |  |       |      |  |                      |           |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                      |           |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

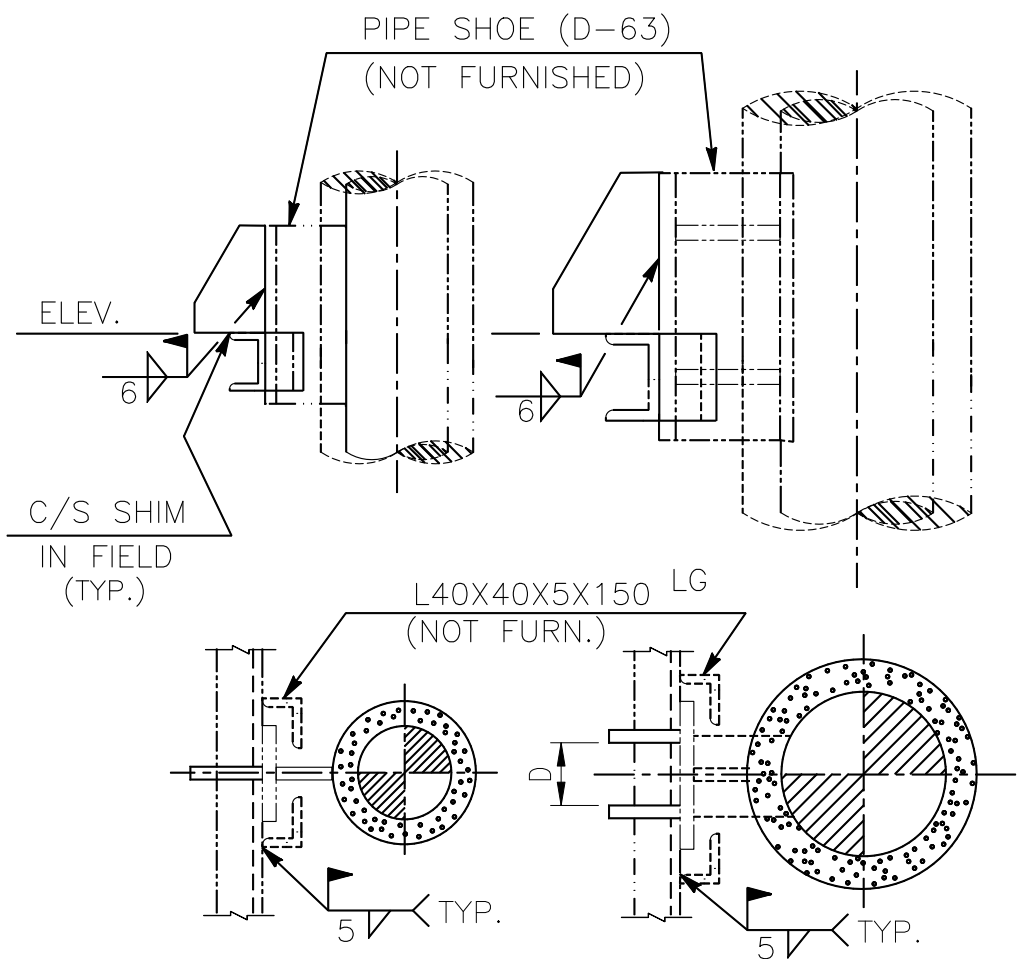


FIG. -A  
(FOR INS. PIPE)


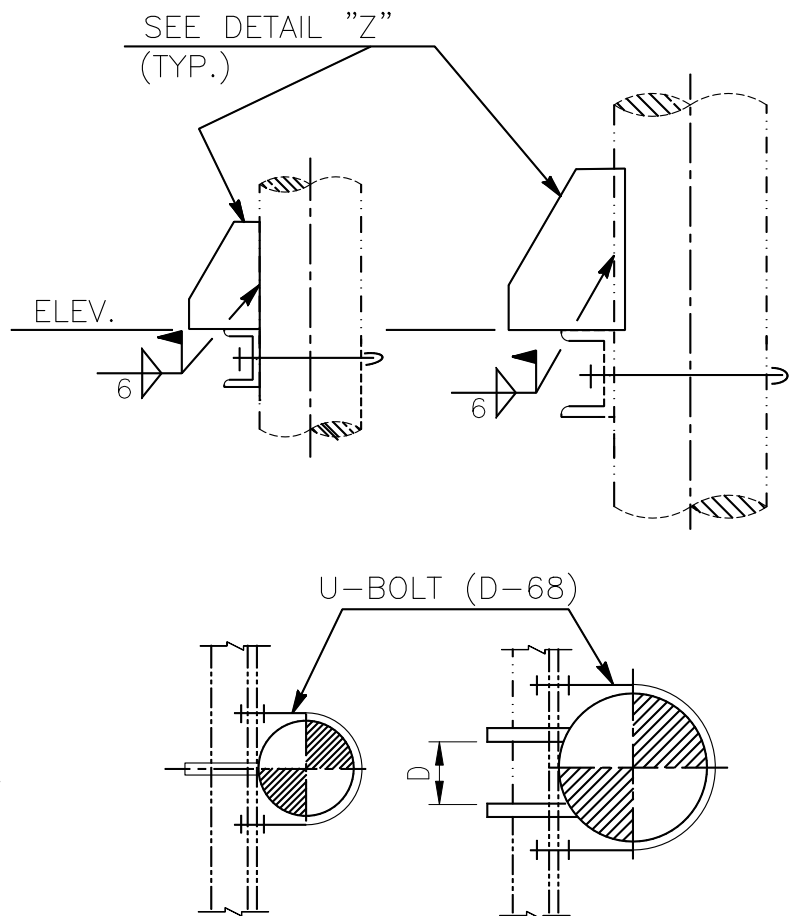


FIG. -B  
(FOR BARE PIPE)

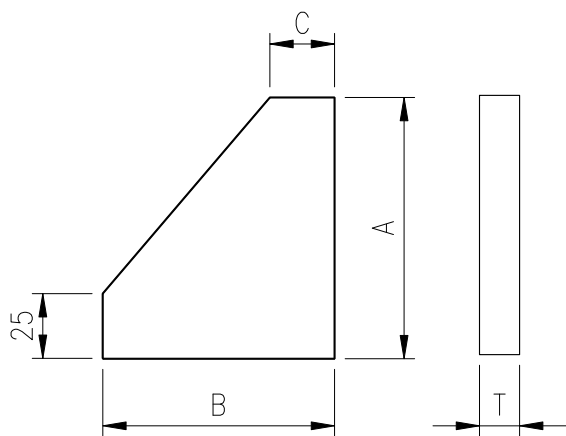

DETAIL "Z"

| MAT'L OF MAIN PIPE     | MAT'L OF LUG PLATE | SYMBOL |
|------------------------|--------------------|--------|
| CARBON STEEL           | A-283-C            | NONE   |
| ALLOY STEEL            | A387-22            | (A)    |
| STAINLESS STEEL        | A240-304           | (S)    |
| CARBON STEEL (A516-60) | A516-60            | (R)    |


TABLE "A"

DIMENSIONS (mm)

| LINE SIZE        | A   | B   | C  | D   | T  | FOR STAINLESS STEEL ONLY |
|------------------|-----|-----|----|-----|----|--------------------------|
| 2 1/2" & SMALLER | 80  | 55  | 15 | —   | 9  | 6                        |
| 3"—8"            | 150 | 100 | 50 | —   | 12 | 9                        |
| 10"—14"          | 150 | 130 | 50 | 120 | 12 | —                        |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

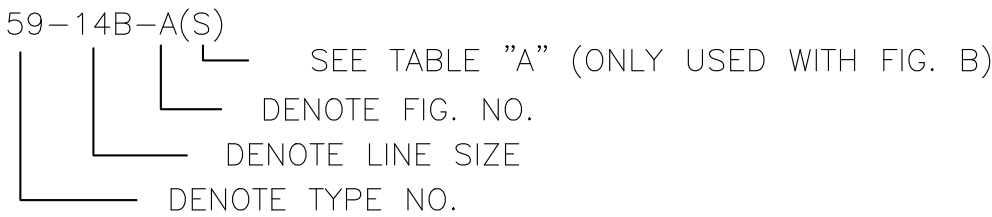


2. MATERIAL : SEE TABLE "A"

FILE: D-70M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-70                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-59




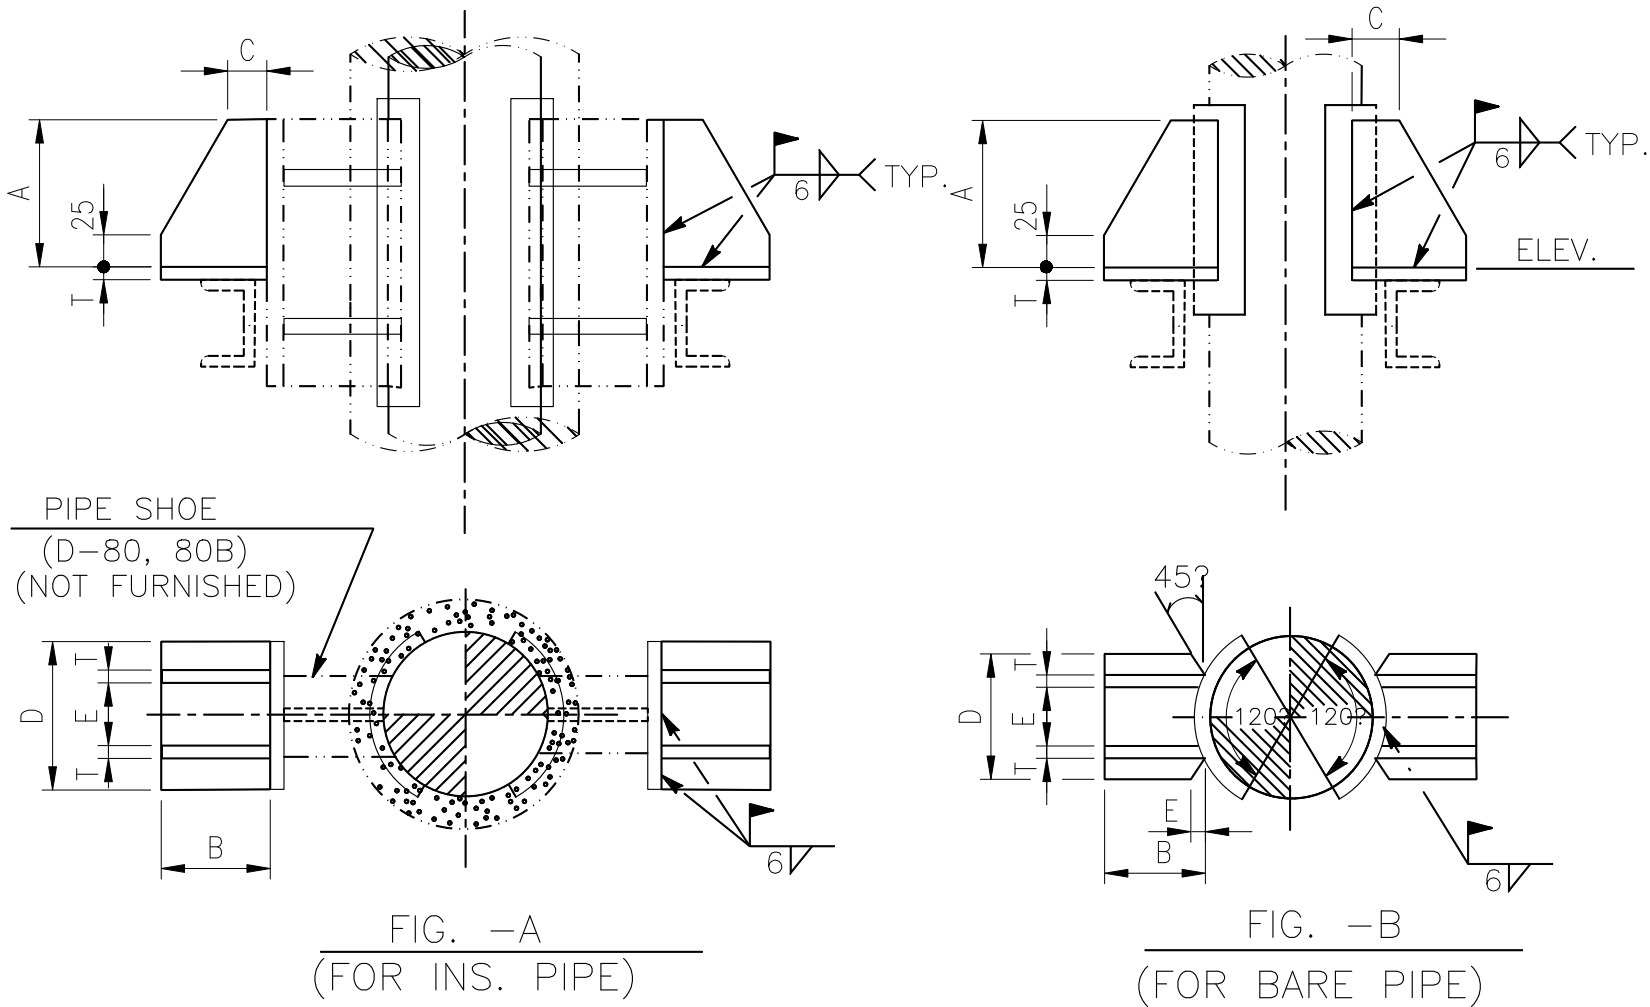

| SUPPORT NO. | LINE SIZE | A   | B   | C  | D   | E   | F  | T  |
|-------------|-----------|-----|-----|----|-----|-----|----|----|
| 60-16B-A    | 16"       | 200 | 120 | 60 | 280 | 200 | -  | 12 |
| 60-18B-A    | 18"       | 200 | 120 | 60 | 300 | 220 | -  | 12 |
| 60-20B-A    | 20"       | 200 | 120 | 60 | 340 | 240 | -  | 12 |
| 60-24B-A    | 24"       | 250 | 150 | 75 | 400 | 300 | -  | 12 |
| 60-26B-A    | 26"       | 250 | 150 | 75 | 430 | 330 | -  | 12 |
| 60-28B-A    | 28"       | 250 | 150 | 75 | 460 | 360 | -  | 12 |
| 60-30B-A    | 30"       | 250 | 150 | 75 | 480 | 380 | -  | 12 |
| 60-32B-A    | 32"       | 250 | 150 | 75 | 540 | 440 | -  | 16 |
| 60-36B-A    | 36"       | 250 | 150 | 75 | 580 | 460 | -  | 16 |
| 60-40B-A    | 40"       | 250 | 150 | 75 | 620 | 500 | -  | 16 |
| 60-42B-A    | 42"       | 250 | 150 | 75 | 660 | 540 | -  | 16 |
| 60-16B-B    | 16"       | 200 | 150 | 75 | 240 | 160 | 20 | 12 |
| 60-18B-B    | 18"       | 200 | 150 | 75 | 260 | 180 | 20 | 12 |
| 60-20B-B    | 20"       | 200 | 150 | 75 | 260 | 180 | 20 | 12 |
| 60-24B-B    | 24"       | 250 | 170 | 85 | 280 | 200 | 20 | 12 |
| 60-26B-B    | 26"       | 250 | 170 | 85 | 280 | 200 | 20 | 12 |
| 60-28B-B    | 28"       | 250 | 170 | 85 | 280 | 200 | 20 | 12 |
| 60-30B-B    | 30"       | 250 | 170 | 85 | 280 | 200 | 15 | 12 |
| 60-32B-B    | 32"       | 250 | 170 | 85 | 280 | 200 | 15 | 16 |
| 60-36B-B    | 36"       | 250 | 170 | 85 | 340 | 260 | 20 | 16 |
| 60-40B-B    | 40"       | 250 | 180 | 90 | 380 | 300 | 25 | 16 |
| 60-42B-B    | 42"       | 250 | 180 | 90 | 380 | 300 | 25 | 16 |

NOTES :


1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

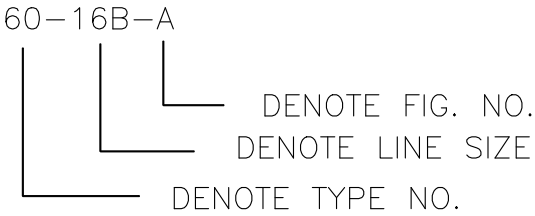

2. MATERIAL : A283 GR. C

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-71                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-60

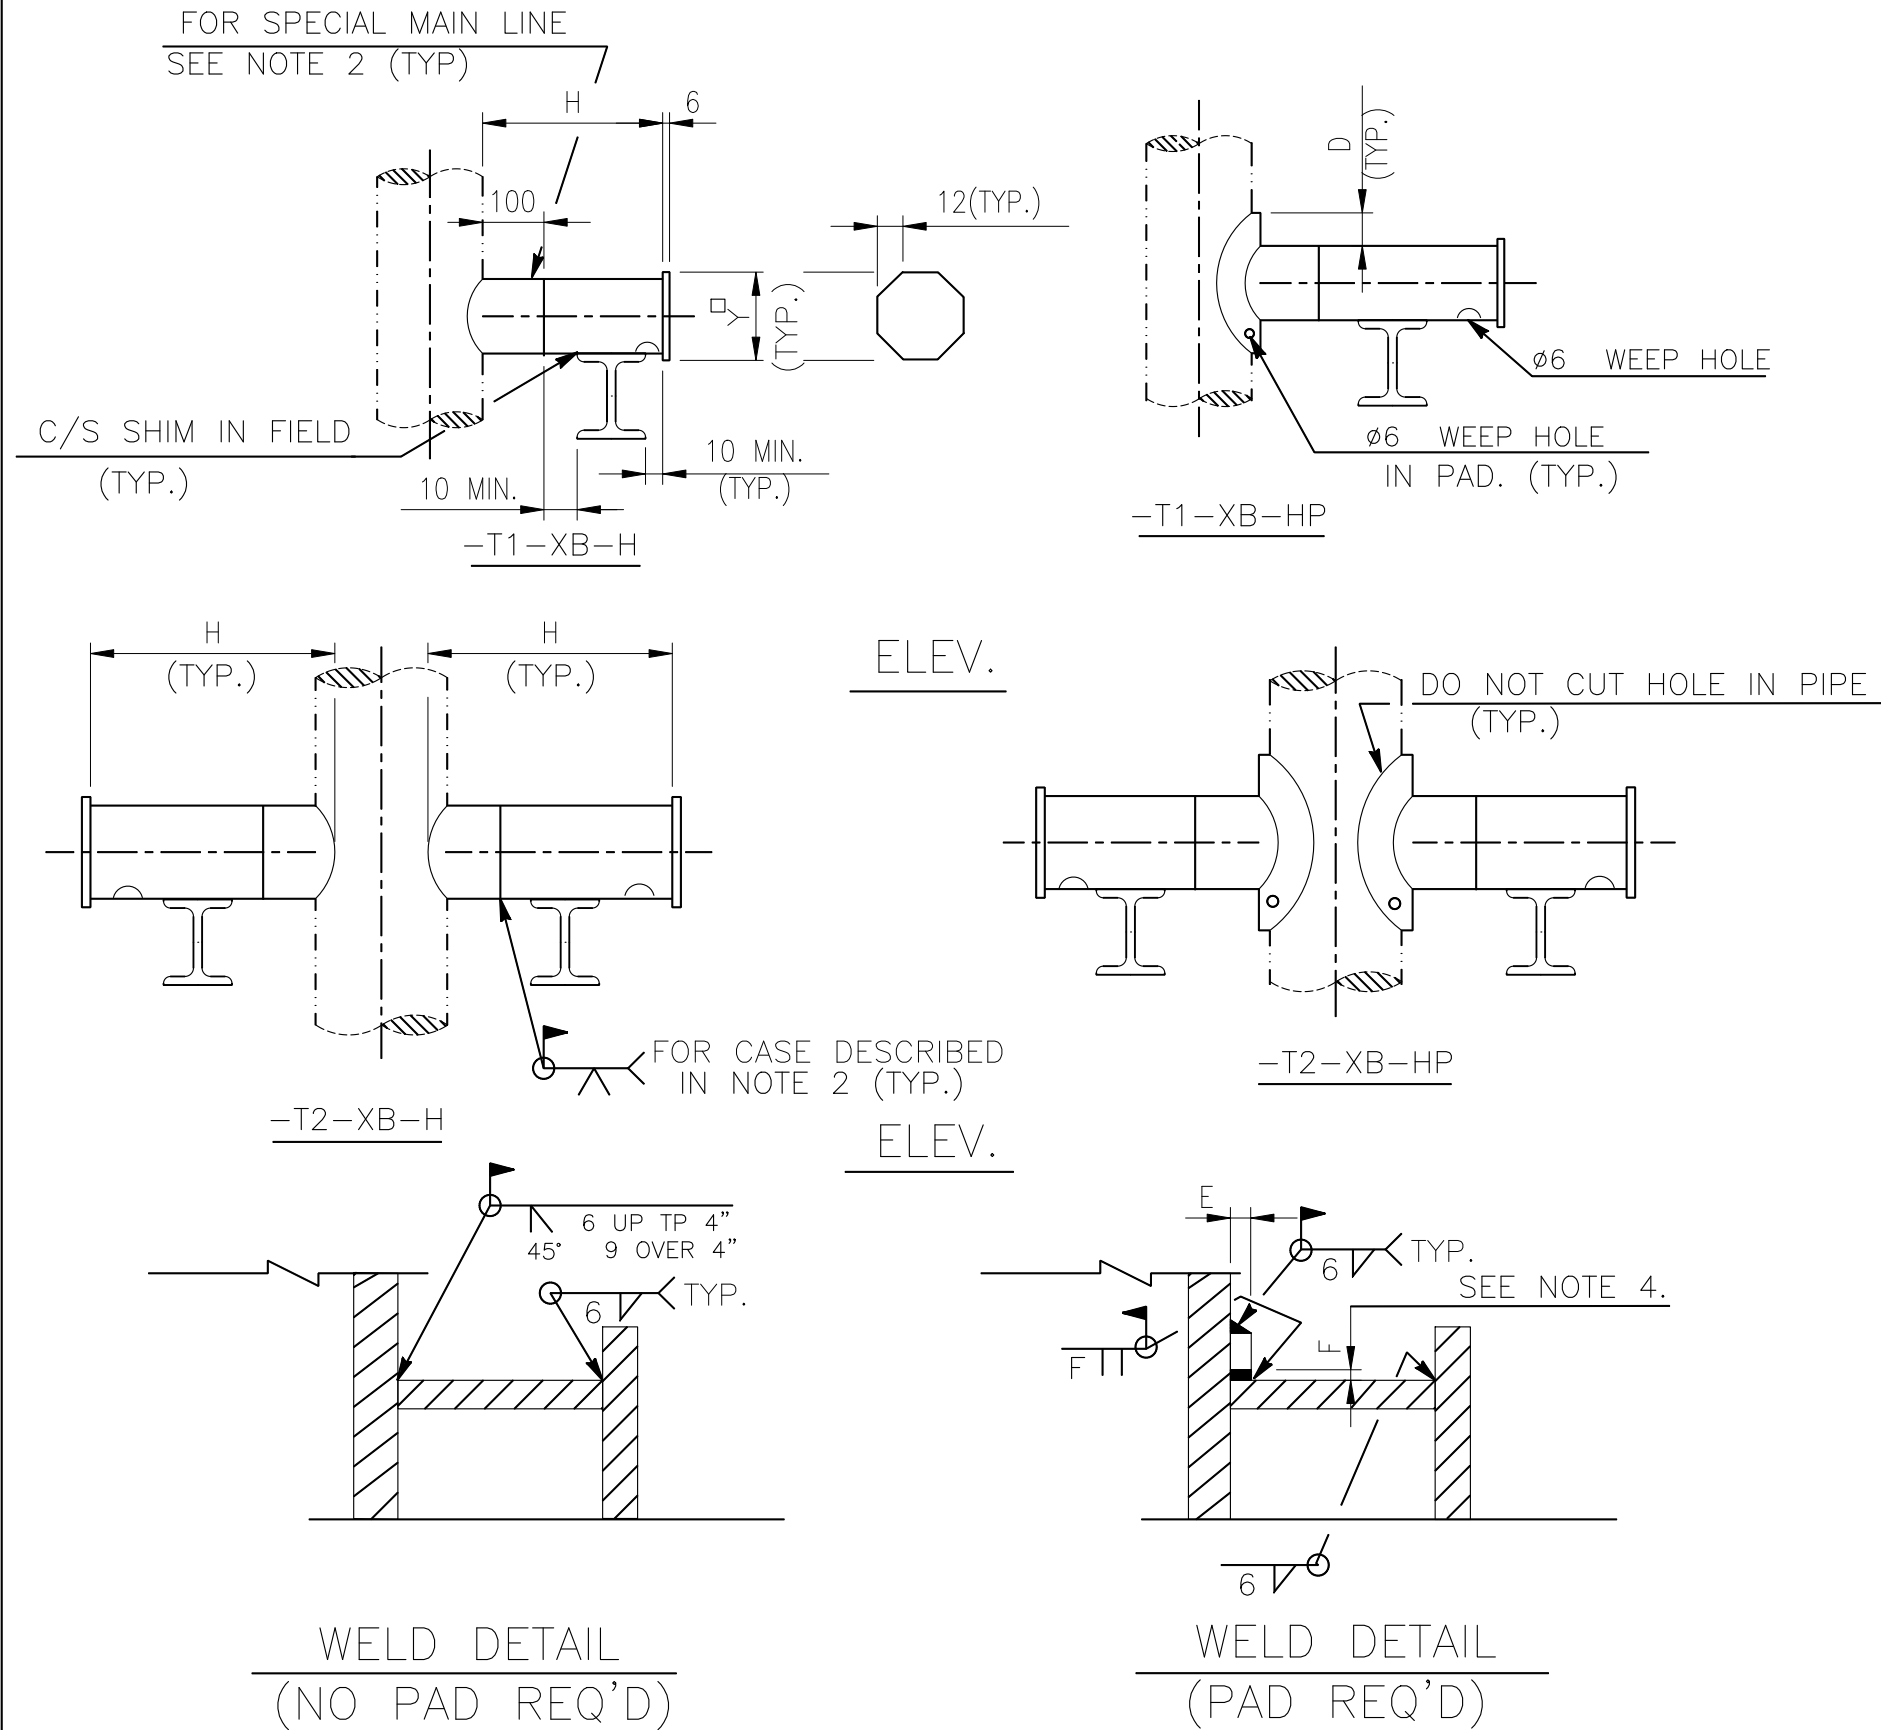

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 61-3B-T1-05(P)
- DENOTE TYPE NO. — DENOTE REIN. PAD IS REQ'D.
- DENOTE NOM. TRUNN. PIPE SIZE — DENOTE THE LG. OF TRUNN. (IN 100mm)
- DENOTE ONE-TRUNN. TYPE
2. FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES, THE MATERIALS SHALL BE THE SAME AS MAIN LINES.
3. THE MOMENT CAPACITY OF THE TABLE ARE FOR ONE-TRUNN. TYPE, FOR TWO-TRUNN. TYPE THE CAPACITIES SHALL BE DOUBLED.
4. DIMENSION "F" : ALLOY OR STAINLESS TAKES 6 mm  
CARBON STEEL TAKES 9 mm

FILE: D-72M.DWG

|                                            |          |  |       |      |  |                      |      |
|--------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司                               |          |  |       |      |  | ENGINEERING STANDARD |      |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                         | SHIH     |  | CHK.  | YANG |  | D-72                 | REV. |
| DATE                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT

TYPE-61

(1 OF 3)

FOR CARBON STEEL

| CORRECTION FACTORS |       |       |       |       |       |       |       |       |
|--------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| TEMP.°F            | 200   | 300   | 400   | 500   | 600   | 650   | 700   | 750   |
| FACTOR             | 1.000 | 1.055 | 1.109 | 1.168 | 1.239 | 1.275 | 1.313 | 1.430 |

DIMENSION (mm)

|                      |              | TRUNNION – NOMINAL PIPE SIZE                 |     |                    |     |           |     |           |     |           |     |           |     |                  |     |           |     |                            |                   |
|----------------------|--------------|----------------------------------------------|-----|--------------------|-----|-----------|-----|-----------|-----|-----------|-----|-----------|-----|------------------|-----|-----------|-----|----------------------------|-------------------|
|                      |              | 2”                                           |     | 3”                 |     | 4”        |     | 6”        |     | 8”        |     | 10”       |     | 12”              |     | 14”       |     |                            |                   |
|                      |              | SCH. 80                                      |     | SCH. 40 OR GREATER |     |           |     |           |     |           |     |           |     | 3/8”W OR GREATER |     |           |     |                            |                   |
| Y                    |              | 80                                           |     | 110                |     | 140       |     | 190       |     | 240       |     | 290       |     | 340              |     | 380       |     |                            |                   |
| NOM.<br>PIPE<br>SIZE | PIPE<br>SCH. | PAD REQUIREMENTS                             |     |                    |     |           |     |           |     |           |     |           |     |                  |     |           |     | PAD<br>TH’K<br>MIN.<br>”E” | DIM.<br>”D”<br>mm |
|                      |              | NO<br>PAD                                    | PAD | NO<br>PAD          | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD        | PAD | NO<br>PAD | PAD |                            |                   |
|                      |              | MOMENT CAPACITY OF ONE TRUNNION. (INCH–KIPS) |     |                    |     |           |     |           |     |           |     |           |     |                  |     |           |     |                            |                   |
| 3”                   | 40           | 1                                            | 6   |                    |     |           |     |           |     |           |     |           |     |                  |     |           |     | 5.5                        | 40                |
| 4”                   | 40           | 1                                            | 7   | 3                  | 15  |           |     |           |     |           |     |           |     |                  |     |           |     | 6.0                        | 50                |
| 6”                   | 40           | 2                                            | 8   | 4                  | 17  | 6         | 28  |           |     |           |     |           |     |                  |     |           |     | 7.0                        | 65                |
| 8”                   | 40           | 2                                            | 9   | 5                  | 19  | 8         | 32  | 17        | 69  |           |     |           |     |                  |     |           |     | 8.5                        | 90                |
| 10”                  | 40           |                                              |     | 6                  | 21  | 9         | 35  | 20        | 77  | 34        | 130 |           |     |                  |     |           |     | 9.0                        | 100               |
| 12”                  | 3/8”W        |                                              |     | 5                  | 21  | 9         | 34  | 19        | 74  | 33        | 125 | 51        | 195 |                  |     |           |     | 9.5                        | 100               |
| 14”                  | 3/8”W        |                                              |     |                    |     | 9         | 33  | 19        | 71  | 31        | 120 | 49        | 186 | 69               | 262 |           |     | 9.5                        | 115               |
| 16”                  | 3/8”W        |                                              |     |                    |     | 8         | 30  | 17        | 66  | 29        | 112 | 46        | 174 | 64               | 245 | 78        | 295 | 9.5                        | 115               |
| 18”                  | 3/8”W        |                                              |     |                    |     |           |     | 16        | 62  | 28        | 106 | 43        | 164 | 61               | 231 | 73        | 278 | 9.5                        | 125               |
| 20”                  | 3/8”W        |                                              |     |                    |     |           |     | 16        | 59  | 26        | 100 | 41        | 156 | 57               | 219 | 69        | 264 | 9.5                        | 125               |
| 24”                  | 3/8”W        |                                              |     |                    |     |           |     | 14        | 54  | 24        | 91  | 37        | 142 | 52               | 200 | 63        | 241 | 9.5                        | 140               |
| 30”                  | 3/8”W        |                                              |     |                    |     |           |     |           |     | 21        | 82  | 33        | 127 | 47               | 179 | 57        | 215 | 9.5                        | 165               |
| 36”                  | 3/8”W        |                                              |     |                    |     |           |     |           |     |           |     | 30        | 116 | 43               | 163 | 52        | 197 | 9.5                        | 180               |
| 42”                  | 3/8”W        |                                              |     |                    |     |           |     |           |     |           |     | 28        | 107 | 40               | 151 | 48        | 182 | 9.5                        | 190               |
| 3”                   | 80           | 3                                            | 9   |                    |     |           |     |           |     |           |     |           |     |                  |     |           |     | 5.5                        | 40                |
| 4”                   | 80           | 3                                            | 10  | 7                  | 21  |           |     |           |     |           |     |           |     |                  |     |           |     | 6.0                        | 50                |
| 6”                   | 80           | 5                                            | 11  | 10                 | 26  | 17        | 43  |           |     |           |     |           |     |                  |     |           |     | 7.0                        | 65                |
| 8”                   | 80           | 5                                            | 11  | 12                 | 26  | 20        | 49  | 43        | 106 |           |     |           |     |                  |     |           |     | 8.5                        | 90                |
| 10”                  | 1/2”W        |                                              |     | 11                 | 26  | 18        | 48  | 38        | 104 | 65        | 175 |           |     |                  |     |           |     | 9.0                        | 100               |
| 12”                  | 1/2”W        |                                              |     | 10                 | 26  | 16        | 45  | 35        | 97  | 59        | 164 | 92        | 255 |                  |     |           |     | 9.5                        | 100               |
| 14”                  | 1/2”W        |                                              |     |                    |     | 15        | 43  | 33        | 93  | 57        | 157 | 88        | 244 | 124              | 343 |           |     | 9.5                        | 115               |
| 16”                  | 1/2”W        |                                              |     |                    |     | 14        | 40  | 31        | 87  | 53        | 147 | 82        | 228 | 116              | 321 | 140       | 387 | 9.5                        | 115               |
| 18”                  | 1/2”W        |                                              |     |                    |     |           |     | 30        | 82  | 50        | 138 | 78        | 215 | 109              | 302 | 132       | 365 | 9.5                        | 125               |
| 20”                  | 1/2”W        |                                              |     |                    |     |           |     | 28        | 77  | 47        | 131 | 74        | 204 | 104              | 287 | 125       | 346 | 9.5                        | 125               |
| 24”                  | 1/2”W        |                                              |     |                    |     |           |     | 26        | 71  | 43        | 120 | 67        | 186 | 95               | 262 | 114       | 316 | 9.5                        | 140               |
| 30”                  | 1/2”W        |                                              |     |                    |     |           |     |           |     | 39        | 107 | 60        | 167 | 85               | 234 | 102       | 283 | 9.5                        | 165               |
| 36”                  | 1/2”W        |                                              |     |                    |     |           |     |           |     |           |     | 55        | 152 | 77               | 214 | 93        | 258 | 9.5                        | 180               |
| 42”                  | 1/2”W        |                                              |     |                    |     |           |     |           |     |           |     | 51        | 141 | 72               | 198 | 86        | 239 | 9.5                        | 190               |

|                                                            |          |  |       |      |  |                                                       |  |  |  |  |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|--|--|--|--|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-61<br><br>(2 OF 3) |  |  |  |  |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  |                                                       |  |  |  |  |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                                       |  |  |  |  |  | D-73                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                       |  |  |  |  |  |                      | 1    |

FILE: D-73M.DWG

FOR STAINLESS STEEL

TEMP.°F

| CORRECTION FACTORS |       |       |       |       |       |       |       |       |       |       |       |
|--------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| TEMP.              | TP304 | TP316 | TP347 | TEMP. | TP304 | TP316 | TP347 | TEMP. | TP304 | TP316 | TP347 |
| -325 TO<br>200     | 1.00  | 0.89  | 0.89  | 750   | 1.60  | 0.99  | 1.13  | 1150  | 2.90  | 1.96  | 2.08  |
|                    |       |       |       | 800   | 1.67  | 0.99  | 1.14  | 1200  | 3.70  | 2.45  | 3.33  |
| 300                | 1.11  | 0.93  | 0.98  | 850   | 1.72  | 1.01  | 1.16  | 1250  | 5.12  | 3.14  | 4.63  |
| 400                | 1.22  | 0.95  | 1.05  | 900   | 1.77  | 1.04  | 1.18  | 1300  | 6.80  | 4.16  | 6.17  |
| 500                | 1.33  | 0.97  | 1.10  | 950   | 1.83  | 1.10  | 1.20  | 1350  | 9.25  | 5.55  | 8.32  |
| 600                | 1.44  | 0.97  | 1.12  | 1000  | 1.89  | 1.19  | 1.23  | 1400  | 11.89 | 7.09  | 10.74 |
| 650                | 1.49  | 0.98  | 1.12  | 1050  | 1.96  | 1.36  | 1.27  | 1450  | 16.65 | 9.00  | 13.88 |
| 700                | 1.54  | 0.98  | 1.13  | 1100  | 2.22  | 1.60  | 1.33  | 1500  | 22.20 | 11.10 | 16.65 |

DIMENSION (mm)

|                      |              | TRUNNION – NOMINAL PIPE SIZE                 |     |           |     |           |     |           |     |           |     |           |     |           |     |           |     |                            |             |
|----------------------|--------------|----------------------------------------------|-----|-----------|-----|-----------|-----|-----------|-----|-----------|-----|-----------|-----|-----------|-----|-----------|-----|----------------------------|-------------|
|                      |              | 2”                                           |     | 3”        |     | 4”        |     | 6”        |     | 8”        |     | 10”       |     | 12”       |     | 14”       |     |                            |             |
|                      |              | MIN. SCH. SAME AS HEADER                     |     |           |     |           |     |           |     |           |     |           |     |           |     |           |     |                            |             |
|                      |              | Y                                            |     | 80        |     | 110       |     | 140       |     | 190       |     | 240       |     | 290       |     | 340       |     |                            |             |
| NOM.<br>PIPE<br>SIZE | PIPE<br>SCH. | PAD REQUIREMENTS                             |     |           |     |           |     |           |     |           |     |           |     |           |     |           |     | PAD<br>TH’K<br>MIN.<br>”E” | DIM.<br>”D” |
|                      |              | NO<br>PAD                                    | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD | NO<br>PAD | PAD |                            |             |
|                      |              | MOMENT CAPACITY OF ONE TRUNNION. (INCH–KIPS) |     |           |     |           |     |           |     |           |     |           |     |           |     |           |     |                            |             |
| 3”                   | 5S           | 1                                            | 3   |           |     |           |     |           |     |           |     |           |     |           |     |           |     | 2.0                        | 30          |
| 4”                   | 5S           | 1                                            | 2   | 2         | 5   |           |     |           |     |           |     |           |     |           |     |           |     | 2.0                        | 40          |
| 6”                   | 5S           | 1                                            | 3   | 2         | 6   | 4         | 10  |           |     |           |     |           |     |           |     |           |     | 3.0                        | 45          |
| 8”                   | 5S           | 1                                            | 3   | 2         | 5   | 3         | 9   | 7         | 20  |           |     |           |     |           |     |           |     | 3.0                        | 60          |
| 10”                  | 5S           |                                              |     | 2         | 7   | 4         | 11  | 8         | 24  | 14        | 41  |           |     |           |     |           |     | 3.5                        | 65          |
| 12”                  | 5S           |                                              |     | 2         | 8   | 5         | 14  | 11        | 30  | 18        | 51  | 28        | 79  |           |     |           |     | 4.0                        | 75          |
| 14”                  | 5S           |                                              |     |           |     | 4         | 12  | 9         | 26  | 16        | 45  | 25        | 70  | 35        | 98  |           |     | 4.0                        | 75          |
| 16”                  | 5S           |                                              |     |           |     | 4         | 12  | 10        | 27  | 16        | 46  | 25        | 71  | 35        | 100 | 42        | 120 | 4.0                        | 85          |
| 18”                  | 5S           |                                              |     |           |     |           |     | 9         | 25  | 15        | 43  | 24        | 67  | 33        | 94  | 40        | 113 | 4.0                        | 90          |
| 20”                  | 5S           |                                              |     |           |     |           |     | 10        | 29  | 18        | 50  | 27        | 77  | 39        | 108 | 47        | 131 | 5.0                        | 100         |
| 24”                  | 5S           |                                              |     |           |     |           |     | 12        | 33  | 20        | 57  | 31        | 88  | 44        | 124 | 53        | 149 | 5.5                        | 120         |
| 30”                  | 5S           |                                              |     |           |     |           |     |           |     | 22        | 62  | 34        | 97  | 48        | 136 | 58        | 164 | 6.5                        | 145         |
| 3”                   | 10S          | 2                                            | 5   |           |     |           |     |           |     |           |     |           |     |           |     |           |     | 3.0                        | 30          |
| 4”                   | 10S          | 1                                            | 4   | 3         | 9   |           |     |           |     |           |     |           |     |           |     |           |     | 3.0                        | 40          |
| 6”                   | 10S          | 1                                            | 4   | 3         | 9   | 5         | 14  |           |     |           |     |           |     |           |     |           |     | 3.5                        | 45          |
| 8”                   | 10S          | 1                                            | 4   | 3         | 9   | 5         | 14  | 11        | 31  |           |     |           |     |           |     |           |     | 4.0                        | 60          |
| 10”                  | 10S          |                                              |     | 3         | 9   | 5         | 15  | 12        | 33  | 20        | 55  |           |     |           |     |           |     | 4.0                        | 65          |
| 12”                  | 10S          |                                              |     | 3         | 10  | 6         | 16  | 12        | 34  | 21        | 58  | 32        | 90  |           |     |           |     | 4.5                        | 75          |
| 14”                  | 10S          |                                              |     |           |     | 6         | 16  | 12        | 35  | 21        | 59  | 33        | 92  | 46        | 130 |           |     | 5.0                        | 75          |
| 16”                  | 10S          |                                              |     |           |     | 5         | 15  | 12        | 33  | 20        | 55  | 30        | 86  | 43        | 121 | 52        | 146 | 5.0                        | 85          |
| 18”                  | 10S          |                                              |     |           |     |           |     | 11        | 31  | 18        | 52  | 29        | 81  | 40        | 114 | 49        | 138 | 5.0                        | 90          |
| 20”                  | 10S          |                                              |     |           |     |           |     | 13        | 37  | 22        | 62  | 34        | 96  | 48        | 135 | 58        | 163 | 5.5                        | 100         |
| 24”                  | 10S          |                                              |     |           |     |           |     | 14        | 41  | 25        | 70  | 38        | 108 | 54        | 152 | 65        | 183 | 6.5                        | 120         |
| 30”                  | 10S          |                                              |     |           |     |           |     |           |     | 31        | 87  | 48        | 135 | 67        | 189 | 81        | 228 | 8.0                        | 145         |

|                                                            |          |  |       |      |  |                                                       |  |  |  |  |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|--|--|--|--|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-61<br><br>(3 OF 3) |  |  |  |  |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  |                                                       |  |  |  |  |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                                       |  |  |  |  |  | D-74                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                       |  |  |  |  |  |                      | 1    |

FILE: D-74M.DWG



FILE: D-75M.DWG

| TYPE   | M-NO. | GRINNELL<br>FIG. NO. | PIPE SIZE<br>RANGE | MAX.<br>TEMP.(?F) | MAX.INSU.<br>TH'K (IN) | REMARKS                             |
|--------|-------|----------------------|--------------------|-------------------|------------------------|-------------------------------------|
| FIG.-A | M-31  | 60                   |                    |                   |                        |                                     |
| FIG.-C | M-28  | 66                   |                    | 750               |                        |                                     |
| FIG.-D | M-28  | 66                   |                    | 750               |                        |                                     |
| FIG.-E | M-3   | 260                  | 1/2"-30"           | 650               |                        |                                     |
| FIG.-G | M-4   | 212                  | 1/2"-24"           | 750               |                        |                                     |
| FIG.-H | M-5   | 216                  | 3"-42"             | 750               |                        | LOAD CAPACITY<br>GREATER THAN FIG-G |
| FIG.-J | M-6   | 295                  | 3/4"-24"           | 750               | 4                      |                                     |
| FIG.-K | M-7   | 295H                 | 6"-36"             | 750               | 4                      | LOAD CAPACITY<br>GREATER THAN FIG-J |
| FIG.-L | M-8   | 295A                 | 1 1/2"-10"         | 1050              | 4                      |                                     |
| FIG.-M | M-9   | 224                  | 4"-16"             | 1050              | 4                      | LOAD CAPACITY<br>GREATER THAN FIG-L |
| FIG.-N | M-10  | 246                  | 10"-24"            | 1075              | 6                      | LOAD CAPACITY<br>GREATER THAN FIG-M |
| FIG.-Q | M-24  | 299                  | 2"-24"             | 750               |                        |                                     |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
62-4B- 5/8 -05 ~ 30D-J(T)  
DENOTE TYPE NO.   
2. FOR WELDING SIZE, SEE M-28.  
3. TURNBUCKLE SHALL BE USED IN ONE OF THE FOLLOWING CASES :  
(a) DIM. "H" LARGER THAN 2000 MM  
(b) THE UPPER PART FIG. -D IS IN HANGER COMBINATION.  
4. IF FIG.-D IS CHOSEN COMBINATION WITHOUT TURNBUCKLE , A LEFT-HAND  
THREADED WELDLESS EYE NUT SHALL BE USED.

|                                                            |          |  |       |      |  |                                                       |      |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|------|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-62<br><br>(2 OF 2) |      | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                                       |      | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                                       |      |                      | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                       | D-76 |                      |           |

FILE: D-76M.DWG






NOTES :

3. "\*" DENOTE FIG.-B & C USE ONLY.

|                                                                               |          |  |       |      |  |                                                      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-64</div> |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |                                                      |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | D-78                                                 |  | REV.                 |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                      |  | 1                    |  |

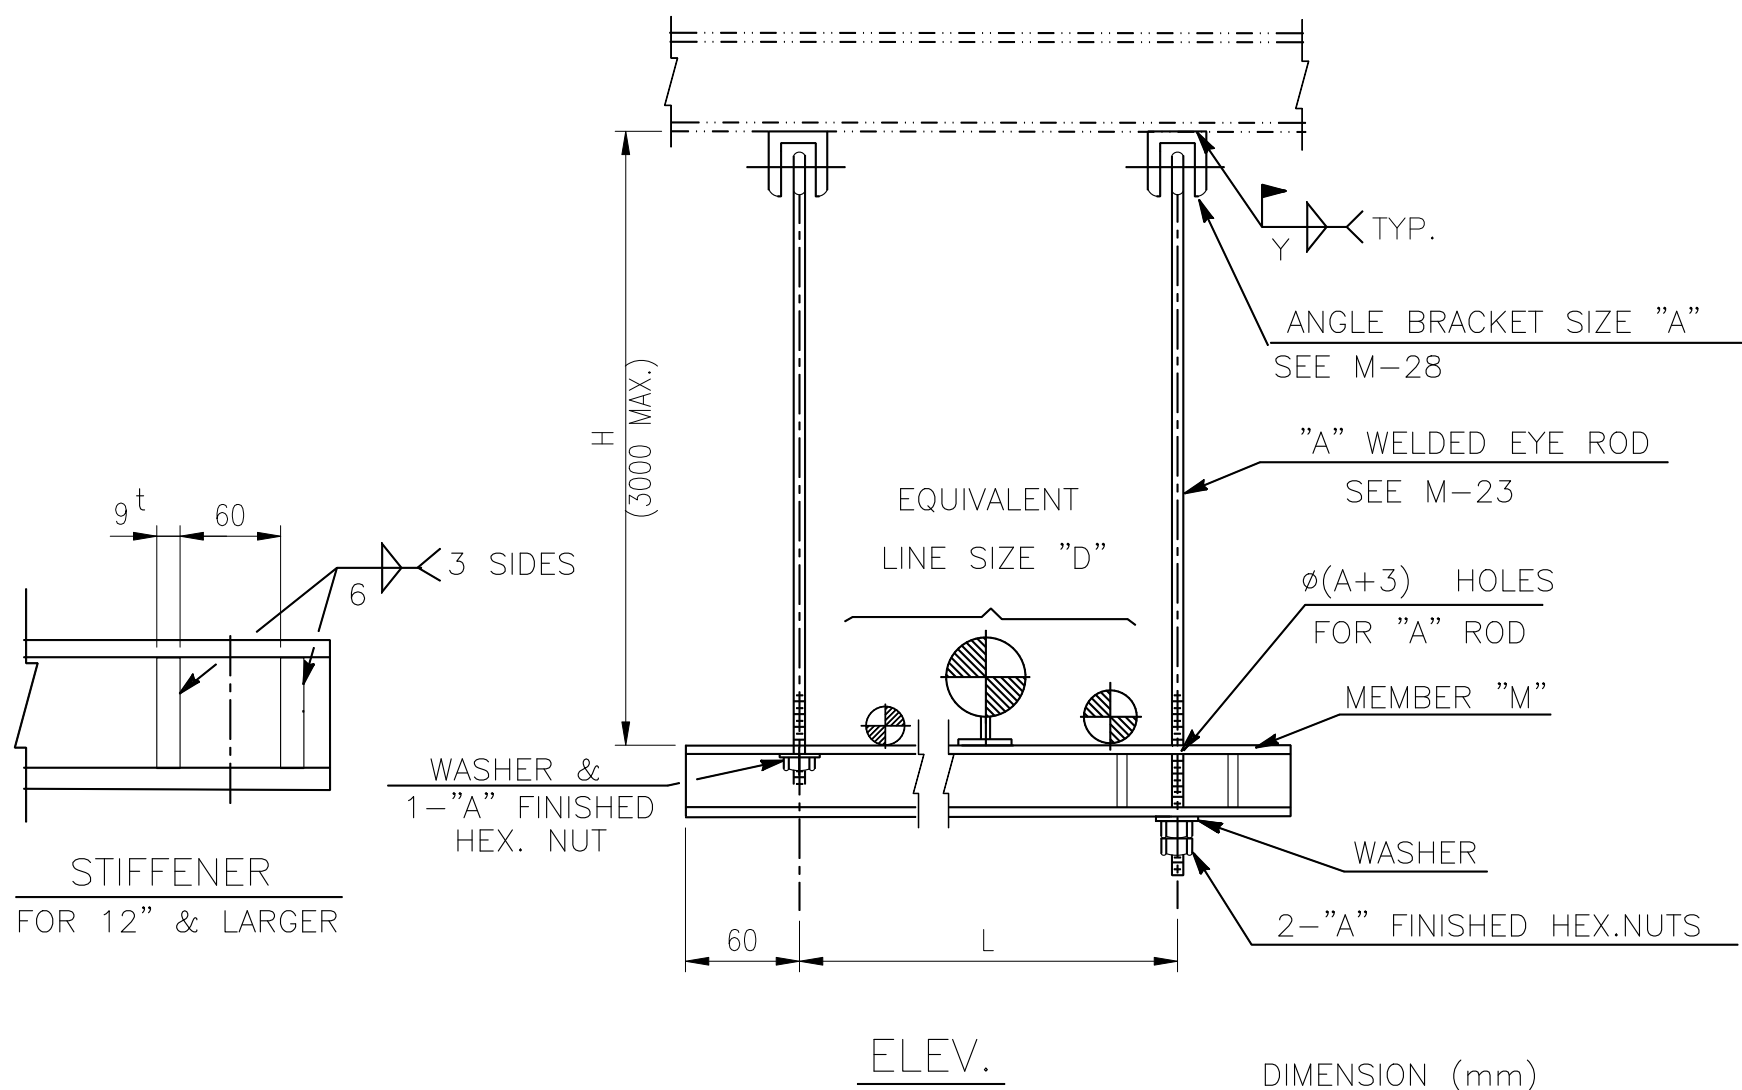

| LINE<br>SIZE<br>"D" | ROD<br>SIZE<br>"A" | MEMBER "M" |           |           |           |           | Y  |
|---------------------|--------------------|------------|-----------|-----------|-----------|-----------|----|
|                     |                    | L=500      | L=1000    | L=1500    | L=2000    | L=2500    |    |
| 2"                  | 3/8"               | L65X65X6   | L65X65X6  | L75X75X9  | L90X90X10 | L90X90X10 | 6  |
| 3"                  | 3/8"               | L65X65X6   | L75X75X9  | L90X90X10 | C100X50X5 | C100X50X5 | 6  |
| 4"                  | 3/8"               | L75X75X9   | L90X90X10 | C100X50X5 | C100X50X5 | C100X50X5 | 6  |
| 6"                  | 1/2"               | L90X90X10  | C100X50X5 | C100X50X5 | C100X50X5 | C100X50X5 | 6  |
| 8"                  | 1/2"               | C100X50X5  | C100X50X5 | C100X50X5 | C100X50X5 | C150X75X9 | 6  |
| 10"                 | 5/8"               | C100X50X5  | C100X50X5 | C100X50X5 | C150X75X9 | C150X75X9 | 6  |
| 12"                 | 3/4"               | C100X50X5  | C100X50X5 | C150X75X9 | C150X75X9 | C150X75X9 | 6  |
| 14"                 | 3/4"               | C100X50X5  | C100X50X5 | C150X75X9 | C150X75X9 | C180X75X7 | 6  |
| 16"                 | 3/4"               | C100X50X5  | C100X50X5 | C150X75X9 | C150X75X9 | C180X75X7 | 6  |
| 18"                 | 7/8"               | C100X50X5  | C100X50X5 | C150X75X9 | C180X75X7 | C200X90X8 | 6  |
| 20"                 | 1"                 | C100X50X5  | C100X50X5 | C150X75X9 | C180X75X7 | C200X90X8 | 6  |
| 24"                 | 1 1/4"             | C100X50X5  | C150X75X9 | C150X75X9 | C200X90X8 | C200X90X8 | 10 |

- NOTES :
1. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 65-2B-1505

DENOTE DIM. "H" (IN 100mm)

DENOTE DIM. "L" (IN 100mm)

DENOTE LINE SIZE "D"


DENOTE TYPE NO.
2. DIMENSION "L" SHALL BE CUT TO SUIT IN FIELD.

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-79                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-65

FILE: D-79M.DWG



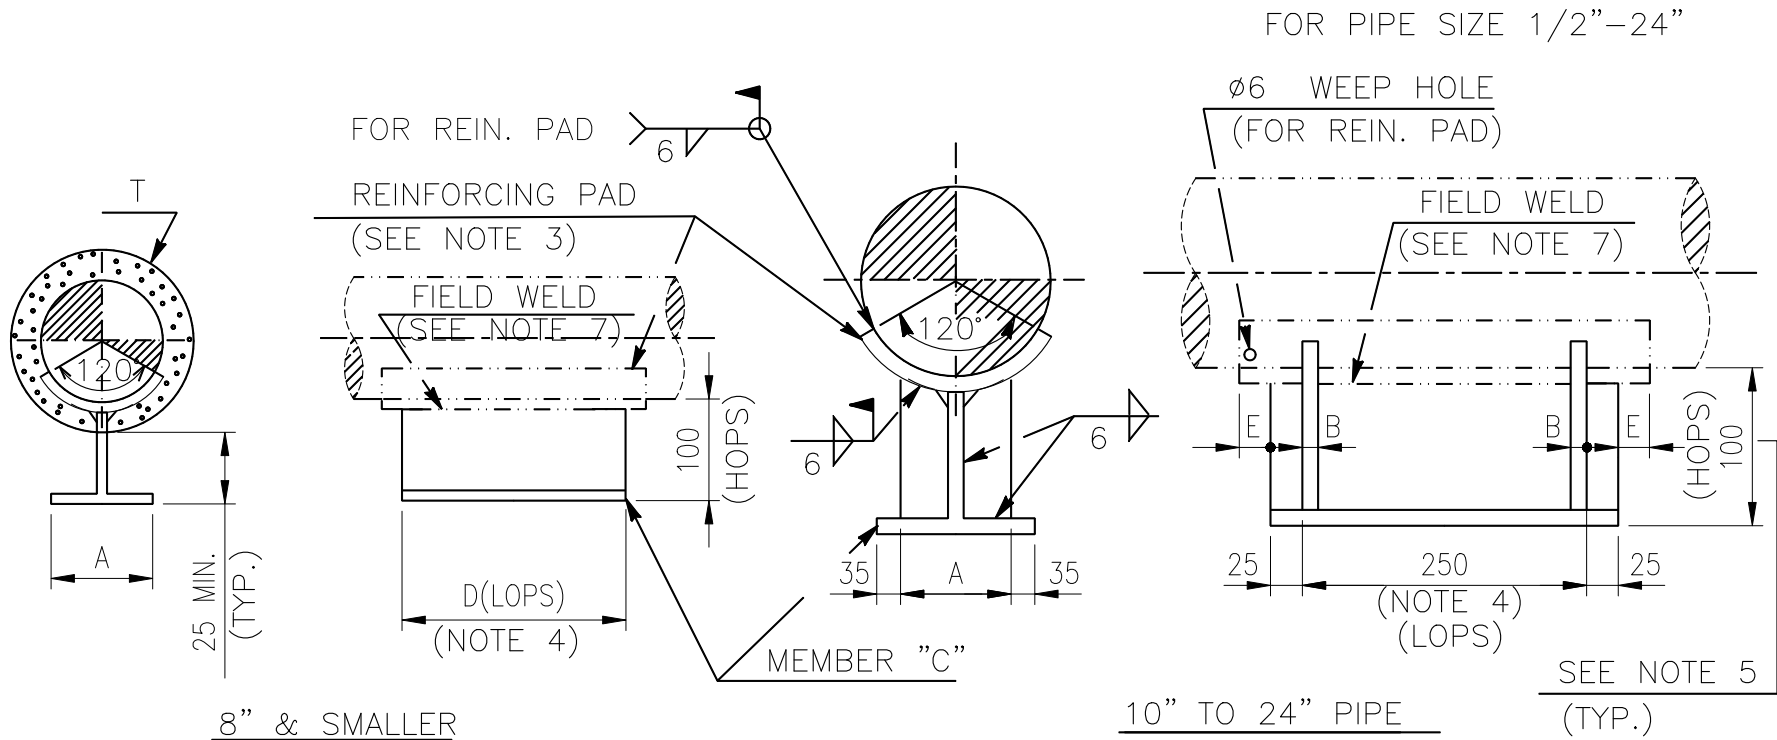

| DIMENSION (mm) |     |    |                                    |            |    |
|----------------|-----|----|------------------------------------|------------|----|
| LINE SIZE      | A   | B  | C (NOTE 1)                         | D (NOTE 4) | E  |
| 1/2"           | 100 | —  | CUT FROM<br>H-200X100X5.5X8        | 150        | —  |
| 3/4"           | 100 | —  |                                    | 150        | —  |
| 1"             | 100 | —  |                                    | 150        | —  |
| 1 1/2"         | 100 | —  |                                    | 150        | —  |
| 2"             | 100 | —  |                                    | 150        | 50 |
| 2 1/2"         | 100 | —  |                                    | 150        | 50 |
| 3"             | 100 | —  |                                    | 250        | 50 |
| 4"             | 100 | —  |                                    | 250        | 50 |
| 5"             | 100 | —  |                                    | 250        | 50 |
| 6"             | 100 | —  |                                    | 250        | 50 |
| 8"             | 100 | —  |                                    | 250        | 50 |
| 10"            | 130 | 9  | CUT FROM<br>H-200X200X8X12         | —          | 50 |
| 12"            | 130 | 9  |                                    | —          | 50 |
| 14"            | 130 | 9  |                                    | —          | 50 |
| 16"            | 250 | 12 | FAB. FROM<br>12 <sup>t</sup> PLATE | —          | 50 |
| 18"            | 250 | 12 |                                    | —          | 50 |
| 20"            | 250 | 12 |                                    | —          | 50 |
| 24"            | 300 | 12 |                                    | —          | 50 |

NOTES : (FOR SH'T D-80,80A ONLY)

1. SHOES FOR PIPES 1 1/2" & SMALLER MAY BE FABRICATED FROM 6<sup>t</sup> PLATE, 2" THRU. 14" FROM 9<sup>t</sup> PLATE, 16" THRU. 24" FROM 12<sup>t</sup> PLATE
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 66-1 1/2B(P)-A(A)-130-500
- DENOTE TYPE NO. —
- DENOTE LINE SIZE —
- DENOTE REIN. PAD IS REQ'D —
- SEE SH'T D-80A TABLE "A" —
- SEE SH'T D-80A TABLE "B" —
- MODIFY LOPS=500 (IN mm) IF ANY
- MODIFY HOPS=130 (IN mm) IF ANY
3. FOR PADS MATERIAL USE PIPE MATERIAL THAT CUT FROM THE PIPE OR EQUIVALENT TO THE PIPE.
4. LONGITUDINAL LENGTH OF PIPE SHOE (SAY LOPS) SHALL BE CALCULATED IN THE CASE WITH PIPE STOP.
5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FILE: D-80M.DWG

|                                            |          |  |       |      |  |                                                       |  |                      |           |
|--------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司                               |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br><br>TYPE-66<br><br>(1 OF 3) |  | ENGINEERING STANDARD |           |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  |                                                       |  | HP6-DSD-A4-500-001   |           |
| BY                                         | SHIH     |  | CHK.  | YANG |  |                                                       |  | D-80                 | REV.<br>1 |
| DATE                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                       |  |                      |           |

NOTES : (CONT'D)

5.

TABLE "A"



| INSULATION TH'K<br>(mm) | HEIGHT OF<br>SHOE (mm)<br>(SAY HOPS) | SYMBOL |
|-------------------------|--------------------------------------|--------|
| 75 & LESSER             | 100                                  | NONE   |
| 80 THRU. 125            | 150                                  | A      |
| 130 THRU. 175           | 200                                  | B      |
| 180 THRU. 200           | 220(NOTE 1)                          | C      |

TABLE "B"

| MAT'L OF SHOES  | FABRICATED FROM<br>(NOTE 1) | SYMBOL |
|-----------------|-----------------------------|--------|
| CARBON STEEL    | SHAPE STEEL OR C/S<br>PLATE | NONE   |
| ALLOY STEEL     | A/S PLATE                   | (A)    |
| STAINLESS STEEL | S/S PLATE                   | (S)    |

6. FOR MATERIAL SPECIFICATION SEE SH'T P-2.



7. FIELD WELD OF PIPE SHOE .

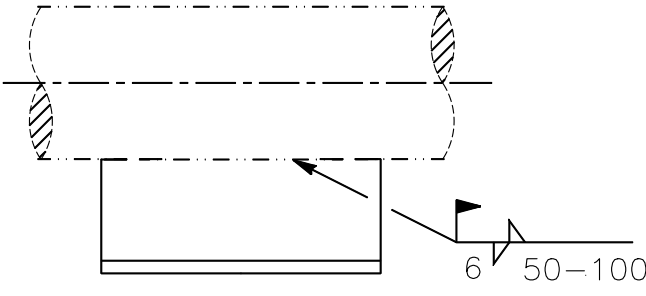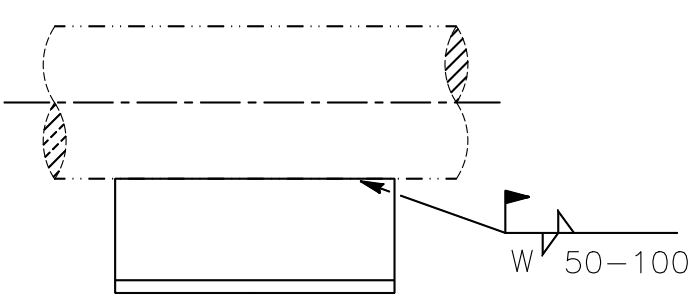

W=4 FOR PIPE SCH. 80 & BELOW  
W=6 FOR PIPE SCH. 160 & ABOVE

1/2"~2"

2 1/2"~8"

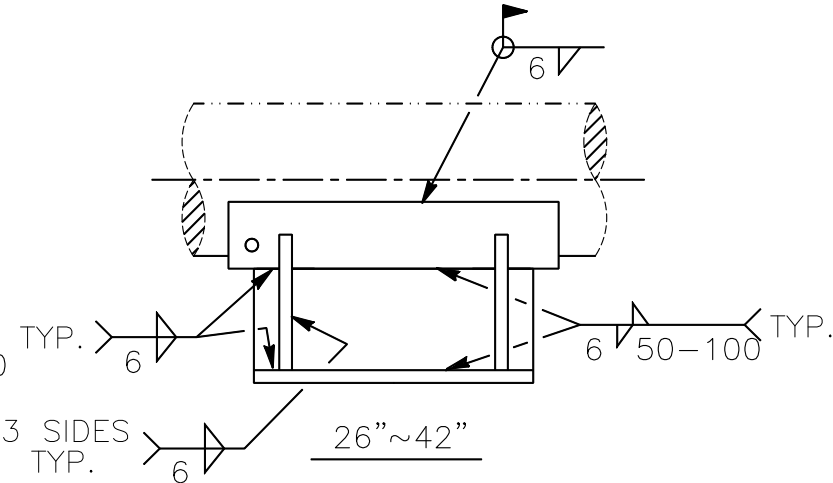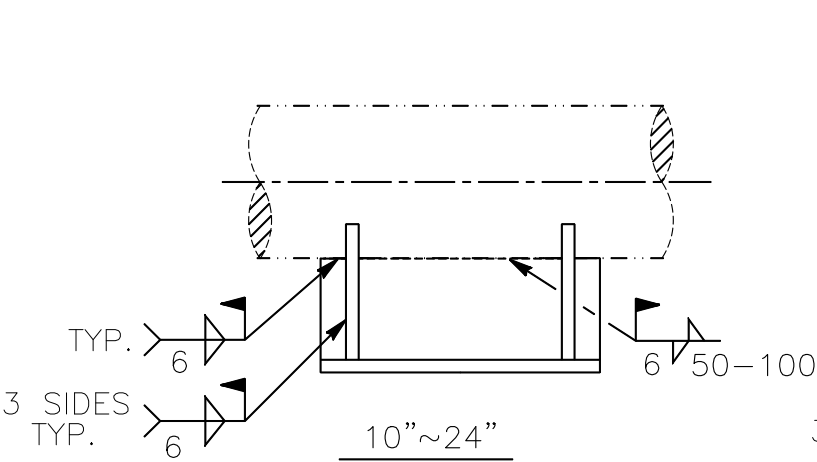

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

DETAIL OF PIPE SUPPORT  
TYPE-66

ENGINEERING STANDARD


HP6-DSD-A4-500-001

|      |          |  |       |      |  |
|------|----------|--|-------|------|--|
| BY   | SHIH     |  | CHK.  | YANG |  |
| DATE | 7/15/'24 |  | APPR. | CHEN |  |

(2 OF 3)

D-80A  
REV. 1

FOR PIPE SIZE 26"-50"

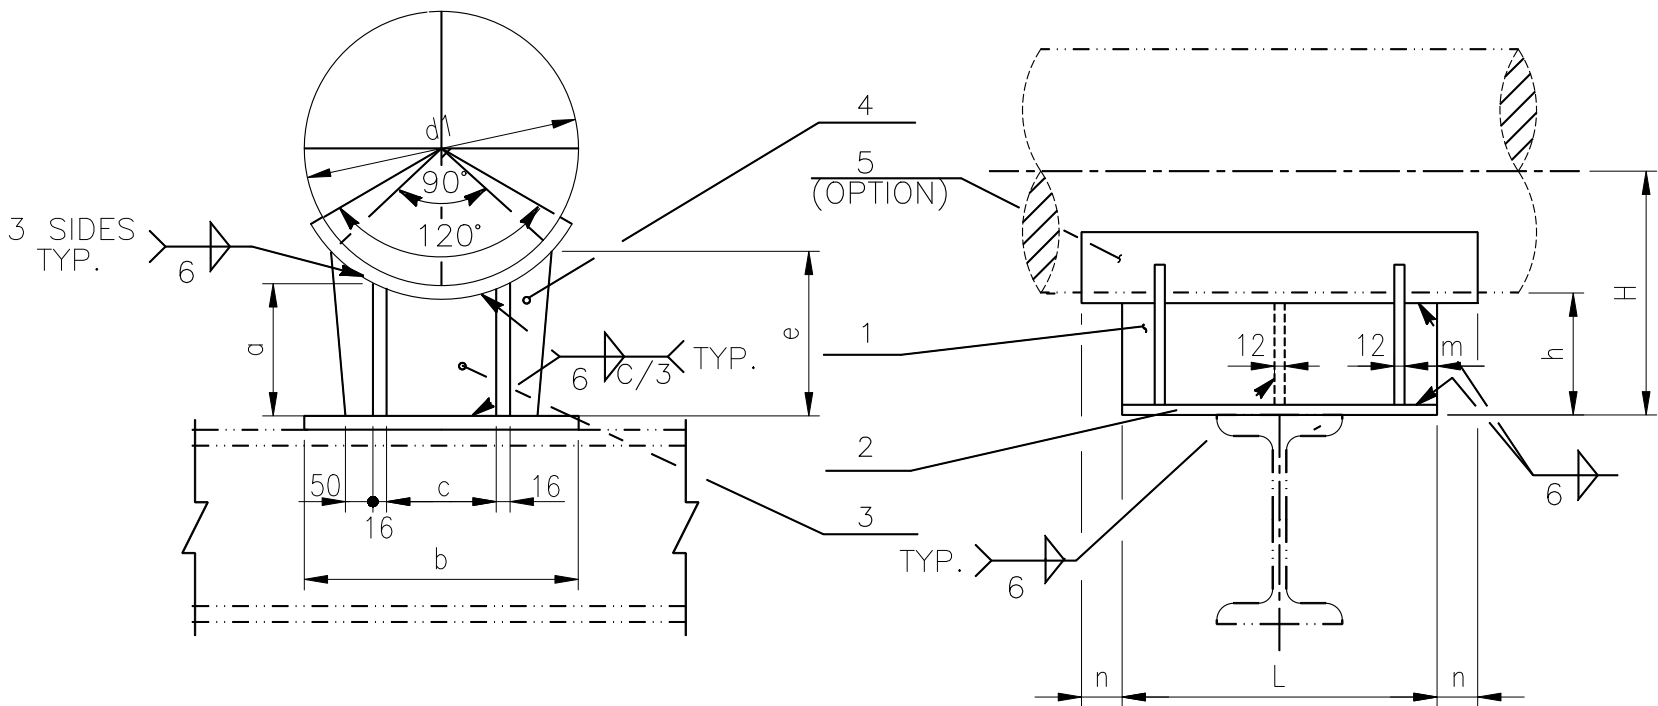

(FOR OTHER WELDS, SEE SH'T D-80A NOTE 7)

DIMENSION (mm)

| NO           | 1                  |               | 2          | 3       | 4       | 5              | DIMENSION |     |            |     |          |     |          |     |     |    |    |
|--------------|--------------------|---------------|------------|---------|---------|----------------|-----------|-----|------------|-----|----------|-----|----------|-----|-----|----|----|
| PIECE        | 2                  |               | 1          | 1       | 4       | 1              |           |     |            |     |          |     |          |     |     |    |    |
| PIPE<br>SIZE | (NOTE 4)<br>FOOT a |               | FOOT PLATE | PLATE   | PLATE   | PAD            |           |     |            |     |          |     |          |     |     |    |    |
|              | A<br>(NOTE 2)      | B<br>(NOTE 2) |            |         |         |                | b         | c   | e          |     | h        |     | H        |     | L   | m  | n  |
|              |                    |               |            |         |         |                |           |     | (NOTE 2,4) |     | (NOTE 2) |     | (NOTE 2) |     |     |    |    |
|              |                    |               |            |         |         |                |           |     | A          | B   | A        | B   | A        | B   |     |    |    |
| 26"          | 148                | 198           | 16 TH'K    | 12 TH'K | 12 TH'K | 12 TH'K (MIN.) | 430       | 230 | 222        | 272 | 150      | 200 | 480      | 530 | 540 | 35 | 75 |
| 28"          | 148                | 198           |            |         |         |                | 440       | 240 | 230        | 280 | 150      | 200 | 506      | 556 | 540 | 35 | 75 |
| 30"          | 148                | 198           |            |         |         |                | 450       | 250 | 237        | 287 | 150      | 200 | 531      | 581 | 540 | 35 | 75 |
| 32"          | 148                | 198           |            |         |         |                | 460       | 260 | 244        | 294 | 150      | 200 | 556      | 606 | 740 | 40 | 75 |
| 36"          | 152                | 202           |            |         |         |                | 500       | 300 | 259        | 309 | 150      | 200 | 607      | 657 | 740 | 40 | 75 |
| 40"          | 156                | 206           |            |         |         |                | 535       | 335 | 274        | 324 | 150      | 200 | 658      | 708 | 740 | 40 | 75 |
| 42"          | 156                | 206           |            |         |         |                | 550       | 350 | 281        | 331 | 150      | 200 | 683      | 733 | 740 | 40 | 75 |
| 44"          | 163                | 213           |            |         |         |                | 594       | 394 | 290        | 340 | 150      | 200 | 710      | 860 | 940 | 45 | 75 |
| 46"          | 167                | 217           |            |         |         |                | 620       | 420 | 297        | 347 | 150      | 200 | 734      | 884 | 940 | 45 | 75 |
| 48"          | 171                | 221           |            |         |         |                | 650       | 450 | 305        | 355 | 150      | 200 | 760      | 910 | 940 | 45 | 75 |
| 50"          | 174                | 224           | 690        | 478     | 312     | 362            | 150       | 200 | 785        | 935 | 1140     | 50  | 75       |     |     |    |    |

NOTES : ( FOR SH'T D-80B ONLY)

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-28B-A(A)-130-500

DENOTE TYPE NO. \_\_\_\_\_ MODIFY LOPS=500 (IN mm) IF ANY  
DENOTE LINE SIZE \_\_\_\_\_ MODIFY HOPS=130 (IN mm) IF ANY  
SEE NOTE 2 \_\_\_\_\_ SEE SH'T D-80A TABLE "B"

2. TYPE-A FOR INSULATION THICKNESS  $\leq 100$   
TYPE-B FOR INSULATION THICKNESS  $> 100 \leq 150$

3. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE  
700°F & PRESSURE 300 PSI.

4. DIMENSION "a" & "e" ARE CALCULATED BASE ON PIPE SHOE WITH 12 mm  
TH'K REINF. PAD.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

DETAIL OF PIPE SUPPORT  
TYPE-66

ENGINEERING STANDARD

HP6-DSD-A4-500-001

BY SHIH  
DATE 7/15/'24  
CHK. YANG  
APPR. CHEN

(3 OF 3)

D-80B

REV.  
1

FILE: D-80MB.DWG



| DIMENSIONS (mm) |     |    |                                    |                           |                  |
|-----------------|-----|----|------------------------------------|---------------------------|------------------|
| LINE SIZE       | A   | B  | C                                  | PIPE CLAMP TYPE           | D <sup>(2)</sup> |
| 1/2"            | 100 | —  | CUT FROM<br>H200X100X5.5X8         | PCL—A—1/2B                | 80               |
| 3/4"            | 100 | —  |                                    | PCL—A—3/4B                | 80               |
| 1"              | 100 | —  |                                    | PCL—A— 1B                 | 80               |
| 1 1/2"          | 100 | —  |                                    | PCL—A—1 1/2B              | 80               |
| 2"              | 100 | —  |                                    | PCL—A— 2B                 | 80               |
| 2 1/2"          | 100 | —  |                                    | PCL—A—2 1/2B              | 80               |
| 3"              | 100 | —  |                                    | PCL—A— 3B                 | 180              |
| 4"              | 100 | —  |                                    | PCL—A— 4B                 | 180              |
| 5"              | 100 | —  |                                    | PCL—A— 5B                 | 180              |
| 6"              | 100 | —  |                                    | PCL—A— 6B                 | 180              |
| 8"              | 100 | —  |                                    | PCL—A— 8B                 | 180              |
| 10"             | 130 | 9  |                                    | CUT FROM<br>H200X200X8X12 | PCL—A— 10B       |
| 12"             | 130 | 9  | PCL—A— 12B                         |                           | —                |
| 14"             | 130 | 9  | PCL—A— 14B                         |                           | —                |
| 16"             | 250 | 12 | FAB. FROM<br>12 <sup>t</sup> PLATE | PCL—A— 16B                | —                |
| 18"             | 250 | 12 |                                    | PCL—A— 18B                | —                |
| 20"             | 250 | 12 |                                    | PCL—A— 20B                | —                |
| 24"             | 300 | 12 |                                    | PCL—A— 24B                | —                |

DENOTE TYPE NO. \_\_\_\_\_

DENOTE LINE SIZE \_\_\_\_\_

\_\_\_\_\_ MODIFY LOPS=500 (IN mm) IF ANY


\_\_\_\_\_ MODIFY HOPS=130 (IN mm) IF ANY

\_\_\_\_\_ SEE NOTE 4

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                   |          |  |       |      |  |                                                                |  |                      |           |
|-----------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------------------------------------------------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> </div> |          |  |       |      |  | <div> DETAIL OF PIPE SUPPORT<br/> TYPE-67<br/> (1 OF 2) </div> |  | ENGINEERING STANDARD |           |
|                                                                                   |          |  |       |      |  |                                                                |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                | SHIH     |  | CHK.  | YANG |  |                                                                |  |                      |           |
| DATE                                                                              | 7/15/'24 |  | APPR. | CHEN |  |                                                                |  | D-81                 | REV.<br>1 |

FOR PIPE SIZE 26"-42"

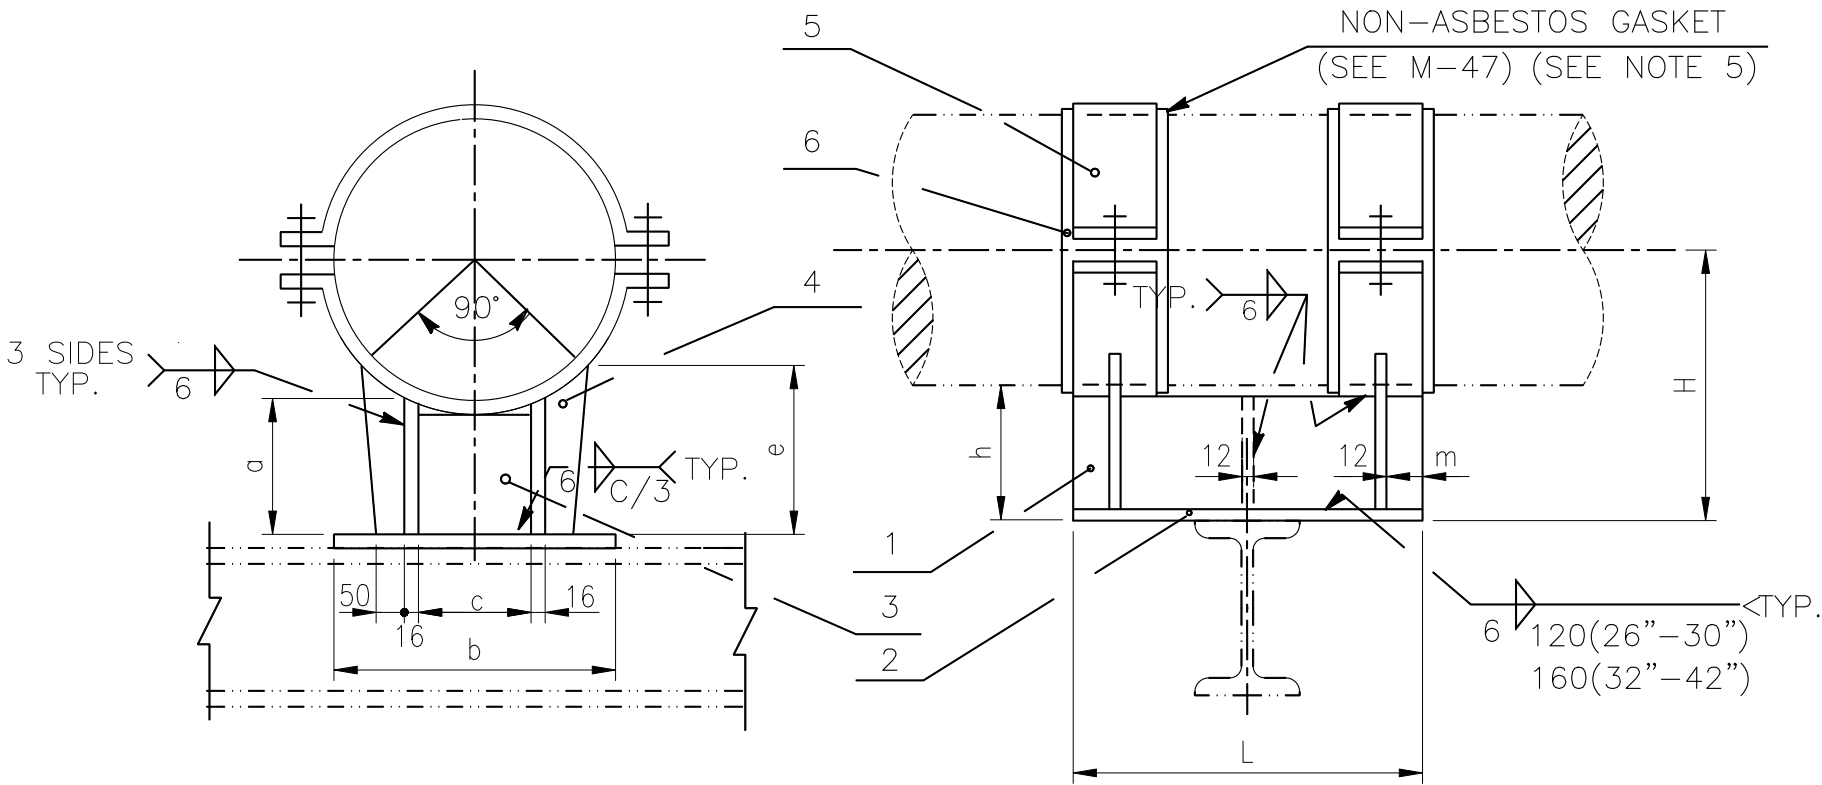


DIMENSIONS (mm)

|              |           |     |            |         |         |               |                        |           |     |     |     |     |     |     |     |     |    |
|--------------|-----------|-----|------------|---------|---------|---------------|------------------------|-----------|-----|-----|-----|-----|-----|-----|-----|-----|----|
| NO.          | 1         |     | 2          | 3       | 4       | 5             | 6                      | DIMENSION |     |     |     |     |     |     |     |     |    |
| PIECE        | 2         |     | 1          | 1       | 4       | 2             | 2                      |           |     |     |     |     |     |     |     |     |    |
| PIPE<br>SIZE | FOOT<br>a |     | FOOT PLATE | PLATE   | PLATE   | CLAMP (NOTE3) | NON-ASBESTOS<br>GASKET |           |     |     |     |     |     |     |     |     |    |
|              | A         | B   |            |         |         |               |                        | b         | c   | e   |     | h   |     | H   |     | L   | m  |
|              |           |     |            |         |         |               |                        |           |     | A   | B   | A   | B   | A   | B   |     |    |
| 26"          | 148       | 198 | 16 TH'K    | 12 TH'K | 12 TH'K | FAB. FROM 12t | 1.5t TH'K              | 430       | 230 | 222 | 272 | 150 | 200 | 480 | 530 | 540 | 35 |
| 28"          | 148       | 198 |            |         |         |               |                        | 440       | 240 | 230 | 280 | 150 | 200 | 506 | 556 | 540 | 35 |
| 30"          | 148       | 198 |            |         |         |               |                        | 450       | 250 | 237 | 287 | 150 | 200 | 531 | 581 | 540 | 35 |
| 32"          | 148       | 198 |            |         |         |               |                        | 460       | 260 | 244 | 294 | 150 | 200 | 556 | 606 | 740 | 40 |
| 36"          | 152       | 202 |            |         |         |               |                        | 500       | 300 | 259 | 309 | 150 | 200 | 607 | 657 | 740 | 40 |
| 40"          | 156       | 206 |            |         |         |               |                        | 535       | 335 | 274 | 324 | 150 | 200 | 658 | 708 | 740 | 40 |
| 42"          | 156       | 206 |            |         |         |               |                        | 550       | 350 | 281 | 331 | 150 | 200 | 683 | 733 | 740 | 40 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

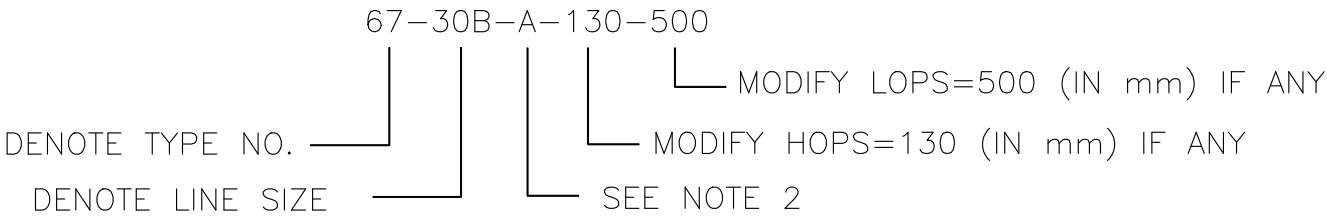

2. TYPE-A FOR INSULATION THICKNESS < 100

TYPE-B FOR INSULATION THICKNESS > 100 < 150

3. FOR CLAMP DETAIL SEE SH'T M-56.

4. FOR NON-ASBESTOS GASKET SEE SH'T M-47 .


5. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES (MAX. LINE TEMP.: 750°F)

6. LOADING CONDITION : CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F

7. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.


FILE: D-81MA.DWG

|                                                            |          |  |       |      |  |                                               |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-67<br>(2 OF 2) |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                               |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                               |  | D-81A                | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |  |                      |           |

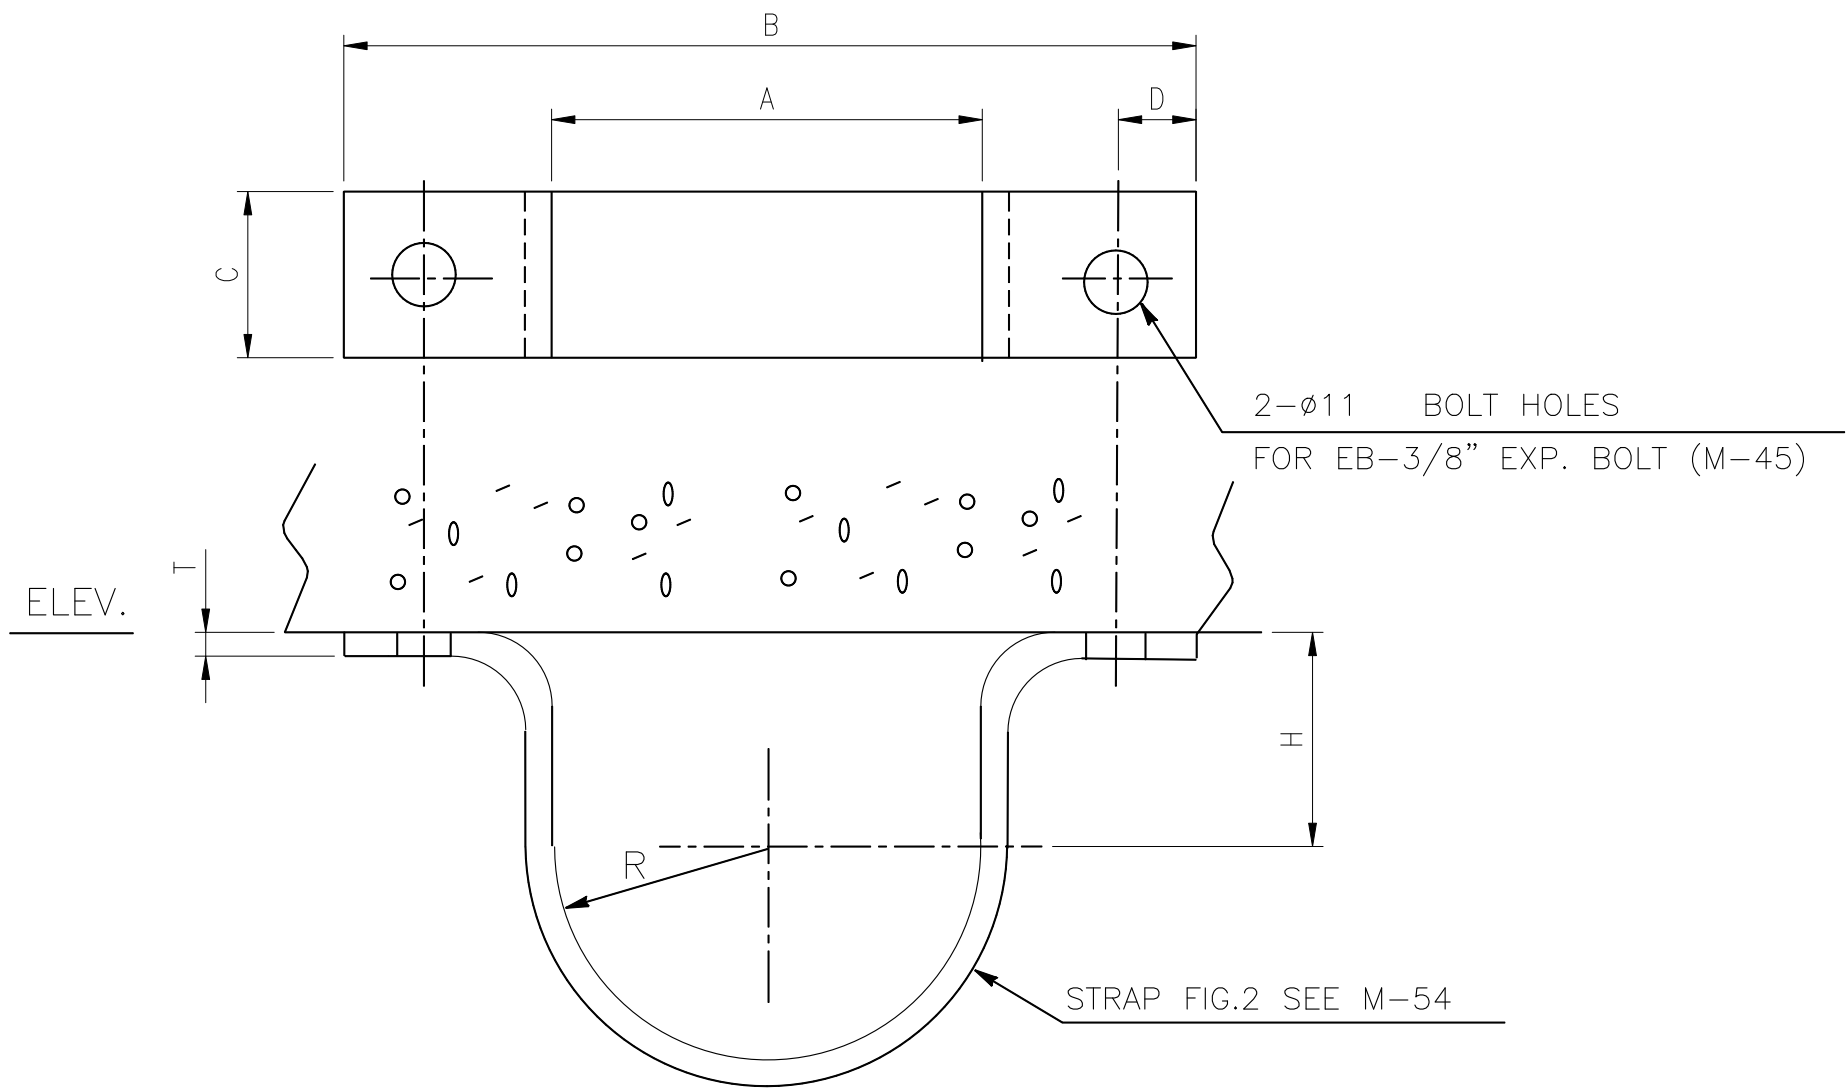

| LINE SIZE | A     | B   | T | C  | H    | R    | D  |
|-----------|-------|-----|---|----|------|------|----|
| 3/4"      | 30    | 110 | 6 | 32 | 13.4 | 15   | 20 |
| 1"        | 36.6  | 120 | 6 | 32 | 16.7 | 18.3 | 20 |
| 1 1/2"    | 51.6  | 140 | 6 | 50 | 24.2 | 25.8 | 20 |
| 2"        | 63.6  | 150 | 6 | 50 | 30.2 | 31.8 | 20 |
| 2 1/2"    | 76    | 220 | 9 | 65 | 36.5 | 38   | 40 |
| 3"        | 92    | 230 | 9 | 65 | 44.5 | 46   | 40 |
| 3 1/2"    | 105   | 240 | 9 | 65 | 50.8 | 52.5 | 40 |
| 4"        | 117.6 | 255 | 9 | 65 | 57.2 | 58.8 | 40 |


NOTE:  
1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

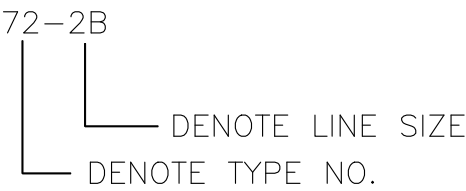

FILE: D-87M.DWG

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  |                      |        |
| DETAIL OF PIPE SUPPORT<br>TYPE-72                          |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | D-87                 | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                      |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |




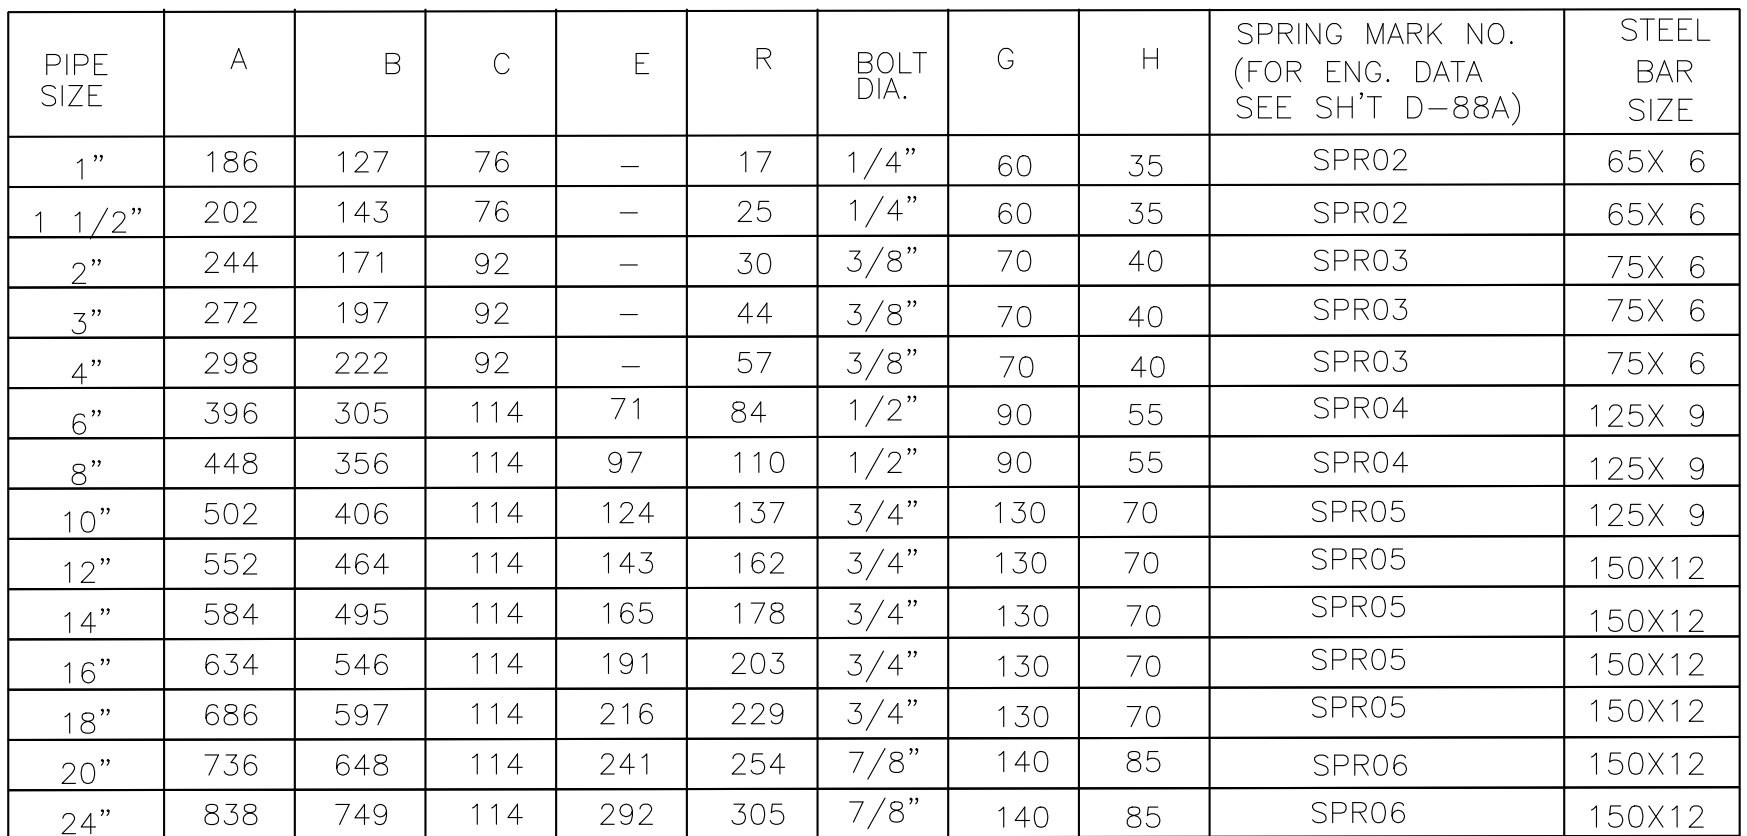

|                                                                                                                                                                 |          |  |       |      |  |                      |           |
|-----------------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/><br/> TYPE-73<br/><br/> (1 OF 2) </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                                                                                 |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                                                                                              | SHIH     |  | CHK.  | YANG |  | D-88                 | REV.<br>1 |
| DATE                                                                                                                                                            | 7/15/'24 |  | APPR. | CHEN |  |                      |           |


| ENGINEERING DATA OF SPRING COILS |                      |                      |                           |                             |                               |                        |
|----------------------------------|----------------------|----------------------|---------------------------|-----------------------------|-------------------------------|------------------------|
| SPRING<br>MARK NO.               | DIA. OF<br>WIRE (MM) | I.D. OF<br>COIL (MM) | NO. OF<br>ACTIVE<br>COILS | NO. OF<br>INACTIVE<br>COILS | SPRING<br>CONSTANT<br>(KG/MM) | FREE<br>LENGTH<br>(MM) |
| SPR02                            | 2                    | 15                   | 5                         | 2                           | 0.7                           | 25                     |
| SPR03                            | 3                    | 19                   | 4                         | 2                           | 1.9                           | 30                     |
| SPR04                            | 4                    | 24                   | 4                         | 2                           | 2.9                           | 40                     |
| SPR05                            | 5                    | 34                   | 3                         | 2                           | 3.5                           | 55                     |
| SPR06                            | 6                    | 39                   | 3                         | 2                           | 4.7                           | 65                     |

\* MATERIAL OF SPRING COILS : ASTM A229 CLASS 1

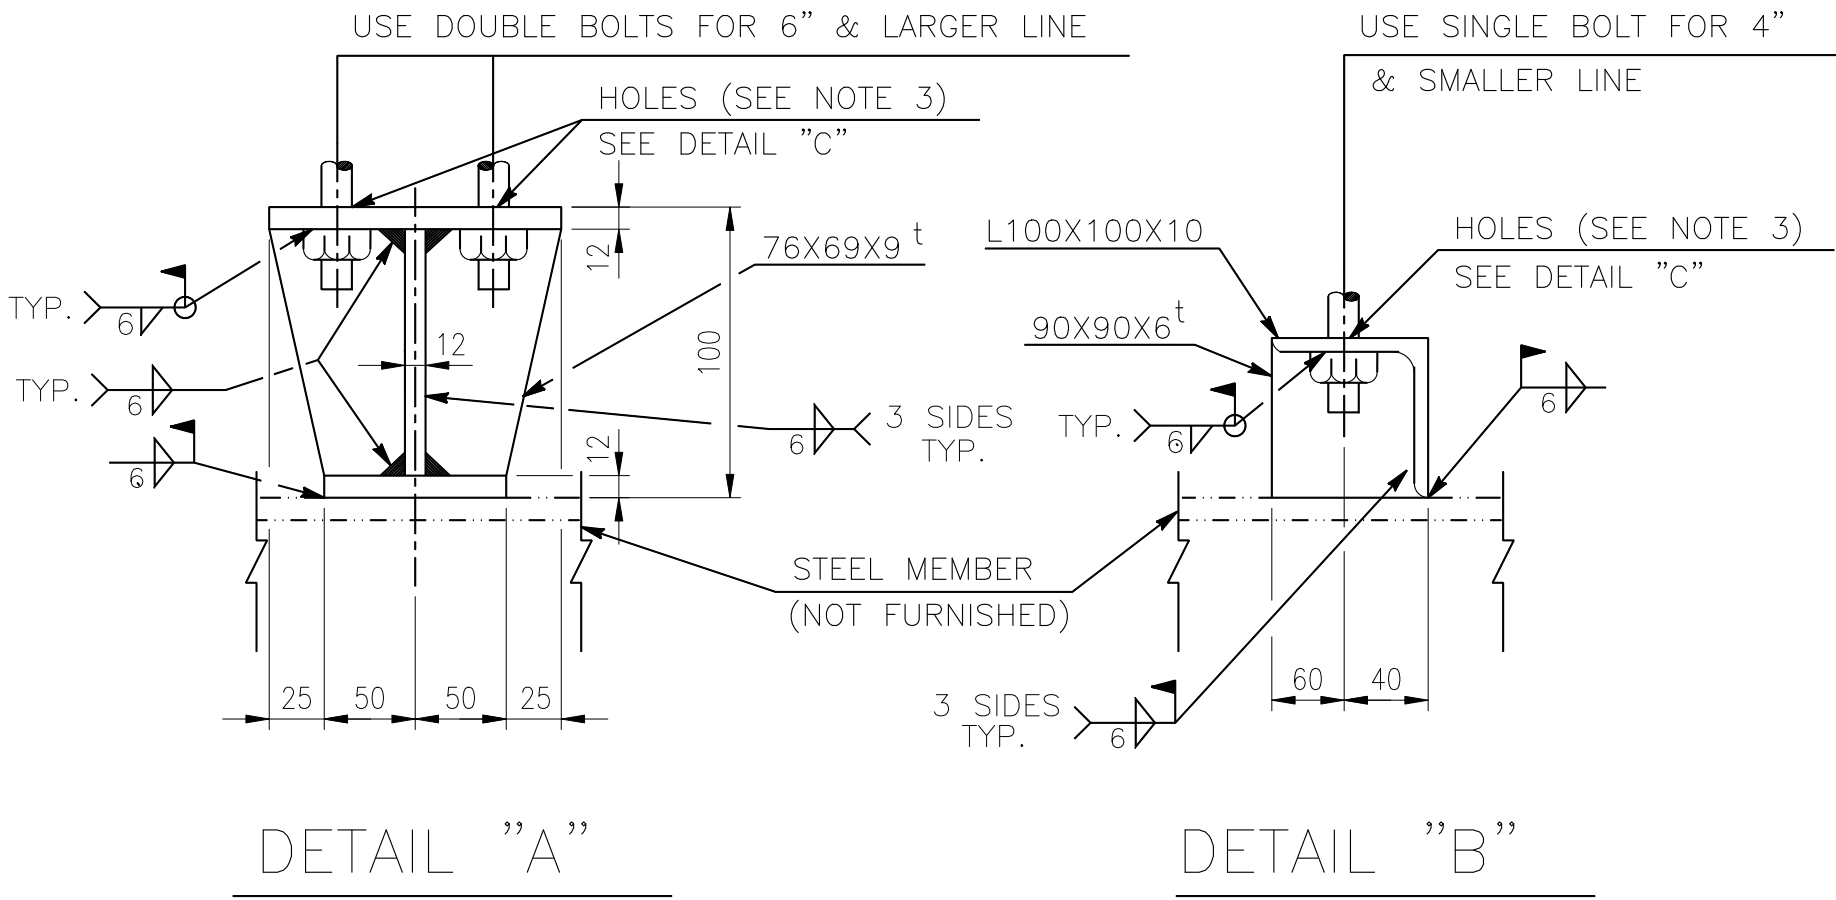


NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOW :

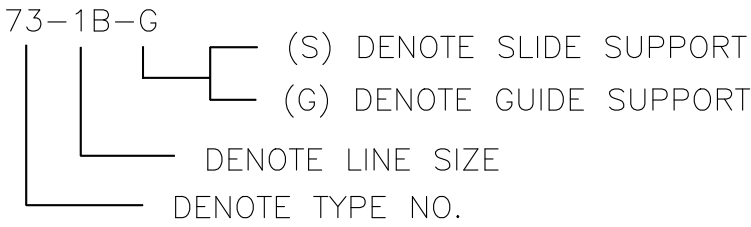

2. BASEPLATES CAN BE CONTINUOUS WHERE HOLDDOWNS ARE ADJACENT TO ONE ANOTHER.

3. L = D+3, USE FOR GUIDE SUP'T  
= 2D, USE FOR SLIDE SUP'T



DETAIL "C"

FILE: D-88MA.DWG


|                                                            |          |  |       |      |  |                                               |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                          |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                            |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-73<br>(2 OF 2) | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |           |





|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                      |  |
| TYPE-76                                                    |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
|                                                            |          |  |       |      |  | D-91                 |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | REV.<br>1            |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |

FILE: D-91M.DWG

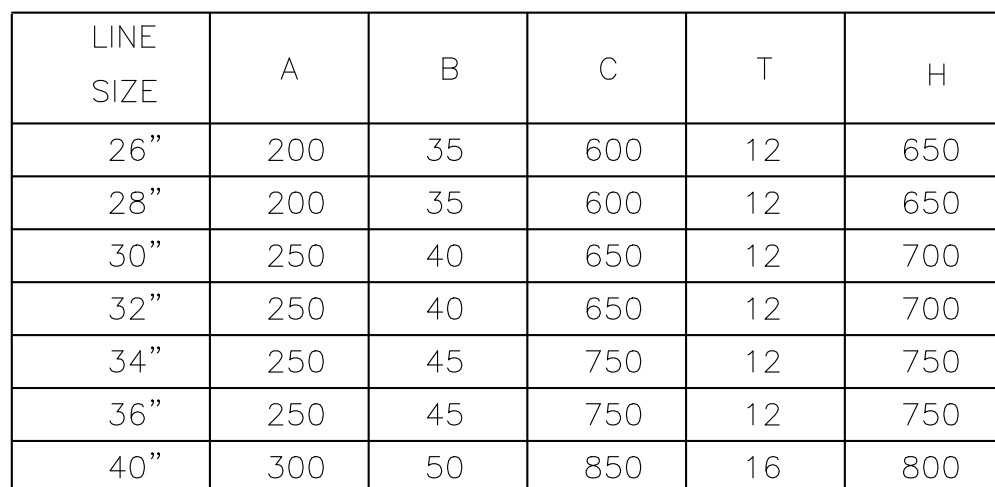

1. MATERIAL FOR SADDLES TO BE IDENTICAL OR SIMILAR TO THE MATERIAL OF THE PIPES .


77-26B-(A)

SEE SH'T D-80A TABLE "B"

DENOTE LINE SIZE

DENOTE TYPE NO.


|                                                            |  |  |  |  |  |                      |  |                    |
|------------------------------------------------------------|--|--|--|--|--|----------------------|--|--------------------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |  |  |  |  |  | ENGINEERING STANDARD |  |                    |
|                                                            |  |  |  |  |  |                      |  | HP6-DSD-A4-500-001 |
| DETAIL OF PIPE SUPPORT<br><br>TYPE-77                      |  |  |  |  |  | D-92                 |  | REV.<br>1          |
|                                                            |  |  |  |  |  |                      |  |                    |

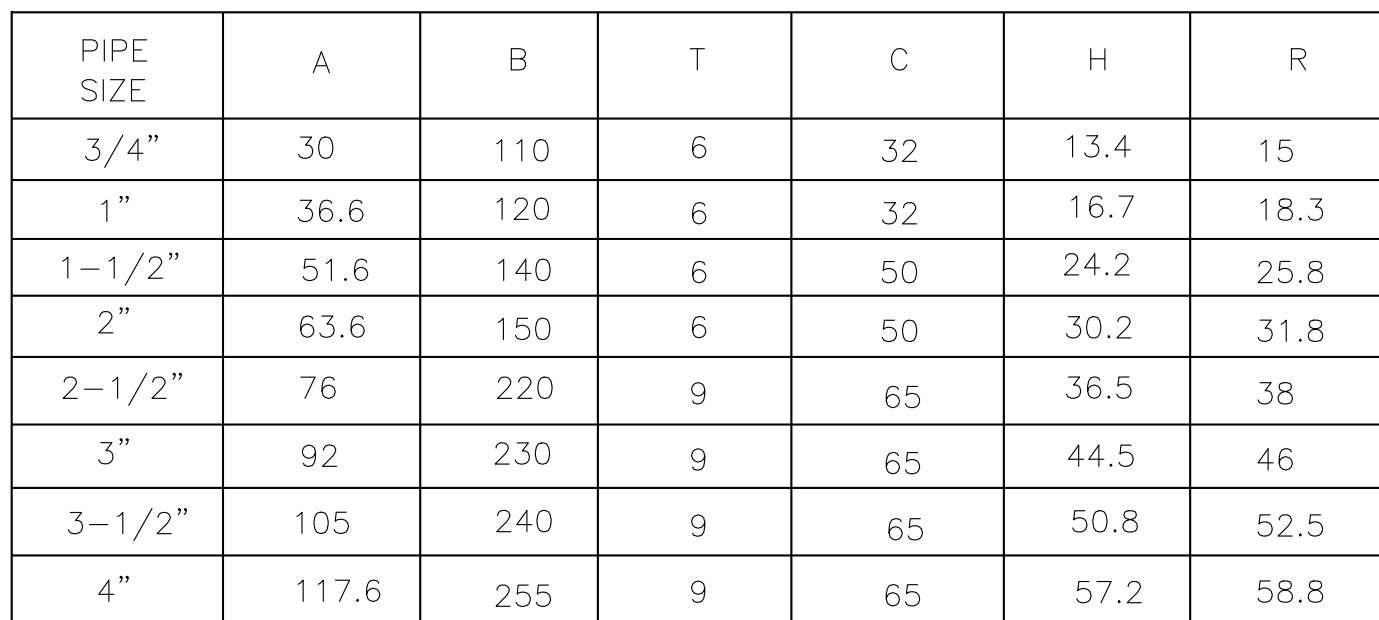

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

REV.  
1

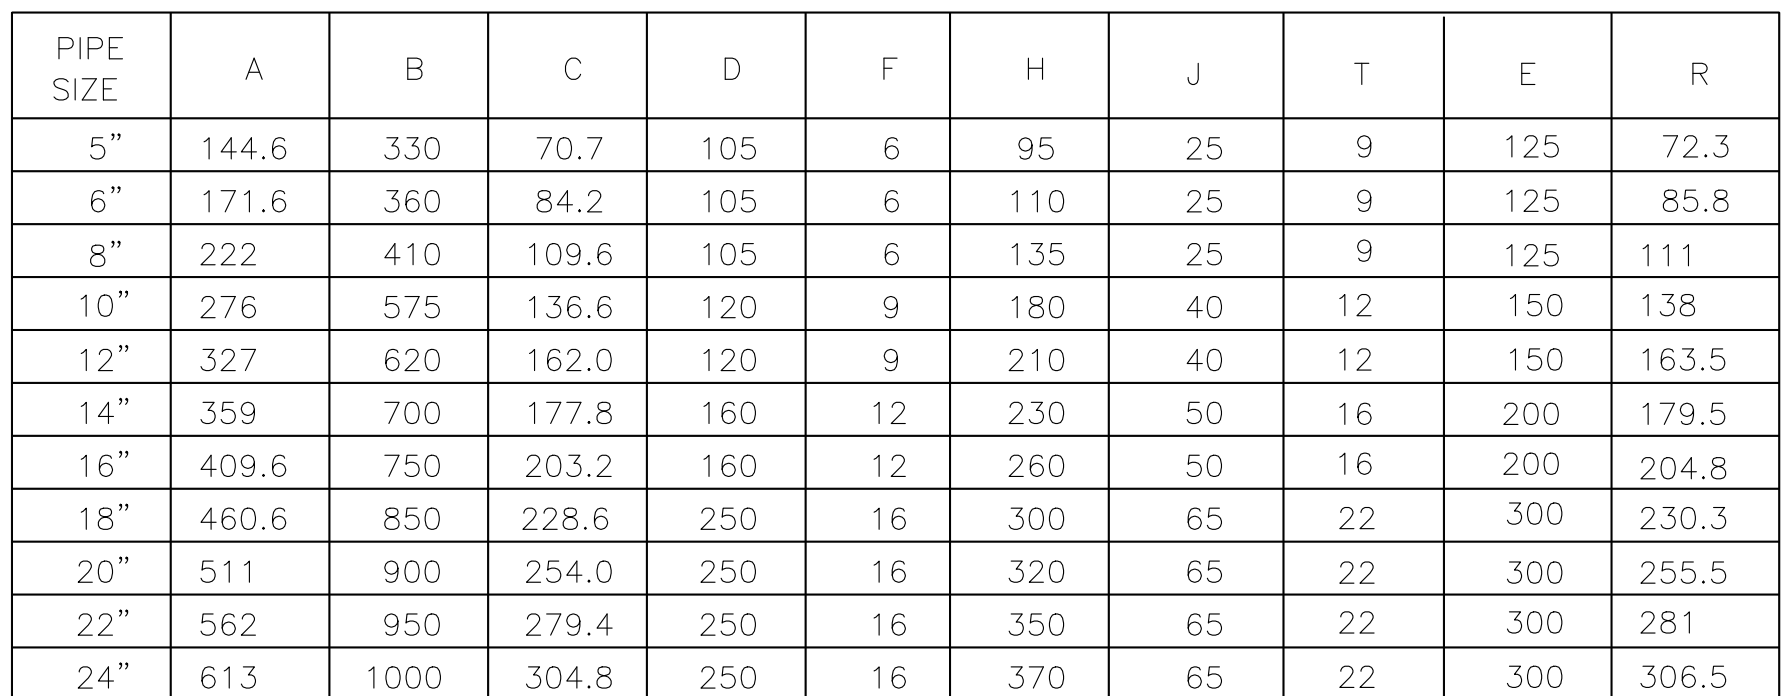

- DENOTE FOR ANCHOR TYPE.
- DENOTE LINE SIZE
- DENOTE TYPE NO.

|                                                                                   |          |  |       |      |  |                                                  |  |                                 |      |
|-----------------------------------------------------------------------------------|----------|--|-------|------|--|--------------------------------------------------|--|---------------------------------|------|
| <div> <div> 中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> </div> |          |  |       |      |  | <div> DETAIL OF PIPE SUPPORT<br/> TYPE-79 </div> |  | ENGINEERING STANDARD            |      |
|                                                                                   |          |  |       |      |  |                                                  |  | <div> HP6-DSD-A4-500-001 </div> |      |
| BY                                                                                | SHIH     |  | CHK.  | YANG |  |                                                  |  | D-94                            | REV. |
| DATE                                                                              | 7/15/'24 |  | APPR. | CHEN |  |                                                  |  |                                 | 1    |



| LINE<br>SIZE | A   | B   | C                                  | D   | E  |
|--------------|-----|-----|------------------------------------|-----|----|
| 3/4"         | 100 | 100 | CUT FROM<br>H200X100X5.5X8         | —   | —  |
| 1"           | 100 | 100 |                                    | —   | —  |
| 1 1/2"       | 100 | 100 |                                    | —   | —  |
| 2"           | 100 | 100 |                                    | —   | —  |
| 2 1/2"       | 100 | 100 |                                    | —   | —  |
| 3"           | 100 | 100 |                                    | —   | —  |
| 4"           | 100 | 100 |                                    | —   | —  |
| 5"           | 100 | 100 |                                    | —   | —  |
| 6"           | 100 | 100 |                                    | —   | —  |
| 8"           | 100 | 100 |                                    | —   | —  |
| 10"          | 200 | 200 | CUT FROM<br>H200X200X8X12          | 70  | —  |
| 12"          | 200 | 200 |                                    | 70  | —  |
| 14"          | 200 | 200 |                                    | 70  | —  |
| 16"          | 300 | 250 | FAB. FROM<br>12 <sup>t</sup> PLATE | 100 | 12 |
| 18"          | 300 | 250 |                                    | 100 | 12 |
| 20"          | 300 | 250 |                                    | 100 | 12 |
| 24"          | 350 | 250 |                                    | 100 | 12 |

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:


80-2B(P)-A(A)-130-500

|                           |  |  |  |  |  |                                |
|---------------------------|--|--|--|--|--|--------------------------------|
| DENOTE TYPE NO.           |  |  |  |  |  | MODIFY LOPS=500 (IN mm) IF ANY |
| DENOTE LINE SIZE          |  |  |  |  |  | MODIFY HOPS=130 (IN mm) IF ANY |
| DENOTE REIN. PAD IS REQ'D |  |  |  |  |  | SEE SH'T D-80A TABLE "B"       |
|                           |  |  |  |  |  | SEE SH'T D-80A TABLE "A"       |

2. LENGTH OF PIPE SHOE (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.

3. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FOR PIPE SIZE 26"-42"

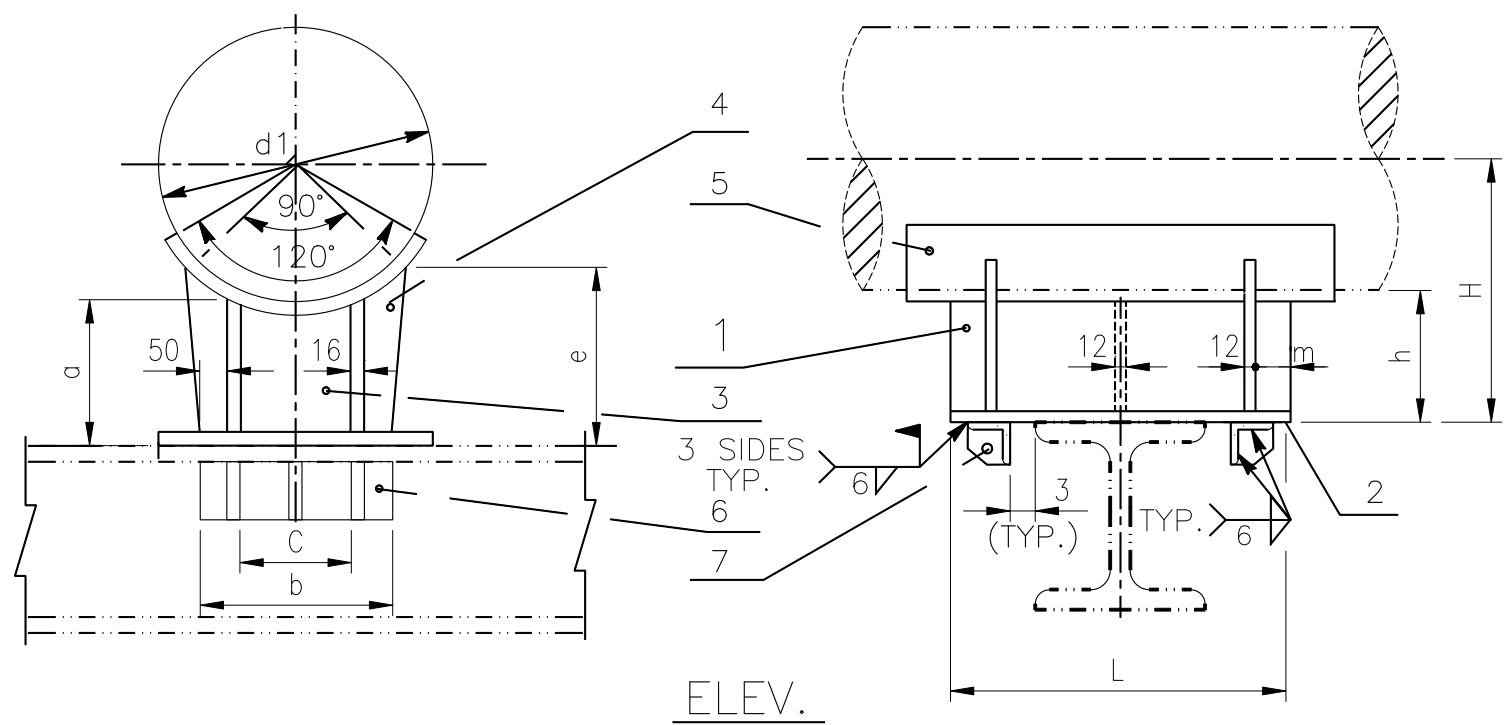

| NO.       | 6          | 7      |
|-----------|------------|--------|
| PIECE     | 2          | 6      |
| PIPE SIZE | STOP ANGLE | PLATE  |
| 26"       | L100X10    | 6 TH'K |
| 28"       |            |        |
| 30"       |            |        |
| 32"       |            |        |
| 36"       |            |        |
| 40"       |            |        |
| 42"       |            |        |

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.
2. DESIGNATION NUMBER DENOTE AS FOLLOW :

80-30B-A(A)-130-500

DENOTE TYPE NO. 

┌

└

DENOTE LINE SIZE 

┌

└

SEE NOTE 3 

┌

└

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"

3. TYPE-A FOR INSULATION THICKNESS < 100  
TYPE-B FOR INSULATION THICKNESS > 100 < 150

4. LOADING CONDITION : CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F &amp; PRESSURE 300 PSI.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FILE: D-96M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-96                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-80                          |          |  |       |      |  | (2 OF 2)             |  |
|                                                            |          |  |       |      |  | REV. 1               |  |





NOTES :


- 81-2B-A-130-500
- DENOTE TYPE NO. ————
- DENOTE LINE SIZE ————
- MODIFY LOPS=500 (IN mm) IF ANY
- MODIFY HOPS=130 (IN mm) IF ANY
- SEE SH'T D-80A TABLE "A"

2. PIPE SHOE LENGTH (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.

3. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES (MAX. LINE TEMP. : 750°F).

4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                                                                                       |          |  |       |      |  |                      |           |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-81<br/> (1 OF 2) </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                                                                       |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                                                                                    | SHIH     |  | CHK.  | YANG |  | D-97                 | REV.<br>1 |
| DATE                                                                                                                                                  | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

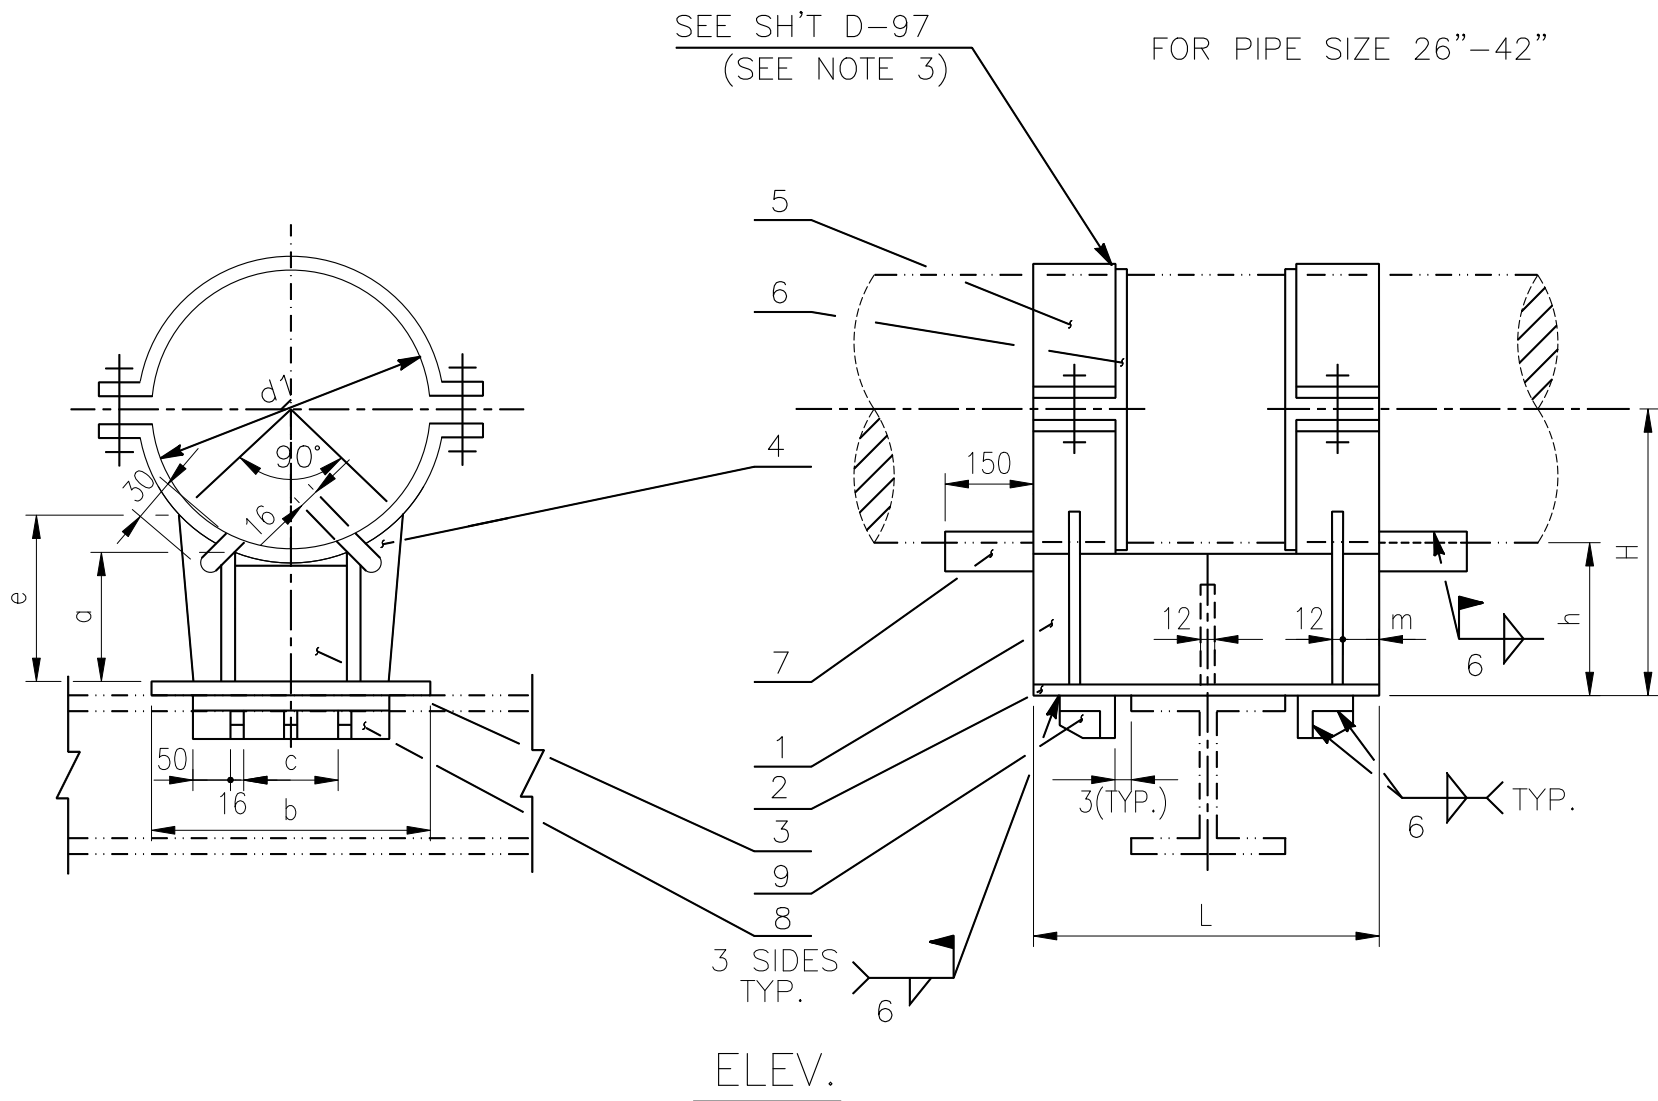

DIMENSIONS (mm)

| NO.       | 7                      | 8          | 9      |
|-----------|------------------------|------------|--------|
| PIECE     | 4                      | 2          | 6      |
| PIPE SIZE | (NOTE 4)<br>STOP PIECE | STOP ANGLE | PLATE  |
| 26"       | PLATE 16 TH'K          | L100X10    | 6 TH'K |
| 28"       |                        |            |        |
| 30"       |                        |            |        |
| 32"       |                        |            |        |
| 36"       |                        |            |        |
| 40"       |                        |            |        |
| 42"       |                        |            |        |

NOTES :

1. FOR DIMENTIONS AND INFORMATION NOT SHOWN ON THIS DWG., SEE SH'T D-81A.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 81-30B-A(A)-130-500

DENOTE TYPE NO.  DENOTE LINE SIZE  SEE SH'T D-80A TABLE "A"  SEE SH'T D-80A TABLE "B"

MODIFY LOPS=500 (IN mm) IF ANY


MODIFY HOPS=130 (IN mm) IF ANY
3. TYPE-A FOR INSULATION THICKNESS < 100 mm  
TYPE-B FOR INSULATION THICKNESS > 100 mm <\_150 mm
4. MATERIAL FOR STOP PIECES ACCORDING TO PIPE MATERIAL.
5. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700.F.
6. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

FILE: D-98M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-98                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-81                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  | (2 OF 2)             |  |



FOR PIPE SIZE 3/4"-24"

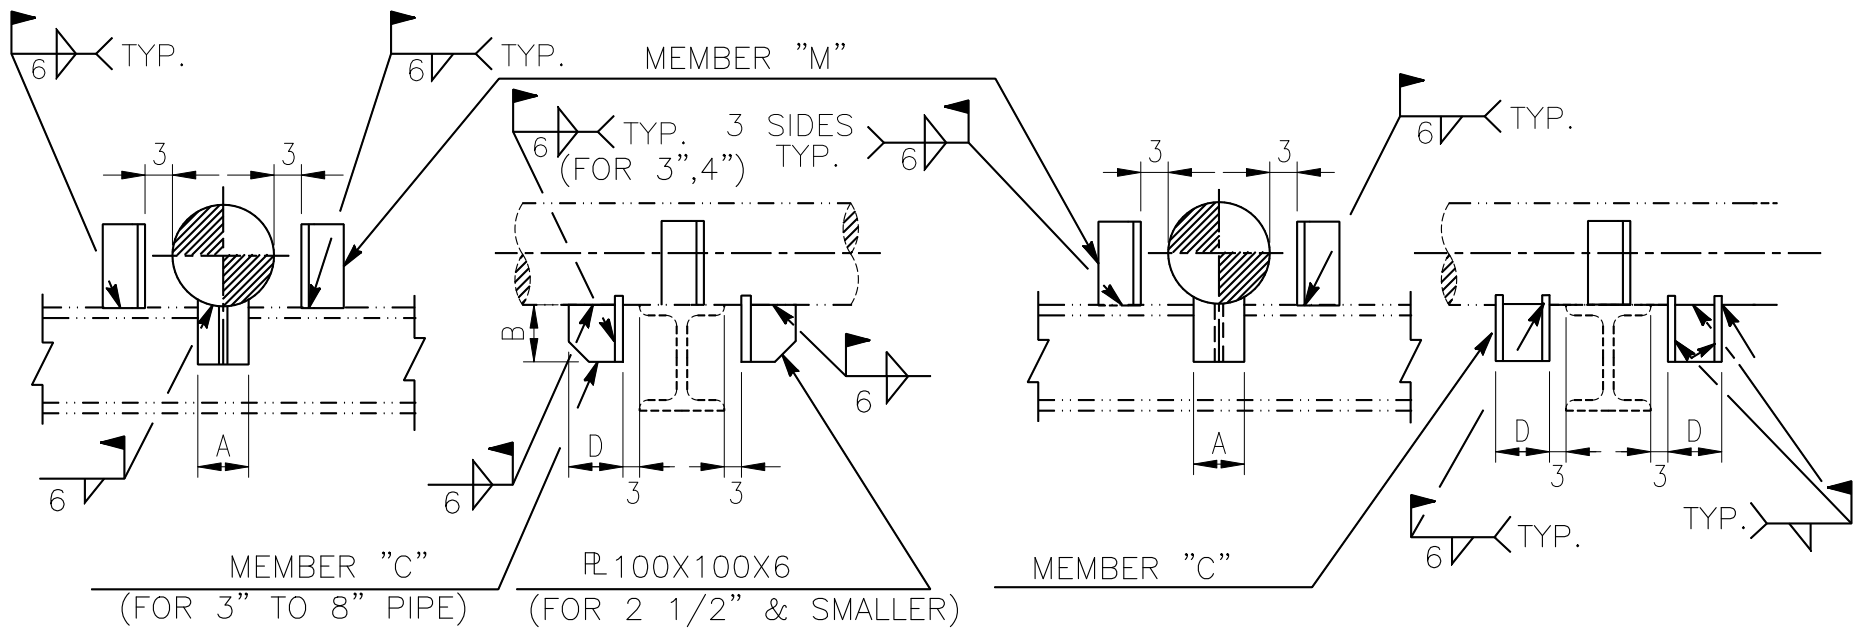

(3/4" TO 8" PIPE)

ELEV.

(10" TO 24" PIPE)

DIMENSIONS (mm)

| LINE SIZE | A   | B   | C                           | D   | M                |
|-----------|-----|-----|-----------------------------|-----|------------------|
| 3/4"      | —   | —   | —                           | —   | L50X50X6X50 LG.  |
| 1"        | —   | —   | —                           | —   |                  |
| 1 1/2"    | —   | —   | —                           | —   |                  |
| 2"        | —   | —   | —                           | —   | L50X50X6X100 LG. |
| 2 1/2"    | —   | —   | —                           | —   |                  |
| 3"        | 75  | 100 | FAB. FROM 6 <sup>t</sup> ϕ  | 75  |                  |
| 4"        | 75  | 100 |                             | 75  | L50X50X6X125 LG. |
| 5"        | 100 | 100 | CUT FROM H200X100X5.5X8     | 100 |                  |
| 6"        | 150 | 150 | CUT FROM H194X150X6X9       | 100 | L65X65X6X150 LG. |
| 8"        | 150 | 150 |                             | 100 |                  |
| 10"       | 200 | 200 | CUT FROM H200X200X8X12      | 200 |                  |
| 12"       | 200 | 200 |                             | 200 | L65X65X6X200 LG. |
| 14"       | 200 | 200 |                             | 200 |                  |
| 16"       | 300 | 250 | FAB. FROM 12 <sup>t</sup> ϕ | 300 | L65X65X6X250 LG. |
| 18"       | 300 | 250 |                             | 300 |                  |
| 20"       | 300 | 250 |                             | 300 |                  |
| 24"       | 350 | 250 |                             | 350 | L65X65X6X300 LG. |

NOTE :


DESIGNATION NUMBER DENOTE AS FOLLOWS :

82-2B  
DENOTE TYPE NO.      DENOTE LINE SIZE

FILE: D-99M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-99                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-82  
(1 OF 2)

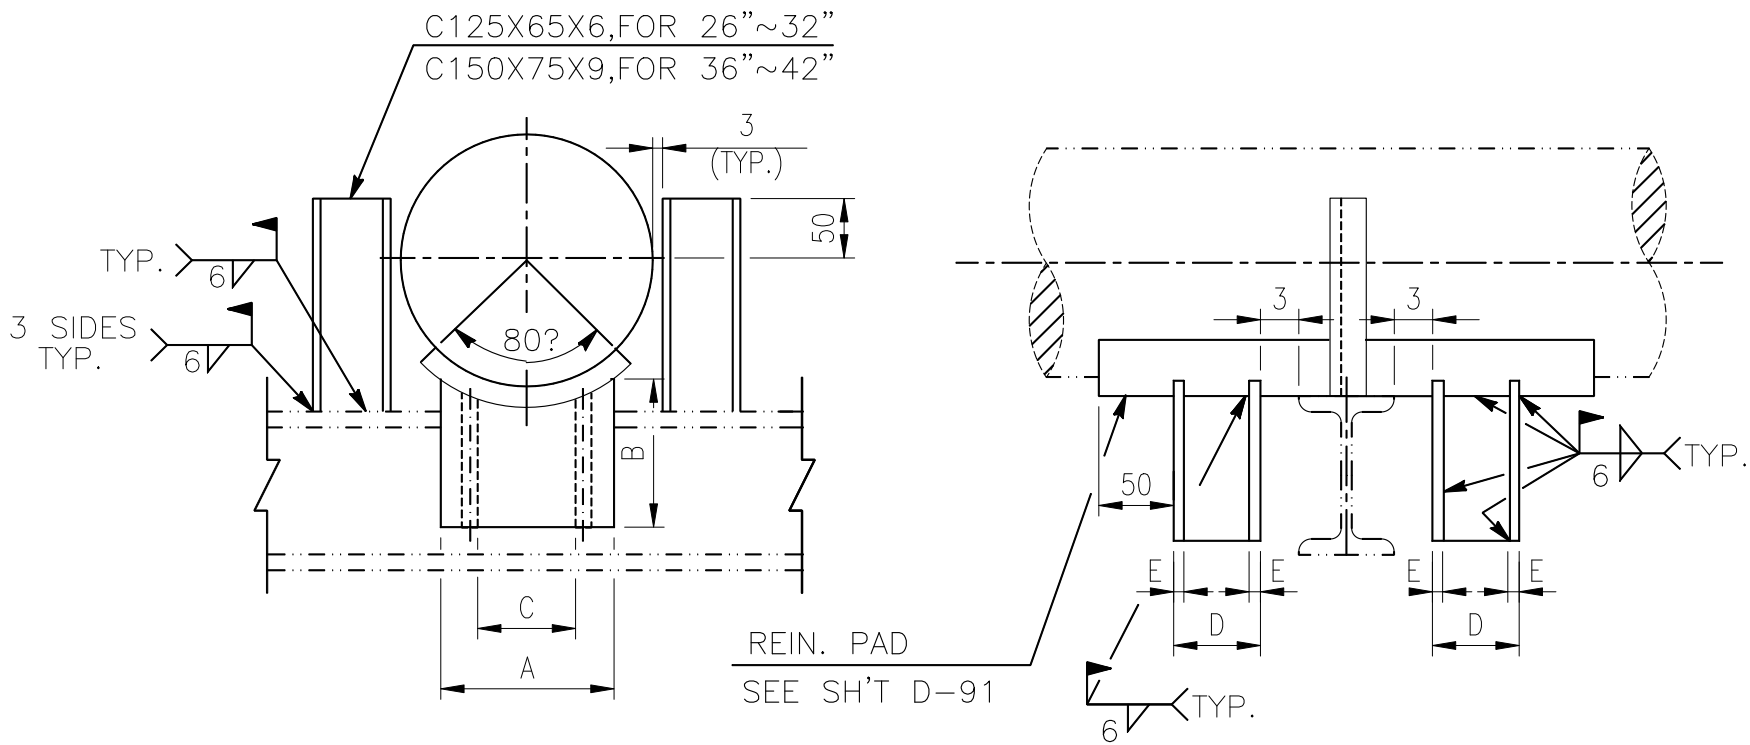

(26"~42" PIPE)

ELEV.


| DIMENSIONS (mm) |     |     |     |     |    |
|-----------------|-----|-----|-----|-----|----|
| LINE SIZE       | A   | B   | C   | D   | E  |
| 26"             | 350 | 250 | 250 | 350 | 12 |
| 28"             | 350 | 250 | 250 | 350 | 12 |
| 30"             | 350 | 250 | 250 | 350 | 12 |
| 32"             | 450 | 300 | 350 | 400 | 12 |
| 36"             | 450 | 300 | 350 | 400 | 12 |
| 40"             | 450 | 300 | 350 | 400 | 12 |
| 42"             | 450 | 300 | 350 | 400 | 12 |

- NOTES :
1. FOR DESIGNATION NUMBER OF SUPPORT, SEE SH'T D-67.
  2. FOR LOADING INFORMATIONS REF. SH'T D-62A & D-67A.

FILE: D-100M.DWG

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  |                      |        |
| DETAIL OF PIPE SUPPORT<br><br>TYPE-82<br><br>(2 OF 2)      |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | D-100                | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                      |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

FOR PIPE SIZE 3/4"-24"

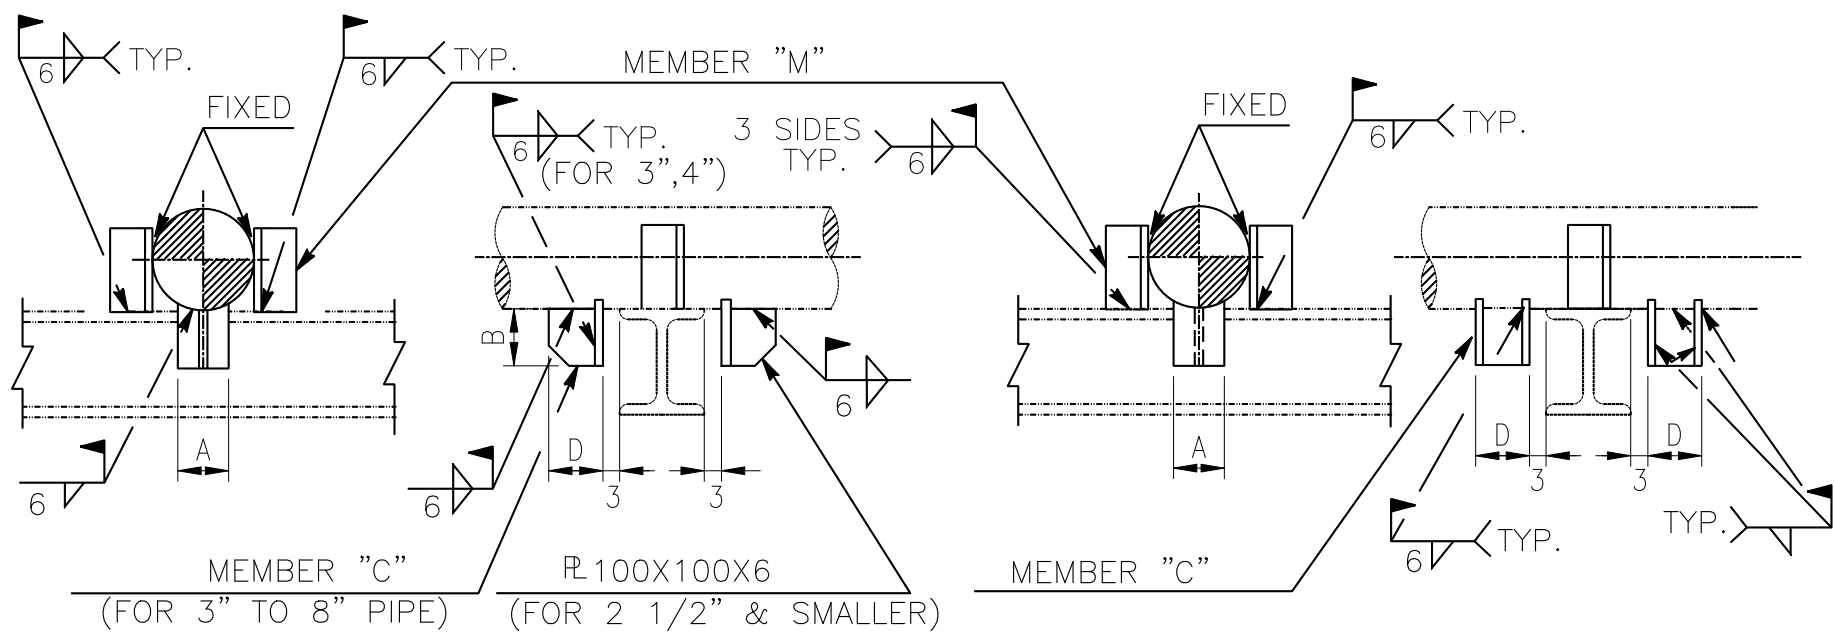

(3/4" TO 8" PIPE)

ELEV.


(10" TO 24" PIPE)

DIMENSIONS (mm)

| LINE SIZE | A   | B   | C                           | D   | M                |
|-----------|-----|-----|-----------------------------|-----|------------------|
| 3/4"      | —   | —   | —                           | —   | L50X50X6X50 LG.  |
| 1"        | —   | —   | —                           | —   |                  |
| 1 1/2"    | —   | —   | —                           | —   |                  |
| 2"        | —   | —   | —                           | —   | L50X50X6X100 LG. |
| 2 1/2"    | —   | —   | —                           | —   |                  |
| 3"        | 75  | 100 | FAB. FROM 6 <sup>t</sup> ϕ  | 75  |                  |
| 4"        | 75  | 100 |                             | 75  | L50X50X6X125 LG. |
| 5"        | 100 | 100 | CUT FROM H200X100X5.5X8     | 100 |                  |
| 6"        | 150 | 150 | CUT FROM H194X150X6X9       | 100 | L65X65X6X150 LG. |
| 8"        | 150 | 150 |                             | 100 |                  |
| 10"       | 200 | 200 | CUT FROM H200X200X8X12      | 200 |                  |
| 12"       | 200 | 200 |                             | 200 | L65X65X6X200 LG. |
| 14"       | 200 | 200 |                             | 200 |                  |
| 16"       | 300 | 250 | FAB. FROM 12 <sup>t</sup> ϕ | 300 | L65X65X6X250 LG. |
| 18"       | 300 | 250 |                             | 300 |                  |
| 20"       | 300 | 250 |                             | 300 |                  |
| 24"       | 350 | 250 |                             | 350 | L65X65X6X300 LG. |

NOTE :


DESIGNATION NUMBER DENOTE AS FOLLOWS :



FILE: D-99M1.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-100A-1             | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

DETAIL OF PIPE SUPPORT  
TYPE-82A  
(1 OF 2)

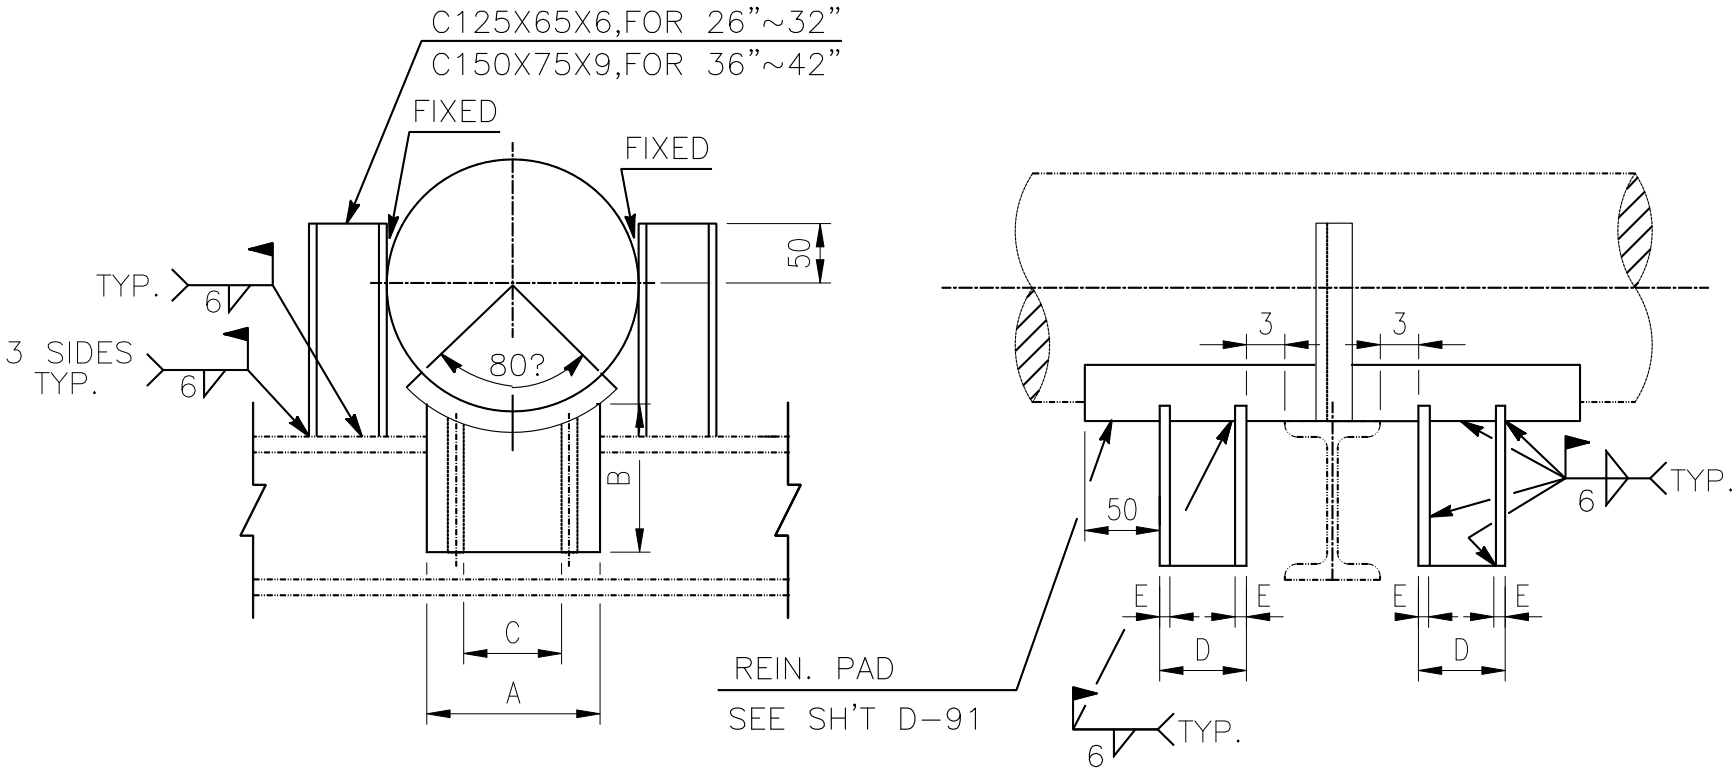

(26"~42" PIPE)

ELEV.

| DIMENSIONS (mm) |     |     |     |     |    |
|-----------------|-----|-----|-----|-----|----|
| LINE SIZE       | A   | B   | C   | D   | E  |
| 26"             | 350 | 250 | 250 | 350 | 12 |
| 28"             | 350 | 250 | 250 | 350 | 12 |
| 30"             | 350 | 250 | 250 | 350 | 12 |
| 32"             | 450 | 300 | 350 | 400 | 12 |
| 36"             | 450 | 300 | 350 | 400 | 12 |
| 40"             | 450 | 300 | 350 | 400 | 12 |
| 42"             | 450 | 300 | 350 | 400 | 12 |

NOTES :

1. FOR DESIGNATION NUMBER OF SUPPORT, SEE SH'T D-67.
2. FOR LOADING INFORMATIONS REF. SH'T D-62A & D-67A.

FILE:D-100M1-DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-100A-2             |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-82A                         |          |  |       |      |  | (2 OF 2)             |  |
|                                                            |          |  |       |      |  | REV. 1               |  |



NOTES :

- 83-2B(P)-A(A)-130-500
- |                           |  |  |  |  |  |                                |
|---------------------------|--|--|--|--|--|--------------------------------|
| DENOTE TYPE NO.           |  |  |  |  |  | MODIFY LOPS=500 (IN mm) IF ANY |
| DENOTE LINE SIZE          |  |  |  |  |  | MODIFY HOPS=130 (IN mm) IF ANY |
| DENOTE REIN. PAD IS REQ'D |  |  |  |  |  | SEE SH'T D-80A TABLE "B"       |
|                           |  |  |  |  |  | SEE SH'T D-80A TABLE "A"       |

2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.
3. PIPE SHOE LENGTH (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.
4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                                                                            |          |  |       |      |  |                      |      |
|--------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| <div> <div> 中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/>TYPE-83 (1 OF 2) </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                                                                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                                                                                                         | SHIH     |  | CHK.  | YANG |  | D-101                | REV. |
| DATE                                                                                                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |



DIMENSIONS (mm)

| DIMENSIONS (mm) |          |             |        |  |  |  |  |
|-----------------|----------|-------------|--------|--|--|--|--|
| NO.             | 6        | 7           | 8      |  |  |  |  |
| PIECE           | 2        | 2           | 6      |  |  |  |  |
| PIPE<br>SIZE    | GUIDE    | STOP ANGLE  | PLATE  |  |  |  |  |
| 26"             | L50X50X6 | L100X100X10 | 6 TH'K |  |  |  |  |
| 28"             |          |             |        |  |  |  |  |
| 30"             |          |             |        |  |  |  |  |
| 32"             |          |             |        |  |  |  |  |
| 36"             |          |             |        |  |  |  |  |
| 40"             |          |             |        |  |  |  |  |
| 42"             |          |             |        |  |  |  |  |

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.

83-30B-A(A)-130-500

DENOTE LINE SIZE

SEE NOTE 3

MODIFY HOPS=130 (IN mm) IF ANY


TYPE-B FOR INSULATION THICKNESS > 100 <\_150

4. LOADING CONDITION : CARBON STEEL SADDLE WITH MAX. PIPE TEMPERATURE 700°F & PRESSURE 300 PSI.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                                                                                       |          |  |       |      |  |                      |           |
|-------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-83<br/> (2 OF 2) </div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                                                                                       |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                                                                                    | SHIH     |  | CHK.  | YANG |  | D-102                | REV.<br>1 |
| DATE                                                                                                                                                  | 7/15/'24 |  | APPR. | CHEN |  |                      |           |



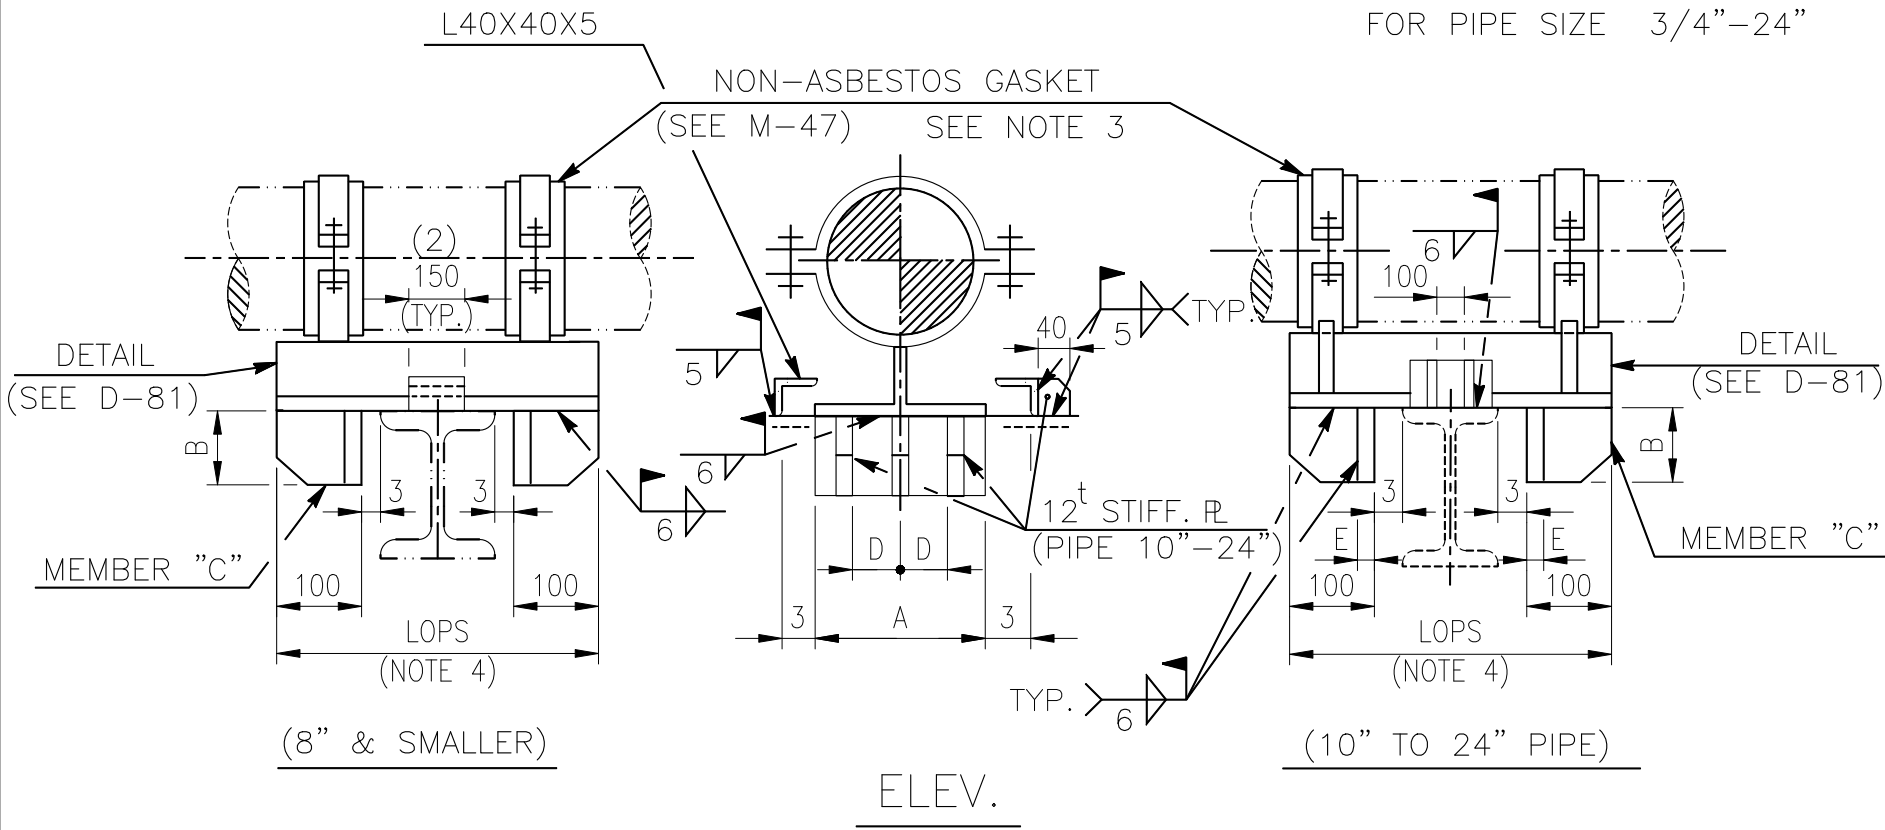

| DIMENSIONS (mm) |     |     |                                 |     |    |
|-----------------|-----|-----|---------------------------------|-----|----|
| LINE SIZE       | A   | B   | C                               | D   | E  |
| 3/4"            | 100 | 100 | CUT FROM<br>H200X100X5.5X8      | —   | —  |
| 1"              | 100 | 100 |                                 | —   | —  |
| 1 1/2"          | 100 | 100 |                                 | —   | —  |
| 2"              | 100 | 100 |                                 | —   | —  |
| 2 1/2"          | 100 | 100 |                                 | —   | —  |
| 3"              | 100 | 100 |                                 | —   | —  |
| 4"              | 100 | 100 |                                 | —   | —  |
| 5"              | 100 | 100 |                                 | —   | —  |
| 6"              | 100 | 100 |                                 | —   | —  |
| 8"              | 100 | 100 |                                 | —   | —  |
| 10"             | 200 | 200 | CUT FROM<br>H200X200X8X12       | 70  | —  |
| 12"             | 200 | 200 |                                 | 70  | —  |
| 14"             | 200 | 200 |                                 | 70  | —  |
| 16"             | 300 | 250 | FAB. FROM<br>12 <sup>t</sup> RL | 100 | 12 |
| 18"             | 300 | 250 |                                 | 100 | 12 |
| 20"             | 300 | 250 |                                 | 100 | 12 |
| 24"             | 350 | 250 |                                 | 100 | 12 |


NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :  

84-2B-A-130-500  
DENOTE TYPE NO.      DENOTE LINE SIZE  
MODIFY LOPS=500 (IN mm) IF ANY  
MODIFY HOPS=130 (IN mm) IF ANY  
SEE SH'T D-80A TABLE "A"
2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.
3. THIS TYPE IS USUALLY USED FOR ALLOY STEEL AND STAINLESS STEEL LINES  
(MAX. LINE TEMP. : 750°F)
4. PIPE SHOE LENGTH (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.
5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                               |          |  |       |      |  |                      |           |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-84</div> <div>(1 OF 2)</div>      |          |  |       |      |  | D-103                | REV.<br>1 |
|                                                                               |          |  |       |      |  |                      |           |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                      |           |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

FILE: D-103M.DWG


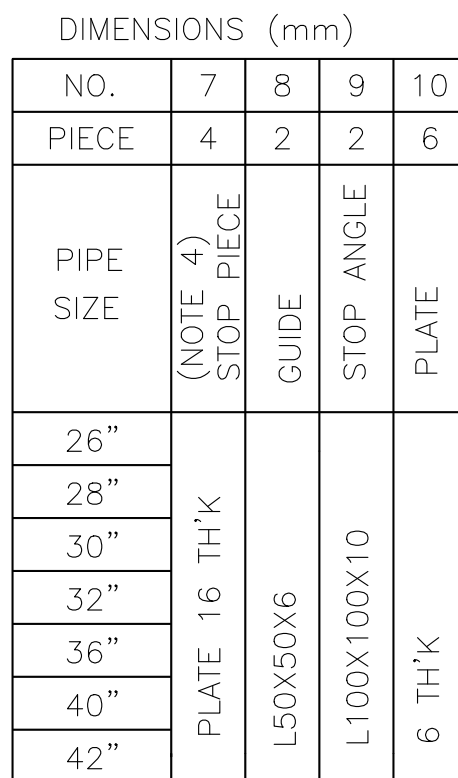


6. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                                                                                                                                                                                            |          |  |       |      |  |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-84<br/> (2 OF 2) </div> <div> <div>ENGINEERING STANDARD</div> <div>HP6-DSD-A4-500-001</div> <div> D-104 REV. 1 </div> </div> </div> |          |  |       |      |  |
| BY                                                                                                                                                                                                                                                         | SHIH     |  | CHK.  | YANG |  |
| DATE                                                                                                                                                                                                                                                       | 7/15/'24 |  | APPR. | CHEN |  |



FOR PIPE SIZE 3/4"-24"

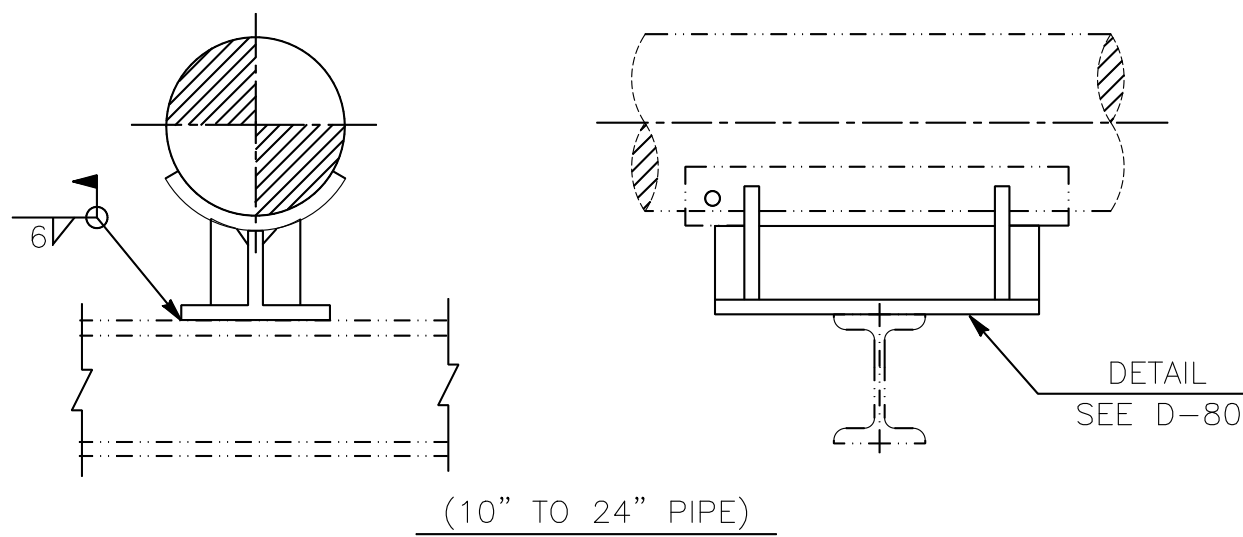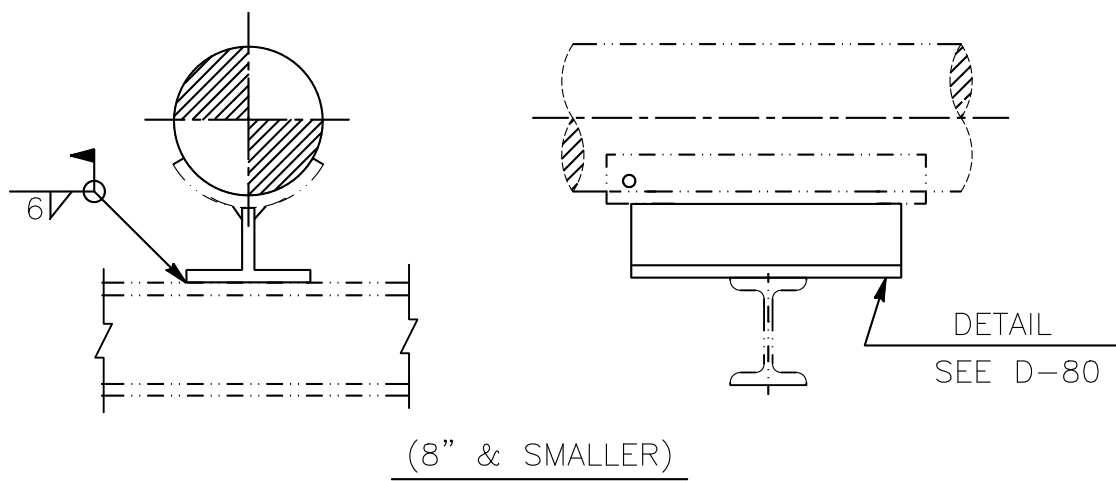

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:

85-2B(P)-A(A)-130-500

DENOTE TYPE NO.      DENOTE LINE SIZE      DENOTE REIN. PAD IS REQ'D

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"


SEE SH'T D-80A TABLE "A"

2. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

FILE: D-105M.DWG

|                                                            |          |  |       |      |  |                                               |           |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                          |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                            |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-85<br>(1 OF 2) | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               |           |

FOR PIPE SIZE 26"-42"

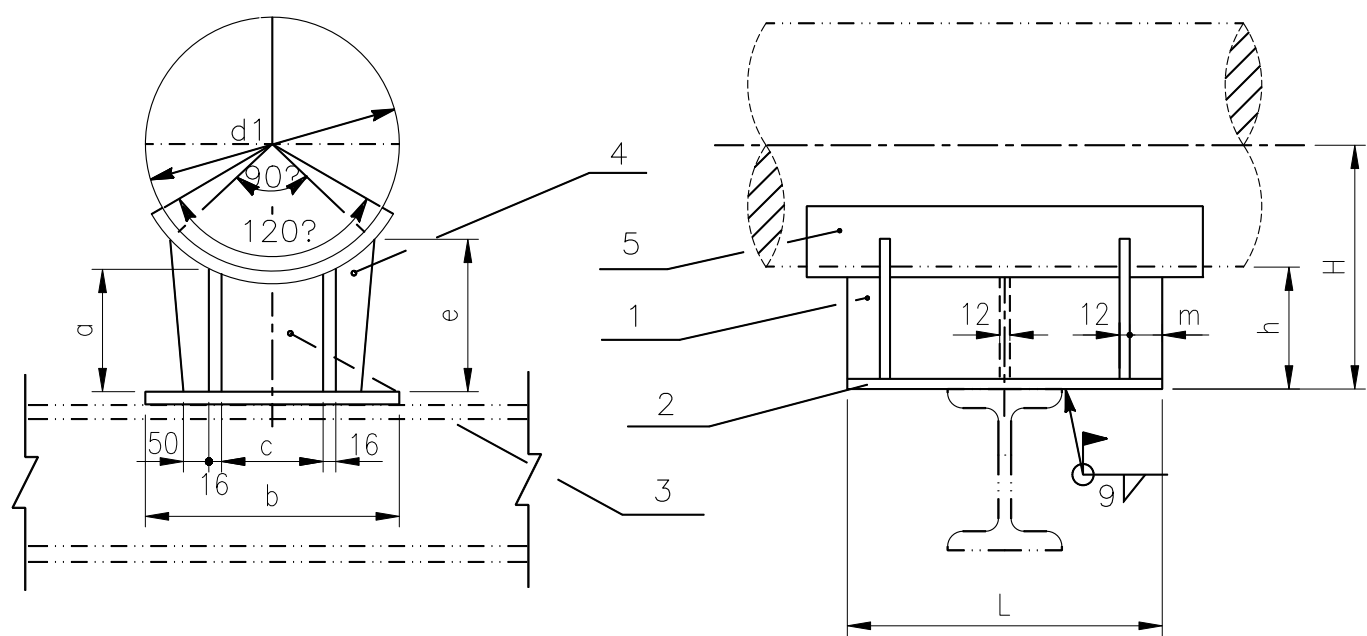

ELEV.


NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :
- 85-30B-A(A)-130-500
- DENOTE TYPE NO. 85-30B-A(A)-130-500
- DENOTE LINE SIZE 30B
- MODIFY LOPS=500 (IN mm) IF ANY
- MODIFY HOPS=130 (IN mm) IF ANY
- SEE SH'T D-80A TABLE "B"
- SEE NOTE 3
3. TYPE-A FOR INSULATION THICKNESS < 100
- TYPE-B FOR INSULATION THICKNESS > 100 < 150
4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

FILE: D-106M.DWG


|                                                            |          |  |       |      |  |                                               |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------------------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                          |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                            |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-85<br>(2 OF 2) | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                               | 1    |



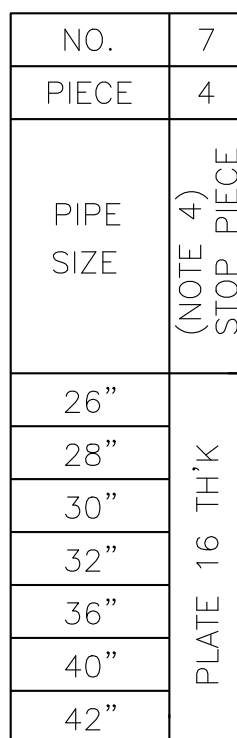

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

|                                                                                   |          |  |       |      |  |                                                                  |  |                                 |        |
|-----------------------------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------------------------|--|---------------------------------|--------|
| <div> <div> 中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> </div> |          |  |       |      |  | <div> DETAIL OF PIPE SUPPORT <br/> TYPE-86 <br/> (2 OF 2) </div> |  | ENGINEERING STANDARD            |        |
|                                                                                   |          |  |       |      |  |                                                                  |  | <div> HP6-DSD-A4-500-001 </div> |        |
| BY                                                                                | SHIH     |  | CHK.  | YANG |  |                                                                  |  |                                 |        |
| DATE                                                                              | 7/15/'24 |  | APPR. | CHEN |  |                                                                  |  | D-108                           | REV. 1 |

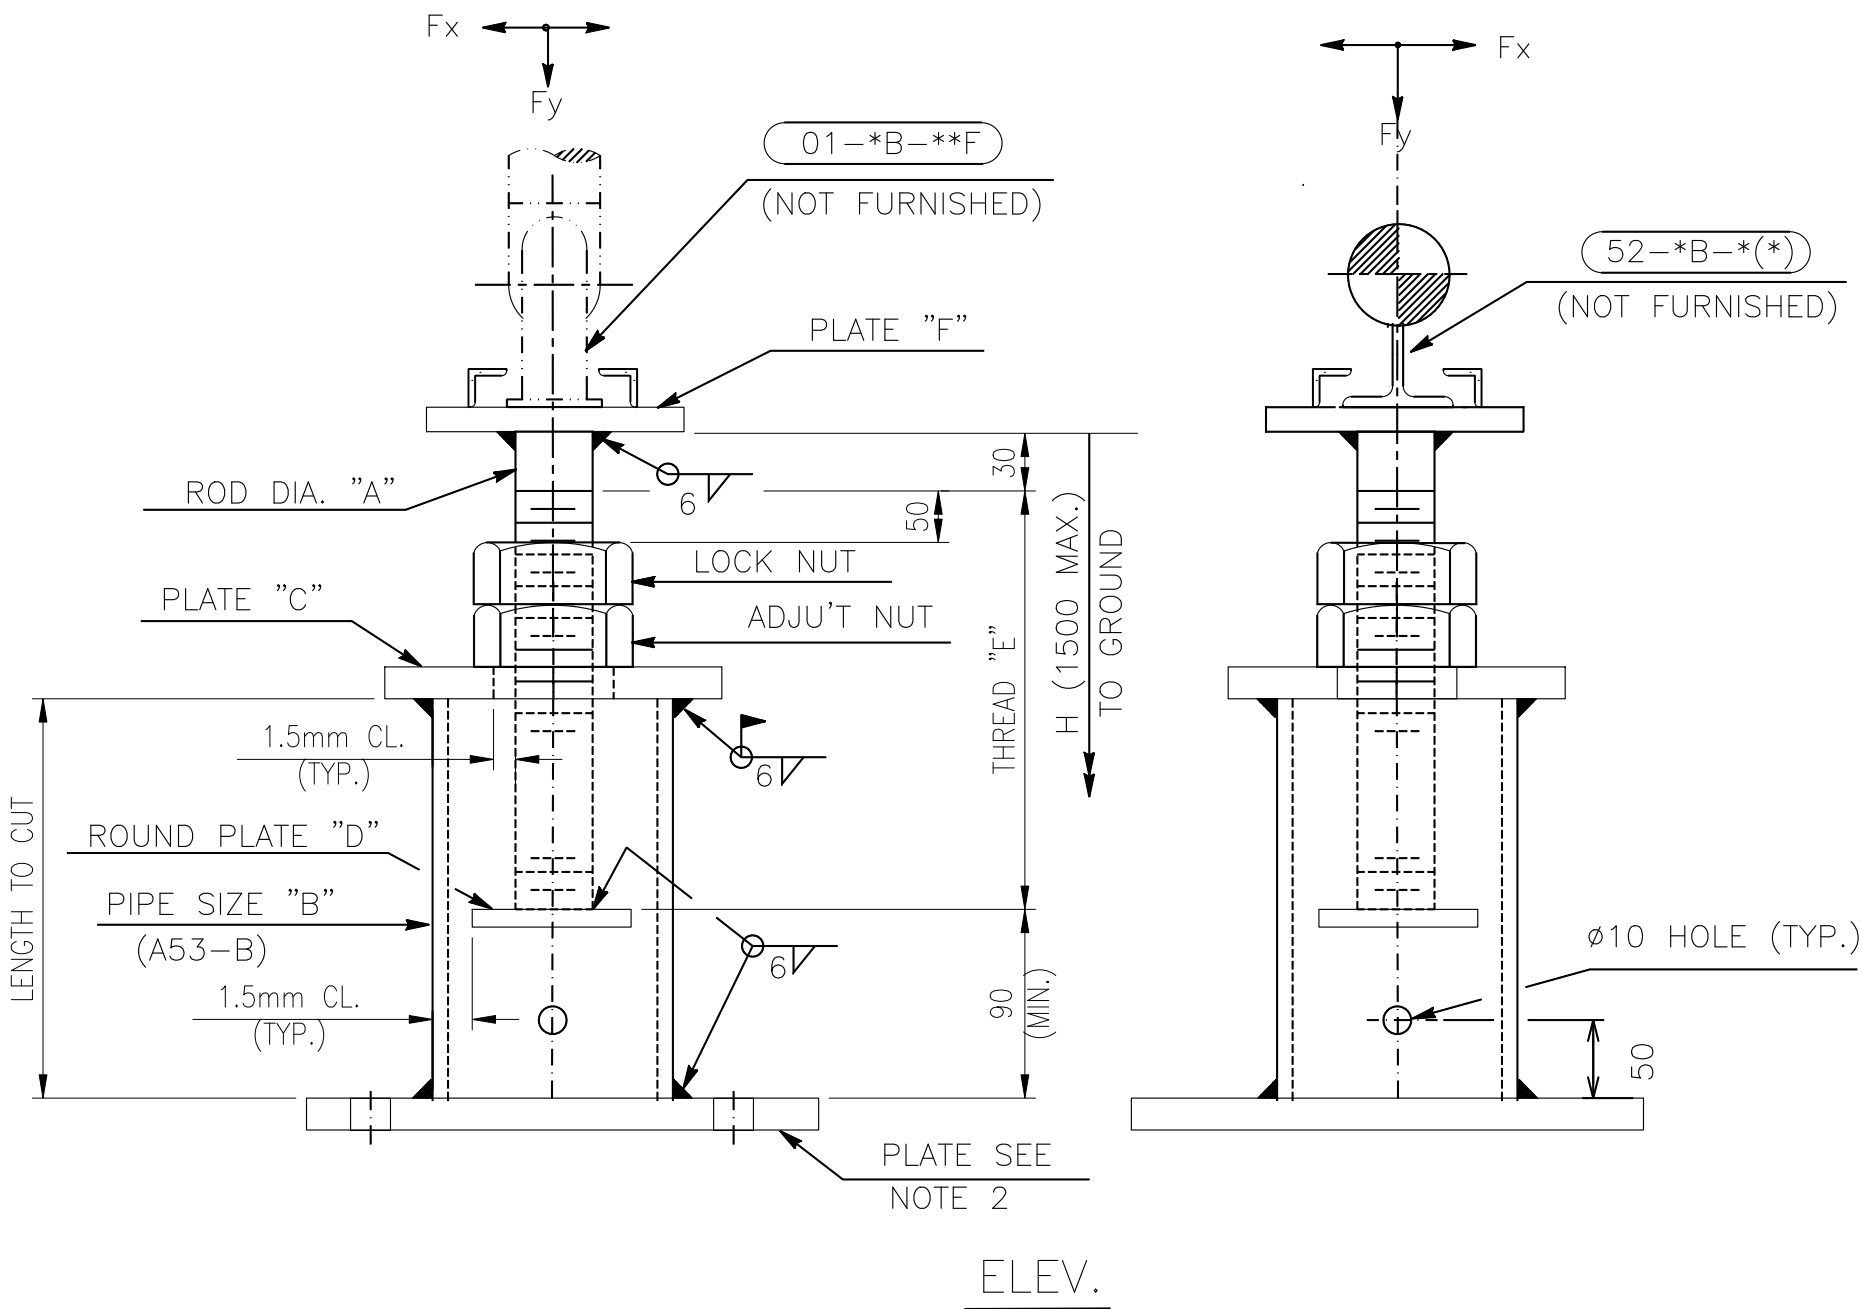

DIMENSIONS (mm)

| A      | B     | C                       | D                    | E   | F                       |
|--------|-------|-------------------------|----------------------|-----|-------------------------|
| 1"     | 3"STD | 120X120X9 <sup>t</sup>  | ø72X9 <sup>t</sup>   | 160 | 210X210X9 <sup>t</sup>  |
| 1 1/2' | 4"STD | 150X150X9 <sup>t</sup>  | ø96X9 <sup>t</sup>   | 185 | 290X290X9 <sup>t</sup>  |
| 2"     | 6"STD | 200X200X12 <sup>t</sup> | ø148X12 <sup>t</sup> | 215 | 290X290X12 <sup>t</sup> |
| 2 1/2" | 8"STD | 250X250X16 <sup>t</sup> | ø197X12 <sup>t</sup> | 245 | 390X390X16 <sup>t</sup> |

NOTES :

1. DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD.
2. THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL USE TYPE-G,J & R ONLY.
3. DESIGNATION NUMBER DENOTE AS FOLLOWS :

87-M27-10G

DENOTE TYPE NO. DENOTE ROD SIZE "A" DENOTE THE LOWER COMPONENT TYPE SEE M-42 DENOTE DIMENSION "H" (IN 100mm)
4. IF THE LOWER COMPONENT TYPE-G IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.

FILE: D-109M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-109                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |



- 101-1 1/2 B(S) OR (A)- A
- DENOTE FIG.-A  
FOR ALLOY PIPE
- FOR STAINLESS PIPE
- DENOTE LINE SIZE "P"
- DENOTE TYPE NO.

|                                                                               |          |  |       |      |  |                                                       |  |  |  |  |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|-------------------------------------------------------|--|--|--|--|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-101</div> |  |  |  |  |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |                                                       |  |  |  |  |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                                       |  |  |  |  |  | D-110                |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                                       |  |  |  |  |  |                      |  |



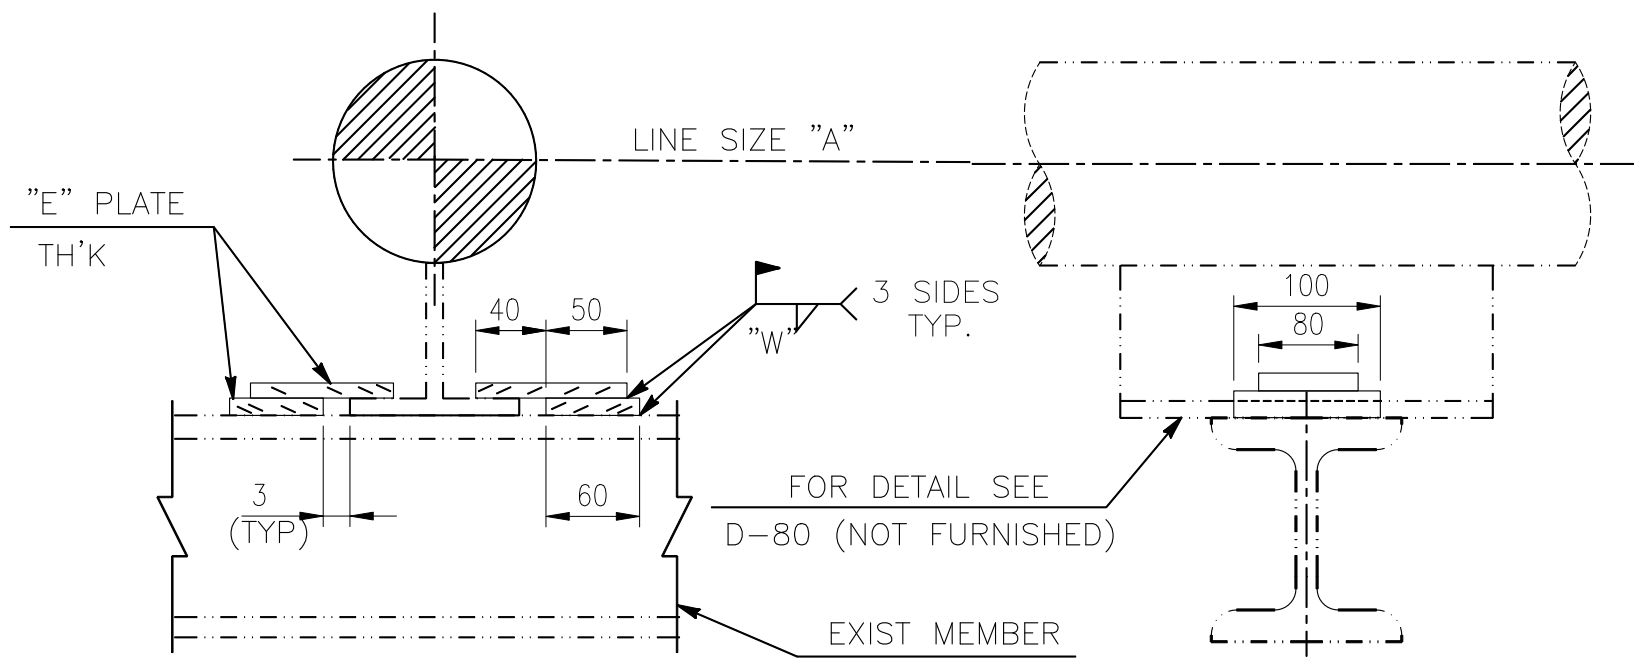


FIG. A

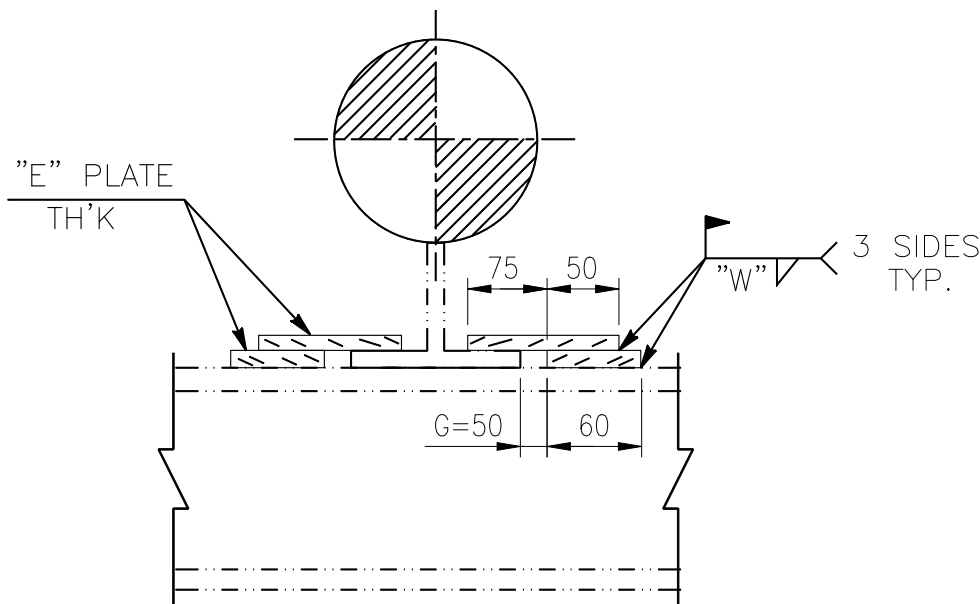



FIG. B

DIMENSIONS (mm)

| LINE<br>SIZE A | 3/4" | 1" | 1 1/2" | 2" | 3" | 4" | 6" | 8" | 10" | 12" | 14" | 16" | 18" | 20" | 24" |
|----------------|------|----|--------|----|----|----|----|----|-----|-----|-----|-----|-----|-----|-----|
| E              | 9    | 9  | 9      | 9  | 9  | 9  | 9  | 9  | 12  | 12  | 12  | 12  | 12  | 12  | 12  |
| W              | 6    | 6  | 6      | 6  | 6  | 6  | 6  | 6  | 10  | 10  | 10  | 10  | 10  | 10  | 10  |


NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

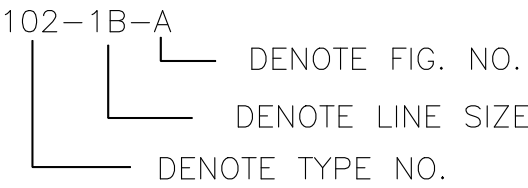

FILE: D-111M.DWG

|                                                            |          |  |       |      |  |                                    |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | DETAIL OF PIPE SUPPORT<br>TYPE-102 |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                    |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                    |  | D-111                | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                    |  |                      |           |

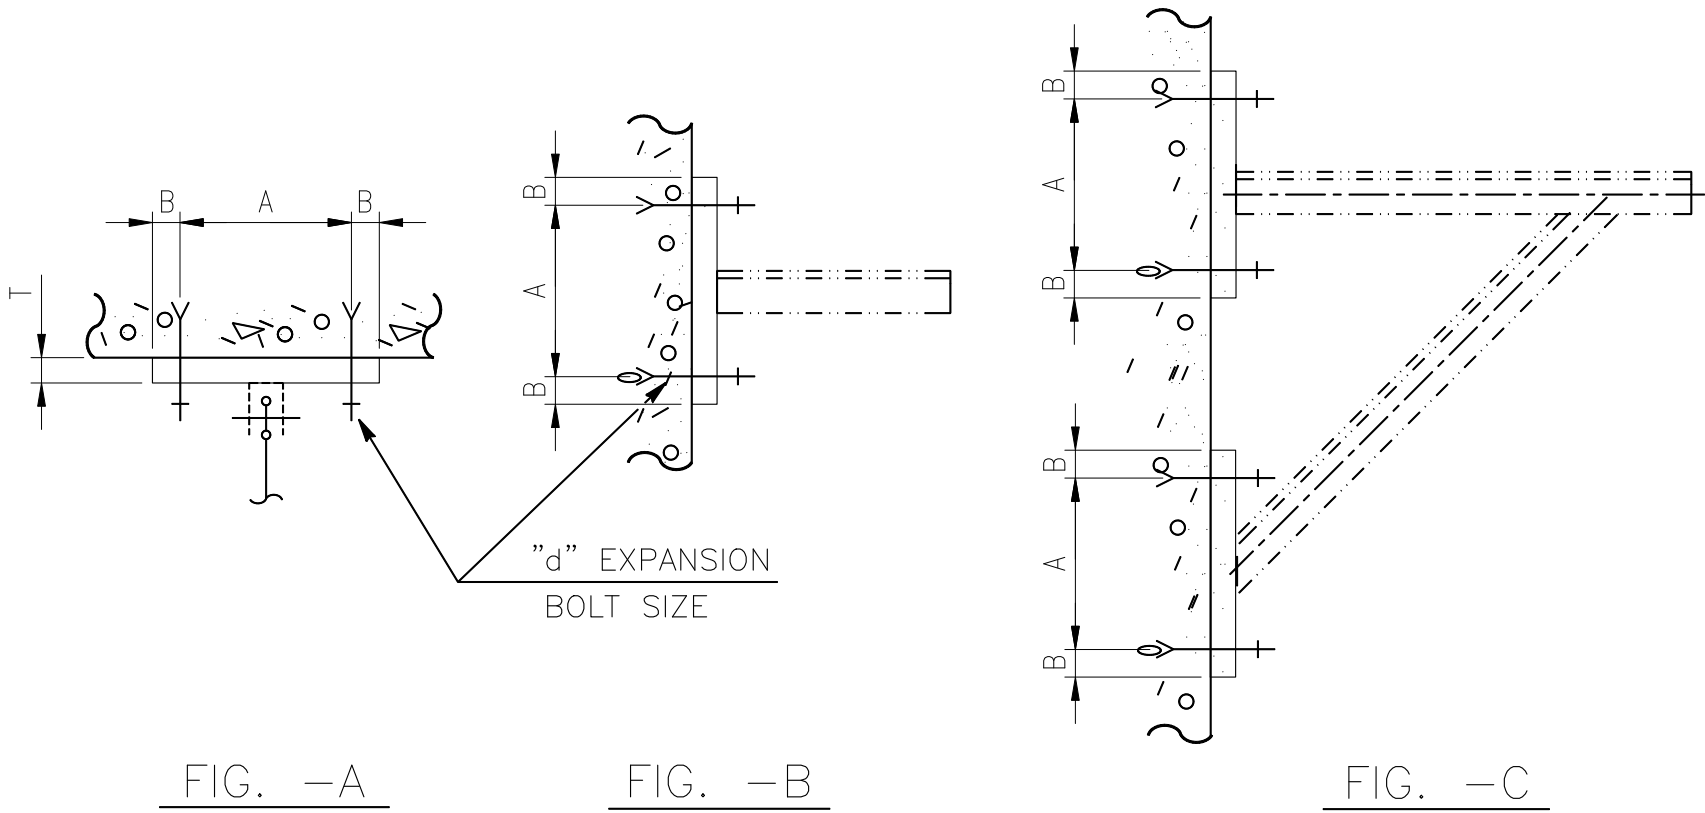

| SUPPORT NO. | A<br>(mm) | B<br>(mm) | T<br>(mm) | d    |
|-------------|-----------|-----------|-----------|------|
| 103-1       | 150       | 15        | 9         | 1/4" |
| 103-2       | 150       | 20        | 9         | 3/8" |
| 103-3       | 200       | 25        | 16        | 1/2" |
| 103-4       | 250       | 30        | 19        | 5/8" |
| 103-5       | 250       | 35        | 19        | 3/4" |
| 103-6       | 250       | 40        | 19        | 7/8" |

NOTES:


1. DESIGNATION NUMBER DENOTE AS FOLLOW:



FILE: D-112M.DWG

|                                                            |          |  |       |      |  |                                    |        |
|------------------------------------------------------------|----------|--|-------|------|--|------------------------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD               |        |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                 |        |
|                                                            |          |  |       |      |  | D-112                              | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-103 |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                    |        |



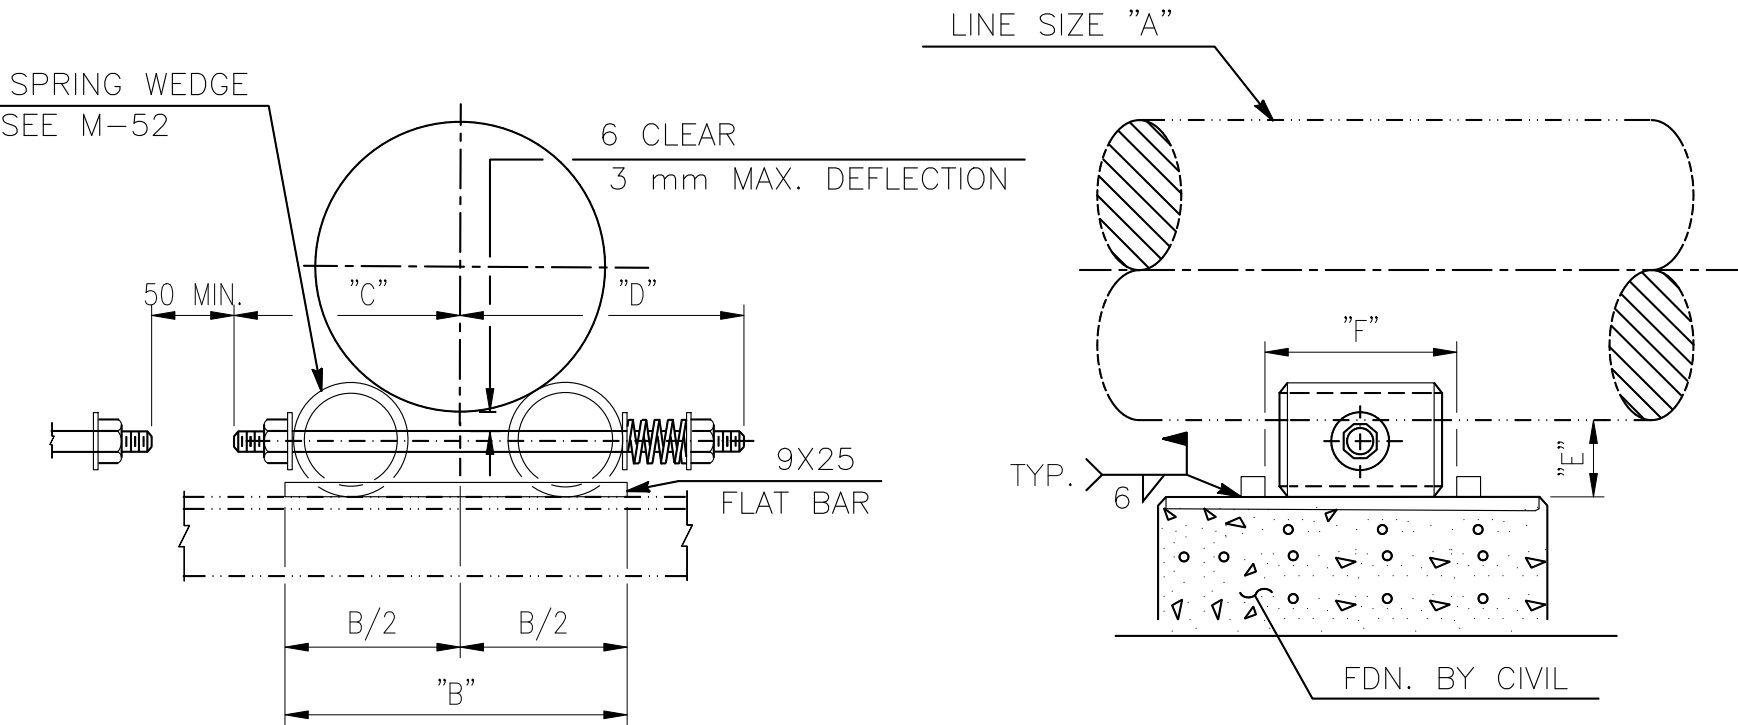

DIMENSIONS (mm)

| LINE SIZE<br>"A" | B   | C   | D   | E  | F   |
|------------------|-----|-----|-----|----|-----|
| 2"               | 170 | 115 | 180 | 43 | 160 |
| 3"               | 170 | 115 | 180 | 43 | 160 |
| 4"               | 170 | 115 | 180 | 43 | 160 |
| 6"               | 200 | 135 | 210 | 46 | 160 |
| 8"               | 200 | 135 | 210 | 46 | 160 |
| 10"              | 290 | 200 | 270 | 60 | 160 |
| 12"              | 290 | 200 | 270 | 60 | 160 |
| 14"              | 290 | 200 | 270 | 60 | 160 |
| 16"              | 330 | 215 | 290 | 60 | 160 |
| 18"              | 330 | 215 | 290 | 60 | 160 |
| 20"              | 330 | 215 | 290 | 60 | 160 |
| 24"              | 380 | 240 | 370 | 64 | 235 |

NOTES:

1. USE SPRING WEDGE WHERE REQUIRED BY VIBRATION ANALYSIS ON PULSATING LINES AT RECIPROCATING PUMPS AND COMPERSSORS.
2. DESIGNATION NUMBER DENOTE AS FOLLOW:


104 - 2B

DENOTE LINE SIZE "A"

DENOTE TYPE NO.
3. WEDGE BOLT TO BE TIGHTENED AFTER COMPRESSOR HAS ATTAINED RUNNING TEMPERATURE. TIGHTEN WEDGE BOLT ONLY ENOUGH TO SUPPORT WEIGHT OF PIPE, AS OVERTIGHTENING WILL FORCE NOZZLE OVERLOADED.

FILE: D-113M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-113                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-104                         |          |  |       |      |  | REV.<br>1            |  |

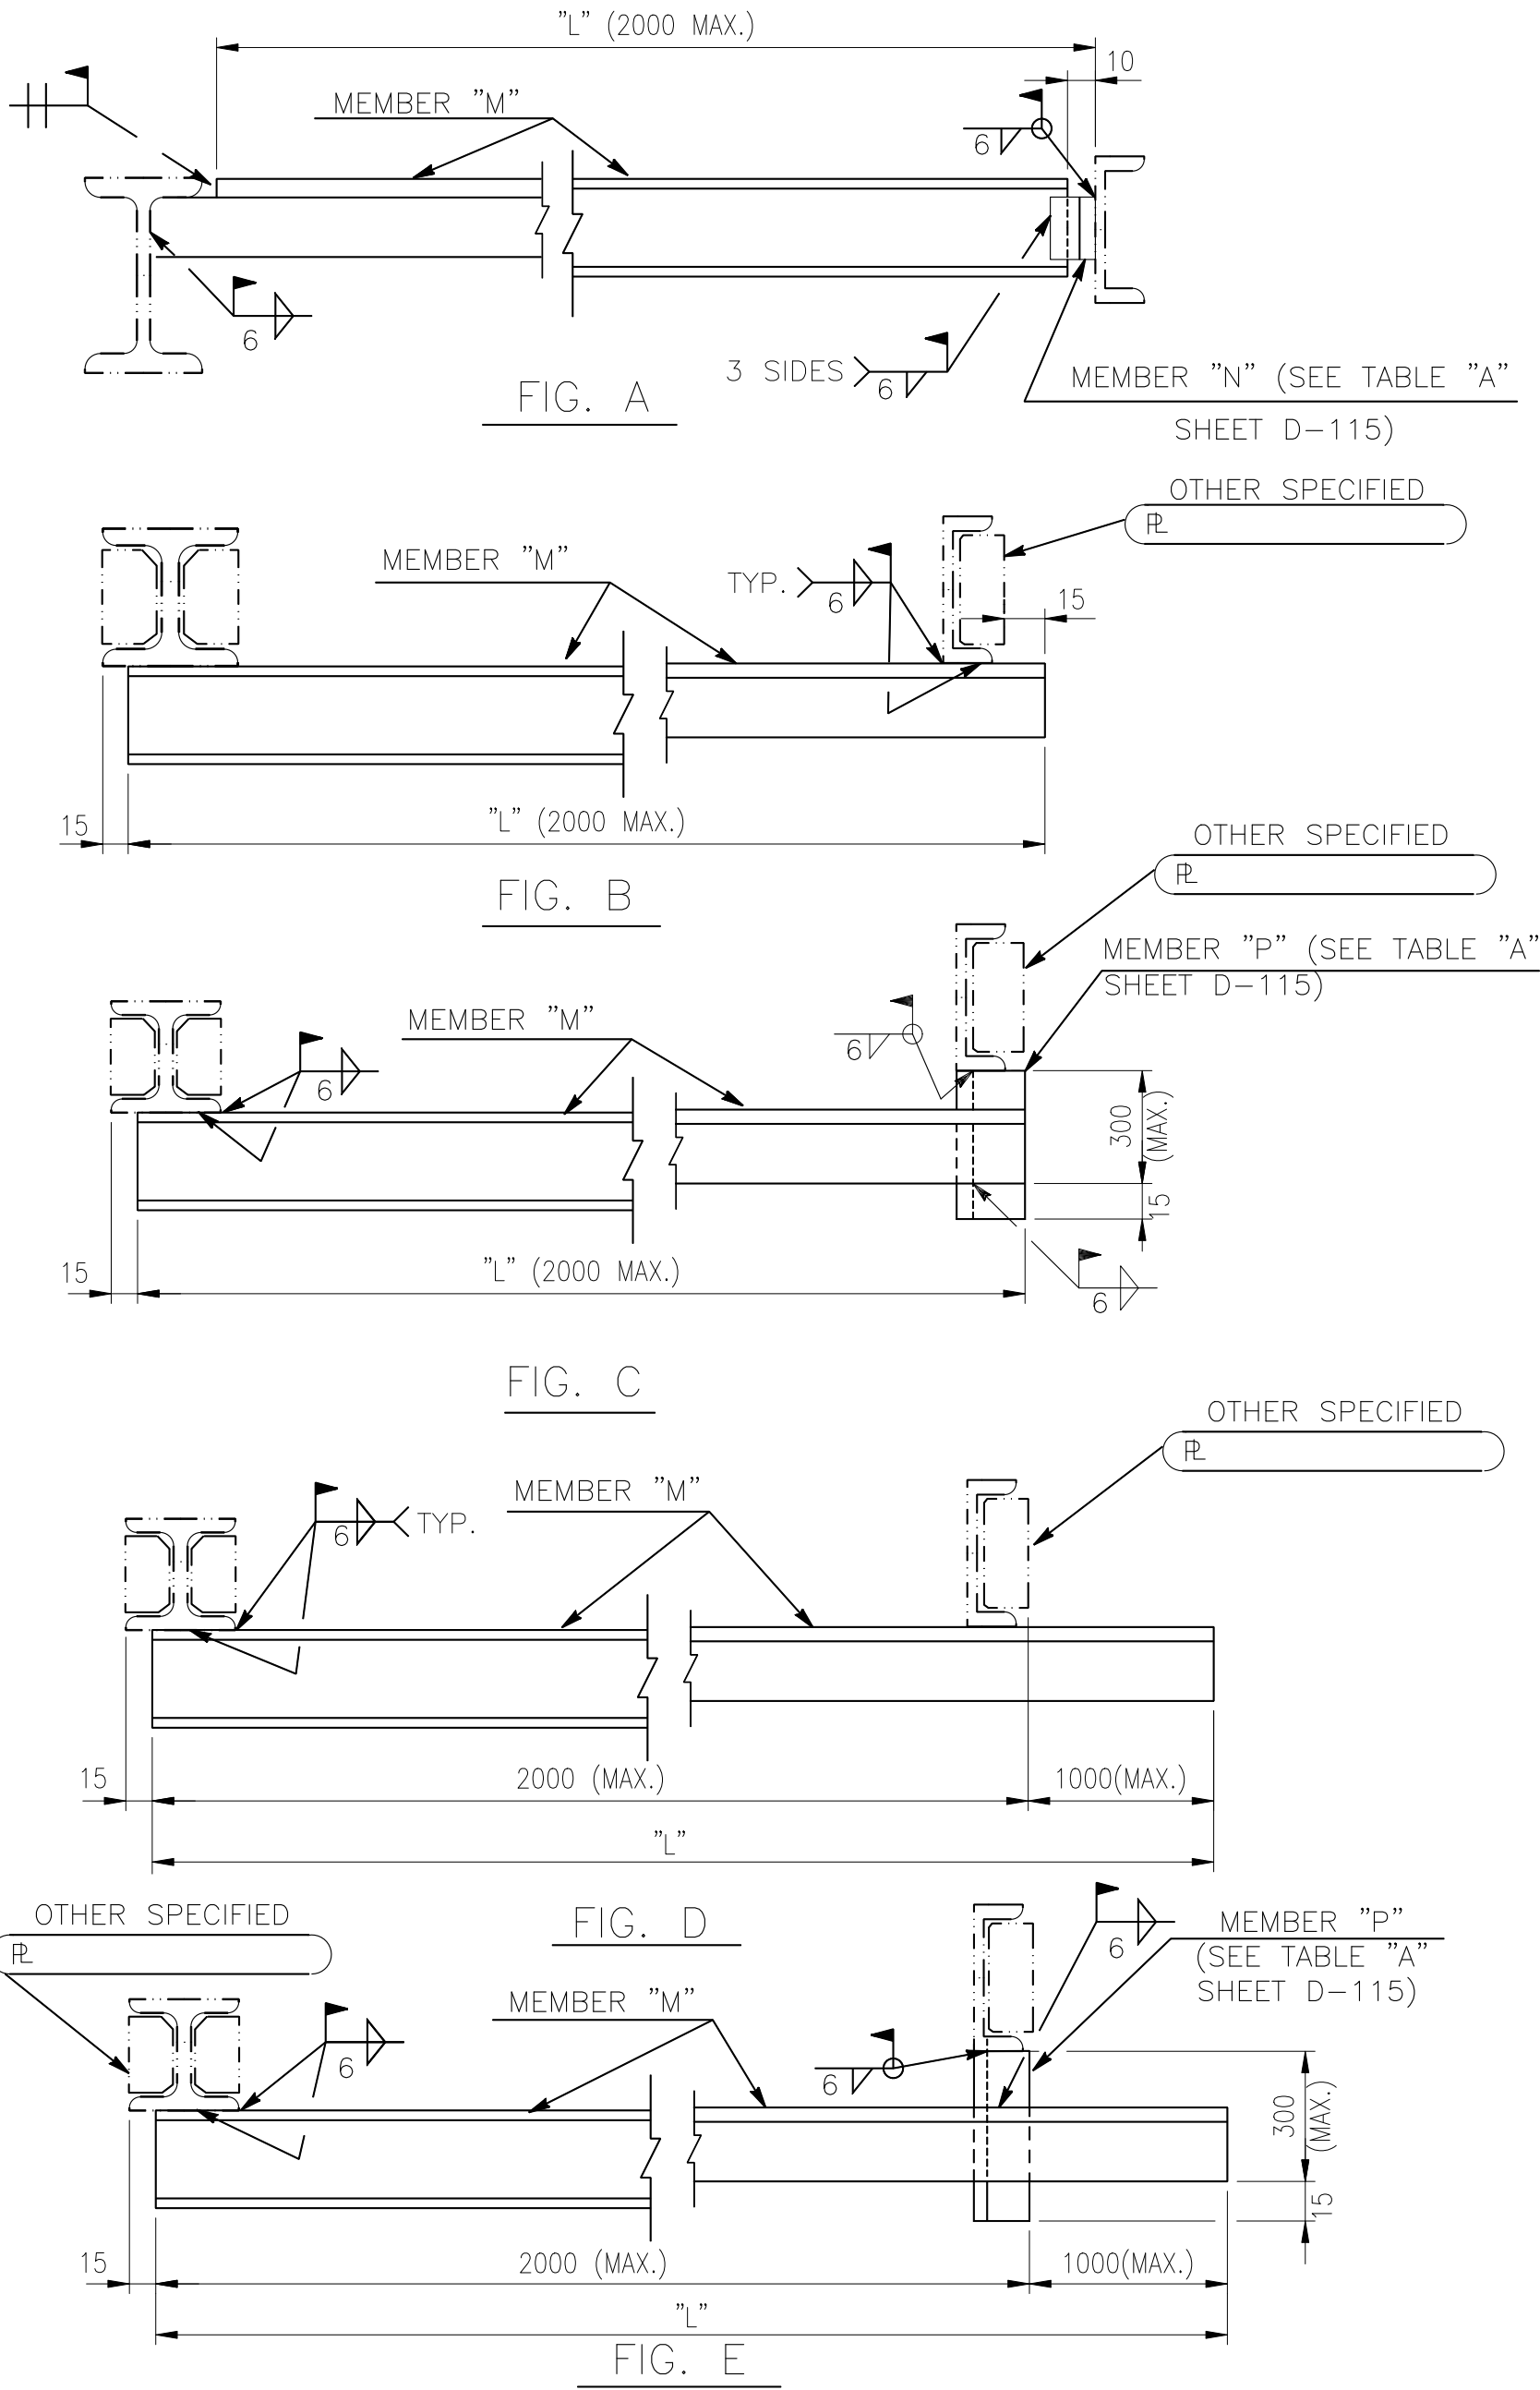

FILE: D-114M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-114                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |


DETAIL OF PIPE SUPPORT  
TYPE-105

| DIMENSIONS (mm) |                      |            |
|-----------------|----------------------|------------|
| MEMBER "M"      | MEMBER "N"           | MEMBER "P" |
| L50X50X6        | 60X60X6 <sup>t</sup> | L50X50X6   |
| L65X65X6        | 80X80X6 <sup>t</sup> | L65X65X6   |
| L75X75X9        | L65X65X6X40 LG.      | L75X75X9   |
| C100X50X5X7.5   | L65X65X6X65 LG.      | L75X75X9   |
| C125X65X6X8     | L65X65X6X80 LG.      | L75X75X9   |
| H150X150X7      | L75X75X9X90 LG.      | NONE       |
| H194X150X6X9    | L100X100X10X135 LG.  | NONE       |
| H294X200X8X12   | L100X100X10X200 LG.  | NONE       |
| H390X300X10X16  | L100X100X10X300 LG.  | NONE       |

TABLE "A"

NOTES :

1. MEMBER LENGTH SHALL BE CUT TO SUIT IN FIELD.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

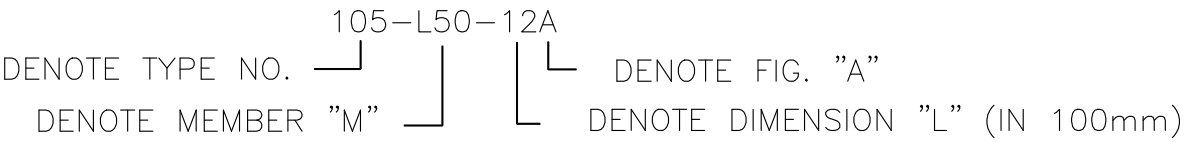

FILE: D-115M.DWG

|                                                            |          |  |       |      |  |                                                |           |
|------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                           |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                             |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-105<br>(2 OF 2) | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                |           |

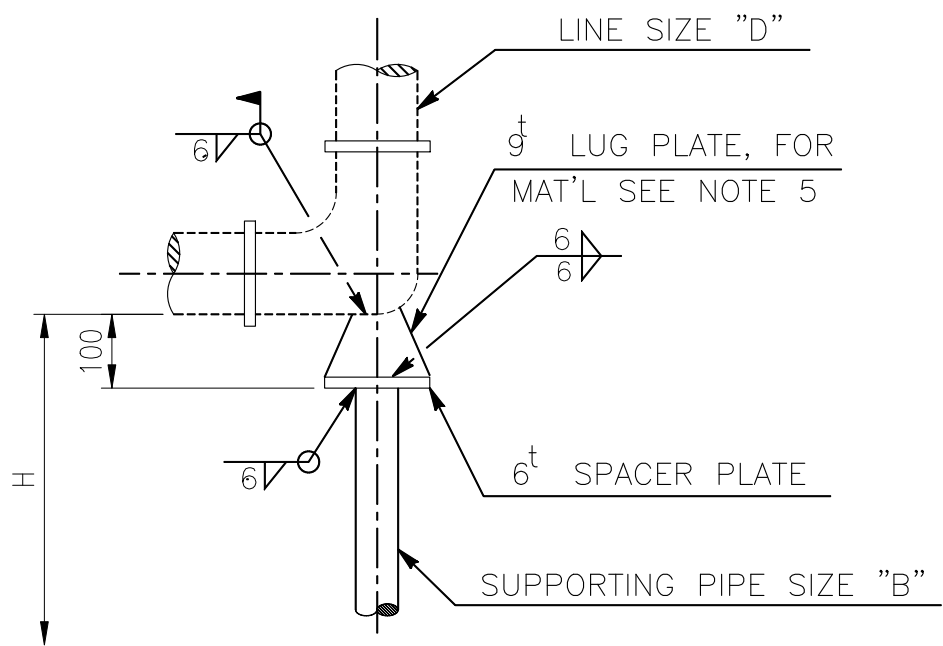


FIG - A

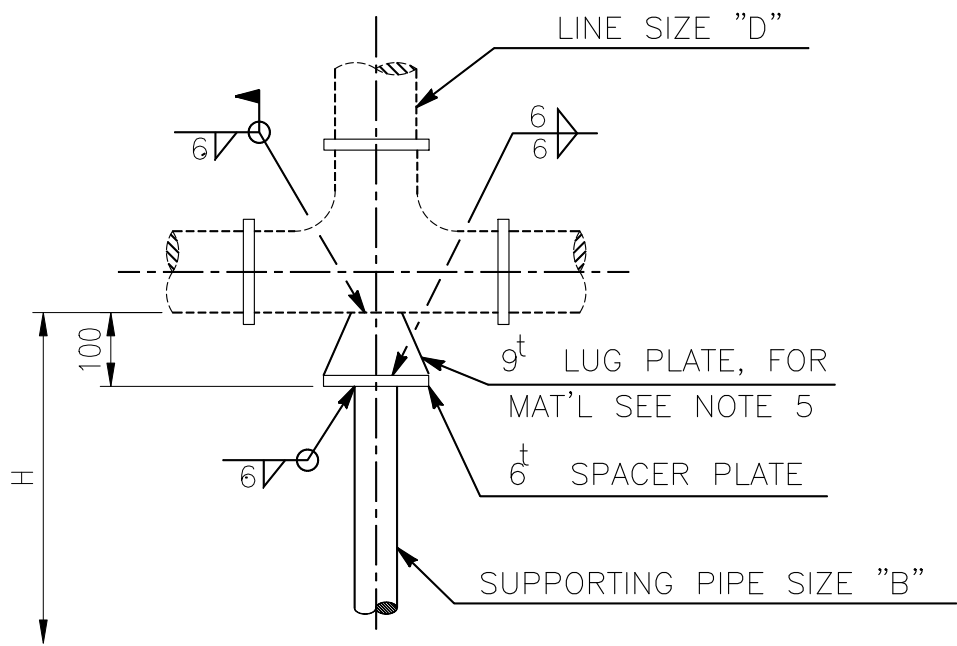
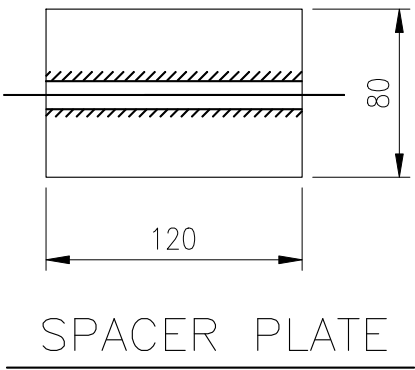


FIG - B

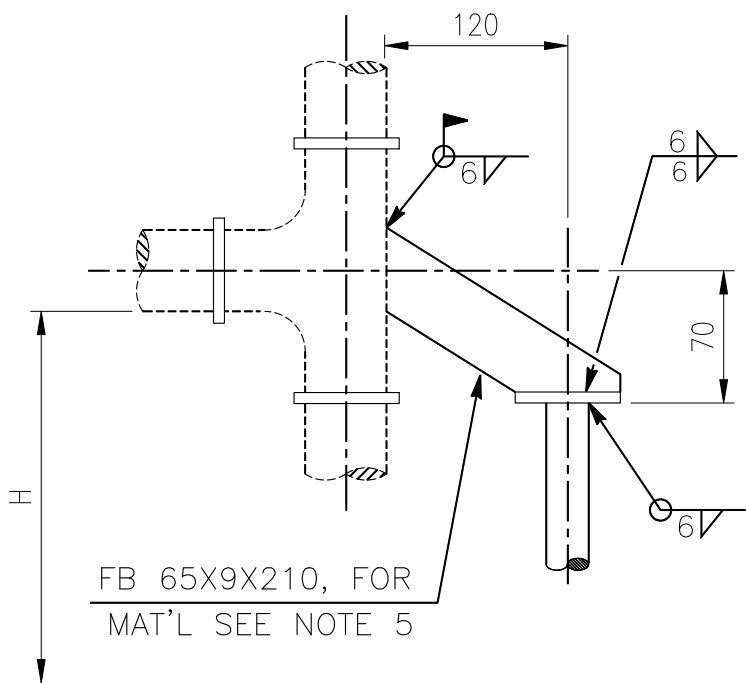


FIG - C

| LINE SIZE<br>NPS "D" | PIPE SIZE<br>"B" | H<br>(HAX.) |
|----------------------|------------------|-------------|
| 3/4"                 | 1" SCH.80        | 1000        |
|                      | 1-1/2" SCH.80    | 1500        |
| 1"                   | 1" SCH.80        | 1000        |
|                      | 1-1/2" SCH.80    | 1500        |
| 1-1/2"               | 1-1/2" SCH.80    | 1000        |
|                      | 2" SCH.40        | 1500        |
| 2"                   | 2" SCH.40        | 1500        |

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

DETAIL OF PIPE SUPPORT  
TYPE-108

ENGINEERING STANDARD

HP6-DSD-A4-500-001

|      |          |  |       |      |  |
|------|----------|--|-------|------|--|
| BY   | SHIH     |  | CHK.  | YANG |  |
| DATE | 7/15/'24 |  | APPR. | CHEN |  |

(1 OF 2)


D-119

REV.  
1

NOTES :

1. FOR ALLOY PIPING, LUG PLATE OR FLAT BAR SHALL BE OF THE MATERIAL HAVING THE EQUIVALENT QUALITY WITH THE RUN PIPE.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS:

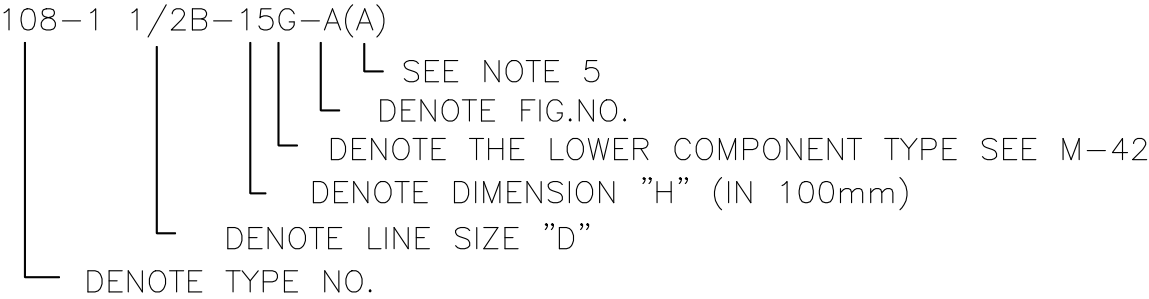

3. DIMENSION SHALL BE CUT TO SUIT IN FIELD .

4. THE LOWER COMPONENT TYPE USED IN THIS DETAIL TO BE TYPE-G, J OR R ONLY.

5.


| MAT'L OF MAIN PIPE | SYMBOL |
|--------------------|--------|
| CARBON STEEL       | NONE   |
| ALLOY STEEL        | (A)    |
| STAINLESS STEEL    | (S)    |

FILE: D-120M.DWG


|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-120                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-108  
(2 OF 2)

SUPPORT ON VALVE  
FOR NON-FERROUS PIPE

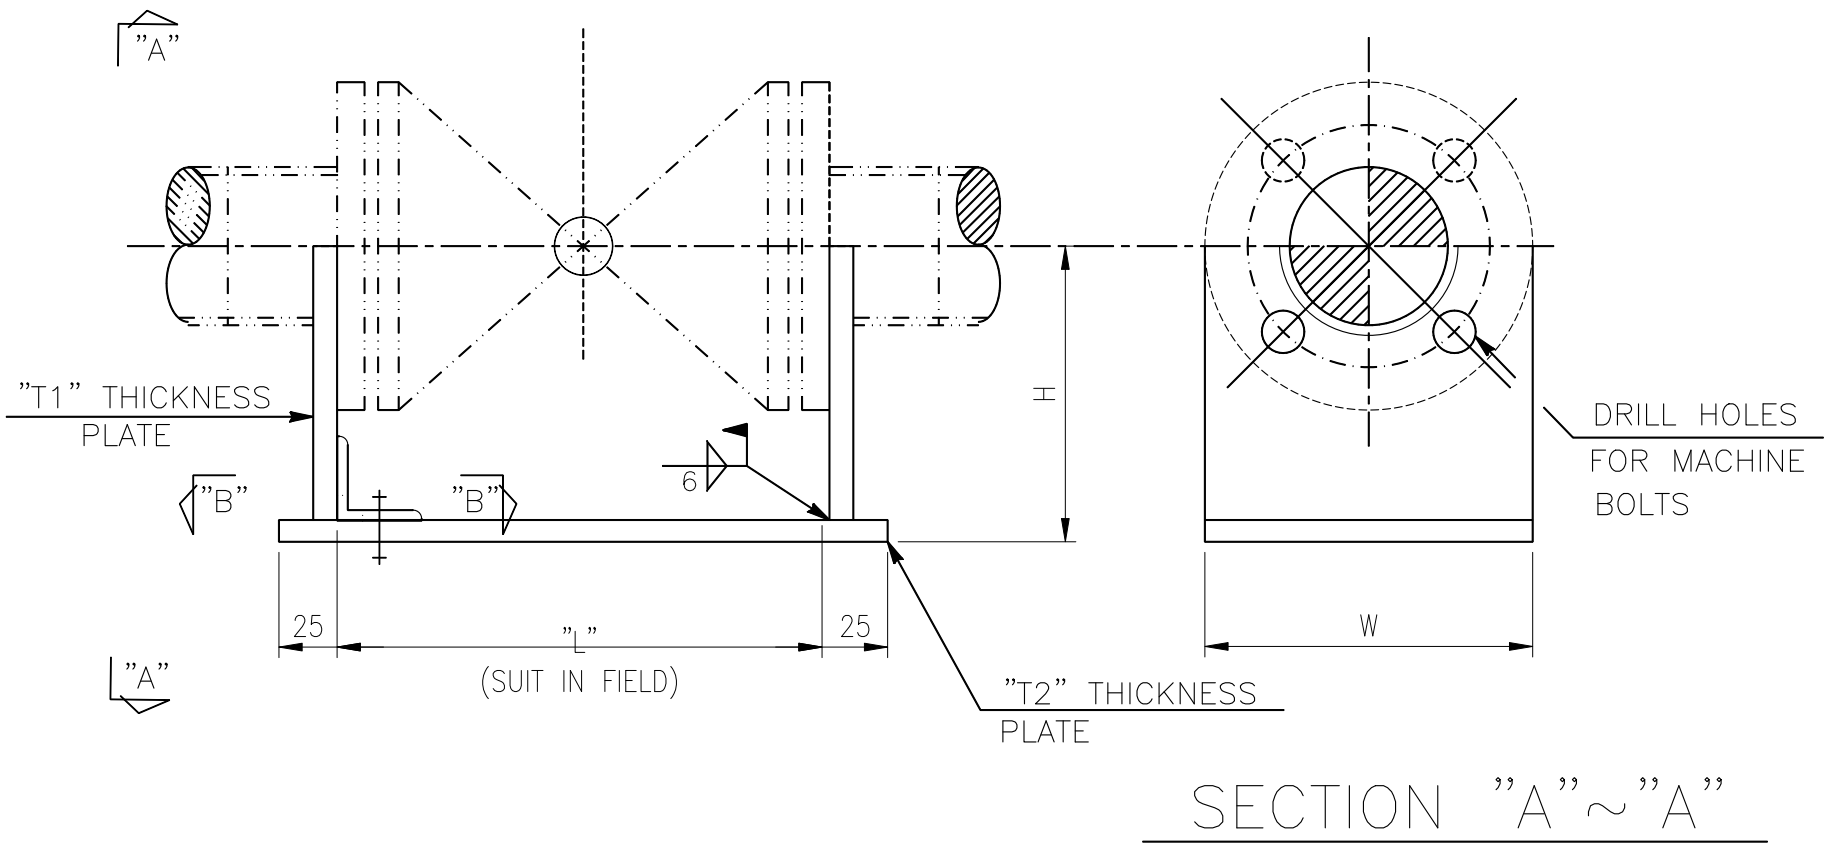

| LINE<br>SIZE | DIMENSION (MM) |    |     |     |     |
|--------------|----------------|----|-----|-----|-----|
|              | T1             | T2 | L   | H   | W   |
| 3/4"         | 3              | 6  | 120 | 130 | 98  |
| 1"           | 3              | 6  | 130 | 140 | 108 |
| 1 1/2"       | 3              | 6  | 180 | 150 | 127 |
| 2"           | 3              | 6  | 210 | 180 | 153 |
| 2 1/2"       | 3              | 9  | 250 | 200 | 178 |
| 3"           | 6              | 9  | 280 | 210 | 190 |
| 4"           | 6              | 9  | 340 | 230 | 229 |
| 5"           | 6              | 9  | 410 | 250 | 250 |
| 6"           | 6              | 9  | 480 | 290 | 280 |
| 8"           | 9              | 12 | 570 | 320 | 330 |

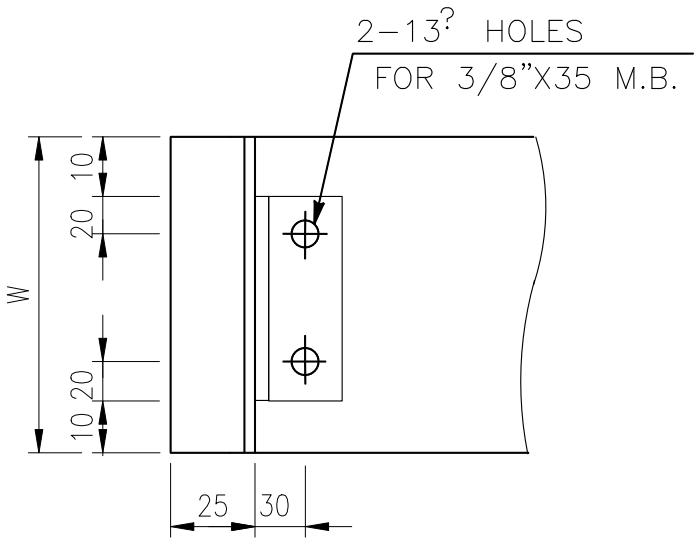

NOTES:

- FOR DIMENSIONS OF FL'G, REF. ANSI 150#
- DESIGNATION NUMBER DENOTE AS FOLLOWS :




FILE: D-125M.DWG

|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-125                | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

DETAIL OF PIPE SUPPORT  
TYPE-112



CONTINUOUS SUPPORT FOR 2" & UNDER  
NON-FERROUS PIPE

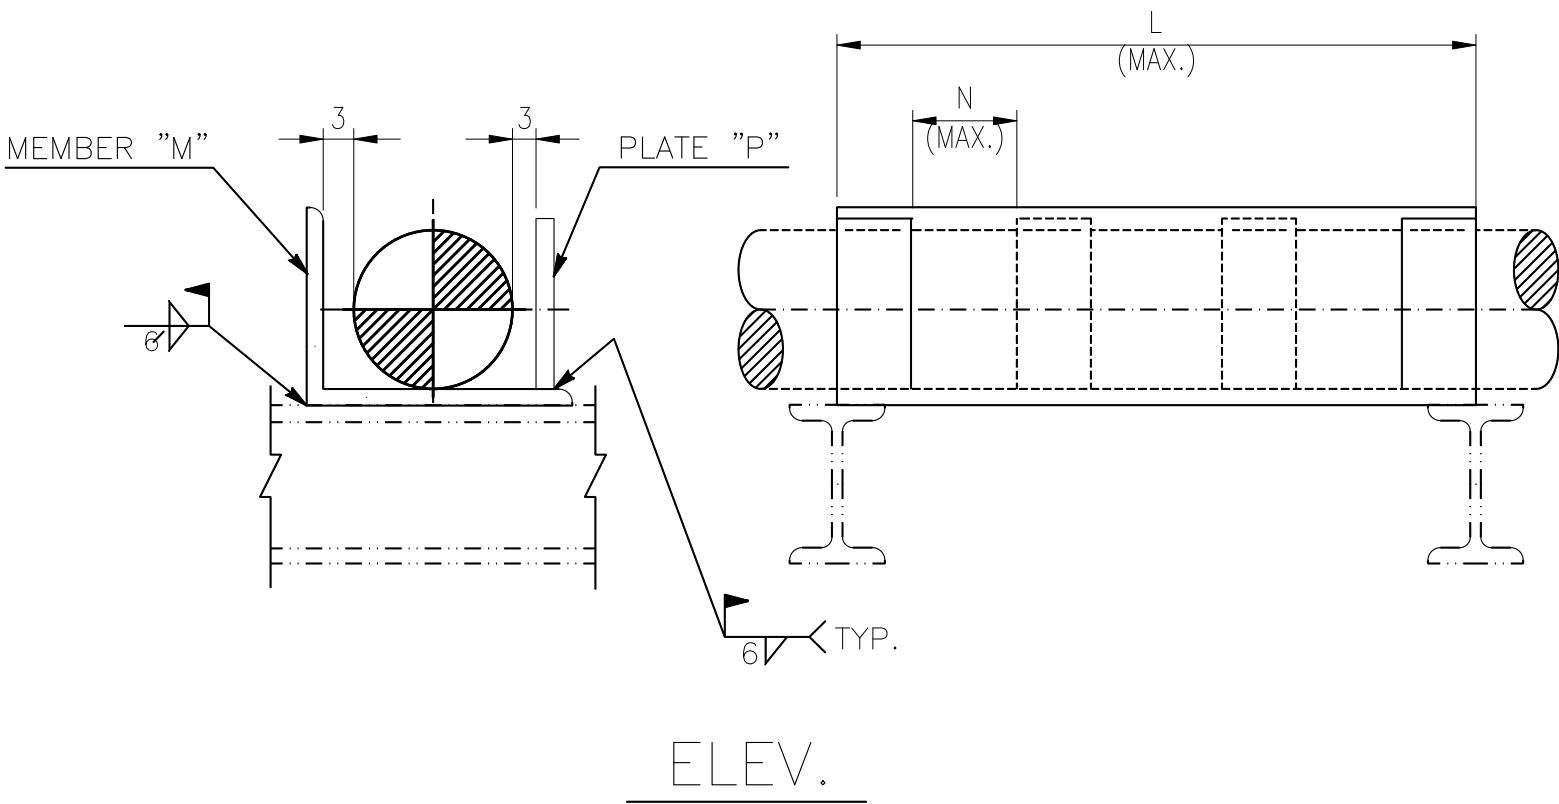


UNIT : MM

| LINE SIZE | MEMBER "M"  | PLATE "P"            | N    | L    |
|-----------|-------------|----------------------|------|------|
| 1/2",3/4" | L50X50X6    | 40X40X6 <sup>t</sup> | 800  | 3000 |
| 1",1 1/2" | L75X75X9    | 60X60X6 <sup>t</sup> | 1000 | 4000 |
| 2"        | L100X100X10 | 6tX80X80             | 1000 | 5000 |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

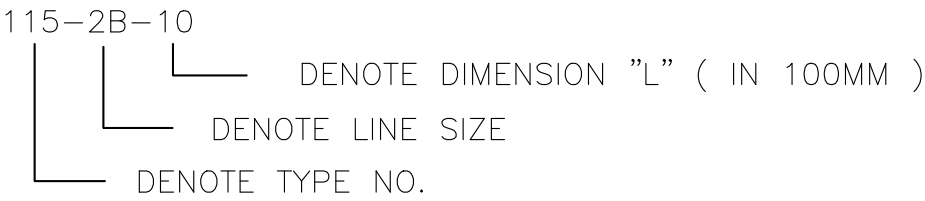

FILE: D-128M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-128                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-115                         |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

3MM RUBBER  
OR NEOPRENE SHEET

T

W

G

"T" THICKNESS  
STEEL SADDLE


SEE M-57

| LINE SIZE  | T  | G  | W   |
|------------|----|----|-----|
| 4" & UNDER | 3  | 6  | 165 |
| 6" & 8"    | 3  | 6  | 165 |
| 10"~16"    | 6  | 9  | 330 |
| 18"~24"    | 9  | 12 | 500 |
| 26"~32"    | 12 | 15 | 600 |

DENOTE TYPE NO.

|                                                                                                                                                                                                               |          |  |       |      |  |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------|--|-------|------|--|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> <div> DETAIL OF PIPE SUPPORT<br/> TYPE-118 </div> <div> ENGINEERING STANDARD<br/> HP6-DSD-A4-500-001<br/> D-131 </div> </div> |          |  |       |      |  |
| BY                                                                                                                                                                                                            | SHIH     |  | CHK.  | YANG |  |
| DATE                                                                                                                                                                                                          | 7/15/'24 |  | APPR. | CHEN |  |
| <div> <div> </div> <div> </div> <div> REV.<br/>1 </div> </div>                                                                                                                                                |          |  |       |      |  |




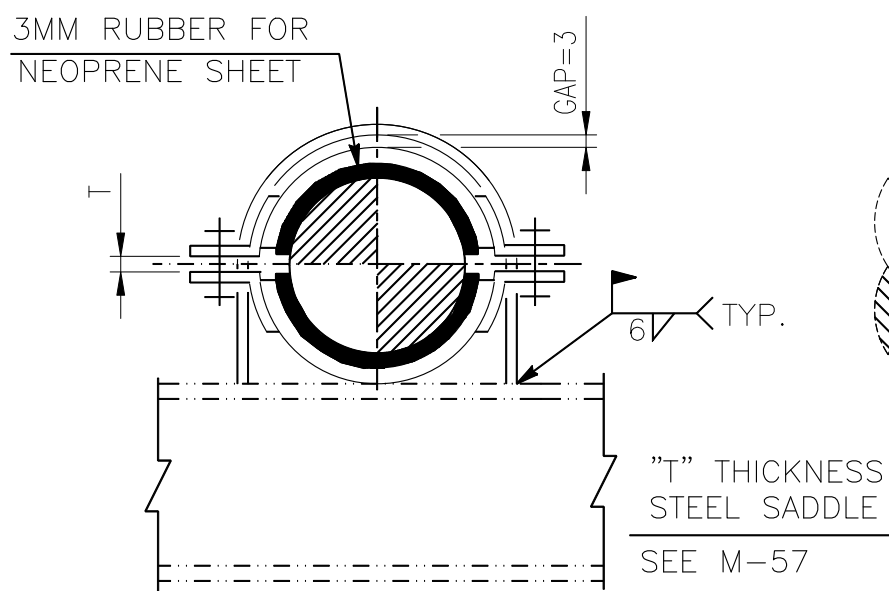

| LINE SIZE | T  | G  | W   |
|-----------|----|----|-----|
| 8" & ↓    | 3  | 6  | 165 |
| 10"~16"   | 6  | 9  | 330 |
| 18"~24"   | 9  | 12 | 500 |
| 26"~32"   | 12 | 15 | 600 |

U-BOLT DIA : SEE SH'T M-58.

|                                                                               |  |          |  |  |  |                                                       |  |  |  |  |  |                      |  |           |  |  |  |
|-------------------------------------------------------------------------------|--|----------|--|--|--|-------------------------------------------------------|--|--|--|--|--|----------------------|--|-----------|--|--|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |  |          |  |  |  | <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-119</div> |  |  |  |  |  | ENGINEERING STANDARD |  |           |  |  |  |
|                                                                               |  |          |  |  |  |                                                       |  |  |  |  |  | HP6-DSD-A4-500-001   |  |           |  |  |  |
| BY                                                                            |  | SHIH     |  |  |  |                                                       |  |  |  |  |  | CHK.                 |  | YANG      |  |  |  |
| DATE                                                                          |  | 7/15/'24 |  |  |  |                                                       |  |  |  |  |  | APPR.                |  | CHEN      |  |  |  |
|                                                                               |  |          |  |  |  |                                                       |  |  |  |  |  | D-132                |  | REV.<br>1 |  |  |  |

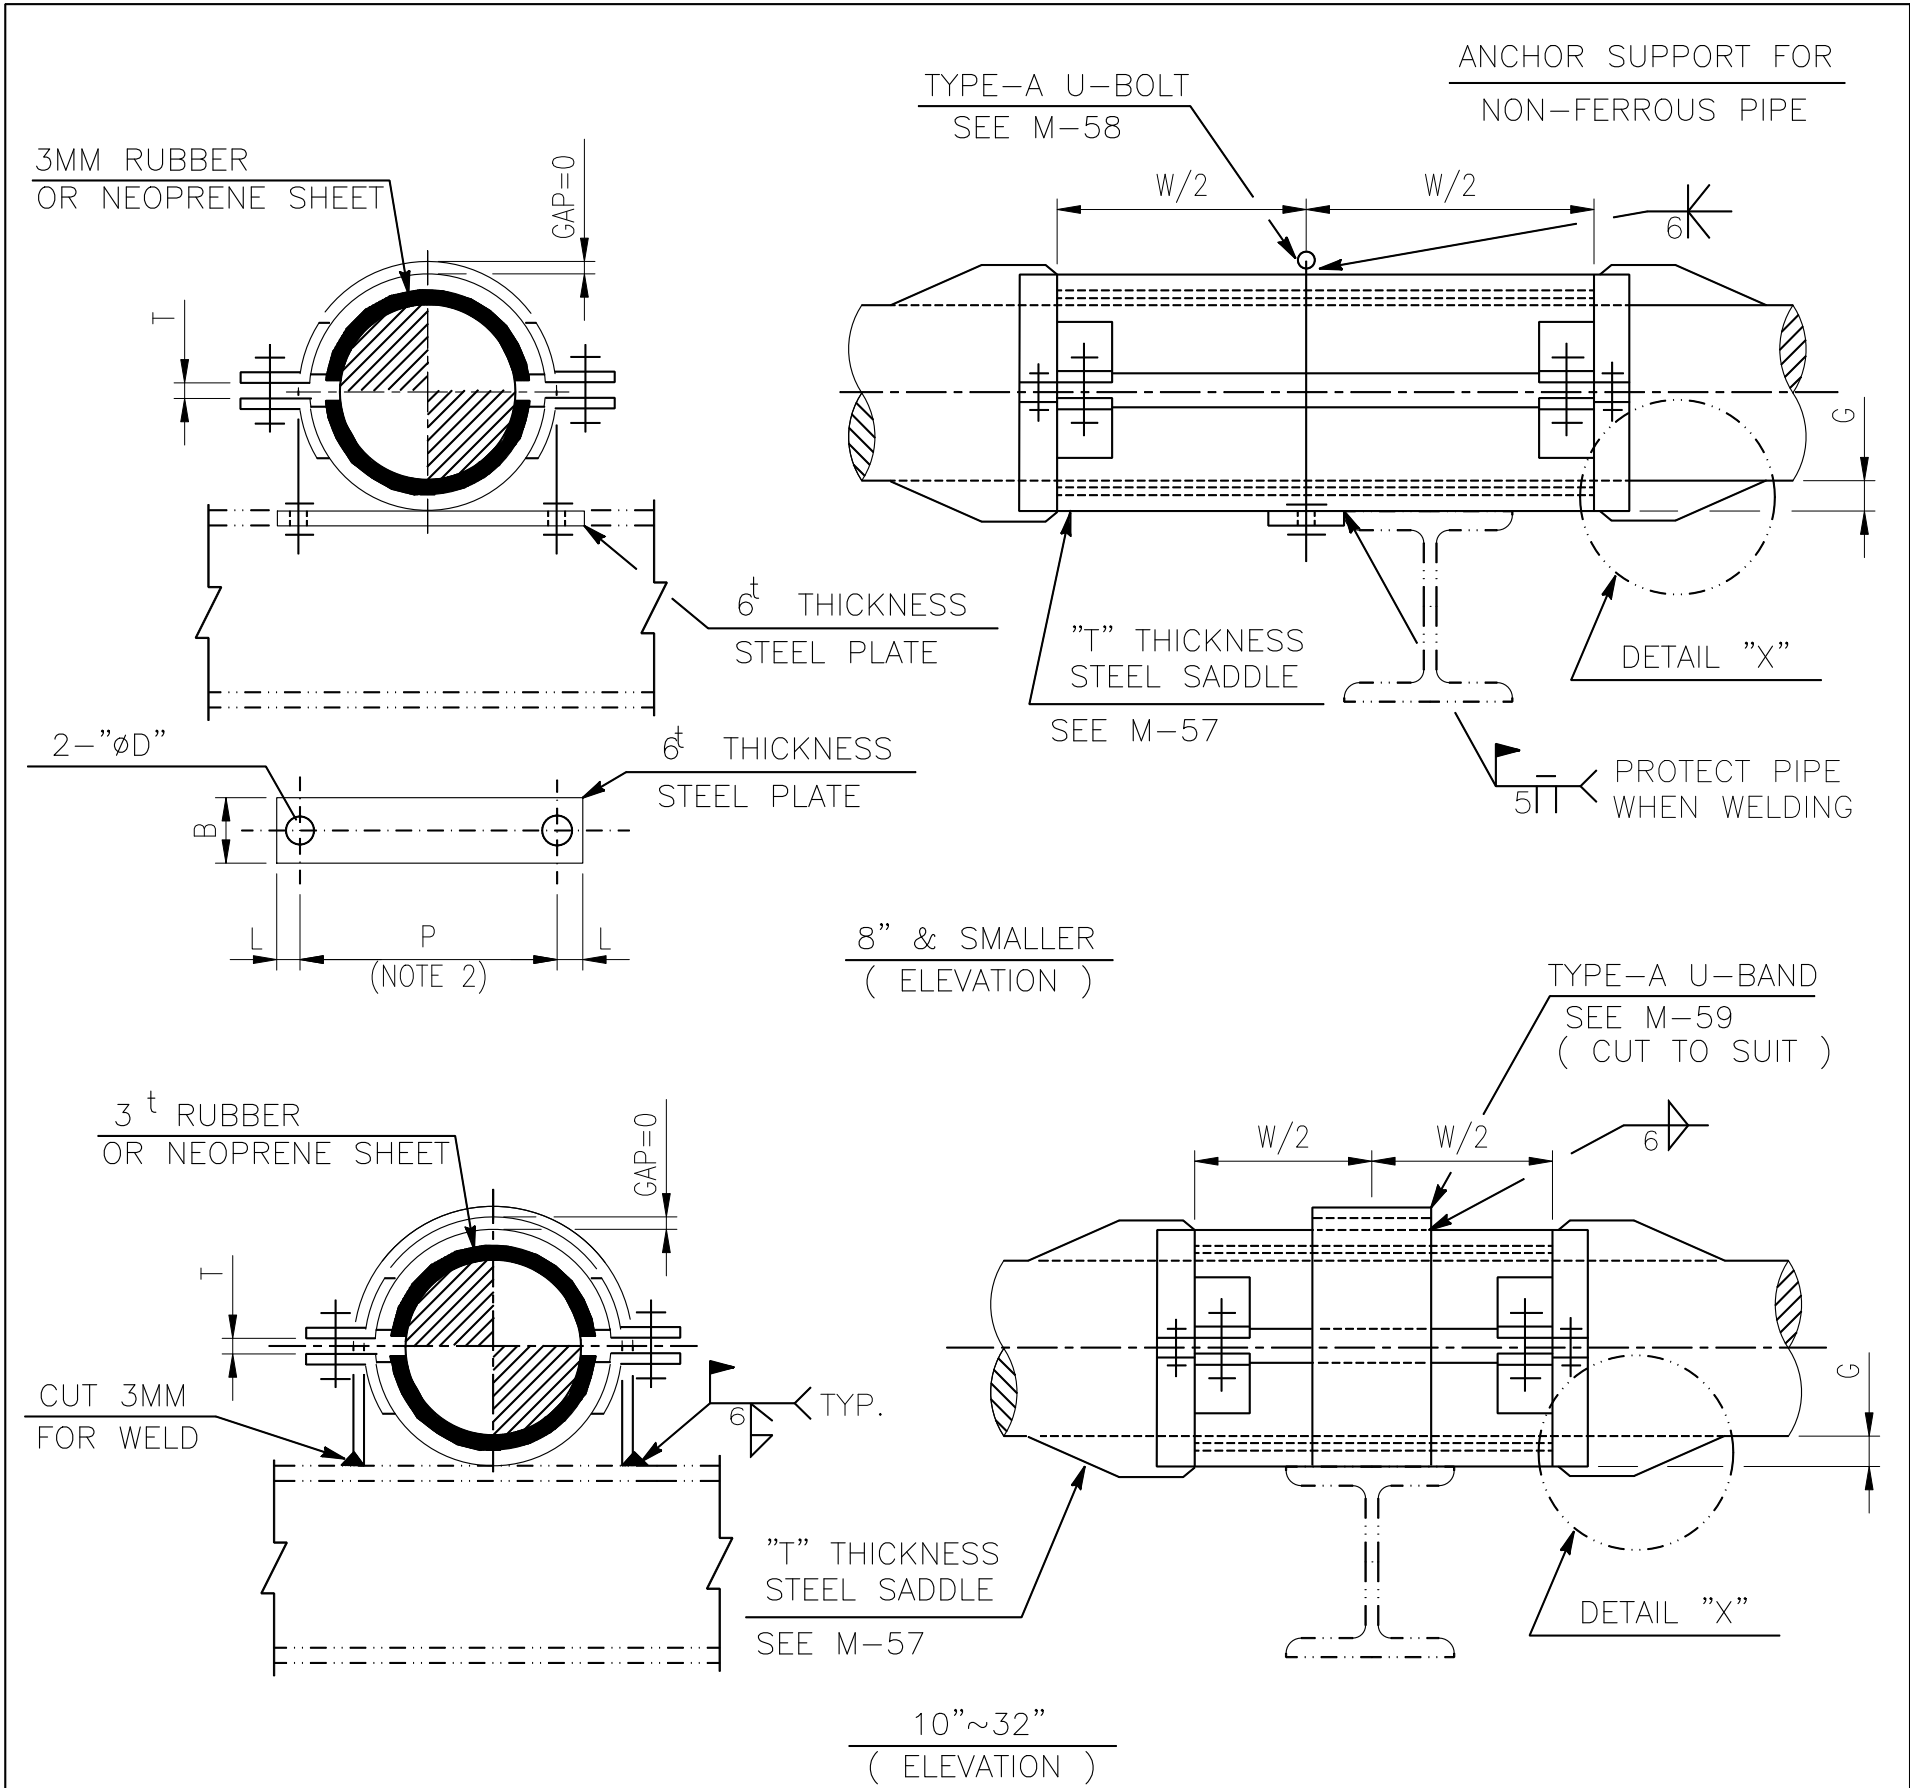


| LINE SIZE   | 1" | 1 1/2" | 2" | 2 1/2" | 3" | 4" | 6" | 8" | LINE SIZE | T  | G  | W   |
|-------------|----|--------|----|--------|----|----|----|----|-----------|----|----|-----|
| B           | 50 | 50     | 50 | 50     | 50 | 65 | 65 | 65 | 8" & ↓    | 3  | 6  | 165 |
| D           | 8  | 8      | 8  | 11     | 11 | 11 | 14 | 14 | 10"~16"   | 6  | 9  | 330 |
| L           | 15 | 15     | 15 | 20     | 20 | 20 | 25 | 25 | 18"~24"   | 9  | 12 | 500 |
| U-BOLT DIA. | 6  | 6      | 6  | 10     | 10 | 10 | 13 | 13 | 26"~32"   | 12 | 15 | 600 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

120-6B-180

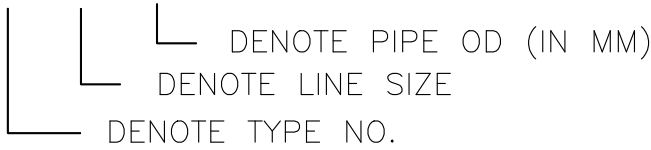



2. P=PIPE O.D.+18+U-BOLT DIA.

PIPE O.D. : OUTSIDE DIAMETER OF NON-FERROUS PIPE.

U-BOLT DIA : SEE SH'T M-58.

FILE: D-133M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-133                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-120                         |          |  |       |      |  | ( 1 OF 2 )           |  |
|                                                            |          |  |       |      |  | REV. 1               |  |

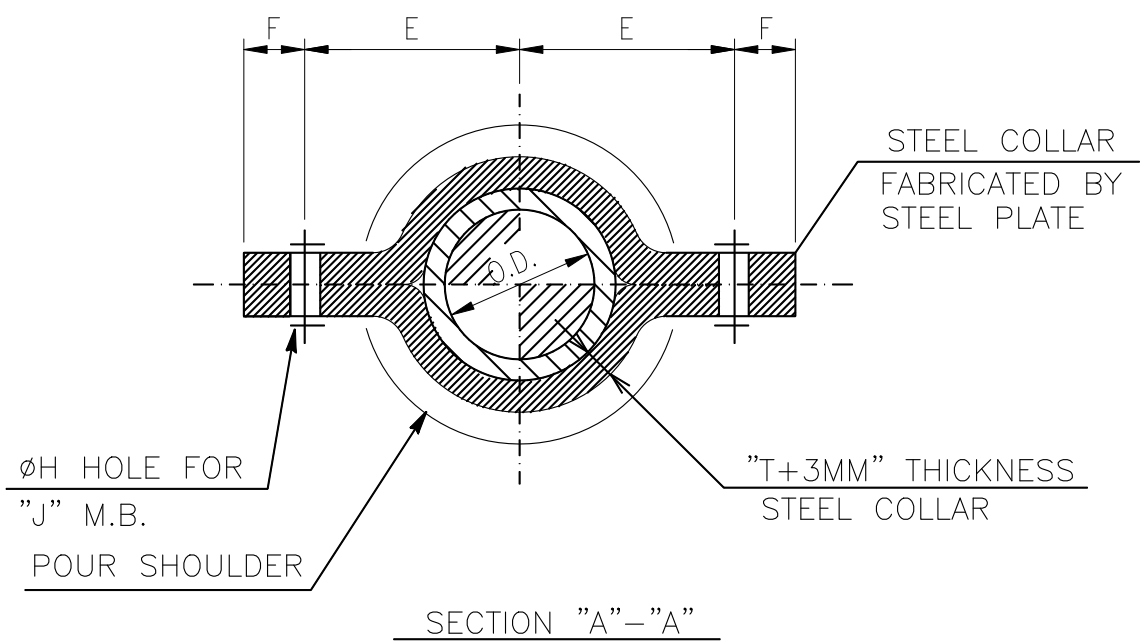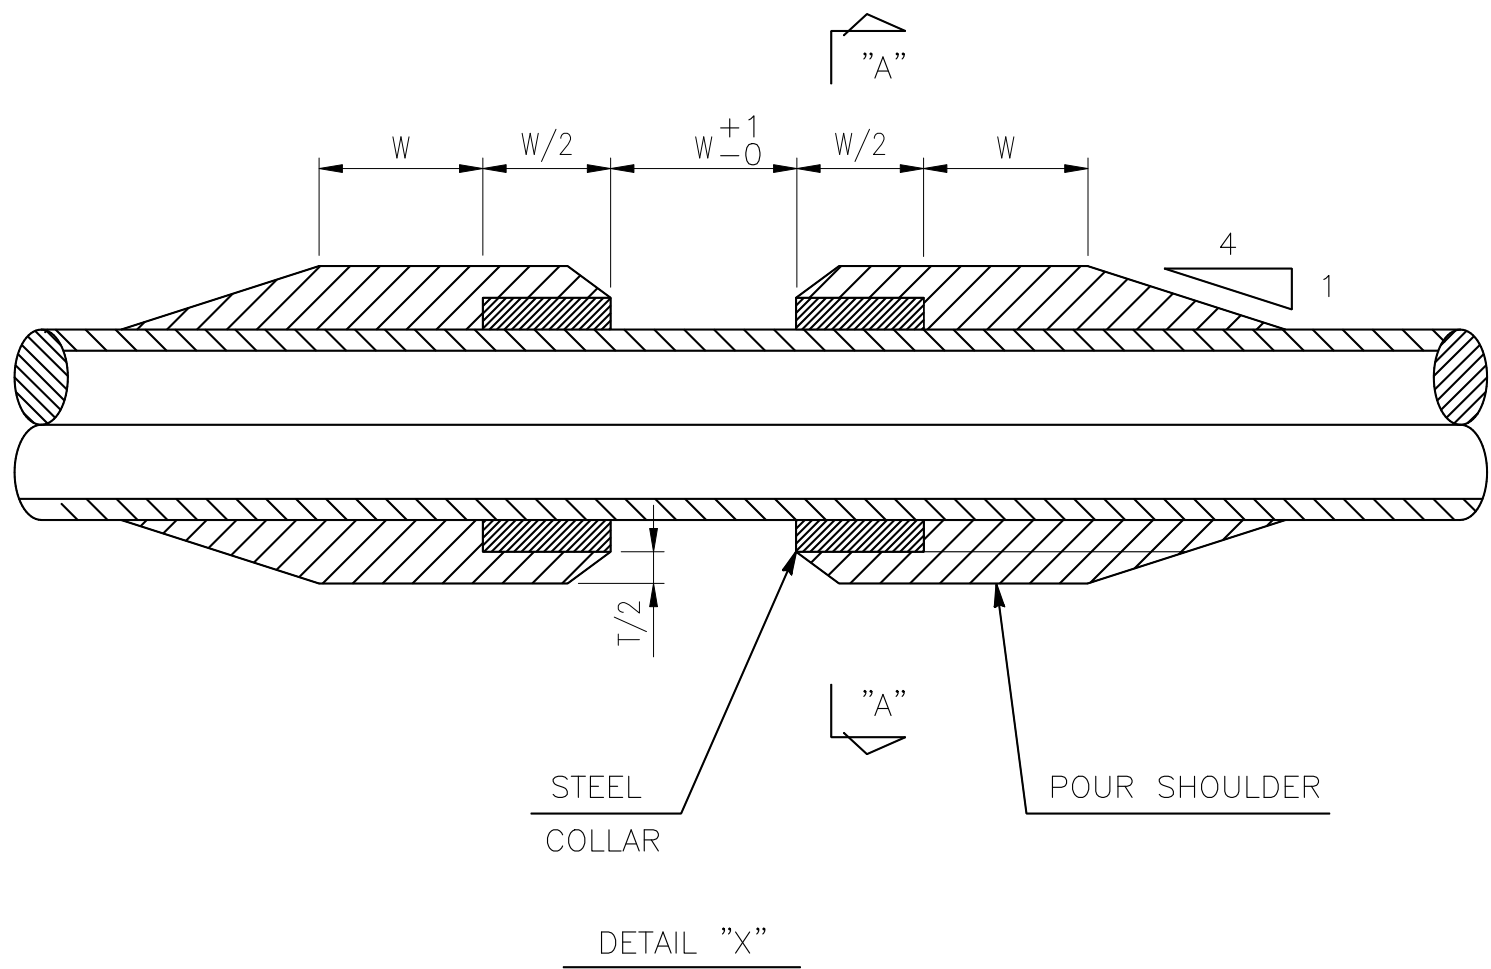

| LINE SIZE  | H  | J         |
|------------|----|-----------|
| 4" & UNDER | 8  | 1/4"X40mm |
| 6",8"      | 11 | 3/8"X50mm |
| 10"~16"    | 14 | 1/2"X60mm |
| 18"~24"    | 18 | 5/8"X80mm |
| 26"~32"    | 21 | 3/4"x90mm |

NOTES :


3.  $E = \frac{O.D.}{2} + 2H$ ,  $F = 1.5H$

O.D. : OUTSIDE DIAMETER OF NON-FERROUS PIPE.

FILE: D-134M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-134                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-120                         |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  | (2 OF 2)             |  |

| DIMENSIONS (mm) |       |      |       |       |       |         |         |      |         |       |
|-----------------|-------|------|-------|-------|-------|---------|---------|------|---------|-------|
| 公稱管徑            | 管外徑   | 螺栓直徑 | 螺栓腳長  | 跨距    | 牙長    | I-Rod高度 | I-Rod長度 | 鑽孔直徑 | I-Rod尺寸 | 螺帽扭矩  |
| Nom.Pipe Size   | D(mm) | d1   | L(mm) | P(mm) | A(mm) | I(mm)   | F(mm)   | G    | H(mm)   | N-m   |
| 1/2"            | 21.3  | 1/4" | 65    | 31.0  | 33    | 11.1    | 63.5    | 3/8" | 1"      | 4.07  |
| 3/4"            | 26.7  | 1/4" | 71    | 36.0  | 33    | 11.1    | 76.2    | 3/8" | 1"      | 4.07  |
| 1"              | 33.4  | 3/8" | 75    | 45.0  | 40    | 11.1    | 76.2    | 1/2" | 1"      | 9.49  |
| 1 1/4"          | 42.2  | 3/8" | 92    | 54.0  | 40    | 11.1    | 88.9    | 1/2" | 1"      | 9.49  |
| 1 1/2"          | 48.3  | 3/8" | 97    | 61.0  | 40    | 11.1    | 101.6   | 1/2" | 1"      | 9.49  |
| 2"              | 60.3  | 3/8" | 110   | 71.0  | 40    | 11.1    | 114.3   | 1/2" | 1"      | 9.49  |
| 2 1/2"          | 73.0  | 1/2" | 122   | 94.0  | 40    | 11.1    | 127.0   | 5/8" | 1"      | 20.34 |
| 3"              | 88.9  | 1/2" | 138   | 106.0 | 50    | 11.1    | 152.4   | 5/8" | 1"      | 20.34 |
| 4"              | 114.3 | 1/2" | 170   | 130.0 | 60    | 11.1    | 177.8   | 5/8" | 1"      | 20.34 |
| 5"              | 141.3 | 1/2" | 191   | 156.0 | 60    | 11.1    | 203.2   | 5/8" | 1"      | 20.34 |
| 6"              | 168.3 | 1/2" | 233   | 183.0 | 65    | 11.1    | 228.6   | 5/8" | 1"      | 20.34 |
| 8"              | 219.1 | 1/2" | 290   | 236.0 | 90    | 11.1    | 279.4   | 5/8" | 1"      | 20.34 |
| 10"             | 273.1 | 1/2" | 339   | 306.0 | 95    | 17.5    | 342.9   | 5/8" | 1.5"    | 20.34 |
| 12"             | 323.9 | 1/2" | 378   | 340.0 | 95    | 17.5    | 406.4   | 5/8" | 1.5"    | 20.34 |

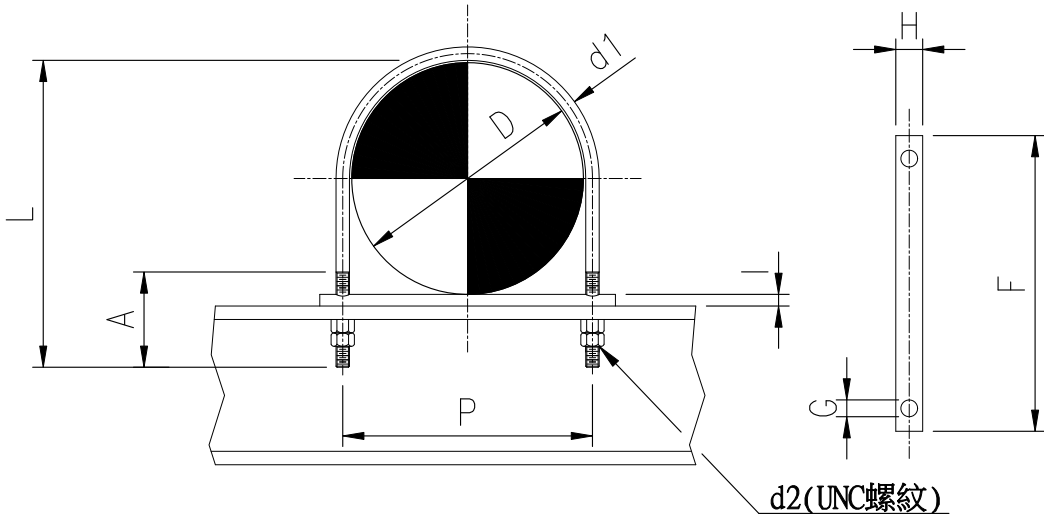

NOTES :

- 1.I-Rod 單點最大負荷:1" 8000LB(3632kg) , 1.5" 10000LB(4540kg)
- 2.I-Rod 可多支並排，最多三支，平均分擔負荷
- 3.I-Rod 材質適用最高溫度 Regular:83℃ , High Temp.:171℃ , PEEK:249℃
- 4.I-Rod 材質:熱塑性塑膠(Theroplastic)
- 5.DESIGNATION NUMBER DENOTE AS FOLLOWS:


125-8B

DENOTE TYPE NO.    DENOTE LINE SIZE

FILE: D-134M.DWG


|                                                            |          |  |       |      |  |                                                  |           |
|------------------------------------------------------------|----------|--|-------|------|--|--------------------------------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD                             |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001                               |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | DETAIL OF PIPE SUPPORT<br>TYPE-125<br>( 1 OF 1 ) | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                  |           |

| DIMENSIONS    |       |          |       |          |       |          |       |              |        |      |        |
|---------------|-------|----------|-------|----------|-------|----------|-------|--------------|--------|------|--------|
| 公稱管徑          | 管外徑   | I-Rod 長度 |       | I-Rod 呎吋 |       | I-Rod 高度 |       | 橫樑墊置最大間距 (M) |        |      |        |
| Nom.Pipe Size | (mm)  | L(inch)  | L(mm) | C(inch)  | C(mm) | D(inch)  | D(mm) | Std          | Sch.40 | XS   | Sch.80 |
| 1/2"          | 21.3  | 2"       | 50.8  | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 3/4"          | 26.7  | 2.5"     | 63.5  | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 1"            | 33.4  | 3"       | 76.2  | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 1 1/4"        | 42.2  | 3.5"     | 88.9  | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 1 1/2"        | 48.3  | 3/8"     | 101.6 | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 2"            | 60.3  | 3/8"     | 114.3 | 1"       | 25.4  | 7/16"    | 11.1  | 406          | 406    | 348  | 348    |
| 2 1/2"        | 73.0  | 1/2"     | 127.0 | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 3"            | 88.9  | 1/2"     | 152.4 | 1"       | 25.4  | 7/16"    | 11.1  | 202          | 202    | 174  | 174    |
| 4"            | 114.3 | 1/2"     | 177.8 | 1"       | 25.4  | 7/16"    | 11.1  | 135          | 135    | 110  | 110    |
| 5"            | 141.3 | 1/2"     | 203.2 | 1"       | 25.4  | 7/16"    | 11.1  | ----         | ----   | ---- | ----   |
| 6"            | 168.3 | 1/2"     | 228.6 | 1"       | 25.4  | 7/16"    | 11.1  | 73           | 71     | 55   | 55     |
| 8"            | 219.1 | 1/2"     | 279.4 | 1"       | 25.4  | 7/16"    | 11.1  | 47           | 45     | 35   | 35     |
| 10"           | 273.1 | 1/2"     | 342.9 | 1.1/2"   | 38.1  | 11/16"   | 17.5  | 39           | 38     | 32   | 29     |
| 12"           | 323.9 | 1/2"     | 406.4 | 1.1/2"   | 38.1  | 11/16"   | 17.5  | 29           | 27     | 24   | 21     |

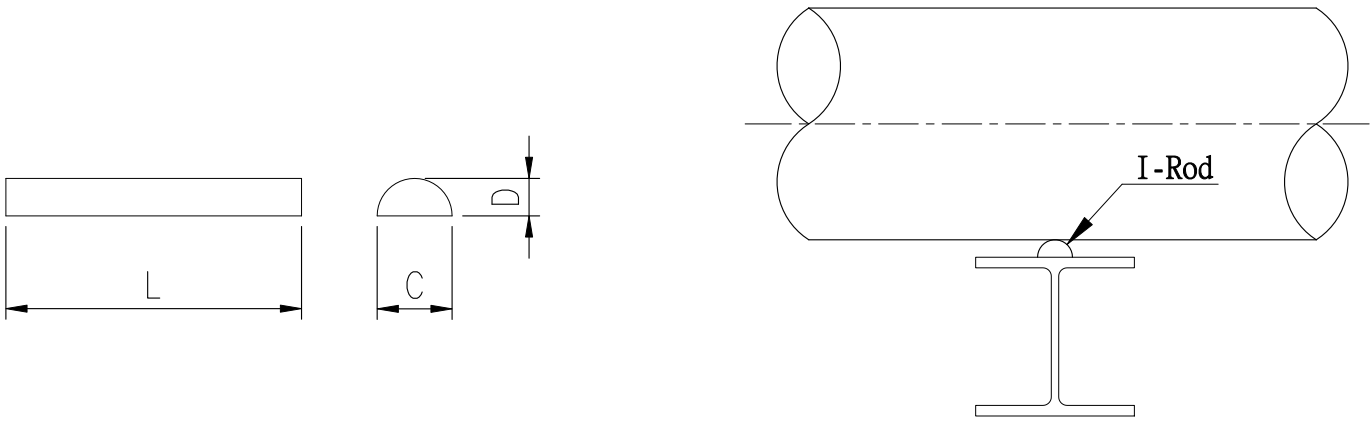

- NOTES :
- 1.I-Rod 單點最大負荷:1" 8000LB(3632kg) , 1.5" 10000LB(4540kg)
  - 2.I-Rod 可多支並排, 最多三支, 平均分擔負荷。
  - 3.I-Rod 材質適用最高溫度 Regular:83℃ , High Temp.:171℃ , PEEK:249℃
  - 4.I-Rod 材質:熱塑性塑膠(Theroplastic)
  - 5.可用3M雙面膠或原廠I-Rod專用黏膠將I-Rod黏置於橫樑上。
  - 6.本表依據單支I-Rod的最大荷重與飽水管重量計算, I-Rod橫樑墊置實際設計間距, 不可超過本表的最大間距, 以免超過I-Rod的最大荷重。
  - 7.DESIGNATION NUMBER DENOTE AS FOLLOWS:  
126-8B  
DENOTE TYPE NO. ———— DENOTE LINE SIZE

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                      |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | HP6-DSD-A4-500-001   |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-126<br>( 1 OF 1 )           |          |  |       |      |  | D-136                |  |
|                                                            |          |  |       |      |  |                      |  |
|                                                            |          |  |       |      |  | REV. 1               |  |

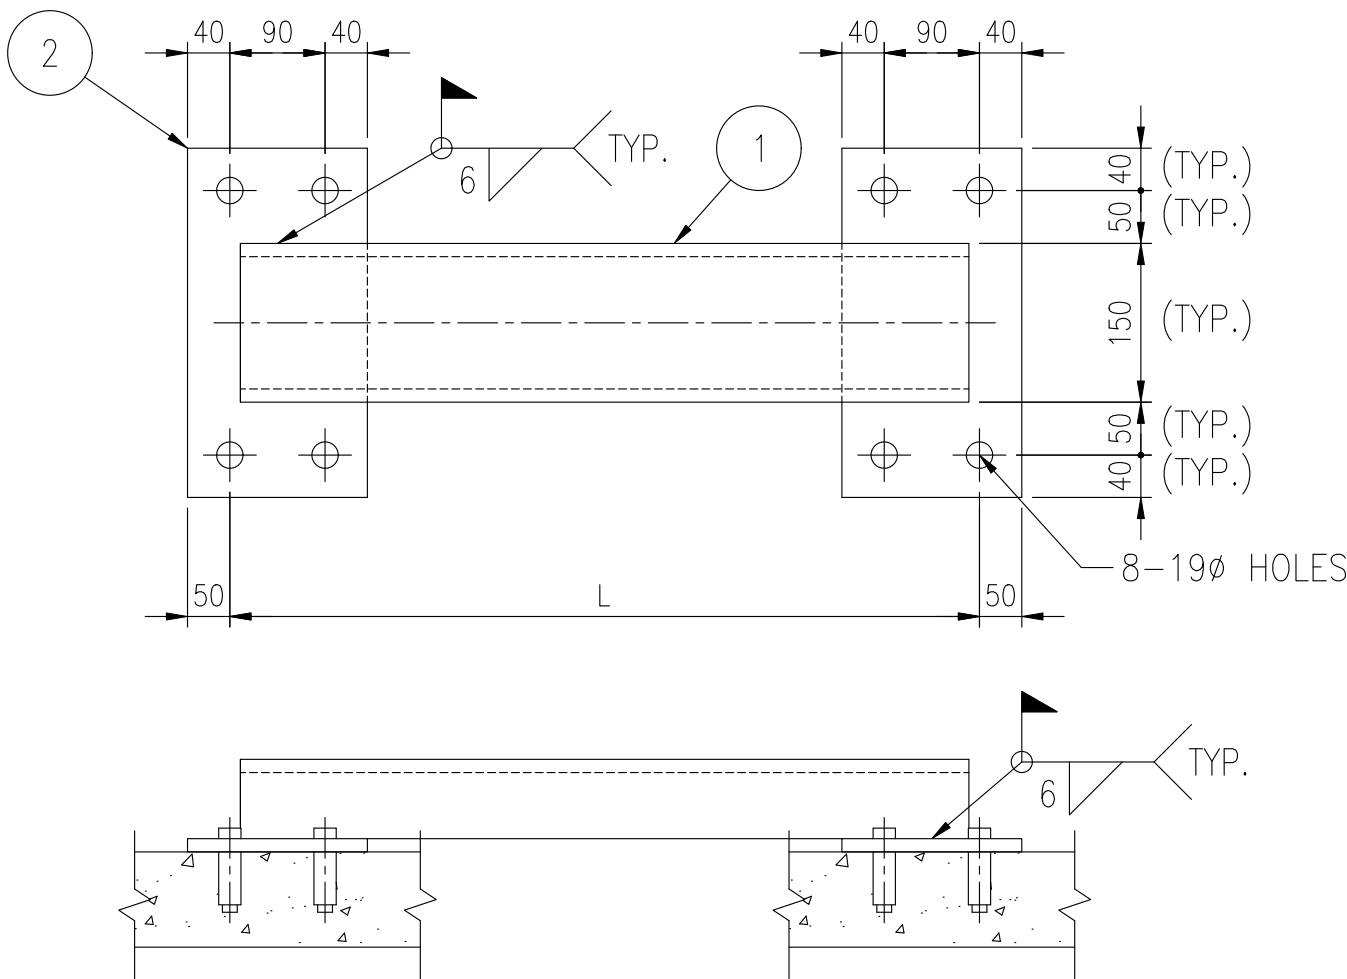

| ITEM NO. | DESCRIPTION    | SIZE           | MAT'L     | Q'TY | REMARK       |
|----------|----------------|----------------|-----------|------|--------------|
| 1        | CHANNEL        | C150x75x6.5    | A36       | 1    |              |
| 2        | BASE PLATE     | PL.12tx170x330 | A283 Gr.C | 2    |              |
| 3        | EXPANSION BOLT | EB2-M16x125L   | A307 Gr.8 | 8    | REFER TO EB2 |

NOTES :

1. L max. = 1,500 mm
2. LENGTH "L" SHOULD BE CUT TO SUIT BY FIELD.
3. DESIGNATION NUMBER :

127- □ L


└── LENGTH OF SUPPORT "L"

| PLAN | SPOOL                                |
|------|--------------------------------------|
|      |                                      |
|      | NOTE:SHOWN ON THE LARGEST PIPE LINE. |

|                                                                               |          |  |       |      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| <div>DETAIL OF PIPE SUPPORT</div> <div>TYPE-127 (1 OF 1)</div>                |          |  |       |      |  | REV.<br>1            |  |
|                                                                               |          |  |       |      |  |                      |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | D-137                |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |

FILE: D-137.DWG



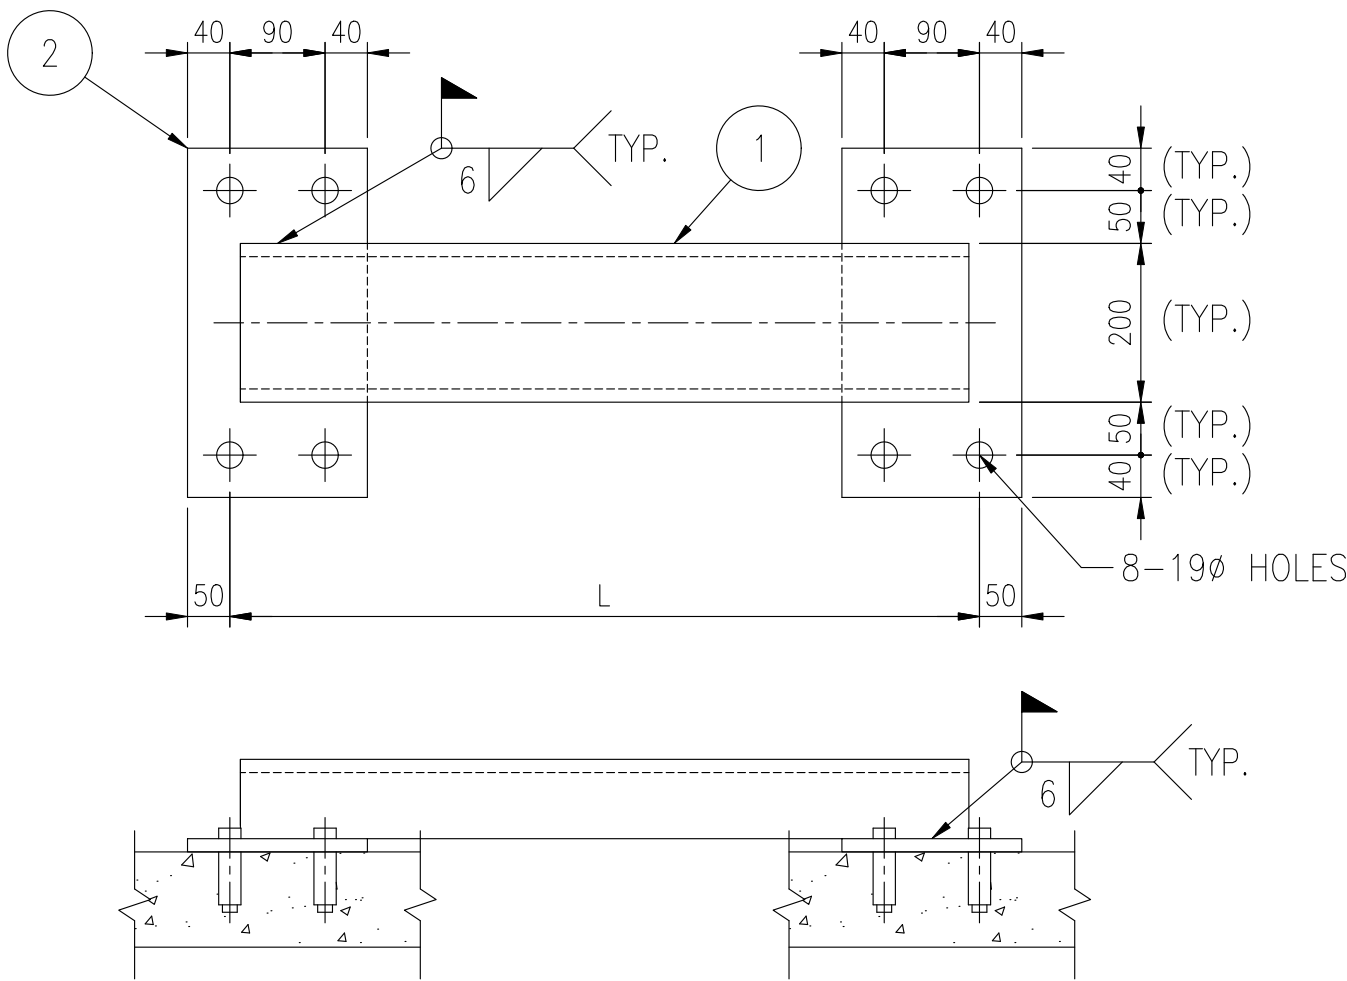

| ITEM NO. | DESCRIPTION    | SIZE           | MAT'L     | Q'TY | REMARK       |
|----------|----------------|----------------|-----------|------|--------------|
| 1        | CHANNEL        | C200x80x7.5    | A36       | 1    |              |
| 2        | BASE PLATE     | PL.12tx170x380 | A283 Gr.C | 2    |              |
| 3        | EXPANSION BOLT | EB2-M16x125L   | A307 Gr.8 | 8    | REFER TO EB2 |

NOTES :


1. L max. = 1,500 mm
2. LENGTH "L" SHOULD BE CUT TO SUIT BY FIELD.
3. DESIGNATION NUMBER :

128- □ L

└── LENGTH OF SUPPORT "L"

| PLAN | SPOOL                                           |
|------|-------------------------------------------------|
|      | <div>NOTE:SHOWN ON THE LARGEST PIPE LINE.</div> |

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-138                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-128 (1 OF 1)                |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

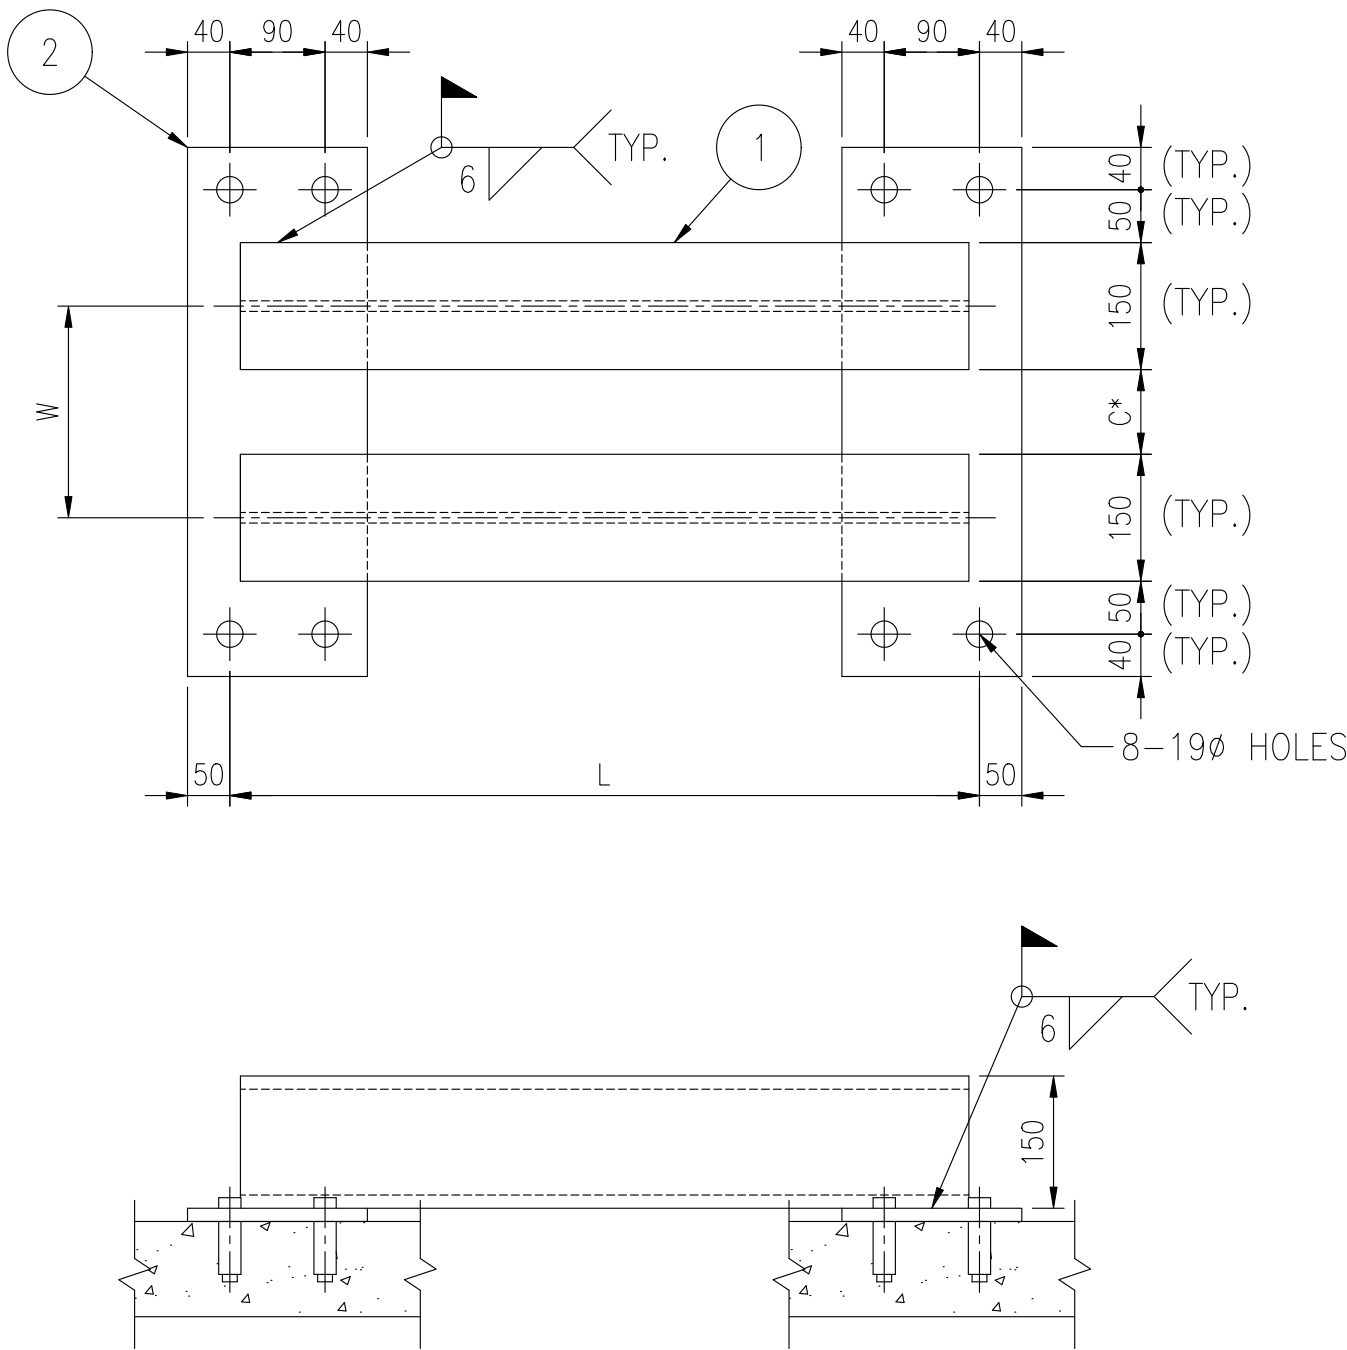

| ITEM NO. | DESCRIPTION    | SIZE                | MAT'L     | Q'TY | REMARK       |
|----------|----------------|---------------------|-----------|------|--------------|
| 1        | CHANNEL        | H150x150x7x10       | A36       | 2    |              |
| 2        | BASE PLATE     | PL.12tx170x(480+C*) | A283 Gr.C | 2    |              |
| 3        | EXPANSION BOLT | EB2-M16x125L        | A307 Gr.8 | 8    | REFER TO EB2 |

NOTES :


1. L max. = 2,000 mm
2. W min. = 300 mm
3. LENGTH "L" SHOULD BE CUT TO SUIT BY FIELD.
4. C\* = W - 150
3. DESIGNATION NUMBER :  
129- □ L-□ W  
└─ LENGTH OF SUPPORT "L"

| PLAN          | SPOOL                                                     |
|---------------|-----------------------------------------------------------|
| <br>F526-100L | <br>F526-100L<br><br>NOTE:SHOWN ON THE LARGEST PIPE LINE. |


|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | D-139                |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| DETAIL OF PIPE SUPPORT<br>TYPE-129 ( 1 OF 1 )              |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

FILE: D-139.DWG





|     |           |
|-----|-----------|
| M-1 | REV.<br>1 |
|-----|-----------|

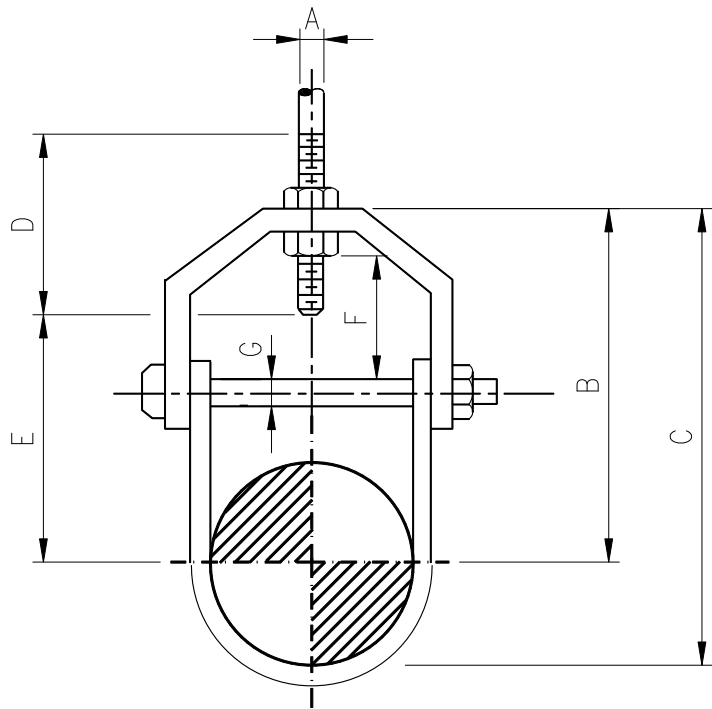

DIMENSIONS (mm)

| TYPE       | LINE SIZE | MAX. RECOM. LOAD(KG) | SIZE OF STEEL |       | A      | B   | C   | D   | E   | ADJUST-MENT F | G      |
|------------|-----------|----------------------|---------------|-------|--------|-----|-----|-----|-----|---------------|--------|
|            |           |                      | UPPER         | LOWER |        |     |     |     |     |               |        |
| ADC-1/2B   | 1/2"      | 275                  | 3X25          | 3X25  | 3/8"   | 43  | 54  | 64  | 22  | 11            | 1/4"   |
| ADC-3/4B   | 3/4"      | 275                  | 3X25          | 3X25  | 3/8"   | 48  | 62  | 64  | 25  | 13            | 1/4"   |
| ADC- 1B    | 1"        | 275                  | 3X25          | 3X25  | 3/8"   | 54  | 71  | 64  | 32  | 16            | 1/4"   |
| ADC-1 1/4B | 1 1/4"    | 275                  | 3X25          | 3X25  | 3/8"   | 65  | 87  | 64  | 44  | 22            | 1/4"   |
| ADC-1 1/2B | 1 1/2"    | 275                  | 4X25          | 3X25  | 3/8"   | 76  | 102 | 64  | 54  | 27            | 1/4"   |
| ADC- 2B    | 2"        | 275                  | 4X25          | 3X25  | 3/8"   | 94  | 124 | 64  | 75  | 41            | 1/4"   |
| ADC-2 1/2B | 2 1/2"    | 515                  | 5X32          | 5X32  | 1/2"   | 119 | 156 | 76  | 97  | 51            | 3/8"   |
| ADC- 3B    | 3"        | 515                  | 5X32          | 5X32  | 1/2"   | 121 | 167 | 76  | 98  | 44            | 3/8"   |
| ADC-3 1/2B | 3 1/2"    | 515                  | 5X32          | 5X32  | 1/2"   | 125 | 176 | 76  | 103 | 44            | 3/8"   |
| ADC- 4B    | 4"        | 650                  | 6X32          | 5X32  | 5/8"   | 141 | 198 | 89  | 114 | 49            | 3/8"   |
| ADC- 5B    | 5"        | 650                  | 6X32          | 5X32  | 5/8"   | 157 | 229 | 89  | 130 | 44            | 1/2"   |
| ADC- 6B    | 6"        | 880                  | 6X38          | 5X38  | 3/4"   | 176 | 257 | 102 | 143 | 48            | 1/2"   |
| ADC- 8B    | 8"        | 910                  | 6X44          | 5X44  | 7/8"   | 213 | 321 | 108 | 178 | 54            | 5/8"   |
| ADC-10B    | 10"       | 1635                 | 9X44          | 6X44  | 7/8"   | 251 | 387 | 114 | 213 | 57            | 3/4"   |
| ADC-12B    | 12"       | 1725                 | 9X51          | 6X51  | 7/8"   | 284 | 446 | 121 | 248 | 67            | 3/4"   |
| ADC-14B    | 14"       | 1910                 | 12X51         | 6X51  | 1"     | 316 | 494 | 133 | 275 | 75            | 7/8"   |
| ADC-16B    | 16"       | 2090                 | 12X64         | 6X64  | 1"     | 357 | 584 | 152 | 316 | 67            | 1"     |
| ADC-18B    | 18"       | 2180                 | 12X64         | 6X64  | 1 1/8" | 394 | 629 | 165 | 354 | 95            | 1"     |
| ADC-20B    | 20"       | 2180                 | 16X76         | 9X76  | 1 1/4" | 438 | 695 | 178 | 367 | 102           | 1 1/4" |
| ADC-24B    | 24"       | 2180                 | 16X76         | 9X76  | 1 1/4" | 498 | 803 | 191 | 445 | 108           | 1 1/4" |
| ADC-30B    | 30"       | 2725                 | 19X76         | 9X76  | 1 1/4" | 613 | 994 | 210 | 556 | 127           | 1 5/8" |

NOTES:

1. MATERIAL: CARBON STEEL
2. DESIGNATION NUMBER DENOTE AS FOLLOWS:

ADC-1/2B

└─ DENOTE LINE SIZE

└─ DENOTE ADJUSTABLE CLEVIS
3. REF. GRINNELL FIG. 260 OR EQ.

FILE: M-3M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-3                  |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| ADJUSTABLE CLEVIS                                          |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |




NOTES :

- PCL-A-1/2B

DENOTE TYPE-A

3. REF. GRINNELL FIG. 212. OR EQ.

|                                                                       |          |  |       |      |  |                             |  |
|-----------------------------------------------------------------------|----------|--|-------|------|--|-----------------------------|--|
| <p>中威工程顧問股份有限公司</p> <p>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</p> |          |  |       |      |  | <p>ENGINEERING STANDARD</p> |  |
| <p>PIPE CLAMP</p>                                                     |          |  |       |      |  | <p>HP6-DSD-A4-500-001</p>   |  |
| <p>TYPE-A</p>                                                         |          |  |       |      |  | <p>REV. 1</p>               |  |
| BY                                                                    | SHIH     |  | CHK.  | YANG |  |                             |  |
| DATE                                                                  | 7/15/'24 |  | APPR. | CHEN |  |                             |  |

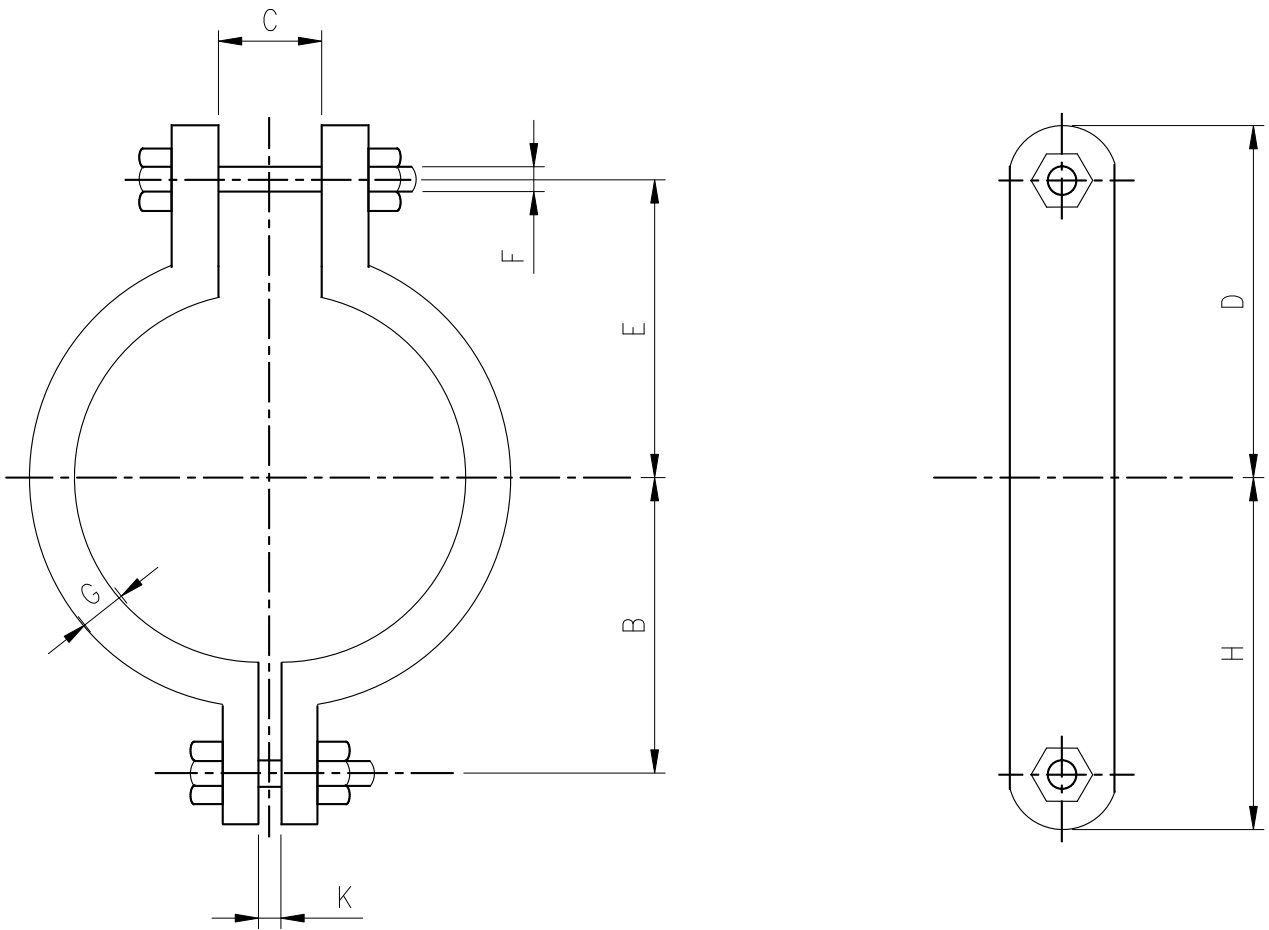

DIMENSION (mm)

| TYPE      | LINE SIZE | MAX. RECOM. LOAD (Kg) |       | B   | C  | D   | E   | F      | G        | H   | K  |
|-----------|-----------|-----------------------|-------|-----|----|-----|-----|--------|----------|-----|----|
|           |           | 650°F                 | 750°F |     |    |     |     |        |          |     |    |
| PCL-B-3B  | 3"        | 1525                  | 1360  | 75  | 25 | 102 | 79  | 3/4"   | 8 × 51   | 97  | 16 |
| PCL-B-4B  | 4"        | 1590                  | 1420  | 91  | 25 | 124 | 95  | 7/8"   | 9 × 51   | 119 | 16 |
| PCL-B-5B  | 5"        | 1590                  | 1420  | 105 | 25 | 140 | 111 | 7/8"   | 9 × 51   | 133 | 16 |
| PCL-B-6B  | 6"        | 2205                  | 1965  | 127 | 29 | 168 | 133 | 1"     | 12 × 64  | 162 | 22 |
| PCL-B-8B  | 8"        | 2205                  | 1965  | 156 | 29 | 194 | 159 | 1"     | 12 × 64  | 191 | 22 |
| PCL-B-10B | 10"       | 2725                  | 2430  | 192 | 32 | 230 | 195 | 1 1/4" | 16 × 64  | 227 | 22 |
| PCL-B-12B | 12"       | 3930                  | 3510  | 228 | 41 | 276 | 235 | 1 1/2" | 19 × 76  | 270 | 22 |
| PCL-B-14B | 14"       | 4135                  | 3685  | 248 | 41 | 302 | 254 | 1 1/2" | 19 × 89  | 295 | 22 |
| PCL-B-16B | 16"       | 4135                  | 3685  | 273 | 41 | 327 | 279 | 1 1/2" | 19 × 89  | 321 | 22 |
| PCL-B-18B | 18"       | 6255                  | —     | 368 | 76 | 470 | 368 | 2"     | 19 × 152 | 470 | 76 |
| PCL-B-20B | 20"       | 6935                  | —     | 406 | 76 | 508 | 406 | 2"     | 25 × 127 | 508 | 76 |
| PCL-B-24B | 24"       | 7390                  | —     | 470 | 83 | 584 | 470 | 2 1/4" | 25 × 152 | 584 | 83 |
| PCL-B-28B | 28"       | 8160                  | —     | 521 | 83 | 635 | 521 | 2 1/4" | 25 × 203 | 635 | 83 |
| PCL-B-30B | 30"       | 9295                  | —     | 572 | 89 | 699 | 572 | 2 1/2" | 32 × 178 | 699 | 89 |
| PCL-B-32B | 32"       | 10770                 | —     | 597 | 89 | 724 | 597 | 2 1/2" | 32 × 203 | 724 | 89 |
| PCL-B-34B | 34"       | 11335                 | —     | 635 | 89 | 762 | 635 | 2 1/2" | 38 × 203 | 762 | 89 |
| PCL-B-36B | 36"       | 12695                 | —     | 673 | 89 | 813 | 673 | 2 3/4" | 38 × 203 | 813 | 89 |
| PCL-B-42B | 42"       | 15870                 | —     | 762 | 89 | 902 | 762 | 2 3/4" | 44 × 254 | 902 | 89 |

- NOTES :
- DESIGNATION NUMBER DENOTE AS FOLLOWS:  

PCL-B-3B

DENOTE LINE SIZE

DENOTE TYPE-B

DENOTE PIPE CLAMP
  - MATERIAL: CARBON STEEL
  - REF. GRINNELL FIG. 216 OR EQ.

|                                                                               |          |  |       |      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | M-5                  |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| <div>PIPE CLAMP</div> <div>TYPE-B</div>                                       |          |  |       |      |  | REV. 1               |  |
|                                                                               |          |  |       |      |  |                      |  |

FILE: M-5M.DWG



NOTES :

- PCL-C-3/4B

3. REF. GRINNELL FIG. 295 OR EQ.

|                                                                                   |          |  |       |      |  |                                                      |  |                      |           |
|-----------------------------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------------|--|----------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司 CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> </div> |          |  |       |      |  | ENGINEERING STANDARD<br><br>PIPE CLAMP<br><br>TYPE-C |  | ENGINEERING STANDARD |           |
|                                                                                   |          |  |       |      |  |                                                      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                | SHIH     |  | CHK.  | YANG |  |                                                      |  | M-6                  | REV.<br>1 |
| DATE                                                                              | 7/15/'24 |  | APPR. | CHEN |  |                                                      |  |                      |           |



NOTES :

3. REF. GRINNELL FIG. 295H OR EQ.

|                                                                                        |          |  |       |      |  |                          |           |
|----------------------------------------------------------------------------------------|----------|--|-------|------|--|--------------------------|-----------|
| <div> <div> 中威工程顧問股份有限公司<br/> CHUNG WEI ENGINEERING CONSULTING CO., LTD. </div> </div> |          |  |       |      |  | ENGINEERING STANDARD     |           |
|                                                                                        |          |  |       |      |  | HP6-DSD-A4-500-001       |           |
| BY                                                                                     | SHIH     |  | CHK.  | YANG |  | PIPE CLAMP<br><br>TYPE-D |           |
| DATE                                                                                   | 7/15/'24 |  | APPR. | CHEN |  |                          |           |
|                                                                                        |          |  |       |      |  | M-7                      | REV.<br>1 |





NOTES :

- PCL-E-4B
- DENOTE LINE SIZE
- DENOTE TYPE-E
- DENOTE PIPE CLAMP

- 中威工程顧問股份有限公司  
JUNG WEI ENGINEERING CONSULTING CO., LTD.

PIPE CLAMP  
TYPE-E

ENGINEERING STANDARD

HP6-DSD-A4-500-001

|    |      |  |      |      |
|----|------|--|------|------|
| BY | SHIH |  | CHK. | YANG |
|----|------|--|------|------|

|      |          |       |      |
|------|----------|-------|------|
| DATE | 7/15/'24 | APPR. | CHEN |
|------|----------|-------|------|

M-8

REV.  
1



NOTES:

PCL-F-4B

2. MATERIAL: CHROME MOLYBDENUM STEEL, EXCEPT U-BOLT WHICH IS STAINLESS STEEL

3. REF. GRINNELL FIG. 224 OR EQ.

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

PIPE CLAMP  
TYPE-F


ENGINEERING STANDARD

HP6-DSD-A4-500-001

M-9

REV.  
1



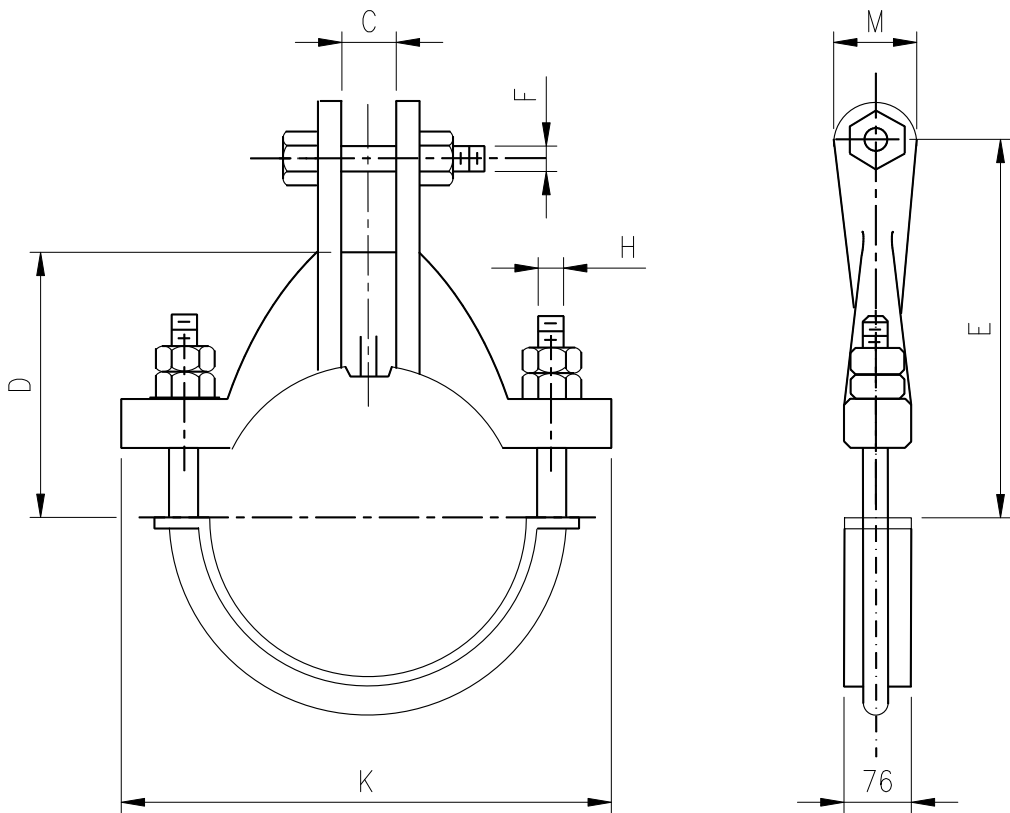


DIMENSIONS (mm)

| TYPE      | LINE SIZE | USED ON O.D. PIPE SIZE (IN) | MAX. RECOM. LOAD (kg) |        |        |        | C  | D   | E   | F      | H      | K   | M   |
|-----------|-----------|-----------------------------|-----------------------|--------|--------|--------|----|-----|-----|--------|--------|-----|-----|
|           |           |                             | 950°F                 | 1000°F | 1050°F | 1075°F |    |     |     |        |        |     |     |
| PCL-G-10B | 10"       | 8?-10?                      | 6120                  | 5340   | 3560   | 2775   | 51 | 232 | 305 | 1 1/2" | 1"     | 391 | 83  |
| PCL-G-12B | 12"       | 10?-12?                     | 7480                  | 6760   | 4505   | 3510   | 57 | 273 | 349 | 1 5/8" | 1 1/4" | 454 | 102 |
| PCL-G-14B | 14"       | 12 <sup>2</sup> -14?        | 7480                  | 6760   | 4505   | 3510   | 57 | 292 | 368 | 1 5/8" | 1 1/4" | 486 | 102 |
| PCL-G-16B | 16"       | 14 <sup>2</sup> -16?        | 7480                  | 6760   | 4505   | 3510   | 57 | 333 | 416 | 1 5/8" | 1 1/4" | 537 | 102 |
| PCL-G-18B | 18"       | 16?-18?                     | 8615                  | 8345   | 5560   | 4340   | 64 | 368 | 464 | 2"     | 1 1/4" | 613 | 114 |
| PCL-G-20B | 20"       | 18?-20?                     | 8615                  | 8345   | 5560   | 4340   | 64 | 400 | 495 | 2"     | 1 1/4" | 664 | 114 |
| PCL-G-24B | 24"       | 20?-24?                     | 11335                 | 10100  | 6730   | 5250   | 76 | 464 | 559 | 2 1/4" | 1 3/8" | 781 | 152 |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:

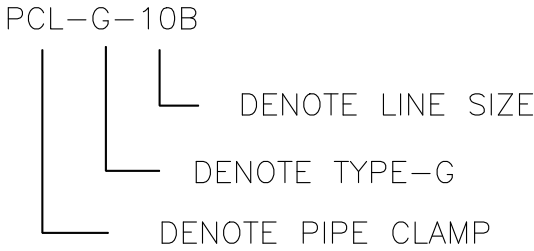


2. MATERIAL: CHROME MOLYBDENUM STEEL, EXCEPT U-BOLT WHICH IS STAINLESS STEEL.

3. REF. GRINNELL FIG. 246 OR EQ.

FILE: M-10M.DWG

|                                                                               |          |  |       |      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |                      |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | HP6-DSD-A4-500-001   |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| <div>PIPE CLAMP</div> <div>TYPE-G</div>                                       |          |  |       |      |  | M-10                 |  |
|                                                                               |          |  |       |      |  | REV. 1               |  |

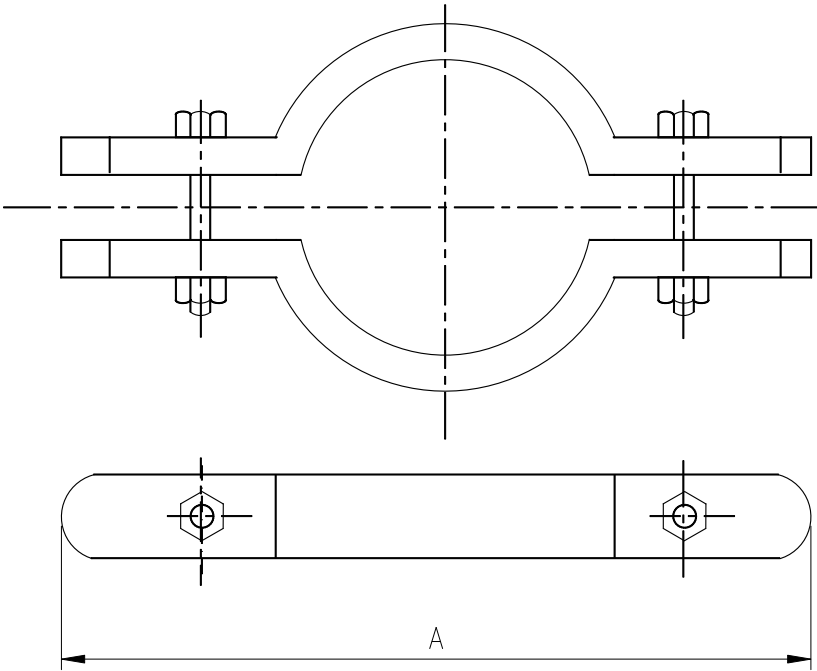

DIMENSION (mm)

| TYPE         | LINE SIZE | MAX. RECOM. LOAD (Kg) | A   | STOCK SIZE | BOLT SIZE |
|--------------|-----------|-----------------------|-----|------------|-----------|
| RCL-A-3/4B   | 3/4"      | 115                   | 238 | 5 X 32     | 3/8"X40   |
| RCL-A- 1B    | 1"        | 115                   | 244 | 5 X 32     | 3/8"X40   |
| RCL-A-1 1/4B | 1 1/4"    | 115                   | 254 | 6 X 32     | 3/8"X40   |
| RCL-A-1 1/2B | 1 1/2"    | 115                   | 264 | 6 X 32     | 3/8"X40   |
| RCL-A- 2B    | 2"        | 115                   | 273 | 6 X 32     | 7/16"X40  |
| RCL-A-2 1/2B | 2 1/2"    | 175                   | 286 | 6 X 32     | 7/16"X40  |
| RCL-A- 3B    | 3"        | 240                   | 305 | 6 X 32     | 7/16"X40  |
| RCL-A-3 1/2B | 3 1/2"    | 305                   | 330 | 6 X 38     | 1/2"X50   |
| RCL-A- 4B    | 4"        | 370                   | 343 | 6 X 38     | 1/2"X50   |
| RCL-A- 5B    | 5"        | 525                   | 368 | 6 X 51     | 1/2"X50   |
| RCL-A- 6B    | 6"        | 715                   | 394 | 6 X 51     | 1/2"X50   |
| RCL-A- 8B    | 8"        | 1135                  | 470 | 9 X 51     | 5/8"X70   |
| RCL-A-10B    | 10"       | 1135                  | 514 | 9 X 51     | 5/8"X70   |
| RCL-A-12B    | 12"       | 1225                  | 578 | 12 X 51    | 5/8"X70   |
| RCL-A-14B    | 14"       | 1225                  | 610 | 12 X 51    | 5/8"X70   |
| RCL-A-16B    | 16"       | 1320                  | 660 | 16 X 64    | 3/4"X80   |
| RCL-A-18B    | 18"       | 1320                  | 711 | 16 X 64    | 3/4"X80   |
| RCL-A-20B    | 20"       | 1320                  | 762 | 16 X 64    | 3/4"X80   |

NOTES :

1. MATERIAL: CARBON STEEL
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

RCL-A-3/4B


DENOTE LINE SIZE

DENOTE TYPE-A

DENOTE RISER CLAMP
3. REF. GRINNELL FIG. 261 OR EQ.

FILE: M-11M.DWG

|                                                            |          |  |       |      |  |                       |        |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD  |        |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001    |        |
|                                                            |          |  |       |      |  | M-11                  | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | RISER CLAMP<br>TYPE-A |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                       |        |

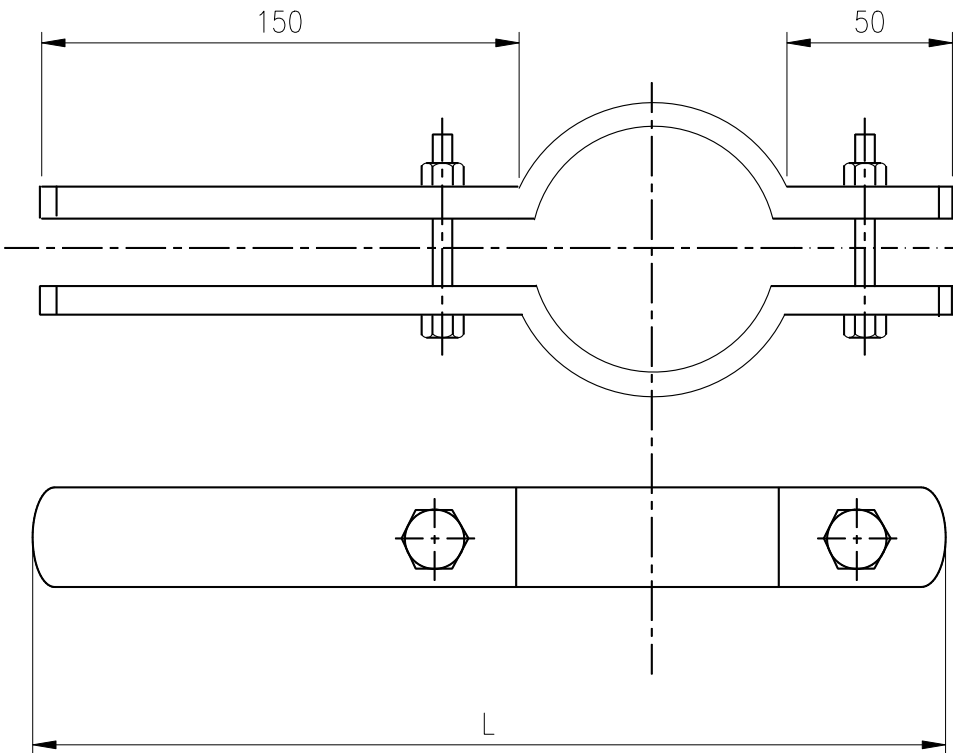


DIMENSIONS (mm)

| TYPE         | PIPE SIZE | MAX. RECOM. LOAD (kg) | L   | STOCK SIZE | BOLT SIZE |
|--------------|-----------|-----------------------|-----|------------|-----------|
| RCL-B-3/4B   | 3/4"      | 115                   | 238 | 5X32       | 3/8"X40   |
| RCL-B-1B     | 1"        | 115                   | 244 | 5X32       | 3/8"X40   |
| RCL-B-1 1/4B | 1 1/4"    | 115                   | 254 | 6X32       | 3/8"X40   |
| RCL-B-1 1/2B | 1 1/2"    | 115                   | 264 | 6X32       | 3/8"X40   |
| RCL-B-2B     | 2"        | 115                   | 273 | 6X32       | 7/16"X40  |
| RCL-B-2 1/2B | 2 1/2"    | 175                   | 286 | 6X32       | 7/16"X40  |
| RCL-B-3B     | 3"        | 240                   | 305 | 6X32       | 7/16"X40  |
| RCL-B-3 1/2B | 3 1/2"    | 305                   | 330 | 6X38       | 1/2"X40   |
| RCL-B-4B     | 4"        | 370                   | 343 | 6X38       | 1/2"X40   |
| RCL-B-5B     | 5"        | 525                   | 368 | 6X51       | 1/2"X40   |
| RCL-B-6B     | 6"        | 715                   | 394 | 6X51       | 1/2"X40   |
| RCL-B-8B     | 8"        | 1135                  | 470 | 10X51      | 5/8"X60   |
| RCL-B-10B    | 10"       | 1135                  | 527 | 10X51      | 5/8"X60   |
| RCL-B-12B    | 12"       | 1225                  | 578 | 13X51      | 5/8"X70   |
| RCL-B-14B    | 14"       | 1225                  | 610 | 13X51      | 5/8"X70   |
| RCL-B-16B    | 16"       | 1320                  | 660 | 16X64      | 3/4"X80   |
| RCL-B-18B    | 18"       | 1320                  | 711 | 16X64      | 3/4"X80   |
| RCL-B-20B    | 20"       | 1320                  | 762 | 16X64      | 3/4"X80   |

NOTES:


1. MATERIAL: CARBON STEEL
2. DESIGNATION NUMBER DENOTE AS FOLLOW:

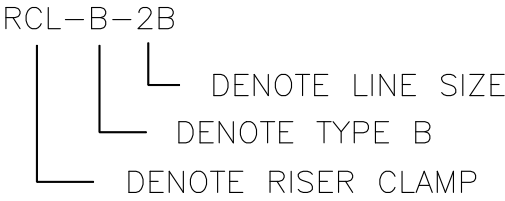

FILE: M-12M.DWG

|                                                                                            |          |  |       |      |  |                      |      |
|--------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| <div> <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> </div> |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                                                         | SHIH     |  | CHK.  | YANG |  | M-12                 | REV. |
| DATE                                                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

RISER CLAMP  
TYPE-B

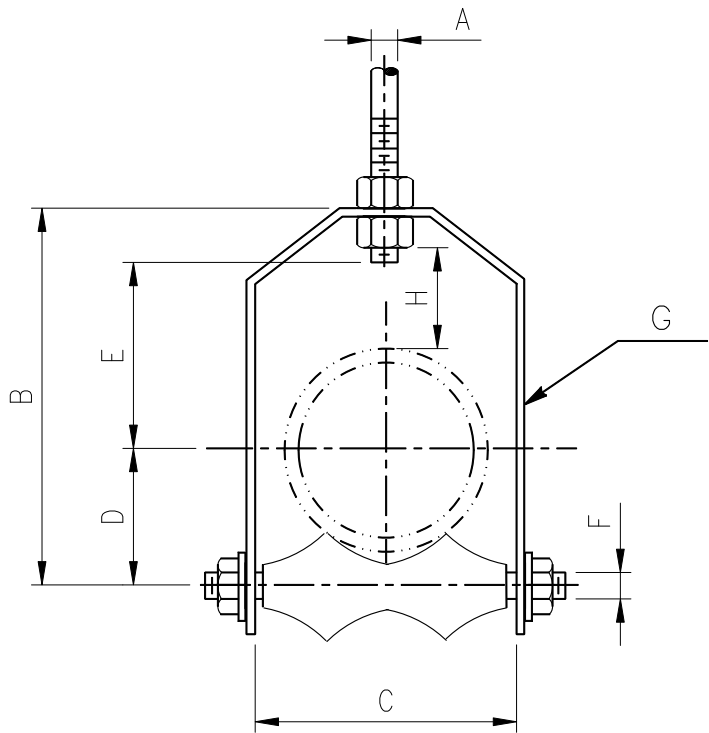


DIMENSIONS (mm)

| TYPE      | PIPE ROLL SIZE | MAX. OD OF COVERING | MAX. RECOM. LOAD (kg) | A    | B   | C   | D   | E   | F    | G     | H  |
|-----------|----------------|---------------------|-----------------------|------|-----|-----|-----|-----|------|-------|----|
| PR-A-2?B  | 2.5"           | 3"                  | 100                   | 1/2" | 146 | 83  | 49  | 73  | 1/2" | 5X32  | 43 |
| PR-A- 3B  | 3"             | 3.5"                | 140                   | 1/2" | 162 | 98  | 57  | 79  | 1/2" | 5X32  | 41 |
| PR-A-3?B  | 3.5"           | 4.5"                | 175                   | 5/8" | 178 | 111 | 65  | 89  | 5/8" | 6X32  | 43 |
| PR-A- 4B  | 4"             | 4.5"                | 215                   | 5/8" | 192 | 125 | 71  | 92  | 5/8" | 6X38  | 41 |
| PR-A- 5 B | 5"             | 5.5"                | 310                   | 3/4" | 232 | 152 | 87  | 114 | 3/4" | 9X51  | 49 |
| PR-A- 6 B | 6"             | 6.5"                | 355                   | 3/4" | 262 | 181 | 102 | 127 | 3/4" | 9X64  | 48 |
| PR-A- 8 B | 8"             | 9"                  | 355                   | 3/4" | 322 | 235 | 130 | 156 | 3/4" | 9X64  | 51 |
| PR-A-10B  | 10"            | 11"                 | 435                   | 7/8" | 383 | 286 | 162 | 184 | 7/8" | 9X64  | 52 |
| PR-A-12B  | 12"            | 13"                 | 545                   | 7/8" | 443 | 337 | 189 | 213 | 7/8" | 12X64 | 57 |
| PR-A-14B  | 14"            | 14.5"               | 545                   | 1"   | 479 | 368 | 213 | 222 | 1"   | 12X64 | 51 |
| PR-A-16B  | 16"            | 16.5"               | 545                   | 1"   | 529 | 419 | 238 | 246 | 1"   | 12X64 | 49 |
| PR-A-18B  | 18"            | 18.5"               | 635                   | 1"   | 603 | 470 | 265 | 291 | 1"   | 12X76 | 71 |
| PR-A-20B  | 20"            | 20.5"               | 725                   | 1.5" | 660 | 521 | 295 | 311 | 1.5" | 16X76 | 64 |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:

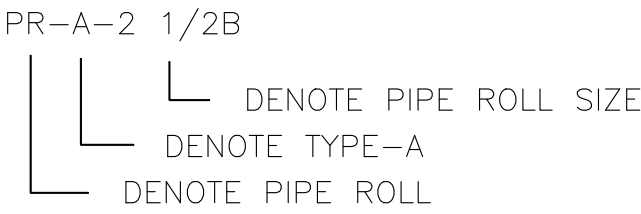


2. MATERIAL: CAST IRON ROLL; CARBON STEEL YOKE, ROLL ROD AND HEX NUTS.

3. REF. GRINNELL FIG. 181 OR EQ.

FILE: M-13M.DWG

|                                            |  |          |  |       |  |                      |  |
|--------------------------------------------|--|----------|--|-------|--|----------------------|--|
| 中威工程顧問股份有限公司                               |  |          |  |       |  | ENGINEERING STANDARD |  |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |  |          |  |       |  | PIPE ROLL            |  |
|                                            |  |          |  |       |  | HP6-DSD-A4-500-001   |  |
| BY                                         |  | SHIH     |  | CHK.  |  | YANG                 |  |
| DATE                                       |  | 7/15/'24 |  | APPR. |  | CHEN                 |  |
|                                            |  |          |  |       |  | TYPE-A               |  |
|                                            |  |          |  |       |  | M-13                 |  |
|                                            |  |          |  |       |  | REV.<br>1            |  |

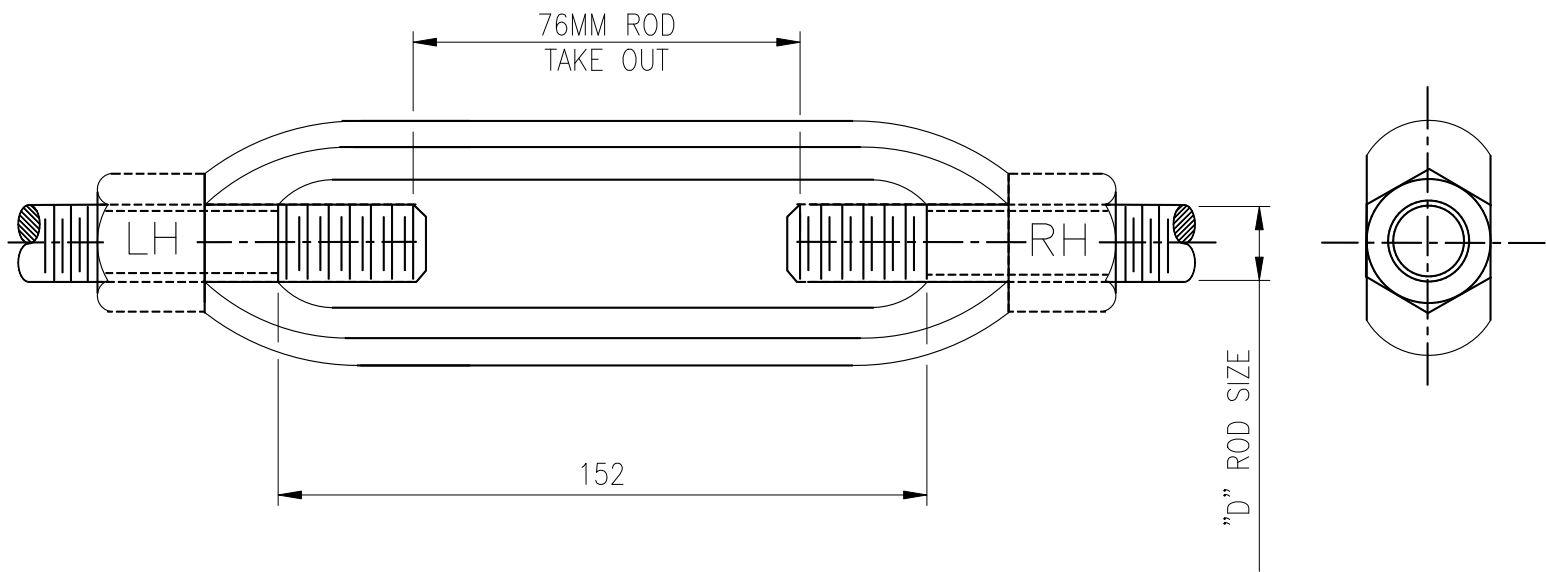

| TYPE       | D     | MAX.RECOM. LOAD (Kg) |       |
|------------|-------|----------------------|-------|
|            |       | 650°F                | 750°F |
| TUB -3/8   | 3/8   | 270                  | 240   |
| TUB -1/2   | 1/2   | 510                  | 460   |
| TUB -5/8   | 5/8   | 820                  | 730   |
| TUB -3/4   | 3/4   | 1230                 | 1100  |
| TUB -7/8   | 7/8   | 1710                 | 1520  |
| TUB - 1    | 1     | 2250                 | 2000  |
| TUB -1 1/4 | 1 1/4 | 3630                 | 3240  |
| TUB -1 1/2 | 1 1/2 | 5280                 | 4700  |
| TUB -1 3/4 | 1 3/4 | 7120                 | 6350  |
| TUB - 2    | 2     | 9390                 | 8370  |
| TUB -2 1/4 | 2 1/4 | 12430                | 11000 |
| TUB -2 1/2 | 2 1/2 | 15200                | 13560 |

NOTES :

1. MATERIAL : FORGE STEEL
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :


TUB-3/8

DENOTE DIAMETER OF INTERNAL THREAD "D"

DENOTE TURNBUCKLE
3. REF. GRINNELL FIG. 230 OR EQ.
4. FURNISHED WITH "UNC" THREADS.

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-21                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| TURNBUCKLE                                                 |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

FILE: M-21M.DWG

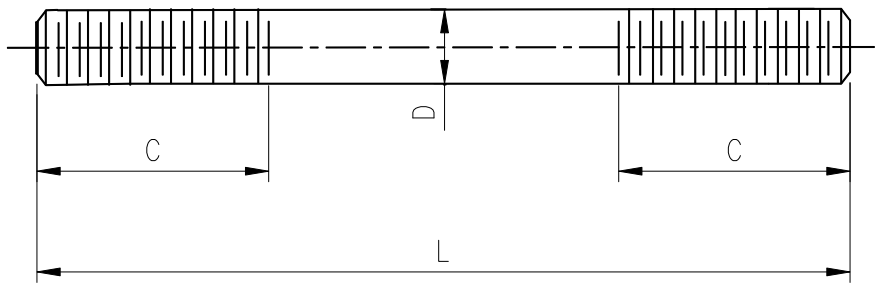

DIMENSION (mm)

| TYPE        | D      | C   | MAX.RECOM. LOAD (Kg) |       |
|-------------|--------|-----|----------------------|-------|
|             |        |     | 650°F                | 750°F |
| MTR - 3/8   | 3/8"   | 152 | 270                  | 240   |
| MTR - 1/2   | 1/2"   | 152 | 510                  | 460   |
| MTR - 5/8   | 5/8"   | 152 | 820                  | 730   |
| MTR - 3/4   | 3/4"   | 152 | 1230                 | 1100  |
| MTR - 7/8   | 7/8"   | 152 | 1710                 | 1520  |
| MTR - 1     | 1"     | 152 | 2250                 | 2000  |
| MTR - 1 1/4 | 1 1/4" | 152 | 3630                 | 3240  |
| MTR - 1 1/2 | 1 1/2" | 152 | 5280                 | 4700  |
| MTR - 1 3/4 | 1 3/4" | 178 | 7120                 | 6350  |
| MTR - 2     | 2"     | 203 | 9390                 | 8370  |
| MTR - 2 1/4 | 2 1/4" | 229 | 12430                | 11000 |
| MTR - 2 1/2 | 2 1/2" | 254 | 15200                | 13560 |

NOTES :

1. MATERIAL : CARBON STEEL
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

MTRL-3/8-600

DENOTE DIM. "L" (IN MM)

DENOTE DIM. "D"

DENOTE W/LH THREAD


DENOTE MACHINE THREADED ROD
3. LENGTH MAY CUT & THREAD TO SUIT IN FIELD .
4. REF. GRINNELL CATALOG FIG. 140 & FIG. 253 OR EQ.
5. FURNISHED WITH "UNC" THREADS.
6. MTR : MACHINE THREAD ROD W/RIGHT HAND THREAD FOR BOTH ENDS,  
MTRL: MACHINE THREAD ROD W/RIGHT HAND THREAD FOR ONE END  
& LEFT HAND THREAD FOR OTHER END.

FILE: M-22M.DWG

|                                                            |          |  |       |      |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-22                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |

MACHINE THREADED ROD



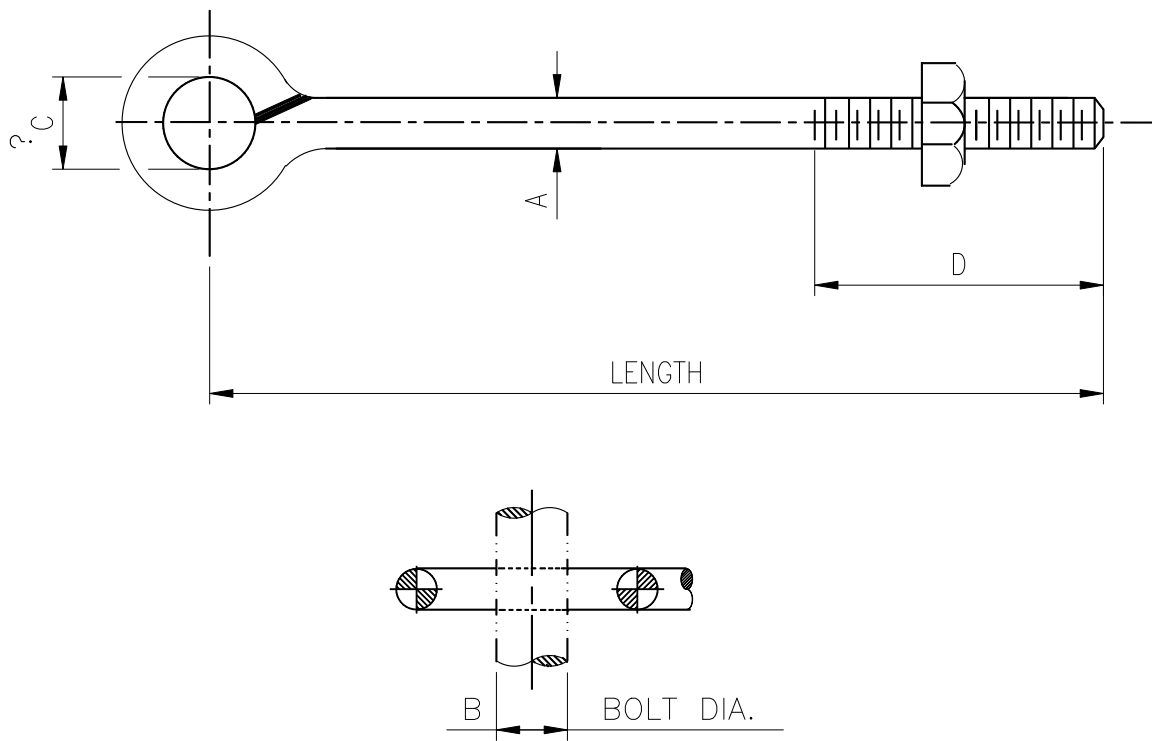

DIMENSION (mm)

| TYPE          | A      | RECOM.<br>"B" | D   | MAX.RECOM. LOAD (Kg) |       | °C |
|---------------|--------|---------------|-----|----------------------|-------|----|
|               |        |               |     | 650°F                | 750°F |    |
| WERR - 3/8"   | 3/8"   | 1/2"          | 64  | 270                  | 240   | 22 |
| WERR - 1/2"   | 1/2"   | 5/8"          | 64  | 510                  | 460   | 22 |
| WERR - 5/8"   | 5/8"   | 3/4"          | 64  | 820                  | 730   | 22 |
| WERR - 3/4"   | 3/4"   | 7/8"          | 76  | 1230                 | 1100  | 32 |
| WERR - 7/8"   | 7/8"   | 1"            | 89  | 1710                 | 1520  | 32 |
| WERR - 1"     | 1"     | 1 1/8"        | 102 | 2250                 | 2000  | 32 |
| WERR - 1 1/4" | 1 1/4" | 1 3/8"        | 127 | 3630                 | 3240  | 45 |
| WERR - 1 1/2" | 1 1/2" | 1 5/8"        | 152 | 5280                 | 4700  | 45 |
| WERR - 1 3/4" | 1 3/4" | 2"            | 178 | 7120                 | 6350  | 65 |
| WERR - 2"     | 2"     | 2 1/4"        | 203 | 9390                 | 8370  | 65 |
| WERR - 2 1/4" | 2 1/4" | 2 1/2"        | 229 | 12430                | 11000 | 76 |
| WERR - 2 1/2" | 2 1/2" | 2 3/4"        | 254 | 15200                | 13560 | 76 |

NOTES :

1. MATERIAL : CARBON STEEL WITH NUT
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :
 

WERR-3/8-500

—

—

—

—

DENOTE ROD LENGTH


DENOTE DIM. "A"

DENOTE W/LH THREAD

DENOTE WELDED EYE ROD WITH HEX NUT
3. LENGTH MAY CUT & THREAD TO SUIT IN FIELD .
4. REF. GRINNELL FIG. 278 & 278L OR EQ.
5. FURNISHED WITH "UNC" THREADS.
6. WERR : WELDED EYE ROD W/RIGHT HAND THREAD,  
 WERL : WELDED EYE ROD W/LEFT HAND THREAD.

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-23                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| WELDED EYE ROD                                             |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

FILE: M-23M.DWG

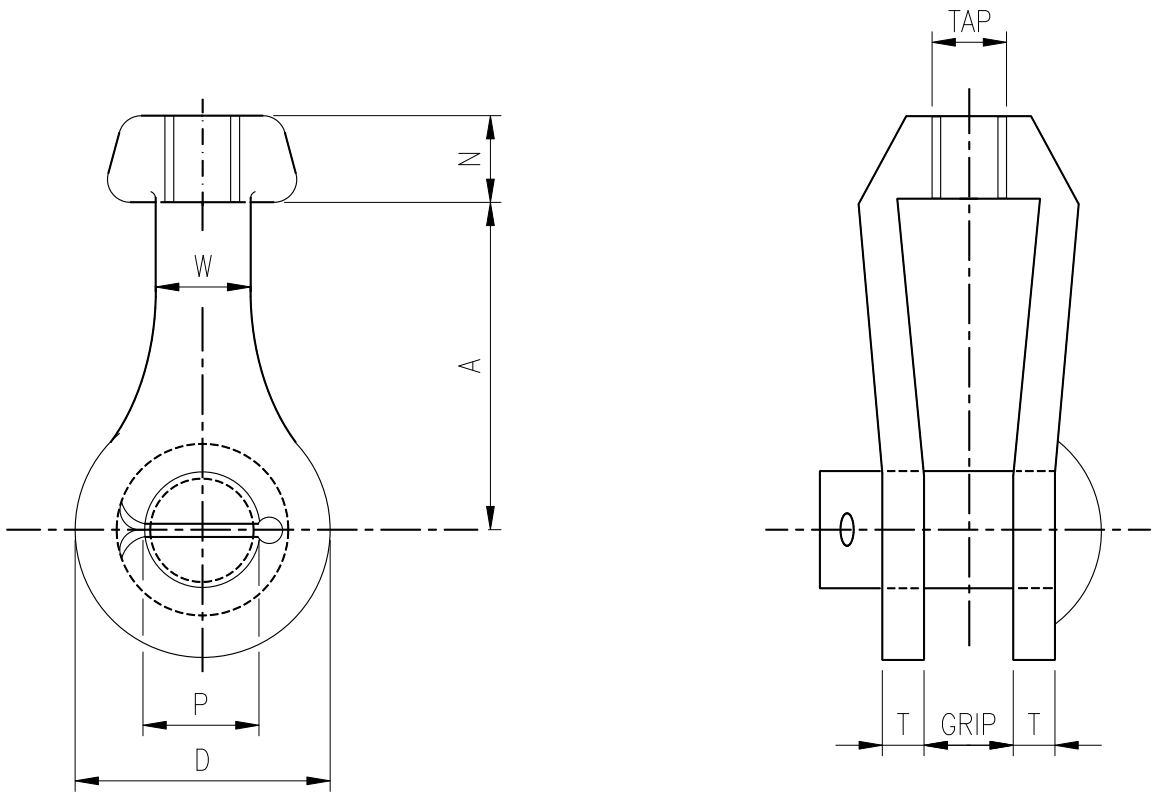

DIMENSIONS (mm)

| TYPE        | TAP SIZE | A   | D   | N  | PIN SIZE P | T  | W  | GRIP | MAX.RECOM. LOAD (Kg) |       |
|-------------|----------|-----|-----|----|------------|----|----|------|----------------------|-------|
|             |          |     |     |    |            |    |    |      | 650°F                | 750°F |
| FSC - 3/8   | 3/8"     | 94  | 37  | 16 | 1/2"       | 8  | 27 | 13   | 270                  | 240   |
| FSC - 1/2   | 1/2"     | 94  | 37  | 16 | 5/8"       | 8  | 27 | 13   | 510                  | 460   |
| FSC - 5/8   | 5/8"     | 94  | 37  | 16 | 3/4"       | 8  | 27 | 16   | 820                  | 730   |
| FSC - 3/4   | 3/4"     | 127 | 51  | 22 | 7/8"       | 10 | 32 | 19   | 1230                 | 1100  |
| FSC - 7/8   | 7/8"     | 127 | 51  | 22 | 1"         | 10 | 32 | 22   | 1710                 | 1520  |
| FSC - 1     | 1"       | 127 | 76  | 33 | 1 1/8"     | 13 | 38 | 25   | 2250                 | 2000  |
| FSC - 1 1/4 | 1 1/4"   | 127 | 76  | 33 | 1 3/8"     | 13 | 38 | 32   | 3630                 | 3240  |
| FSC - 1 1/2 | 1 1/2"   | 152 | 89  | 41 | 1 5/8"     | 13 | 44 | 38   | 5280                 | 4700  |
| FSC - 1 3/4 | 1 3/4"   | 152 | 102 | 44 | 1 7/8"     | 13 | 51 | 38   | 7120                 | 6350  |
| FSC - 2     | 2"       | 178 | 127 | 57 | 2 1/4"     | 16 | 64 | 64   | 9390                 | 8370  |
| FSC - 2 1/4 | 2 1/4"   | 203 | 152 | 70 | 2 1/2"     | 19 | 76 | 64   | 12430                | 11000 |
| FSC - 2 1/2 | 2 1/2"   | 203 | 152 | 70 | 2 3/4"     | 19 | 76 | 64   | 15200                | 13560 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :



2. MATERIAL : FORGE STEEL AND PIN WITH COTTER PIN.


3. REF. GRINNELL FIG. 299 OR EQ.

4. FURNISHED WITH "UNC" THREADS.

FILE: M-24M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-24                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| FORGED STEEL CLEVIS                                        |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |



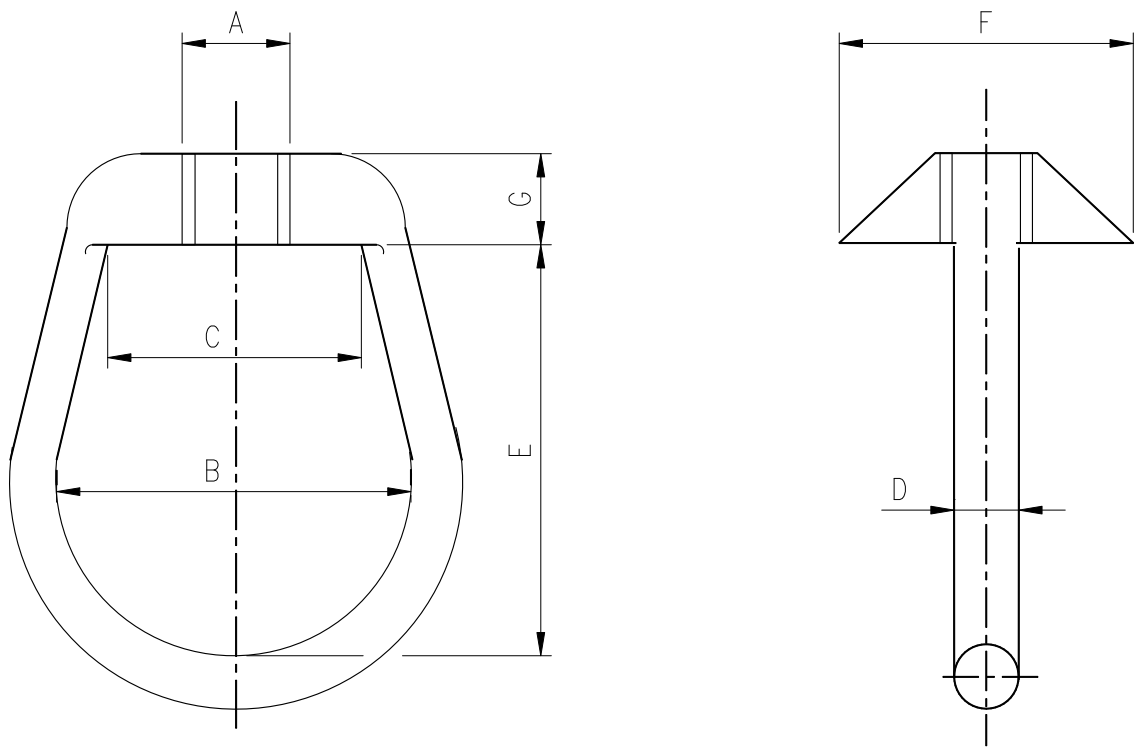


DIMENSIONS (mm)

| TYPE         | ROD SIZE<br>A | B   | C   | D  | E   | F   | G  | MAX.RECOM. LOAD (kg) |       |
|--------------|---------------|-----|-----|----|-----|-----|----|----------------------|-------|
|              |               |     |     |    |     |     |    | 650°F                | 750°F |
| WENR - 3/8   | 3/8"          | 38  | 30  | 13 | 51  | 35  | 18 | 270                  | 240   |
| WENR - 1/2   | 1/2"          | 38  | 30  | 13 | 51  | 35  | 18 | 510                  | 460   |
| WENR - 5/8   | 5/8"          | 38  | 30  | 13 | 51  | 35  | 18 | 820                  | 730   |
| WENR - 3/4   | 3/4"          | 38  | 30  | 13 | 51  | 35  | 18 | 1230                 | 1100  |
| WENR - 7/8   | 7/8"          | 51  | 43  | 19 | 67  | 49  | 25 | 1710                 | 1520  |
| WENR - 1     | 1"            | 51  | 43  | 19 | 67  | 49  | 25 | 2250                 | 2000  |
| WENR - 1 1/4 | 1 1/4"        | 64  | 46  | 25 | 86  | 60  | 32 | 3630                 | 3240  |
| WENR - 1 1/2 | 1 1/2"        | 64  | 46  | 25 | 86  | 60  | 32 | 5280                 | 4700  |
| WENR - 1 3/4 | 1 3/4"        | 102 | 102 | 38 | 159 | 102 | 57 | 7120                 | 6350  |
| WENR - 2     | 2"            | 102 | 102 | 38 | 159 | 102 | 57 | 9390                 | 8370  |
| WENR - 2 1/4 | 2 1/4"        | 102 | 102 | 38 | 159 | 102 | 57 | 12430                | 11000 |
| WENR - 2 1/2 | 2 1/2"        | 102 | 102 | 38 | 159 | 102 | 57 | 15200                | 13560 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

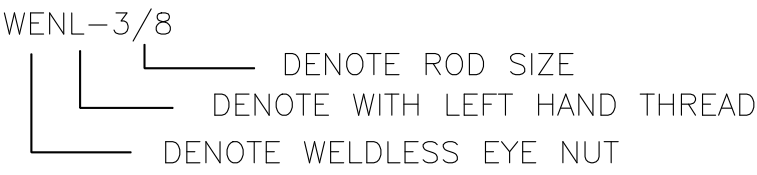

2. MATERIAL : FORGE STEEL (A668 GR.C)


3. REF. GRINNELL FIG. 290 & 290L OR EQ.

4. FURNISHED WITH "UNC" THREADS.

5. WENL : WELDLESS EYE NUT W/LEFT HAND THREAD,  
WENR : WELDLESS EYE NUT W/RIGHT HAND THREAD.

FILE: M-25M.DWG

|                                                                               |          |  |       |      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | M-25                 |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| WELDLESS EYE NUT                                                              |          |  |       |      |  | REV. 1               |  |
|                                                                               |          |  |       |      |  |                      |  |

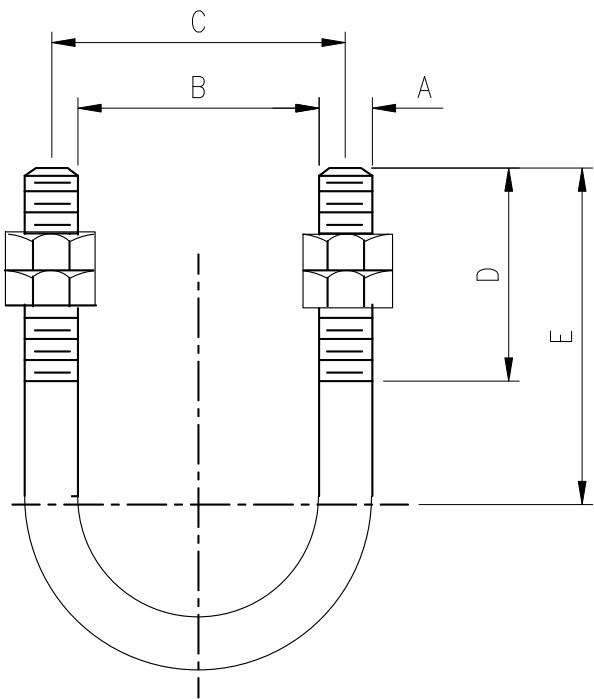

DIMENSIONS (mm)

| TYPE        | LINE SIZE | ROD SIZE A | MAX. RECOM. LOAD (Kg) |       | B   | C   | D   | E   |
|-------------|-----------|------------|-----------------------|-------|-----|-----|-----|-----|
|             |           |            | 650°F                 | 750°F |     |     |     |     |
| UB - 1/4 B  | 1/4"      | 1/4"       | 220                   | 220   | 18  | 24  | 36  | 39  |
| UB - 1/2 B  | 1/2"      | 1/4"       | 220                   | 200   | 24  | 30  | 40  | 43  |
| UB - 3/4 B  | 3/4"      | 1/4"       | 220                   | 200   | 29  | 35  | 40  | 45  |
| UB -1B      | 1"        | 1/4"       | 220                   | 200   | 35  | 41  | 40  | 49  |
| UB -1 1/4 B | 1 1/4"    | 3/8"       | 555                   | 495   | 43  | 52  | 58  | 65  |
| UB -1 1/2 B | 1 1/2"    | 3/8"       | 555                   | 495   | 51  | 60  | 58  | 68  |
| UB -2B      | 2"        | 3/8"       | 555                   | 495   | 62  | 71  | 58  | 74  |
| UB -2 1/2 B | 2 1/2"    | 1/2"       | 1025                  | 920   | 75  | 87  | 64  | 85  |
| UB -3B      | 3"        | 1/2"       | 1025                  | 920   | 91  | 103 | 64  | 93  |
| UB -3 1/2 B | 3 1/2"    | 1/2"       | 1025                  | 920   | 103 | 116 | 64  | 99  |
| UB -4B      | 4"        | 1/2"       | 1025                  | 920   | 116 | 129 | 67  | 108 |
| UB -5B      | 5"        | 1/2"       | 1025                  | 920   | 143 | 156 | 67  | 122 |
| UB -6B      | 6"        | 5/8"       | 1645                  | 1470  | 171 | 187 | 79  | 143 |
| UB -8B      | 8"        | 5/8"       | 1645                  | 1470  | 222 | 238 | 79  | 169 |
| UB -10B     | 10"       | 3/4"       | 2460                  | 2155  | 276 | 295 | 102 | 213 |
| UB -12B     | 12"       | 7/8"       | 3425                  | 3060  | 327 | 349 | 111 | 245 |
| UB -14B     | 14"       | 7/8"       | 3425                  | 3060  | 359 | 381 | 111 | 261 |
| UB -16B     | 16"       | 7/8"       | 3425                  | 3060  | 410 | 432 | 111 | 286 |
| UB -18B     | 18"       | 1"         | 4500                  | 4015  | 460 | 486 | 117 | 316 |
| UB -20B     | 20"       | 1"         | 4500                  | 4015  | 511 | 537 | 121 | 345 |
| UB -24B     | 24"       | 1"         | 4500                  | 4015  | 613 | 638 | 121 | 396 |
| UB -30B     | 30"       | 1"         | 4500                  | 4015  | 765 | 791 | 121 | 472 |


NOTES :

1. MATERIAL : CARBON STEEL U-BOLT AND FOUR FINISHED HEX. NUTS.
2. DESIGNATION NUMBER DENOTE AS FOLLOWS :  
UB-1/2B



FILE: M-26M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-26                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| U-BOLT                                                     |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

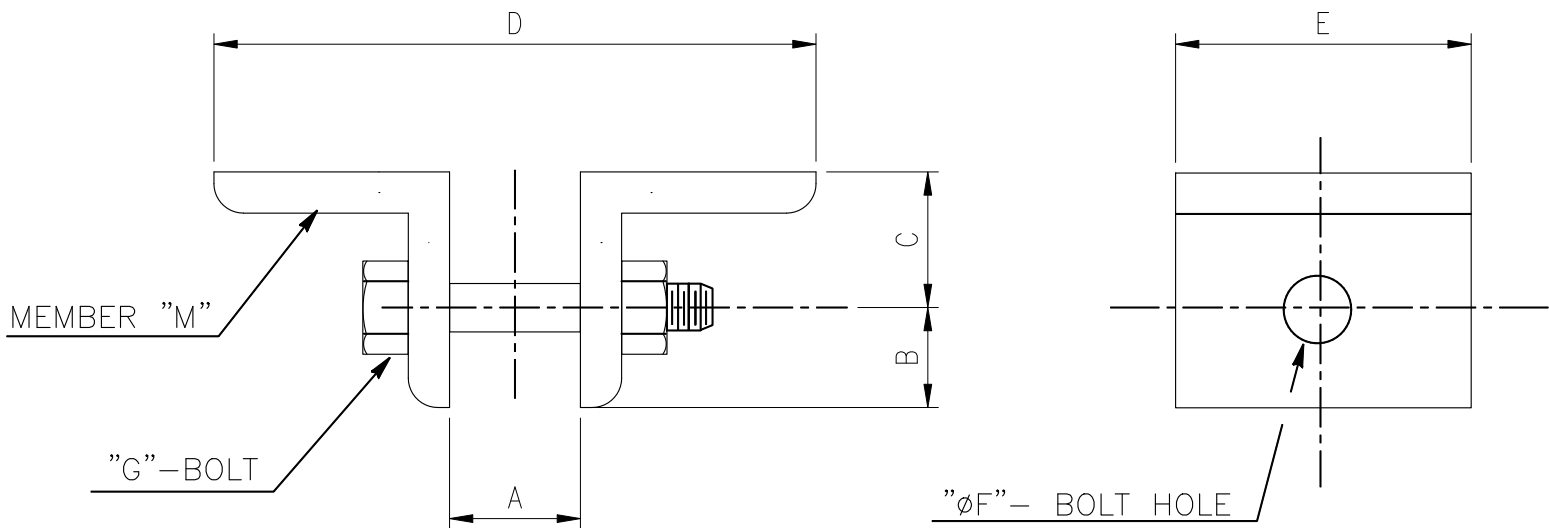

DIMENSIONS (mm)

| TYPE        | MEMBER "M"  | A  | B  | C  | D   | E   | F  | G            |
|-------------|-------------|----|----|----|-----|-----|----|--------------|
| ABR - 3/8   | L50X50X6    | 30 | 20 | 30 | 130 | 50  | 14 | 1/2" X 60    |
| ABR - 1/2   | L75X75X9    | 30 | 30 | 45 | 180 | 75  | 18 | 5/8" X 70    |
| ABR - 5/8   | L75X75X9    | 30 | 30 | 45 | 180 | 75  | 21 | 3/4" X 70    |
| ABR - 3/4   | L100X100X10 | 40 | 45 | 55 | 240 | 100 | 24 | 7/8" X 90    |
| ABR - 7/8   | L100X100X10 | 50 | 45 | 55 | 250 | 100 | 28 | 1" X 100     |
| ABR - 1     | L100X100X10 | 50 | 45 | 55 | 250 | 100 | 31 | 1 1/8" X 100 |
| ABR - 1 1/4 | L150X150X15 | 55 | 65 | 85 | 355 | 150 | 38 | 1 3/8" X 130 |
| ABR - 1 1/2 | L150X150X15 | 55 | 65 | 85 | 355 | 150 | 44 | 1 5/8" X 140 |
| ABR - 1 3/4 | L150X150X15 | 55 | 65 | 85 | 355 | 150 | 51 | 2" X 150     |
| ABR - 2     | L175X175X15 | 65 | 80 | 95 | 415 | 175 | 54 | 2 1/4" X 160 |
| ABR - 2 1/4 | L175X175X15 | 70 | 80 | 95 | 420 | 175 | 60 | 2 1/2" X 170 |
| ABR - 2 1/2 | L175X175X15 | 75 | 80 | 95 | 425 | 200 | 67 | 2 3/4" X 180 |

- NOTES :
- MATERIAL : CARBON STEEL, WITH BOLT & NUT
  - DESIGNATION NUMBER DENOTE AS FOLLOWS :
 

ABR- 1/2

└──┬──┐

└──┬──┐ DENOTE WELDED EYE ROD SIZE

└──┬──┐ DENOTE ANGLE BRACKET

FILE: M-27M.DWG

|                                            |          |  |       |      |  |                      |           |
|--------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司                               |          |  |       |      |  | ENGINEERING STANDARD |           |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                         | SHIH     |  | CHK.  | YANG |  | ANGLE BRACKET        |           |
| DATE                                       | 7/15/'24 |  | APPR. | CHEN |  | M-27                 | REV.<br>1 |

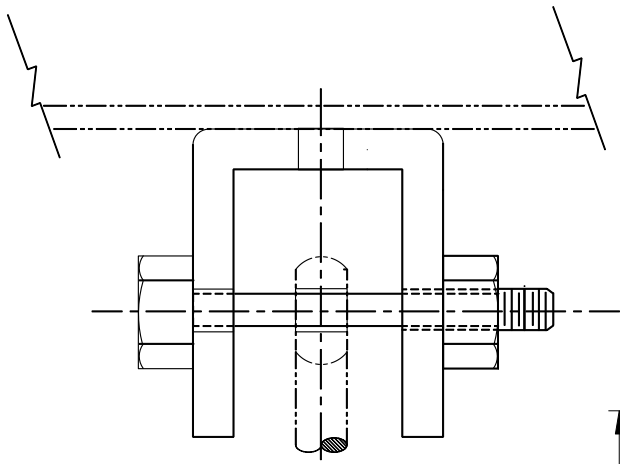


FIG.-1

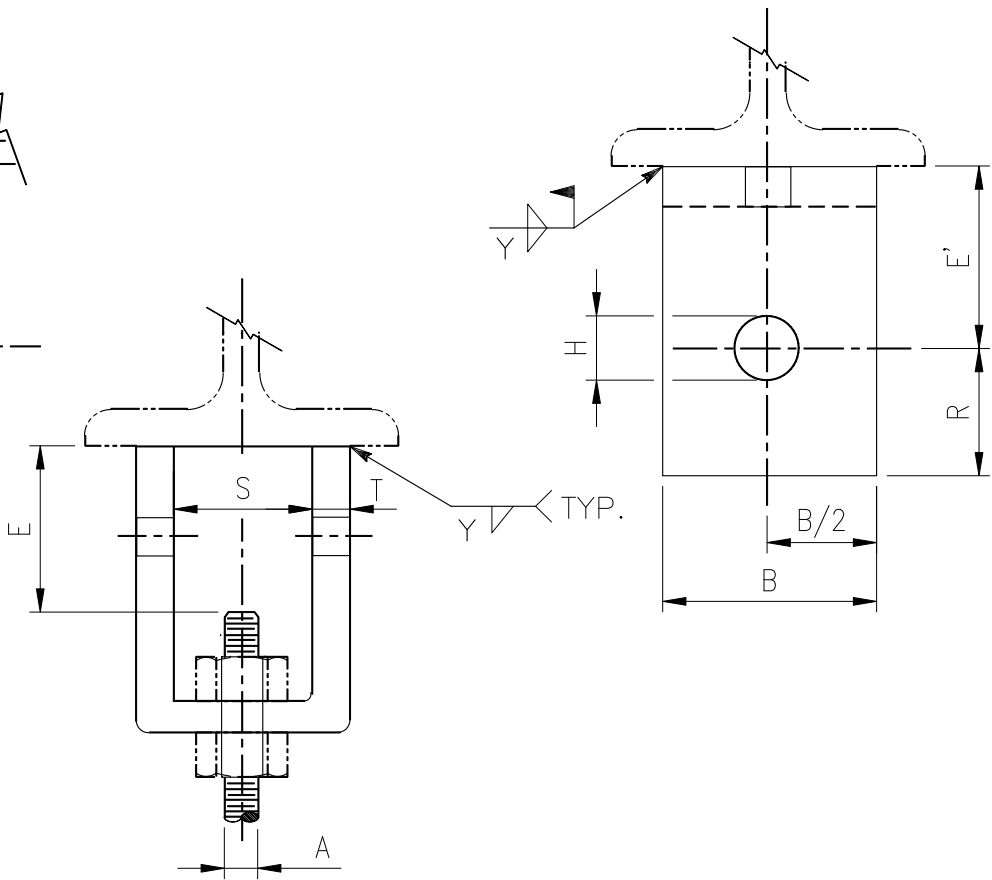


FIG.-2

(FOR 1 3/4" ROD DIA. AND SMALLER ONLY)

DIMENSION (mm)

| TYPE       | ROD<br>SIZE<br>A | BOLT SIZE    | MAX. RECOM.<br>LOAD (Kg) |       | ROD<br>TAKEOFF |     | B   | H  | R  | S   | T  | Y  |
|------------|------------------|--------------|--------------------------|-------|----------------|-----|-----|----|----|-----|----|----|
|            |                  |              | 650°F                    | 750°F | E              | E'  |     |    |    |     |    |    |
| BA-A-3/8   | 3/8"             | 1/2" X 70    | 270                      | 240   | 48             | 51  | 51  | 14 | 22 | 32  | 6  | 6  |
| BA-A-1/2   | 1/2"             | 5/8" X 70    | 510                      | 460   | 44             | 51  | 51  | 17 | 22 | 32  | 6  | 6  |
| BA-A-5/8   | 5/8"             | 3/4" X 70    | 820                      | 730   | 44             | 51  | 51  | 21 | 22 | 32  | 6  | 6  |
| BA-A-3/4   | 3/4"             | 7/8" X 80    | 1230                     | 1100  | 44             | 51  | 64  | 24 | 29 | 38  | 9  | 6  |
| BA-A-7/8   | 7/8"             | 1" X 110     | 1710                     | 1520  | 67             | 76  | 64  | 29 | 32 | 51  | 9  | 6  |
| BA-A-1     | 1"               | 1 1/8" X 120 | 2250                     | 2000  | 70             | 76  | 76  | 32 | 38 | 51  | 12 | 6  |
| BA-A-1 1/4 | 1 1/4"           | 1 3/8" X 130 | 3630                     | 3240  | 73             | 76  | 102 | 38 | 51 | 64  | 16 | 10 |
| BA-A-1 1/2 | 1 1/2"           | 1 5/8" X 150 | 5280                     | 4700  | 102            | 102 | 127 | 44 | 64 | 76  | 19 | 10 |
| BA-A-1 3/4 | 1 3/4"           | 1 7/8" X 180 | 7120                     | 6350  | 127            | 127 | 127 | 51 | 70 | 95  | 19 | 10 |
| BA-A-2     | 2"               | 2 1/4" X 180 | 9390                     | 8370  | 133            | 127 | 152 | 60 | 83 | 95  | 19 | 10 |
| BA-A-2 1/4 | 2 1/4"           | 2 1/2" X 190 | 12430                    | 11000 | 159            | 152 | 152 | 67 | 89 | 108 | 19 | 16 |
| BA-A-2 1/2 | 2 1/2"           | 2 3/4" X 200 | 15200                    | 13560 | 159            | 152 | 152 | 73 | 95 | 114 | 19 | 16 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

BA-A1-3/8

DENOTE ROD SIZE


DENOTE FIG.1

DENOTE TYPE-A

DENOTE BEAM ATTACHMENT
2. MATERIAL: CARBON STEEL
3. ROD SIZE 1 1/4" AND LARGER ARE PINS WITH COTTER PINS,  
ROD SIZE 1 1/8" AND SMALLER ARE MACHINE BOLTS WITH NUTS.
4. REF. GRINNELL FIG. 66 OR EQ.

FILE: M-28M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-28                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| BEAM ATTACHMENT<br>TYPE-A                                  |          |  |       |      |  | REV. 1               |  |
|                                                            |          |  |       |      |  |                      |  |

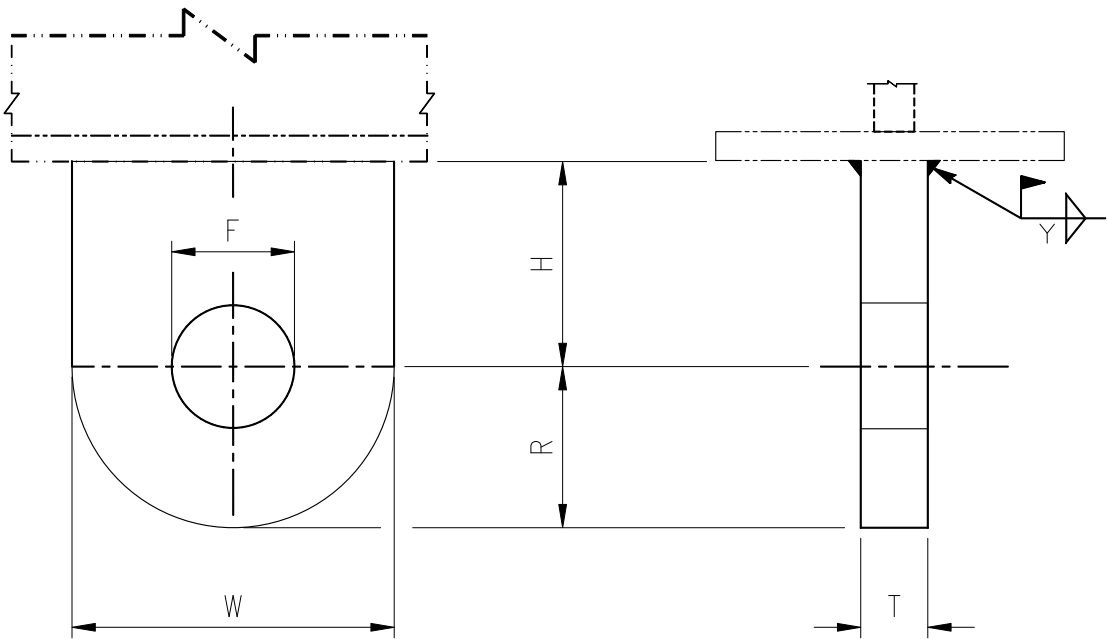

DIMENSION (mm)


| TYPE       | ROD SIZE | MAX. RECOM. LOAD (Kg) | PIN OR BOLT | F   | H   | R   | T  | W   | Y  |
|------------|----------|-----------------------|-------------|-----|-----|-----|----|-----|----|
| BA-B-1/2   | 1/2"     | 510                   | 5/8"        | 18  | 38  | 32  | 6  | 64  | 6  |
| BA-B-5/8   | 5/8"     | 820                   | 3/4"        | 21  | 38  | 32  | 6  | 64  | 6  |
| BA-B-3/4   | 3/4"     | 1225                  | 7/8"        | 24  | 38  | 32  | 10 | 64  | 6  |
| BA-B-7/8   | 7/8"     | 1710                  | 1"          | 29  | 51  | 32  | 10 | 64  | 6  |
| BA-B-1     | 1"       | 2250                  | 1 1/8"      | 32  | 51  | 38  | 13 | 76  | 6  |
| BA-B-1 1/4 | 1 1/4"   | 3625                  | 1 3/8"      | 38  | 76  | 51  | 16 | 102 | 6  |
| BA-B-1 1/2 | 1 1/2"   | 5275                  | 1 5/8"      | 45  | 76  | 64  | 19 | 127 | 10 |
| BA-B-1 3/4 | 1 3/4"   | 7120                  | 1 7/8"      | 51  | 76  | 64  | 19 | 127 | 10 |
| BA-B-2     | 2"       | 9355                  | 2 1/4"      | 60  | 102 | 76  | 19 | 152 | 10 |
| BA-B-2 1/4 | 2 1/4"   | 10430                 | 2 1/2"      | 67  | 114 | 76  | 19 | 152 | 13 |
| BA-B-2 1/2 | 2 1/2"   | 13855                 | 2 3/4"      | 73  | 114 | 102 | 25 | 203 | 13 |
| BA-B-2 3/4 | 2 3/4"   | 18865                 | 3"          | 79  | 114 | 102 | 25 | 203 | 13 |
| BA-B-3     | 3"       | 22905                 | 3 1/4"      | 86  | 127 | 102 | 25 | 203 | 16 |
| BA-B-3 1/4 | 3 1/4"   | 27440                 | 3 1/2"      | 92  | 127 | 114 | 25 | 229 | 16 |
| BA-B-3 1/2 | 3 1/2"   | 32340                 | 3 3/4"      | 98  | 152 | 114 | 38 | 229 | 16 |
| BA-B-3 3/4 | 3 3/4"   | 37600                 | 4"          | 105 | 152 | 114 | 45 | 229 | 16 |

- NOTES :
- DESIGNATION NUMBER DENOTE AS FOLLOWS :  

DENOTE ROD SIZE  
 DENOTE TYPE-B  
 DENOTE BEAM ATTACHMENT
  - MATERIAL: CARBON STEEL
  - REF. GRINNELL FIG. 55 OR EQ.

FILE: M-29M.DWG

|                                            |          |  |       |      |  |                      |           |
|--------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| 中威工程顧問股份有限公司                               |          |  |       |      |  | ENGINEERING STANDARD |           |
| CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | BEAM ATTACHMENT      |           |
|                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                         | SHIH     |  | CHK.  | YANG |  | TYPE-B               |           |
| DATE                                       | 7/15/'24 |  | APPR. | CHEN |  | M-29                 | REV.<br>1 |

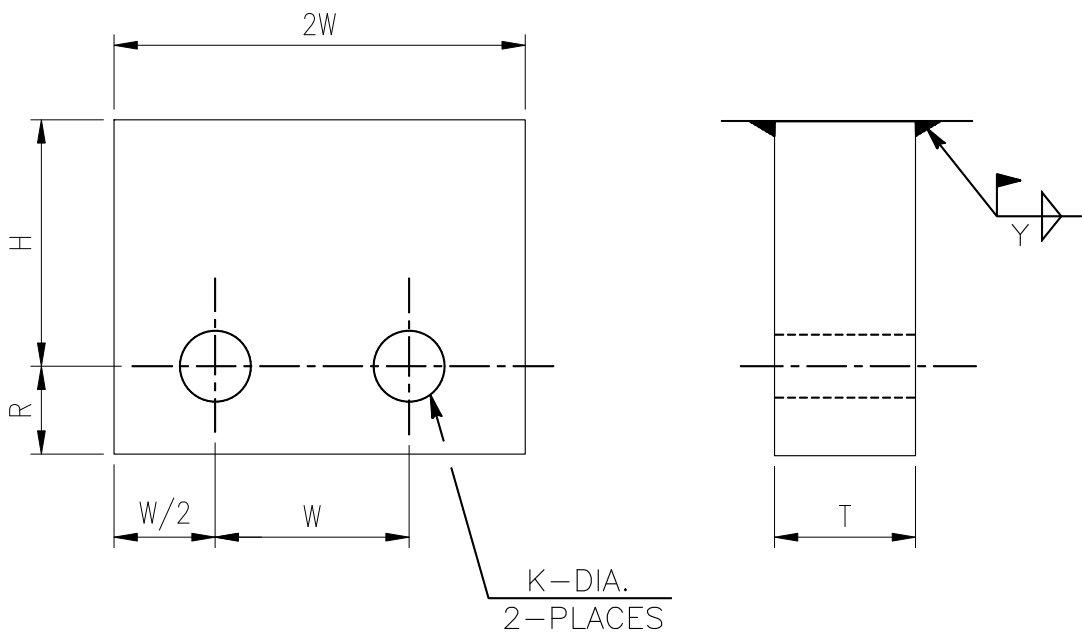

DIMENSIONS (mm)

| TYPE       | ROD SIZE | MAX. LOAD RATING (kg) | H<br>CONSTANT SUPPORT FRAME SIZES |       |       |       |       | PIN OR BOLT | K  | R  | T  | W   | 2W  | W/2 | Y  |
|------------|----------|-----------------------|-----------------------------------|-------|-------|-------|-------|-------------|----|----|----|-----|-----|-----|----|
|            |          |                       | 1-9                               | 10-18 | 19-34 | 35-49 | 50-63 |             |    |    |    |     |     |     |    |
| BA-C-1/2   | 1/2"     | 510                   | 38                                | 38    | 51    | 76    | —     | 5/8"        | 18 | 32 | 10 | 64  | 127 | 32  | 6  |
| BA-C-5/8   | 5/8"     | 820                   | 38                                | 38    | 51    | 76    | —     | 3/4"        | 21 | 32 | 10 | 64  | 127 | 32  | 6  |
| BA-C-3/4   | 3/4"     | 1225                  | —                                 | 38    | 51    | 76    | 102   | 7/8"        | 24 | 32 | 10 | 64  | 127 | 32  | 6  |
| BA-C-7/8   | 7/8"     | 1710                  | —                                 | 38    | 51    | 76    | 102   | 1"          | 29 | 32 | 10 | 64  | 127 | 32  | 6  |
| BA-C-1     | 1"       | 2250                  | —                                 | —     | 51    | 76    | 102   | 1 1/8"      | 32 | 38 | 13 | 76  | 152 | 38  | 6  |
| BA-C-1 1/4 | 1 1/4"   | 3625                  | —                                 | —     | 51    | 76    | 102   | 1 3/8"      | 38 | 51 | 16 | 102 | 203 | 51  | 6  |
| BA-C-1 1/2 | 1 1/2"   | 5275                  | —                                 | —     | —     | 76    | 102   | 1 5/8"      | 45 | 64 | 19 | 127 | 254 | 64  | 6  |
| BA-C-1 3/4 | 1 3/4"   | 7120                  | —                                 | —     | —     | 76    | 102   | 1 7/8"      | 51 | 64 | 19 | 127 | 254 | 64  | 6  |
| BA-C-2     | 2"       | 9355                  | —                                 | —     | —     | —     | 102   | 2 1/4"      | 60 | 76 | 19 | 152 | 305 | 76  | 10 |
| BA-C-2 1/4 | 2 1/4"   | 10430                 | —                                 | —     | —     | —     | 102   | 2 1/2"      | 67 | 76 | 19 | 152 | 305 | 76  | 10 |

NOTES:

- DESIGNATION NUMBER DENOTE AS FOLLOW:  

BA-C-1/2

DENOTE ROD SIZE  
DENOTE TYPE C  
DENOTE BEAM ATTACHMENT


2. MATERIAL: CARBON STEEL

3. REF. GRINNELL FIG. 54 OR EQ.

FILE: M-30M-DWG

|                                                                               |          |  |       |      |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |                      |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | HP6-DSD-A4-500-001   |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| <div>BEAM ATTACHMENT</div> <div>TYPE-C</div>                                  |          |  |       |      |  | M-30                 |  |
|                                                                               |          |  |       |      |  | REV. 1               |  |



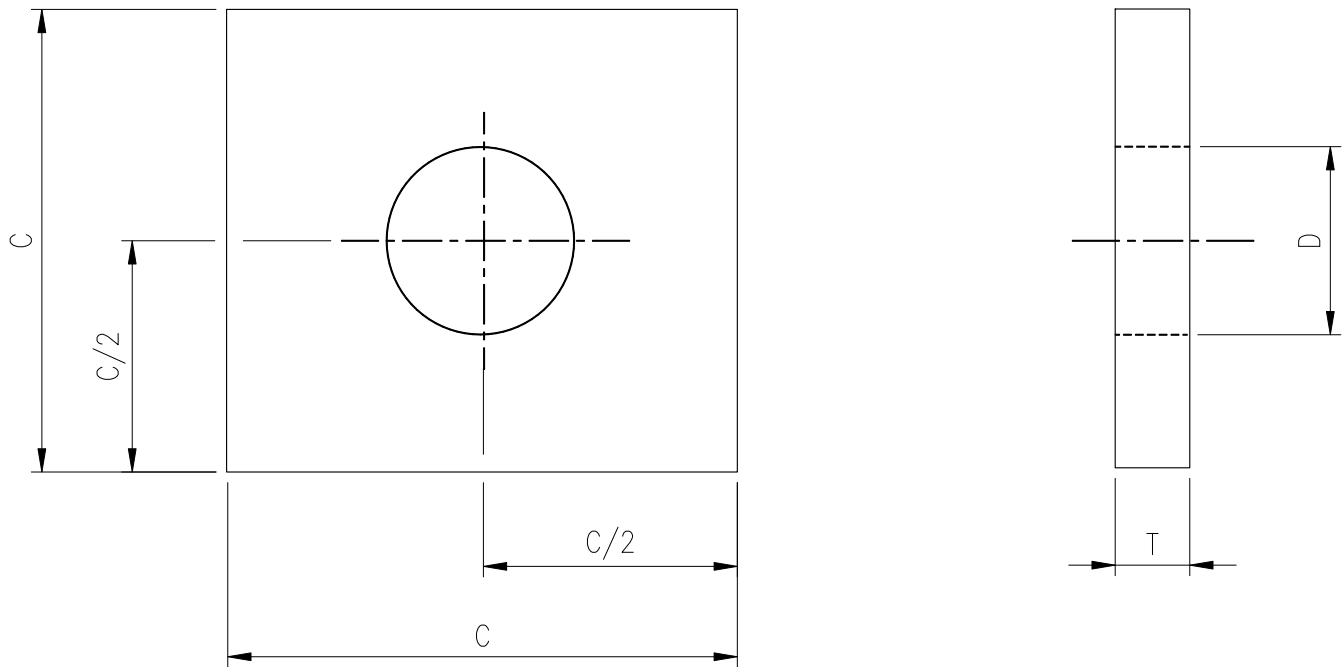

DIMENSION (mm)

| TYPE        | ROD SIZE | C   | D   | T  |
|-------------|----------|-----|-----|----|
| SWP - 3/8   | 3/8"     | 76  | 11  | 6  |
| SWP - 1/2   | 1/2"     | 76  | 16  | 6  |
| SWP - 5/8   | 5/8"     | 76  | 19  | 9  |
| SWP - 3/4   | 3/4"     | 102 | 22  | 9  |
| SWP - 7/8   | 7/8"     | 102 | 25  | 12 |
| SWP - 1     | 1"       | 102 | 32  | 12 |
| SWP - 1 1/4 | 1 1/4"   | 127 | 38  | 12 |
| SWP - 1 1/2 | 1 1/2"   | 127 | 44  | 19 |
| SWP - 3/4   | 1 3/4"   | 127 | 51  | 19 |
| SWP - 2     | 2"       | 127 | 57  | 19 |
| SWP - 2 1/4 | 2 1/4"   | 152 | 64  | 19 |
| SWP - 2 1/2 | 2 1/2"   | 152 | 70  | 19 |
| SWP - 2 3/4 | 2 3/4"   | 152 | 76  | 19 |
| SWP - 3     | 3"       | 152 | 83  | 19 |
| SWP - 3 1/4 | 3 1/4"   | 152 | 89  | 19 |
| SWP - 3 1/2 | 3 1/2"   | 178 | 75  | 19 |
| SWP - 3 3/4 | 3 3/4"   | 178 | 102 | 19 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

SWP- 3/8


DENOTE ROD SIZE

DENOTE STEEL WASHER PLATE

2. MATERIAL: CARBON STEEL

FILE: M-31M.DWG

|                                                                               |          |  |       |      |  |                      |        |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                                               |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                                               |          |  |       |      |  | M-31                 | REV. 1 |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  | STEEL WASHER PLATE   |        |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

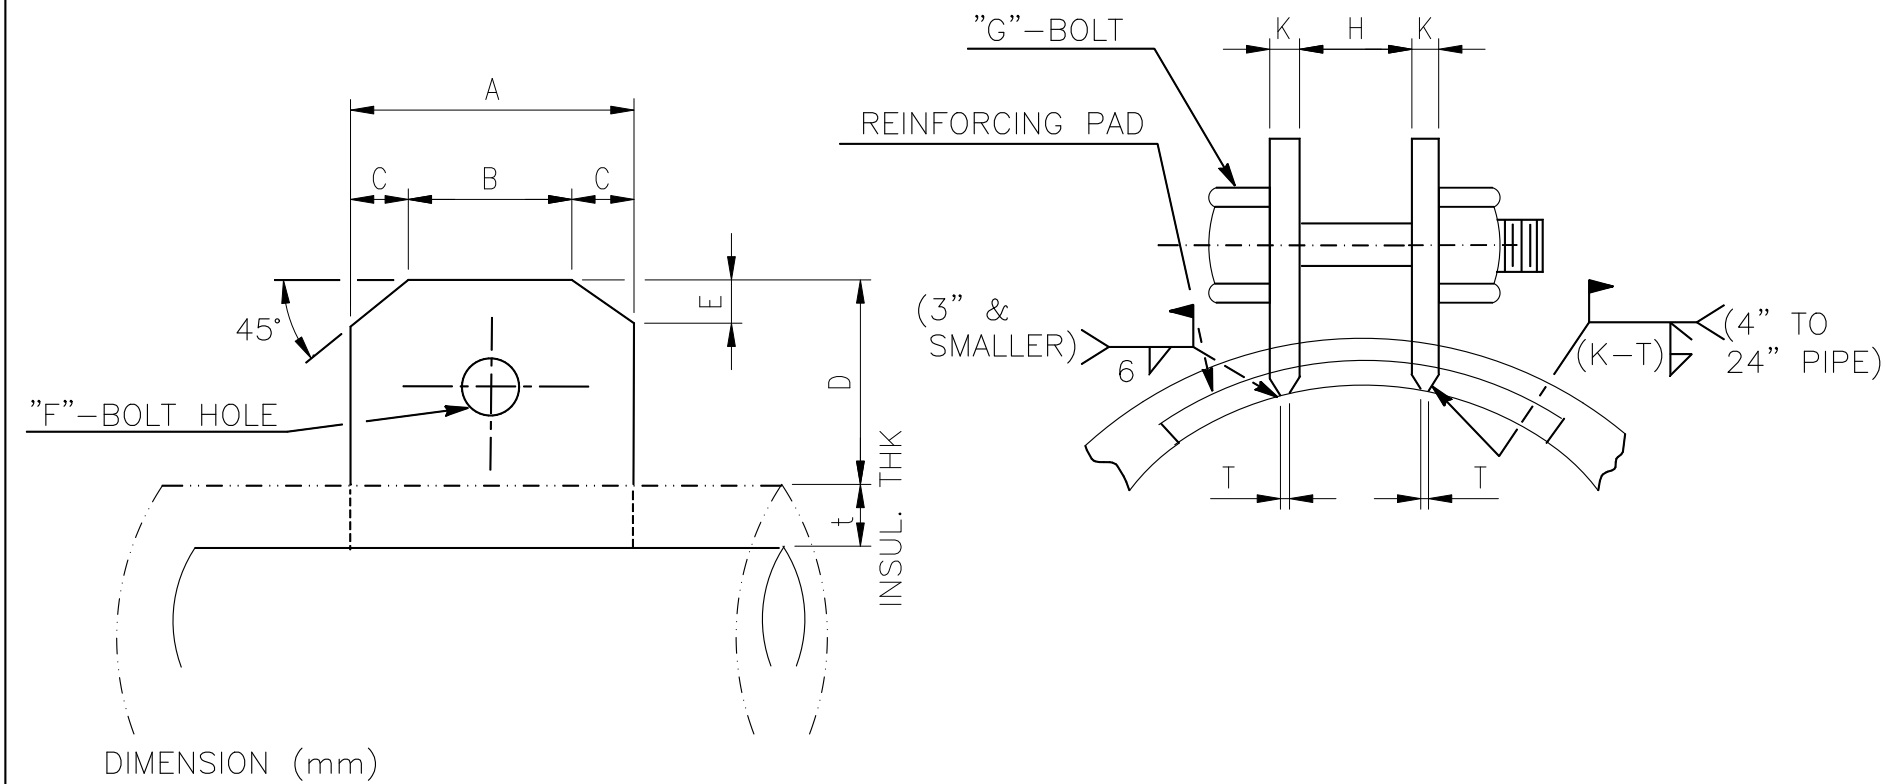


DIMENSION (mm)

| TYPE         | A   | B   | C  | D   | E  | F  | H  | K  | T | G            | HANGER ROD SIZE |
|--------------|-----|-----|----|-----|----|----|----|----|---|--------------|-----------------|
| LGP-A-1B     | 100 | 50  | 25 | 80  | 25 | 14 | 30 | 6  | 6 | 1/2" X 60    | 3/8"            |
| LGP-A-1 1/2B | 100 | 50  | 25 | 80  | 25 | 18 | 30 | 6  | 6 | 5/8" X 70    | 1/2"            |
| LGP-A-2B     | 120 | 60  | 30 | 90  | 30 | 21 | 30 | 6  | 6 | 3/4" X 70    | 5/8"            |
| LGP-A-3B     | 120 | 60  | 30 | 90  | 30 | 21 | 30 | 6  | 6 | 3/4" X 70    | 5/8"            |
| LGP-A-4B     | 130 | 70  | 30 | 90  | 30 | 24 | 40 | 9  | 4 | 7/8" X 90    | 3/4"            |
| LGP-A-6B     | 160 | 90  | 35 | 100 | 35 | 28 | 50 | 9  | 4 | 1" X 100     | 7/8"            |
| LGP-A-8B     | 160 | 90  | 35 | 100 | 35 | 28 | 50 | 9  | 4 | 1" X 100     | 7/8"            |
| LGP-A-10B    | 160 | 90  | 35 | 100 | 35 | 28 | 50 | 9  | 4 | 1" X 100     | 7/8"            |
| LGP-A-12B    | 160 | 90  | 35 | 100 | 35 | 28 | 50 | 9  | 4 | 1" X 100     | 7/8"            |
| LGP-A-14B    | 160 | 90  | 35 | 100 | 35 | 31 | 50 | 16 | 6 | 1 1/8" X 100 | 1"              |
| LGP-A-16B    | 160 | 90  | 35 | 100 | 35 | 31 | 50 | 16 | 6 | 1 1/8" X 100 | 1"              |
| LGP-A-18B    | 160 | 90  | 35 | 100 | 35 | 31 | 50 | 16 | 6 | 1 1/8" X 100 | 1"              |
| LGP-A-20B    | 180 | 100 | 40 | 110 | 35 | 35 | 55 | 16 | 6 | 1 1/4" X 110 | 1 1/8"          |
| LGP-A-24B    | 180 | 100 | 40 | 110 | 35 | 35 | 55 | 16 | 6 | 1 1/4" X 110 | 1 1/8"          |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

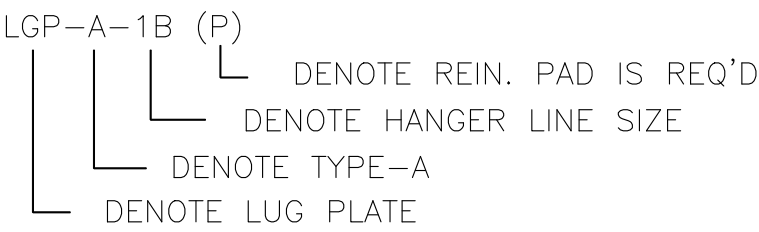

2. MATERIAL : LUG PLATE : CARBON STEEL  
BOLT & NUT : A307 GR.B /A563 GR.A  
REINFORCING PAD : THE SAME MATERIAL AS THE PIPE


3. REINFORCING PAD TO BE USED ALLOY & LOW ALLOY PIPING

4. THE MINIMUM REINFORCING PAD THICKNESS SHALL NOT BE LESS THAN THE PIPE WALL THICKNESS

FILE: M-32M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                      |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | HP6-DSD-A4-500-001   |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| LUG PLATE<br>TYPE-A                                        |          |  |       |      |  | M-32                 |  |
|                                                            |          |  |       |      |  |                      |  |
|                                                            |          |  |       |      |  | REV. 1               |  |



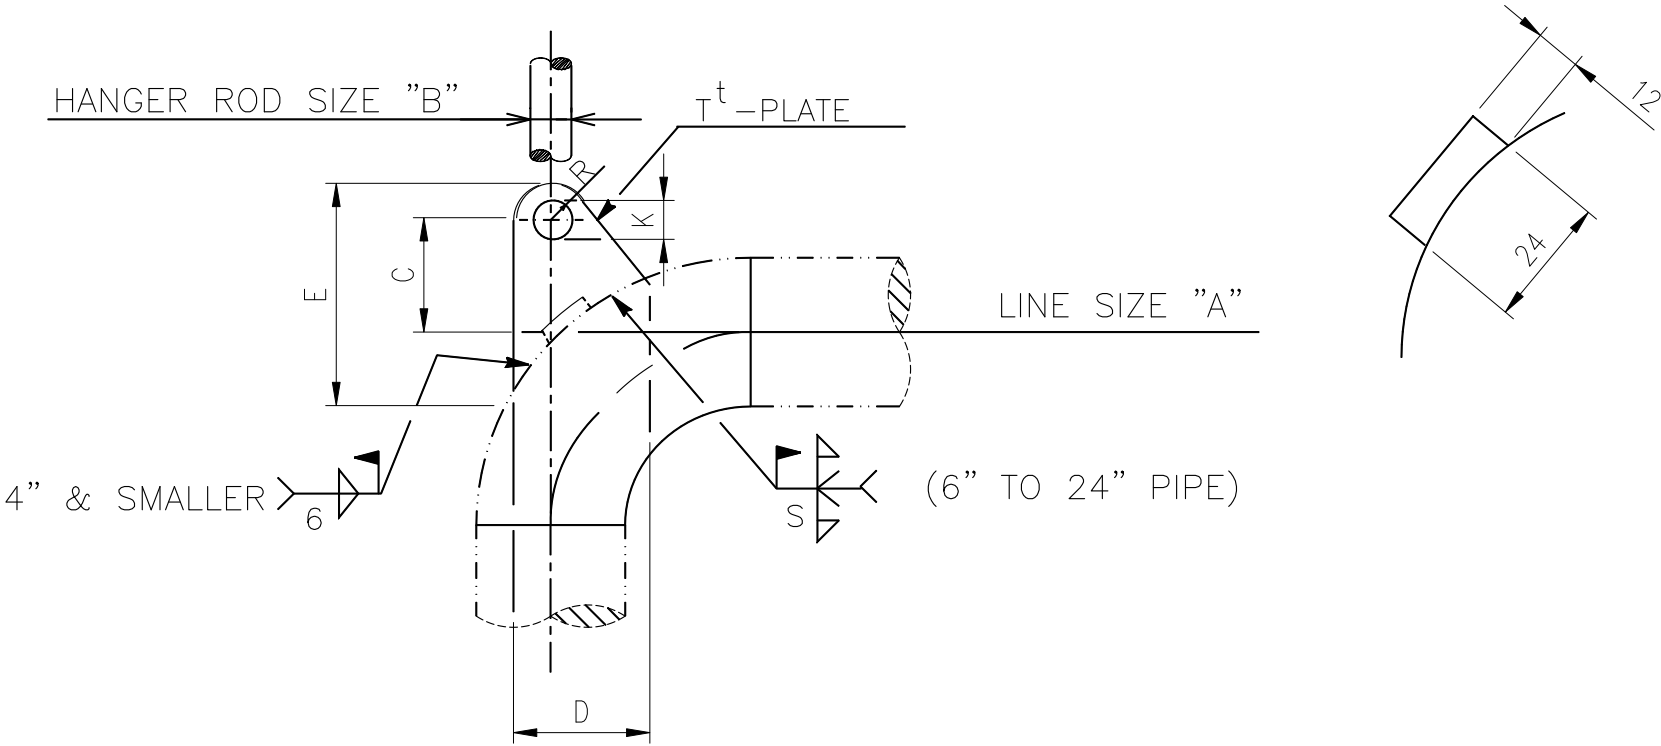


DIMENSION (mm)

| TYPE       | A   | B      | C   | D   | E   | K  | R  | T  | S | MAX. RECOM. LOAD (kg) |
|------------|-----|--------|-----|-----|-----|----|----|----|---|-----------------------|
| LGP-B- 2B  | 2"  | 5/8"   | 185 | 90  | 320 | 21 | 40 | 10 | — | 1000                  |
| LGP-B- 3B  | 3"  | 5/8"   | 190 | 90  | 295 | 21 | 40 | 10 | — | 1000                  |
| LGP-B- 4B  | 4"  | 5/8"   | 190 | 90  | 295 | 21 | 40 | 10 | — | 1000                  |
| LGP-B- 6B  | 6"  | 7/8"   | 190 | 90  | 295 | 28 | 40 | 12 | 6 | 1700                  |
| LGP-B- 8B  | 8"  | 7/8"   | 190 | 90  | 300 | 28 | 40 | 12 | 6 | 1700                  |
| LGP-B- 10B | 10" | 7/8"   | 185 | 90  | 300 | 28 | 40 | 12 | 6 | 1700                  |
| LGP-B- 12B | 12" | 7/8"   | 180 | 90  | 305 | 28 | 40 | 12 | 6 | 1700                  |
| LGP-B- 14B | 14" | 1"     | 160 | 125 | 340 | 32 | 50 | 12 | 6 | 2500                  |
| LGP-B- 16B | 16" | 1"     | 155 | 125 | 345 | 32 | 50 | 12 | 6 | 2500                  |
| LGP-B- 18B | 18" | 1"     | 150 | 125 | 345 | 32 | 50 | 12 | 6 | 2500                  |
| LGP-B- 20B | 20" | 1 1/8" | 170 | 125 | 375 | 35 | 50 | 16 | 9 | 4500                  |
| LGP-B- 24B | 24" | 1 1/8" | 185 | 125 | 470 | 35 | 50 | 16 | 9 | 4500                  |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS

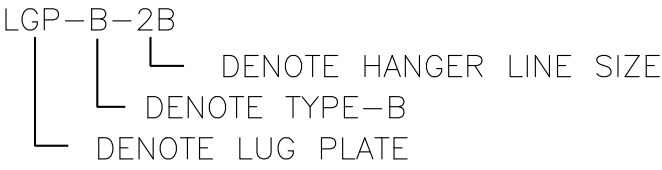


2. MATERIAL: LUG PLATE: CARBON STEEL

3. FOR ALLOY PIPE, THE LUG PLATE SHALL BE THE SAME MATERIAL AS PIPE

FILE: M-33.DWG

|                                                            |          |  |       |      |  |                         |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | LUG PLATE<br><br>TYPE-B |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                         |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                         |  | M-33                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                         |  |                      |           |

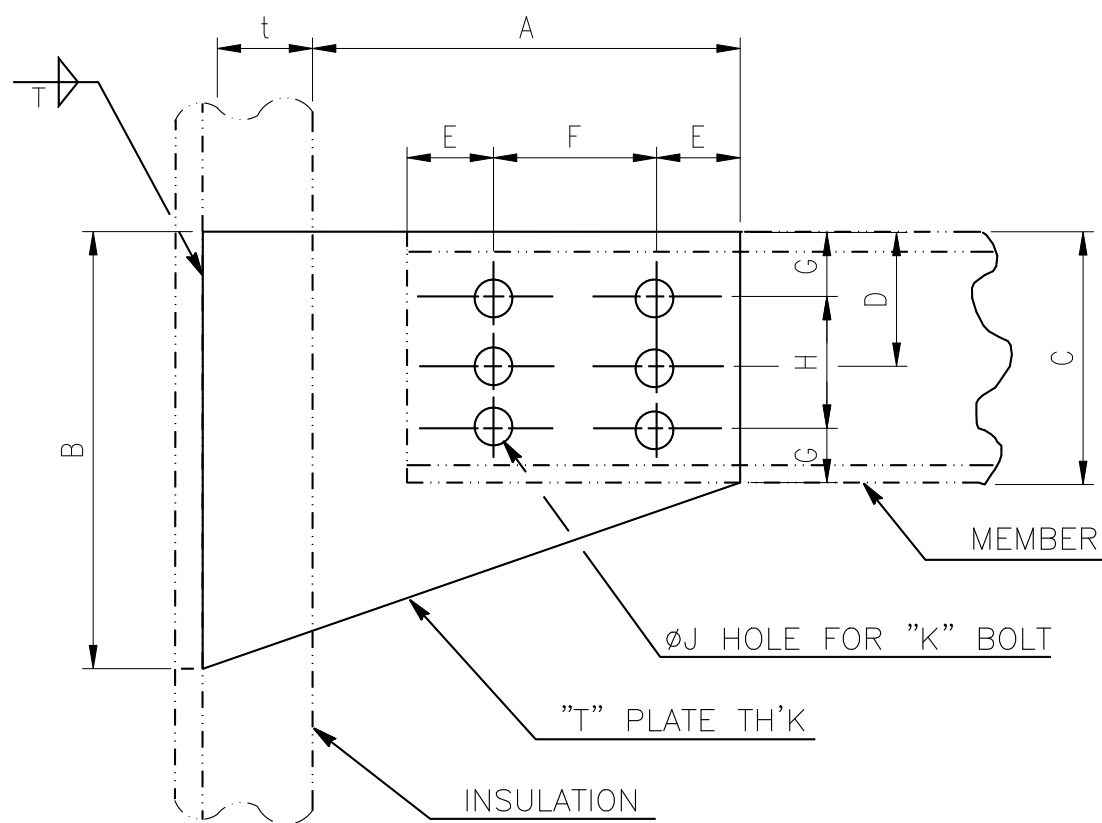

DIMENSIONS (mm)

| TYPE     | MEMBER    | A   | B   | C   | D  | E  | F   | G  | H   | ØJ | K    | T  |
|----------|-----------|-----|-----|-----|----|----|-----|----|-----|----|------|----|
| LGP-C-1  | L50X50X6  | 150 | 100 | 50  | 30 | 30 | 60  | —  | —   | 19 | 5/8" | 9  |
| LGP-C-2  | L65X65X6  | 160 | 130 | 65  | 35 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-C-3  | L75X75X9  | 160 | 140 | 75  | 40 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-C-4  | C100X50X5 | 170 | 160 | 100 | 50 | 30 | 80  | —  | —   | 22 | 3/4" | 10 |
| LGP-C-5  | C100X50X5 | 170 | 160 | 100 | —  | 30 | 80  | 25 | 50  | 19 | 5/8" | 10 |
| LGP-C-6  | C125X65X6 | 170 | 180 | 125 | —  | 30 | 80  | 35 | 55  | 22 | 3/4" | 10 |
| LGP-C-7  | C150X75X9 | 190 | 220 | 150 | —  | 30 | 100 | 40 | 70  | 22 | 3/4" | 12 |
| LGP-C-8  | C180X75X7 | 210 | 260 | 180 | —  | 35 | 110 | 45 | 90  | 22 | 3/4" | 12 |
| LGP-C-9  | C200X90X8 | 220 | 300 | 200 | —  | 35 | 120 | 50 | 100 | 22 | 3/4" | 12 |
| LGP-C-10 | C250X90X9 | 250 | 350 | 250 | —  | 40 | 140 | 60 | 130 | 25 | 7/8" | 16 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




2. MATERIAL: SAME AS THE METAL TO WHICH IT IS CONNECTED

3. IF REINFORCING PAD IS ADDED, NOTE THAT THE PAD THICKNESS IS INCLUDED IN THE DIMENSION A OR A+t.

FILE: M-34M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                      |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | HP6-DSD-A4-500-001   |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| LUG PLATE<br>TYPE-C                                        |          |  |       |      |  | M-34                 |  |
|                                                            |          |  |       |      |  |                      |  |
|                                                            |          |  |       |      |  | REV. 1               |  |

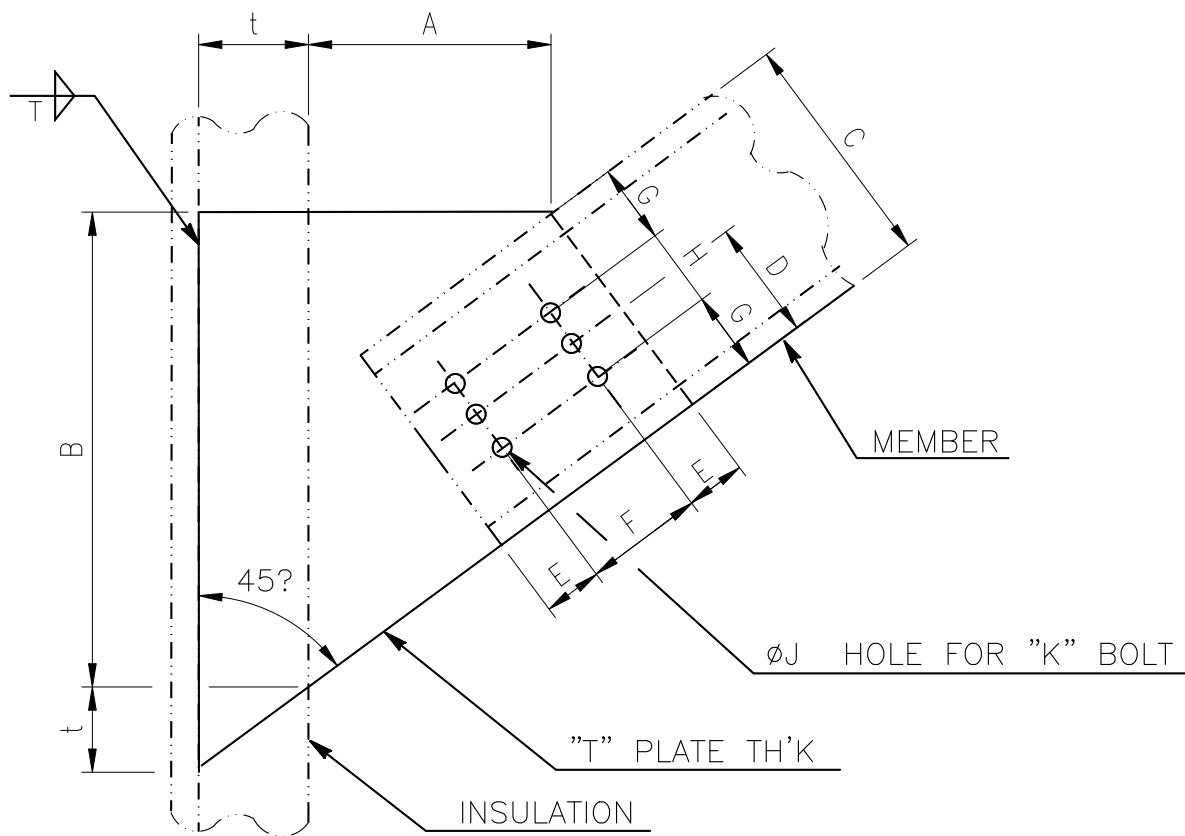

DIMENSION (mm)

| TYPE    | MEMBER    | A   | B   | C   | D  | E  | F   | G  | H   | J  | K    | T  |
|---------|-----------|-----|-----|-----|----|----|-----|----|-----|----|------|----|
| LGP-D-1 | L50X50X6  | 100 | 170 | 50  | 30 | 30 | 60  | —  | —   | 19 | 5/8" | 9  |
| LGP-D-2 | L65X65X6  | 110 | 200 | 65  | 35 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-D-3 | L75X75X9  | 115 | 220 | 75  | 40 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-D-4 | C100X50X5 | 120 | 260 | 100 | 50 | 30 | 80  | —  | —   | 22 | 3/4" | 10 |
| LGP-D-5 | C125X65X6 | 130 | 310 | 125 | —  | 30 | 80  | 35 | 55  | 22 | 3/4" | 10 |
| LGP-D-6 | C150X75X9 | 140 | 350 | 150 | —  | 30 | 100 | 40 | 70  | 22 | 3/4" | 12 |
| LGP-D-7 | C180X75X7 | 150 | 405 | 180 | —  | 35 | 110 | 45 | 90  | 22 | 3/4" | 12 |
| LGP-D-8 | C200X90X8 | 160 | 445 | 200 | —  | 35 | 120 | 50 | 100 | 22 | 3/4" | 12 |
| LGP-D-9 | C250X90X9 | 190 | 545 | 250 | —  | 40 | 140 | 60 | 130 | 25 | 7/8" | 16 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




2. MATERIAL: SAME AS THE METAL TO WHICH IT IS CONNECTED

3. IF REINFORCING PAD IS ADDED, NOTE THAT THE PAD THICKNESS IS INCLUDED IN THE DIMENSION A OR A+t.

FILE: M-35M.DWG

|                                                                               |          |  |       |      |  |                                        |  |                      |      |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------------------------|--|----------------------|------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | <div>LUG PLATE</div> <div>TYPE-D</div> |  | ENGINEERING STANDARD |      |
|                                                                               |          |  |       |      |  |                                        |  | HP6-DSD-A4-500-001   |      |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                                        |  | M-35                 | REV. |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                                        |  |                      | 1    |

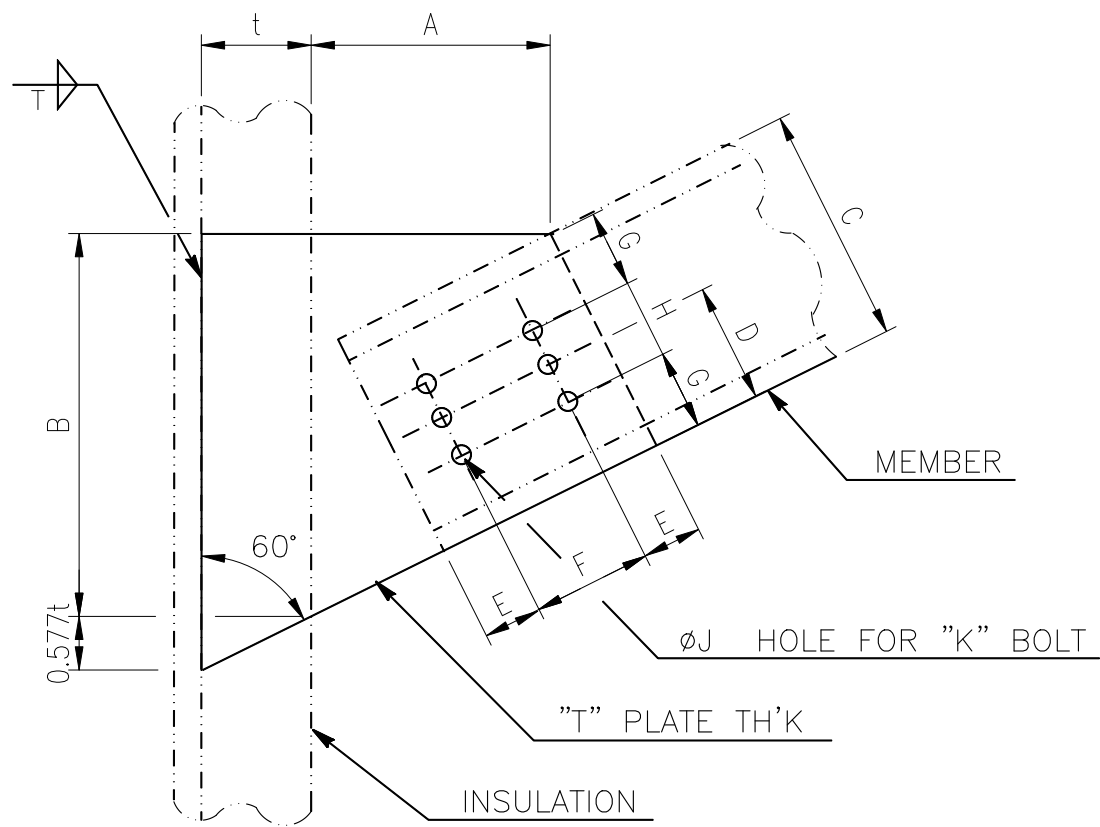

DIMENSION (mm)

| TYPE    | MEMBER    | A   | B   | C   | D  | E  | F   | G  | H   | øJ | K    | T  |
|---------|-----------|-----|-----|-----|----|----|-----|----|-----|----|------|----|
| LGP-E-1 | L50X50X6  | 125 | 130 | 50  | 30 | 30 | 60  | —  | —   | 19 | 5/8" | 9  |
| LGP-E-2 | L65X65X6  | 135 | 155 | 65  | 35 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-E-3 | L75X75X9  | 135 | 165 | 75  | 40 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-E-4 | C100X50X5 | 145 | 200 | 100 | 50 | 30 | 80  | —  | —   | 22 | 3/4" | 10 |
| LGP-E-5 | C125X65X6 | 145 | 230 | 125 | —  | 30 | 80  | 35 | 55  | 22 | 3/4" | 10 |
| LGP-E-6 | C150X75X9 | 165 | 270 | 150 | —  | 30 | 100 | 40 | 70  | 22 | 3/4" | 12 |
| LGP-E-7 | C180X75X7 | 185 | 315 | 180 | —  | 35 | 110 | 45 | 90  | 22 | 3/4" | 12 |
| LGP-E-8 | C200X90X8 | 195 | 345 | 200 | —  | 35 | 120 | 50 | 100 | 22 | 3/4" | 12 |
| LGP-E-9 | C250X90X9 | 220 | 415 | 250 | —  | 40 | 140 | 60 | 130 | 25 | 7/8" | 16 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




2. MATERIAL: SAME AS THE METAL TO WHICH IT IS CONNECTED

3. IF REINFORCING PAD IS ADDED, NOTE THAT THE PAD THICKNESS IS INCLUDED IN THE DIMENSION A OR A+t.

FILE: M-36M.DWG

|                                                            |          |  |       |      |  |                     |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|---------------------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | LUG PLATE<br>TYPE-E |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                     |  | HP6-DSD-A4-500-001   |  |
|                                                            |          |  |       |      |  |                     |  | REV. 1               |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                     |  | M-36                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                     |  |                      |  |

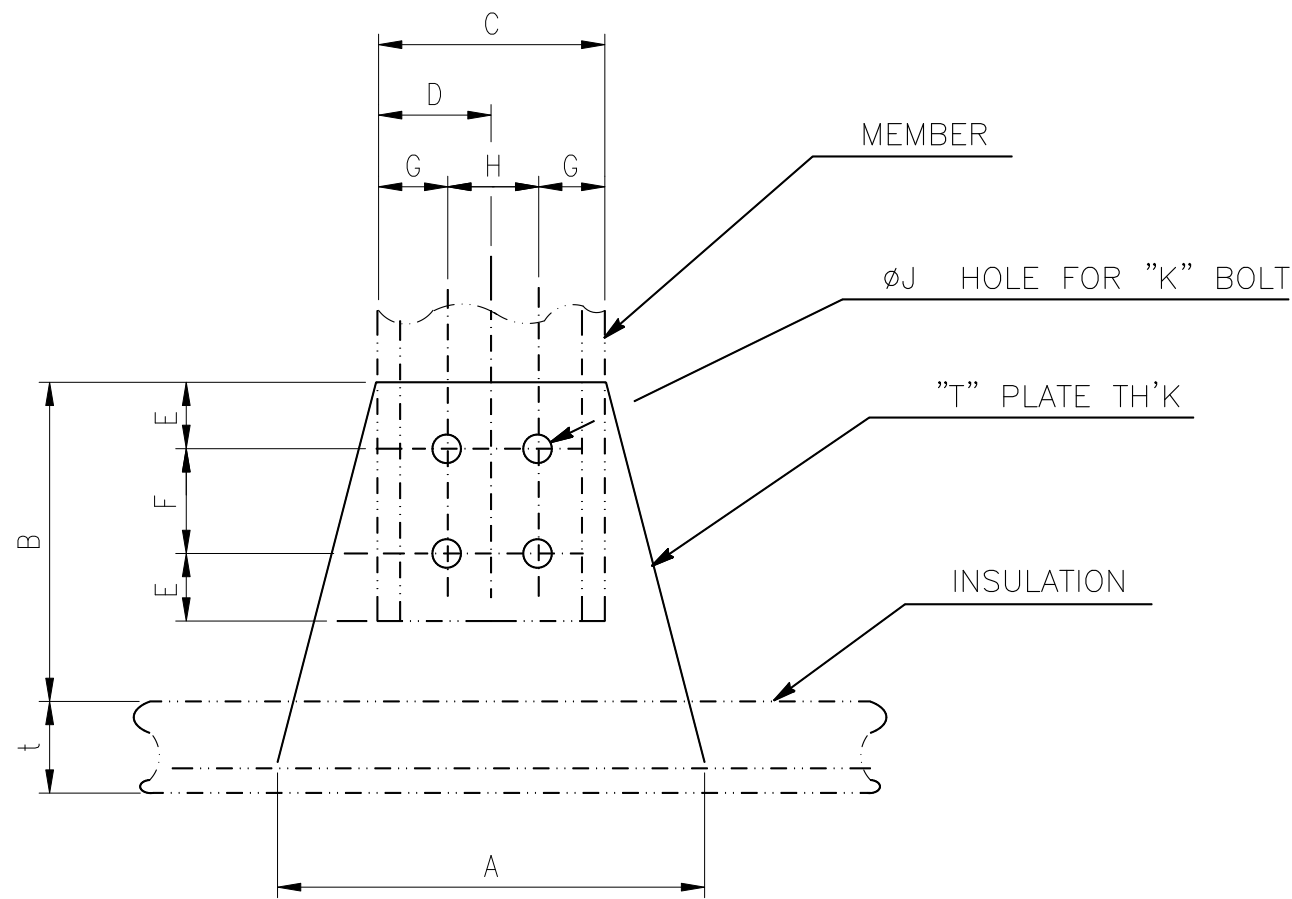

DIMENSIONS (mm)

| TYPE    | MEMBER    | A   | B   | C   | D  | E  | F   | G  | H   | J  | K    | T  |
|---------|-----------|-----|-----|-----|----|----|-----|----|-----|----|------|----|
| LGP-F-1 | L50X50X6  | 150 | 200 | 50  | 30 | 30 | 60  | —  | —   | 19 | 5/8" | 9  |
| LGP-F-2 | L65X65X6  | 160 | 220 | 65  | 35 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-F-3 | L75X75X9  | 160 | 220 | 75  | 40 | 30 | 70  | —  | —   | 22 | 3/4" | 9  |
| LGP-F-4 | C100X50X5 | 170 | 230 | 100 | 50 | 30 | 80  | —  | —   | 22 | 3/4" | 10 |
| LGP-F-5 | C125X65X6 | 170 | 230 | 125 | —  | 30 | 80  | 35 | 55  | 22 | 3/4" | 10 |
| LGP-F-6 | C150X75X9 | 190 | 260 | 150 | —  | 30 | 100 | 40 | 70  | 22 | 3/4" | 12 |
| LGP-F-7 | C180X75X7 | 210 | 280 | 180 | —  | 35 | 110 | 45 | 90  | 22 | 3/4" | 12 |
| LGP-F-8 | C200X90X8 | 220 | 300 | 200 | —  | 35 | 120 | 50 | 100 | 22 | 3/4" | 12 |
| LGP-F-9 | C250X90X9 | 250 | 340 | 250 | —  | 40 | 140 | 60 | 130 | 25 | 7/8" | 16 |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :



LGP-F-1  
└──┬──┘ DENOTE TYPE NO.  
└──┘ DENOTE LUG PLATE

2. MATERIAL: SAME AS THE METAL TO WHICH IT IS CONNECTED



3. IF REINFORCING PAD IS ADDED, NOTE THAT THE PAD THICKNESS IS INCLUDED IN THE DIMENSION B OR B+t.

FILE: M-37M.DWG

|                                                            |          |  |       |      |  |                         |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|-------------------------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | LUG PLATE<br><br>TYPE-F |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  |                         |  | HP6-DSD-A4-500-001   |  |
|                                                            |          |  |       |      |  |                         |  | REV. 1               |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                         |  | M-37                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                         |  |                      |  |

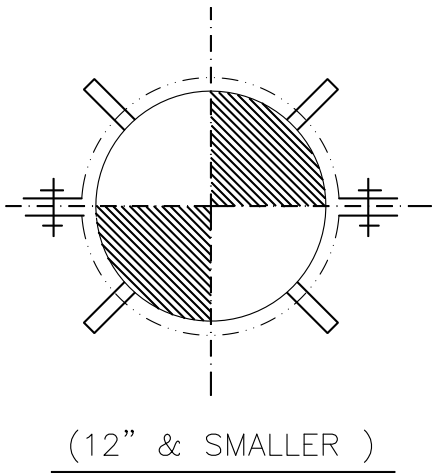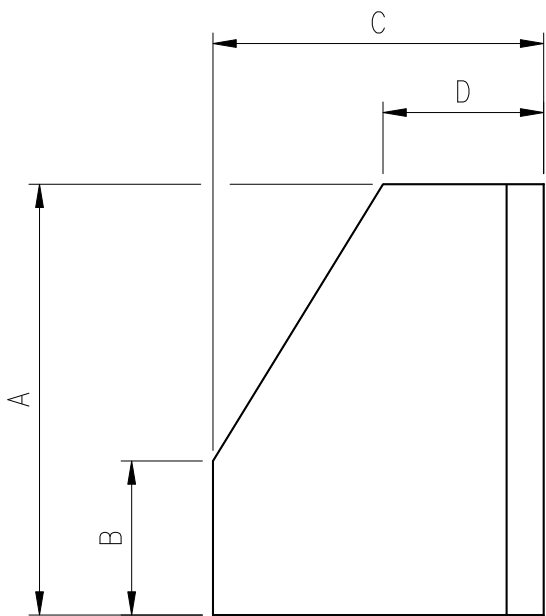

( 12" & SMALLER )

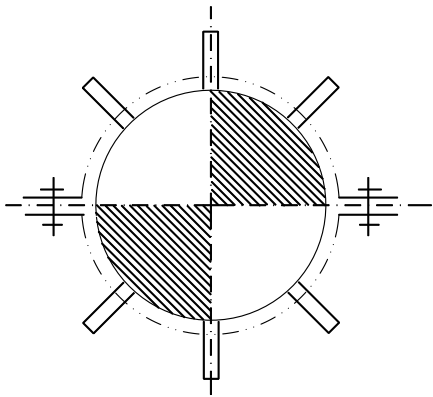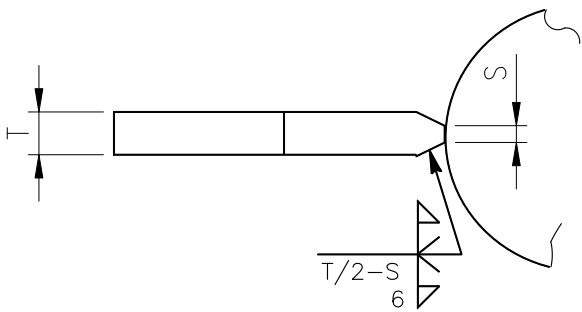


( 14" TO 24" PIPE )

DIMENSIONS (mm)

| TYPE    | LINE SIZE | A   | B  | C  | D  | S | T  | NO. REQ'D |
|---------|-----------|-----|----|----|----|---|----|-----------|
| LGP-P-1 | 3"-8"     | 75  | 45 | 30 | 15 | 3 | 9  | 4         |
| LGP-P-2 | 10"-12"   | 100 | 60 | 40 | 15 | 3 | 12 | 4         |
| LGP-P-3 | 14"-18"   | 120 | 70 | 50 | 20 | 5 | 16 | 6         |
| LGP-P-4 | 20"-24"   | 140 | 75 | 60 | 20 | 7 | 19 | 6         |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

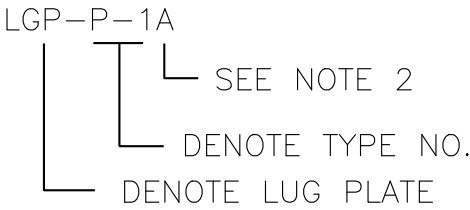


2. MATERIAL :

| MAT'L OF PLATES | SYMBOL |
|-----------------|--------|
| CARBON STEEL    | NONE   |
| ALLOY STEEL     | A      |
| STAINLESS STEEL | S      |

FILE: M-4 1 M . DWG

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | M-4 1                | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | LUG PLATE<br>TYPE-P  |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |



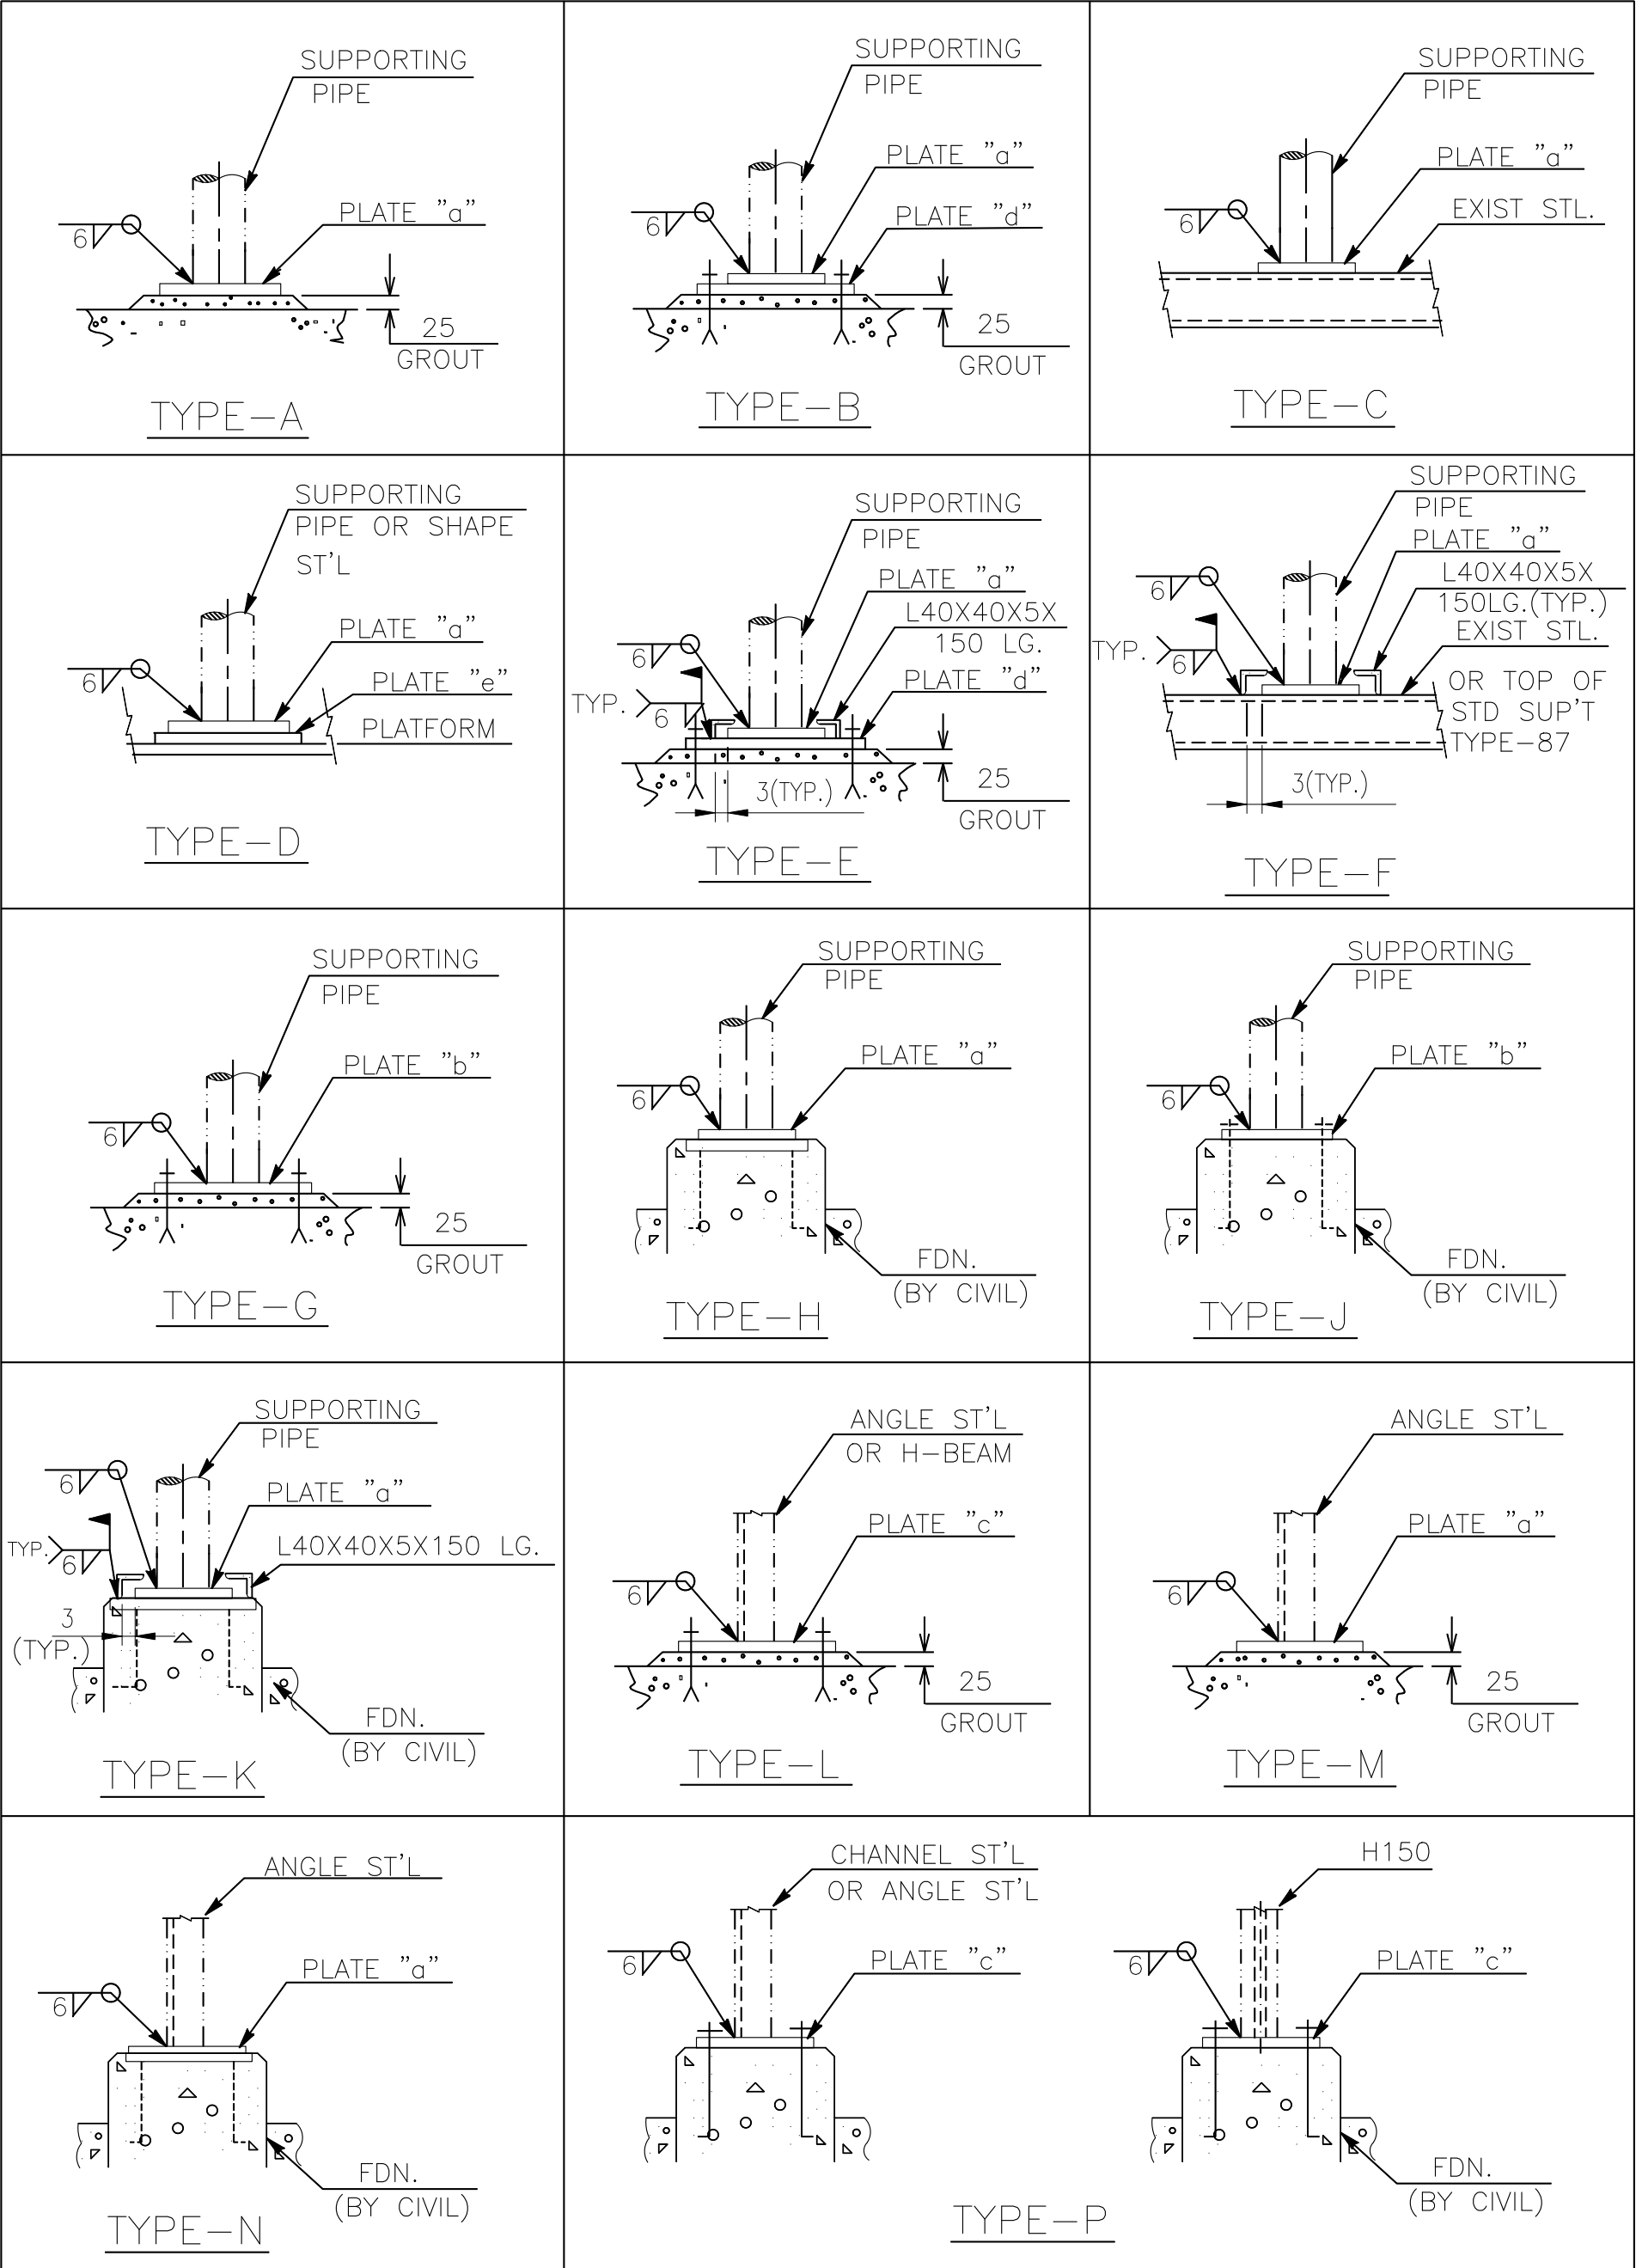

中威工程顧問股份有限公司  
CHUNG WEI ENGINEERING CONSULTING CO., LTD.

LOWER COMPONENT OF  
BASE SUPPORT

(1 OF 3)

ENGINEERING STANDARD

HP6-DSD-A4-500-001

M-42

REV.  
1

FILE: M-42M.DWG

TYPE-R

TYPE-S

TYPE-T

TYPE-U




TYPE-V

TYPE—W

TYPE-X

TYPE-Y



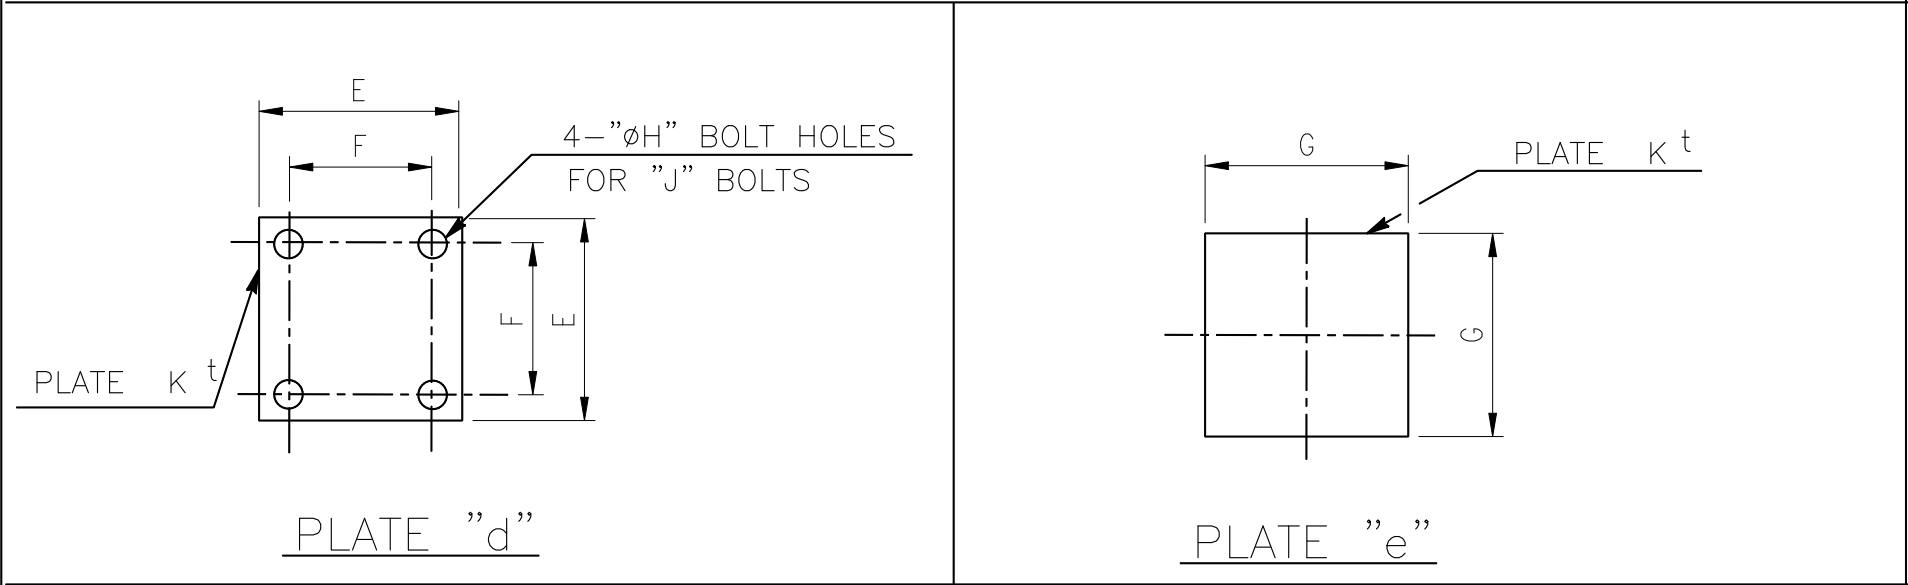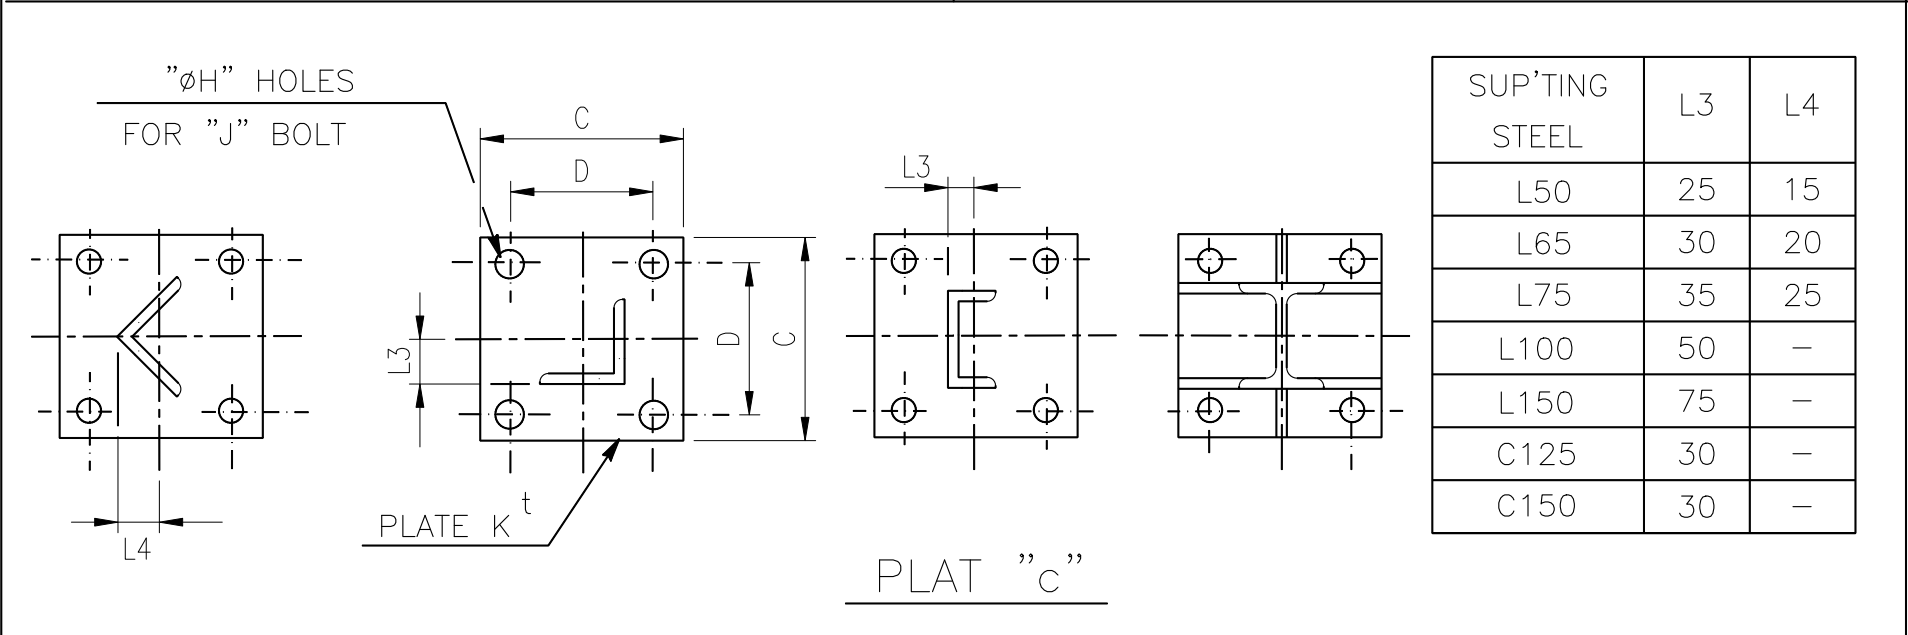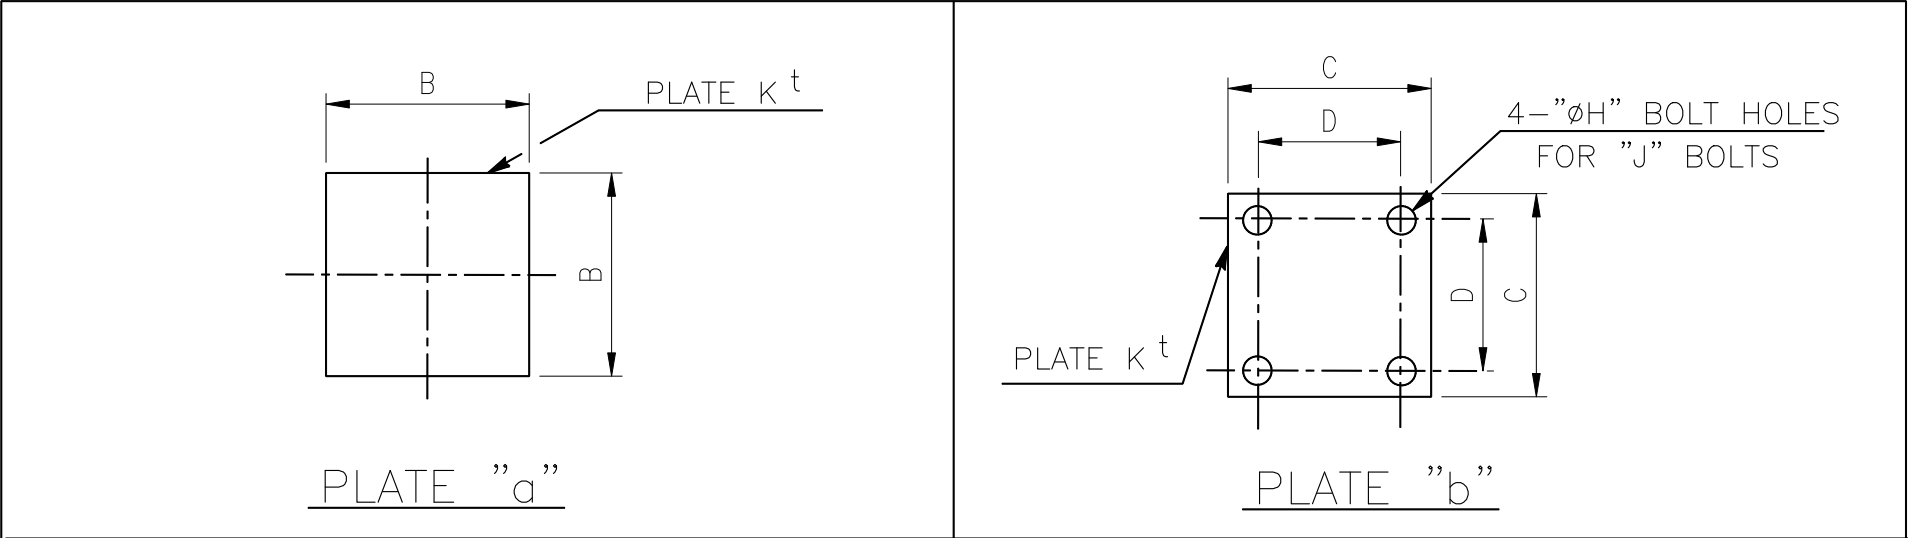

| SUPPORTING PIPE | SUPPORTING STEEL | B   | C   | D   | E   | F   | G   | EXP. BOLT |      | K  |
|-----------------|------------------|-----|-----|-----|-----|-----|-----|-----------|------|----|
|                 |                  |     |     |     |     |     |     | H         | J    |    |
| 1"~3"           | L50,L65          | 150 | 180 | 110 | 290 | 220 | 200 | 19        | 5/8" | 9  |
| 4"~6"           | L75,L100         | 230 | 260 | 190 | 370 | 300 | 280 | 19        | 5/8" | 9  |
| 8"              | C125             | 330 | 380 | 300 | 490 | 410 | 380 | 22        | 3/4" | 16 |
| 10"             | C150             | 330 | 380 | 300 | 490 | 410 | 380 | 22        | 3/4" | 16 |
| 12"             | H150,H250        | 380 | 500 | 410 | 560 | 470 | 430 | 26        | 7/8" | 16 |
| 14"             | —                | 440 | 580 | 490 | 580 | 490 | 580 | 26        | 7/8" | 16 |
| 16"             | —                | 490 | 630 | 540 | 630 | 540 | 630 | 26        | 7/8" | 16 |
| 18"             | —                | 540 | 680 | 590 | 680 | 590 | 680 | 26        | 7/8" | 16 |
| 24"             | —                | 690 | 830 | 740 | 830 | 740 | 830 | 26        | 7/8" | 16 |
| 28"             | —                | 790 | 930 | 840 | 930 | 840 | 930 | 26        | 7/8" | 16 |

- NOTES :
- IF TYPE-B AND TYPE-H USED FOR SUPPORT TYPE-09. PLATE "a" SHALL BE DELETED.
  - GRATING SHALL BE CUT FOR LOWER COMPONENT TYPE C,F,R AND S IF REQUIRED.


|                                                            |          |  |       |      |  |                                                |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|------------------------------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | LOWER COMPONENT OF<br>BASE SUPPORT<br>(3 OF 3) |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                                                |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                                                |  | M-43                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                                                |  |                      |           |



NOTES :

3. THESE LOADINGS ARE BASED ON R.C. STRENGTH 210 KG/CM<sup>2</sup>  
THE SAFETY FACTOR SHALL BE 5 WHEN DESIGNNING.

|                                                                                            |          |  |       |      |  |                      |           |
|--------------------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|-----------|
| <div> <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> </div> |          |  |       |      |  | ENGINEERING STANDARD |           |
|                                                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |           |
| BY                                                                                         | SHIH     |  | CHK.  | YANG |  | EXPANSION BOLT       |           |
| DATE                                                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |           |
|                                                                                            |          |  |       |      |  | M-45                 | REV.<br>1 |

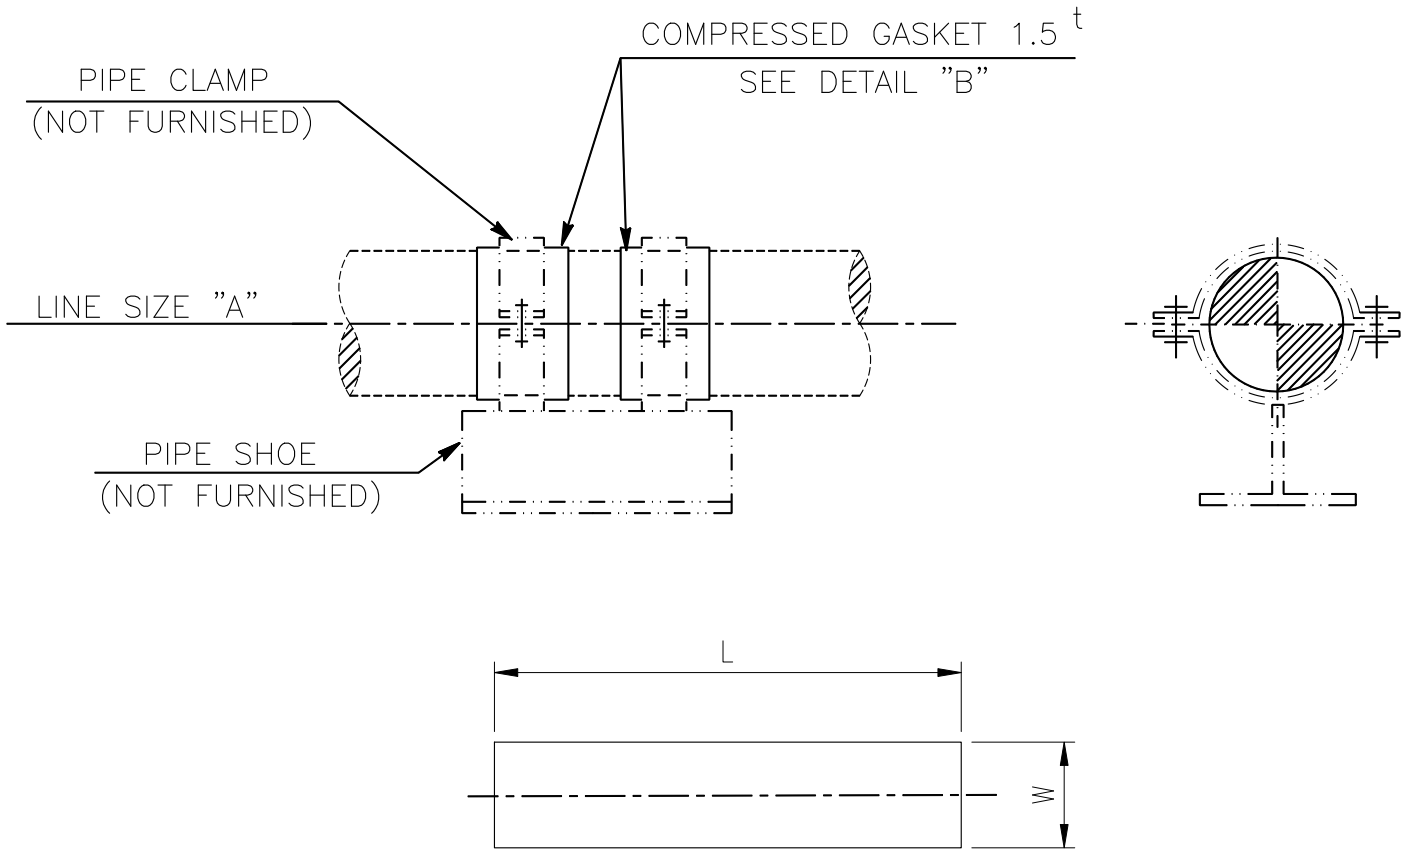

DETAIL "B"

| LINE<br>SIZE<br>"A" | L    | W  |
|---------------------|------|----|
| ASB – 3/4B          | 83   | 50 |
| ASB – 1B            | 105  | 50 |
| ASB – 1 1/2B        | 152  | 50 |
| ASB – 2B            | 190  | 50 |
| ASB – 2 1/2B        | 229  | 50 |
| ASB – 3B            | 279  | 50 |
| ASB – 4B            | 359  | 50 |
| ASB – 5B            | 444  | 50 |
| ASB – 6B            | 529  | 50 |
| ASB – 8B            | 688  | 50 |
| ASB – 10B           | 858  | 80 |
| ASB – 12B           | 1017 | 80 |
| ASB – 14B           | 1117 | 80 |
| ASB – 16B           | 1277 | 80 |
| ASB – 18B           | 1436 | 80 |
| ASB – 20B           | 1596 | 80 |
| ASB – 24B           | 1915 | 90 |


| LINE<br>SIZE<br>"A" | L    | W   |
|---------------------|------|-----|
| ASB- 26B            | 2074 | 90  |
| ASB- 28B            | 2234 | 90  |
| ASB- 30B            | 2393 | 90  |
| ASB- 32B            | 2553 | 90  |
| ASB- 34B            | 2712 | 110 |
| ASB- 36B            | 2872 | 110 |
| ASB- 40B            | 3191 | 110 |
| ASB- 42B            | 3350 | 110 |

NOTES :

1. MATERIAL : NON-ASBESTOS COMPRESSED GASKET THICKNESS 1.5 mm :  
GARLOCK BLUE-GARD STYLE 3000 OR EQ.

FILE: M-47M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
|                                                            |          |  |       |      |  | REV. 1               |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | COMPRESSED GASKET    |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
|                                                            |          |  |       |      |  | M-47                 |  |

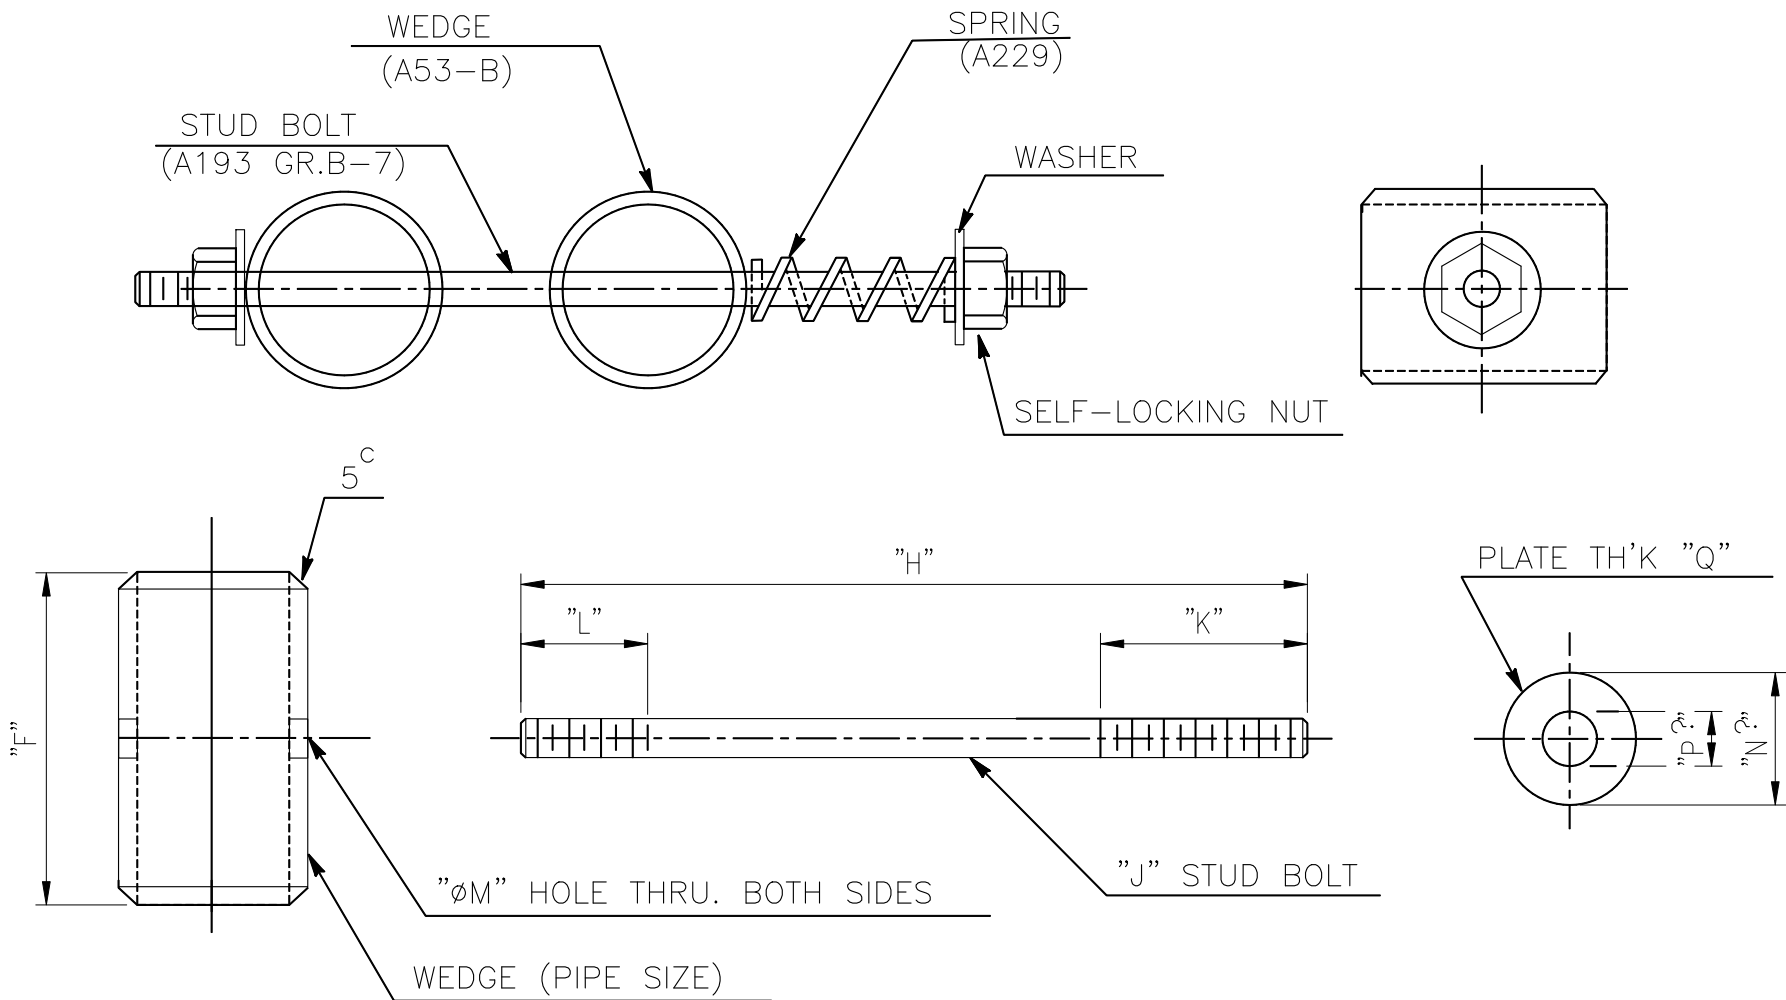

DIMENSIONS (mm)

| TYPE       | LINE SIZE | PIPE SIZE | F   | H   | J    | K   | L  | M  | N  | P  | Q  |
|------------|-----------|-----------|-----|-----|------|-----|----|----|----|----|----|
| SPRW - 2B  | 2"        | 2"-SCH.80 | 154 | 295 | 1/2" | 102 | 57 | 14 | 40 | 14 | 6  |
| SPRW - 3B  | 3"        | 2"-SCH.80 | 154 | 295 | 1/2" | 102 | 57 | 14 | 40 | 14 | 6  |
| SPRW - 4B  | 4"        | 2"-SCH.80 | 154 | 295 | 1/2" | 102 | 57 | 14 | 40 | 14 | 6  |
| SPRW - 6B  | 6"        | 2"-SCH.80 | 154 | 345 | 3/4" | 127 | 57 | 21 | 45 | 21 | 10 |
| SPRW - 8B  | 8"        | 2"-SCH.80 | 154 | 345 | 3/4" | 127 | 57 | 21 | 45 | 21 | 10 |
| SPRW - 10B | 10"       | 3"-SCH.80 | 154 | 470 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 12B | 12"       | 3"-SCH.80 | 154 | 470 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 14B | 14"       | 3"-SCH.80 | 154 | 470 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 16B | 16"       | 3"-SCH.80 | 154 | 505 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 18B | 18"       | 3"-SCH.80 | 154 | 505 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 20B | 20"       | 3"-SCH.80 | 154 | 505 | 3/4" | 127 | 70 | 21 | 45 | 21 | 10 |
| SPRW - 24B | 24"       | 3"-SCH.80 | 229 | 610 | 1"   | 190 | 95 | 27 | 65 | 27 | 10 |


| SPRING DATA TABLE                               |          |          |          |
|-------------------------------------------------|----------|----------|----------|
| COMPRESSION SPRING WITH SQUARED AND GROUND ENDS |          |          |          |
| LINE SIZE "P"                                   | 2"-4"    | 6"-20"   | 24"      |
| WIRE DIAMETER                                   | 5 mm     | 8 mm     | 10 mm    |
| SPRING INSIDE DIAMETER                          | 14 mm    | 22 mm    | 28 mm    |
| NUMBER OF ACTIVE COILS                          | 6        | 5        | 4        |
| NUMBER OF UNACTIVE COILS                        | 2        | 2        | 2        |
| FREE LENGTH                                     | 65 mm    | 80 mm    | 110 mm   |
| SPRING CONSTANT                                 | 15 kg/mm | 30 kg/mm | 45 kg/mm |
| COMPRESS SPRING FOR INSTALLATION                | 12 mm    | 12 mm    | 25 mm    |

NOTE : 1. DESIGNATION NUMBER DENOTE AS FOLLOWS :




FILE: M-52M.DWG

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | M-52                 | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | SPRING WEDGE         |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

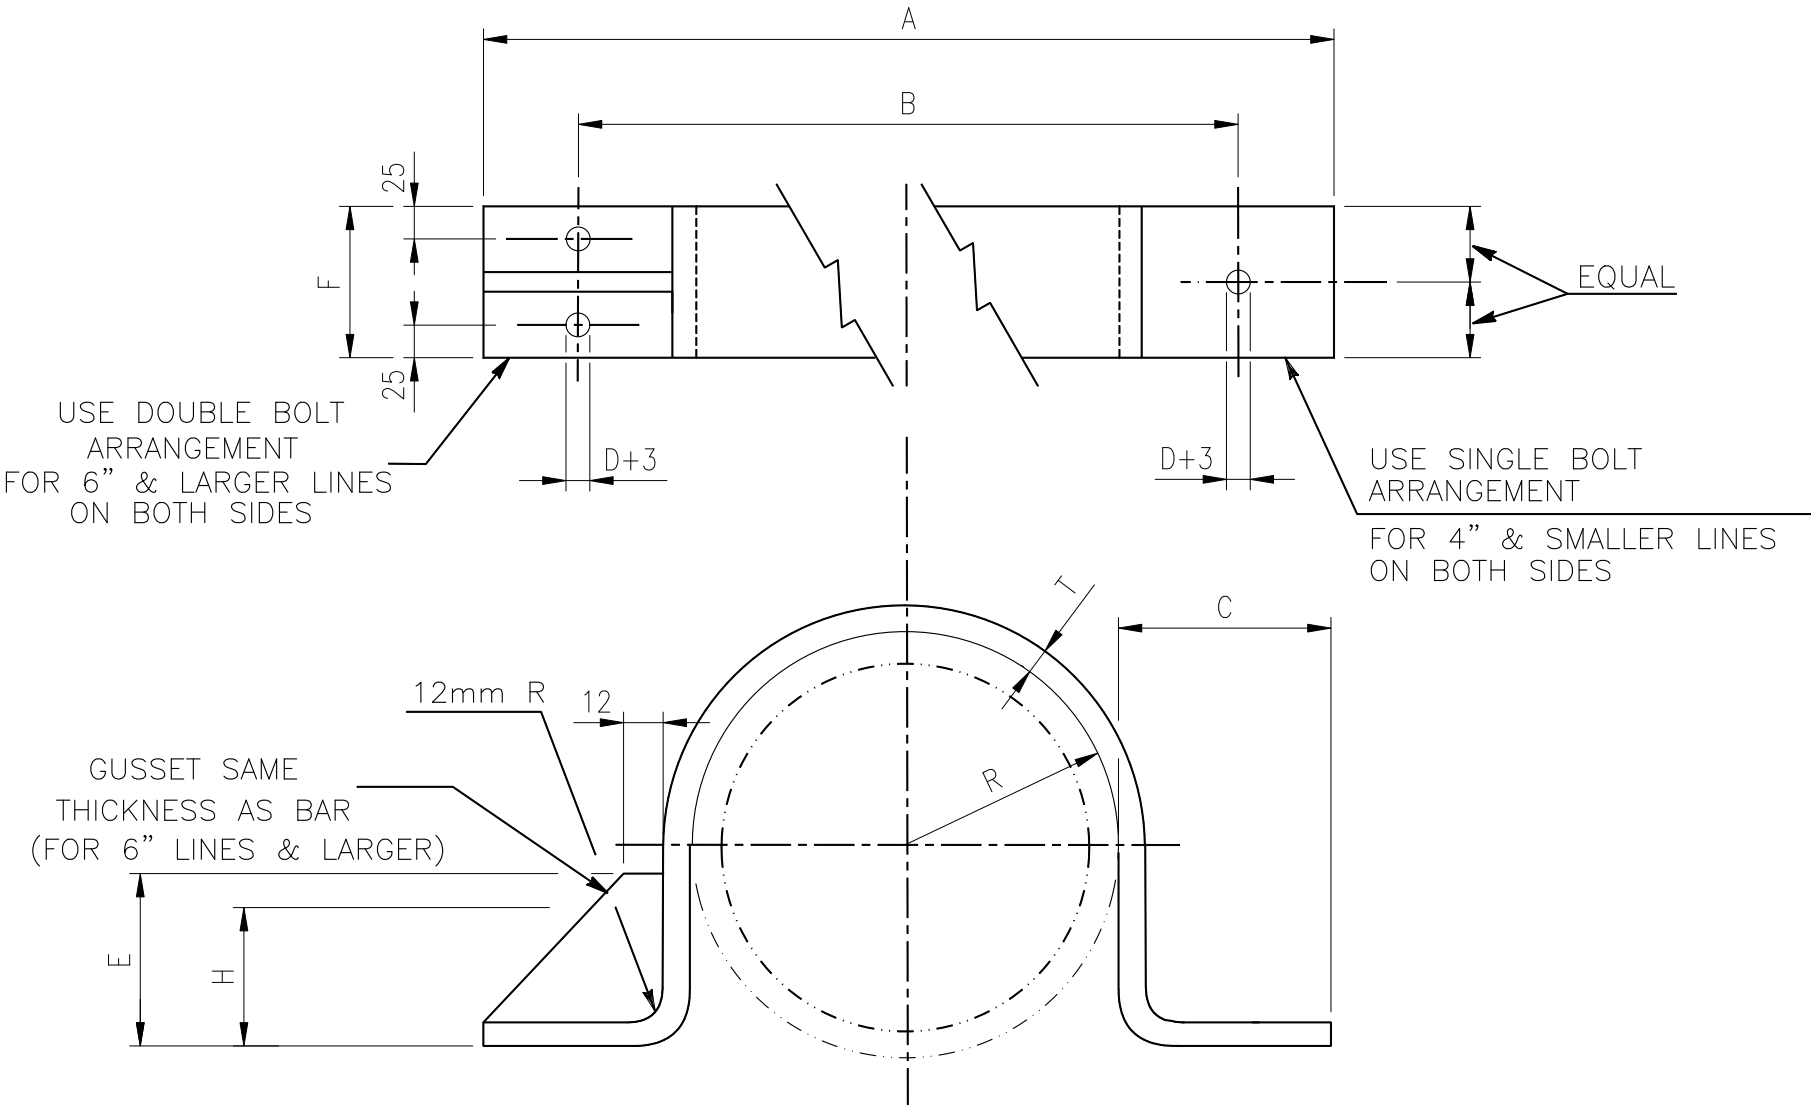

| TYPE<br>PUBS2 | LINE<br>SIZE | A   | B   | C   | E   | R   | D    | F X T  |
|---------------|--------------|-----|-----|-----|-----|-----|------|--------|
| 1B            | 1"           | 186 | 127 | 76  | —   | 17  | 1/4" | 65X 6  |
| 1 1/2B        | 1 1/2"       | 202 | 143 | 76  | —   | 25  | 1/4" | 65X 6  |
| 2B            | 2"           | 244 | 171 | 92  | —   | 30  | 3/8" | 75X 6  |
| 3B            | 3"           | 272 | 197 | 92  | —   | 44  | 3/8" | 75X 6  |
| 4B            | 4"           | 298 | 222 | 92  | —   | 57  | 3/8" | 75X 6  |
| 6B            | 6"           | 396 | 305 | 114 | 71  | 84  | 1/2" | 125X 9 |
| 8B            | 8"           | 448 | 356 | 114 | 97  | 110 | 1/2" | 125X 9 |
| 10B           | 10"          | 502 | 406 | 114 | 124 | 137 | 3/4" | 125X 9 |
| 12B           | 12"          | 552 | 464 | 114 | 143 | 162 | 3/4" | 150X12 |
| 14B           | 14"          | 584 | 495 | 114 | 165 | 178 | 3/4" | 150X12 |
| 16B           | 16"          | 634 | 546 | 114 | 191 | 203 | 3/4" | 150X12 |
| 18B           | 18"          | 686 | 597 | 114 | 216 | 229 | 3/4" | 150X12 |
| 20B           | 20"          | 736 | 648 | 114 | 241 | 254 | 7/8" | 150X12 |
| 24B           | 24"          | 838 | 749 | 114 | 292 | 305 | 7/8" | 150X12 |

NOTE: 1. ILLUSTRATION OF DESIGNATION NUMBER:

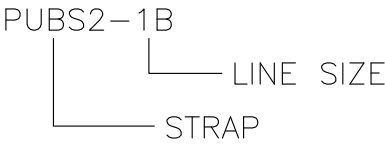

2. MATERIAL: A283-C

|                                                            |          |  |       |      |  |                      |        |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |        |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |        |
|                                                            |          |  |       |      |  | M-53                 | REV. 1 |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | STRAP<br>TYPE-PUBS2  |        |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |        |

FILE: M-53M.DWG



NOTE:


PUBS3-2B-1

DENOTE LINE SIZE

2. MATERIAL : CARBON STEEL


|                                                                               |          |  |       |      |  |                      |  |                    |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|--------------------|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | ENGINEERING STANDARD |  |                    |
|                                                                               |          |  |       |      |  |                      |  | HP6-DSD-A4-500-001 |
| <div>STRAP</div>                                                              |          |  |       |      |  | M-54                 |  | REV.<br>1          |
|                                                                               |          |  |       |      |  |                      |  |                    |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |                      |  |                    |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |                      |  |                    |



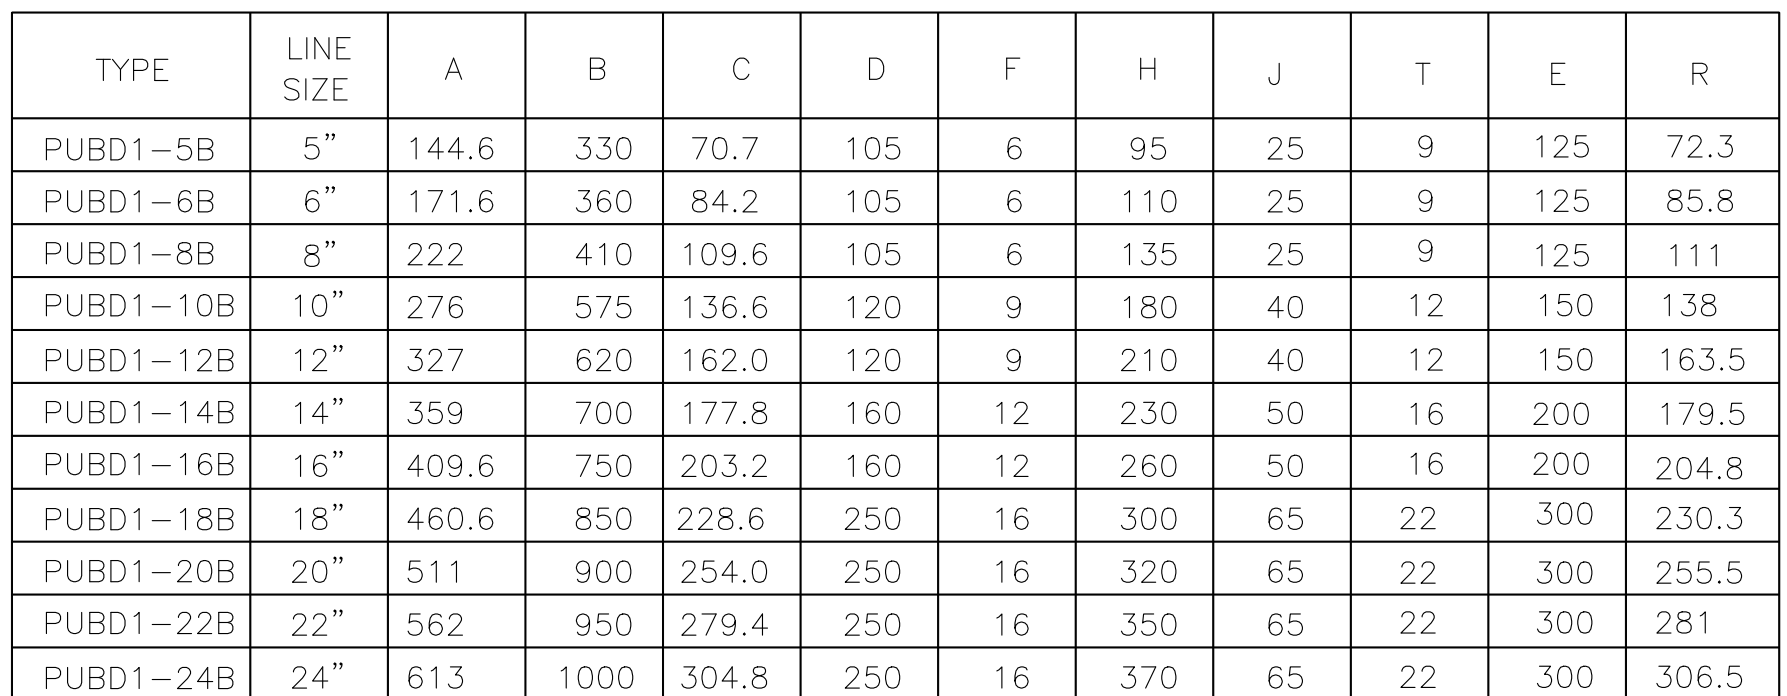

2. MATERIAL : CARBON STEEL

|                                                                               |          |  |       |      |  |        |  |  |  |  |  |                      |  |
|-------------------------------------------------------------------------------|----------|--|-------|------|--|--------|--|--|--|--|--|----------------------|--|
| <div>中威工程顧問股份有限公司</div> <div>CHUNG WEI ENGINEERING CONSULTING CO., LTD.</div> |          |  |       |      |  | U-BAND |  |  |  |  |  | ENGINEERING STANDARD |  |
|                                                                               |          |  |       |      |  |        |  |  |  |  |  | HP6-DSD-A4-500-001   |  |
| BY                                                                            | SHIH     |  | CHK.  | YANG |  |        |  |  |  |  |  | M-55                 |  |
| DATE                                                                          | 7/15/'24 |  | APPR. | CHEN |  |        |  |  |  |  |  |                      |  |

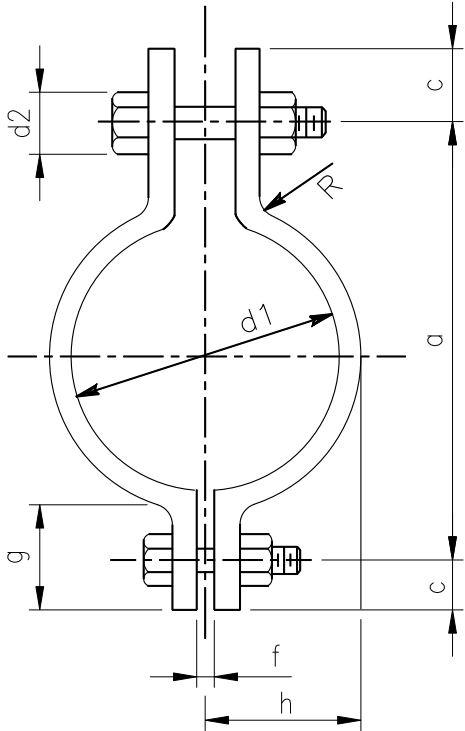

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOWS:
- PCL-H-A-4B
- DENOTE LINE SIZE
  - DENOTE PIPE CLAMP MATERIAL (SEE NOTE 2)
  - DENOTE TYPE
  - DENOTE PIPE CLAMP
2. A: ALLOY STEEL  
C: CARBON STEEL  
S: STAINLESS STEEL



DIMENSIONS (mm)

| d1   | USE FOR SIZE | Clamp |    |    |    |    |     |    | Flat or Plate | Total length of a Half Clamp | Hex Bolt ANSI B18.21 Hex Nut ANSI B18.2.2 | Weight Kg/Set |
|------|--------------|-------|----|----|----|----|-----|----|---------------|------------------------------|-------------------------------------------|---------------|
|      |              | a     | c  | d2 | f  | R  | h   | g  |               |                              |                                           |               |
| 22   | 1/2"         | 53    | 15 | 12 | 7  | 4  | 16  |    | 30X5          | 86                           | 3/8"X35                                   | 0.226         |
| 27   | 3/4"         | 66    | 15 | 12 | 7  | 4  | 19  |    | 30X5          | 99                           | 3/8"X35                                   | 0.305         |
| 34   | 1"           | 72    | 15 | 12 | 7  | 4  | 22  |    | 30X5          | 109                          | 3/8"X35                                   | 0.327         |
| 43   | 1 1/4"       | 82    | 15 | 12 | 7  | 4  | 27  |    | 30X5          | 122                          | 3/8"X35                                   | 0.358         |
| 49   | 1 1/2"       | 88    | 15 | 12 | 7  | 4  | 30  |    | 30X5          | 130                          | 3/8"X35                                   | 0.383         |
| 61   | 2"           | 108   | 18 | 14 | 9  | 6  | 37  |    | 40X6          | 160                          | 1/2"X35                                   | 0.705         |
| 77   | 2 1/2"       | 122   | 18 | 14 | 9  | 6  | 45  |    | 40X6          | 185                          | 1/2"X35                                   | 0.786         |
| 89   | 3"           | 136   | 18 | 14 | 9  | 6  | 51  |    | 40X6          | 204                          | 1/2"X35                                   | 0.876         |
| 115  | 4"           | 178   | 24 | 18 | 11 | 6  | 66  |    | 50X8          | 268                          | 5/8"X45                                   | 1.895         |
| 141  | 5"           | 204   | 24 | 18 | 11 | 6  | 78  |    | 50X8          | 308                          | 5/8"X45                                   | 2.092         |
| 169  | 6"           | 232   | 24 | 18 | 11 | 6  | 93  |    | 50X8          | 352                          | 5/8"X45                                   | 2.342         |
| 220  | 8"           | 284   | 24 | 18 | 11 | 6  | 118 |    | 50X8          | 434                          | 5/8"X45                                   | 2.905         |
| 273  | 10"          | 348   | 30 | 23 | 14 | 8  | 145 |    | 60X8          | 536                          | 3/4"X50                                   | 4.391         |
| 324  | 12"          | 398   | 30 | 23 | 14 | 8  | 170 | 59 | 60X8          | 616                          | 3/4"X50                                   | 4.934         |
| 356  | 14"          | 432   | 30 | 23 | 14 | 8  | 186 | 60 | 60X8          | 656                          | 3/4"X50                                   | 5.572         |
| 407  | 16"          | 498   | 36 | 27 | 18 | 8  | 214 | 72 | 70X10         | 767                          | 1"X60                                     | 9.350         |
| 457  | 18"          | 550   | 36 | 27 | 18 | 8  | 239 | 73 | 70X10         | 833                          | 1"X60                                     | 10.228        |
| 508  | 20"          | 600   | 36 | 27 | 18 | 8  | 264 | 72 | 70X10         | 926                          | 1"X60                                     | 11.028        |
| 610  | 24"          | 702   | 36 | 27 | 22 | 10 | 317 | 72 | 80X12         | 1088                         | 1"X70                                     | 14.548        |
| 660  | 26"          | 753   | 36 | 27 | 22 | 10 | 342 | 72 | 80X12         | 1166                         | 1"X70                                     | 15.724        |
| 712  | 28"          | 804   | 36 | 27 | 22 | 10 | 368 | 72 | 80X12         | 1244                         | 1"X70                                     | 16.520        |
| 762  | 30"          | 855   | 36 | 27 | 22 | 10 | 393 | 72 | 80X12         | 1324                         | 1"X70                                     | 17.726        |
| 813  | 32"          | 905   | 36 | 27 | 22 | 10 | 419 | 72 | 80X12         | 1403                         | 1"X70                                     | 18.500        |
| 915  | 36"          | 1007  | 36 | 27 | 28 | 10 | 470 | 72 | 90X12         | 1558                         | 1"X80                                     | 22.930        |
| 1016 | 40"          | 1108  | 36 | 27 | 28 | 10 | 520 | 72 | 90X12         | 1716                         | 1"X80                                     | 25.160        |
| 1067 | 42"          | 1158  | 36 | 27 | 28 | 10 | 546 | 72 | 90X12         | 1796                         | 1"X80                                     | 26.400        |
| 1120 | 44"          | 1212  | 36 | 27 | 28 | 10 | 572 | 72 | 90X12         | 1880                         | 1"X80                                     | 27.480        |
| 1169 | 46"          | 1260  | 36 | 27 | 32 | 10 | 597 | 72 | 120X12        | 1953                         | 1"X85                                     | 37.750        |
| 1220 | 48"          | 1312  | 36 | 27 | 32 | 10 | 622 | 72 | 120X12        | 2033                         | 1"X85                                     | 39.250        |
| 1270 | 50"          | 1362  | 36 | 27 | 32 | 10 | 647 | 72 | 120X12        | 2112                         | 1"X85                                     | 40.740        |
| 1320 | 52"          | 1412  | 36 | 27 | 32 | 10 | 672 | 72 | 120X12        | 2190                         | 1"X85                                     | 42.210        |

FILE: M-56M.DWG

|                                                            |          |  |       |      |  |                          |  |                      |           |
|------------------------------------------------------------|----------|--|-------|------|--|--------------------------|--|----------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | PIPE CLAMP<br><br>TYPE-H |  | ENGINEERING STANDARD |           |
|                                                            |          |  |       |      |  |                          |  | HP6-DSD-A4-500-001   |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  |                          |  | M-56                 | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                          |  |                      |           |



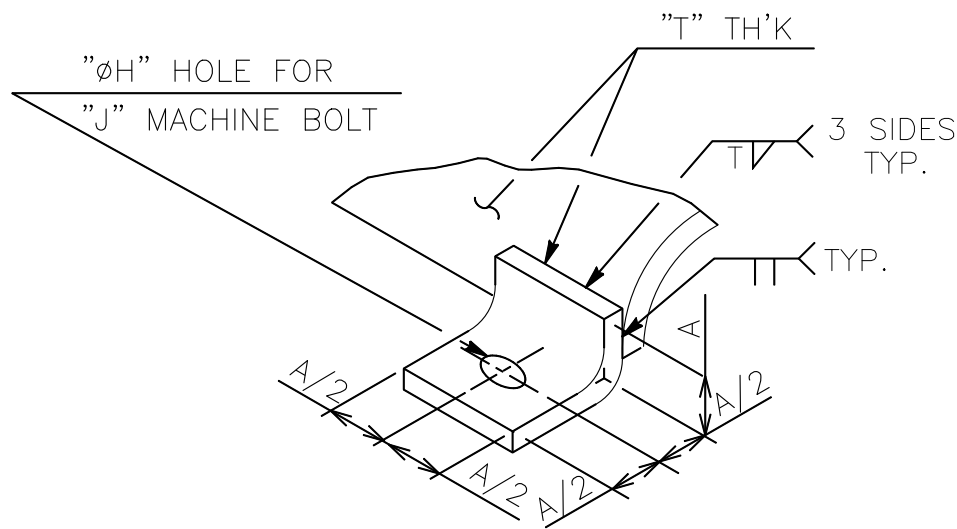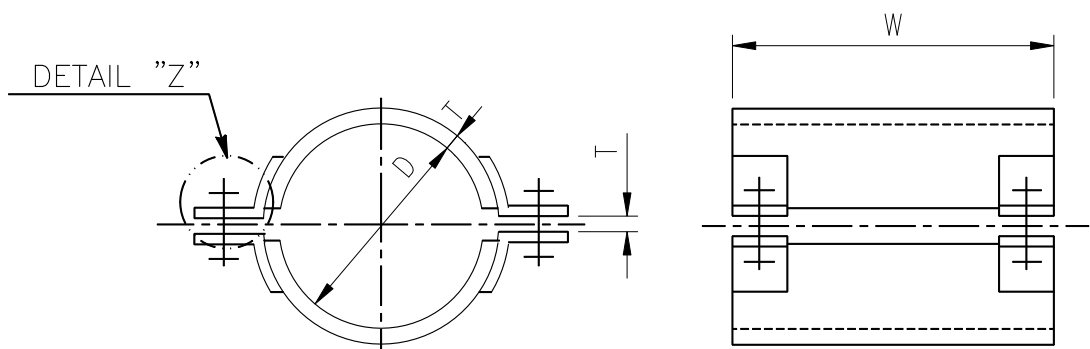


DETAIL "Z"

| LINE SIZE  | W   | T  | A  | H  | J          |
|------------|-----|----|----|----|------------|
| 4" & UNDER | 165 | 3  | 25 | 8  | 1/4"X30mm  |
| 6"& 8"     | 165 | 3  | 25 | 11 | 3/8"X40mm  |
| 10"~16"    | 330 | 6  | 40 | 14 | 1/2"X60mm  |
| 18"~24"    | 500 | 9  | 40 | 18 | 5/8"X80mm  |
| 26"~32"    | 600 | 12 | 50 | 21 | 3/4"X100mm |

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

SADD-6B-175

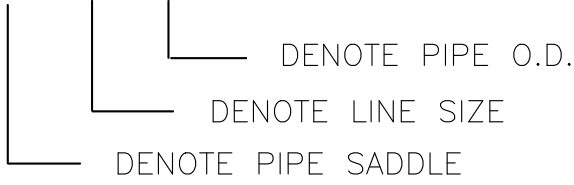


2. D=PIPE O.D.+6mm, NON-FERROUS PIPE O.D. SHOULD BE REFERRED TO THE MANUFACTURER’S DIMENSIONS.

3. MATERIAL : PLATE , CARBON STEEL  
BOLT & NUTS, A307 GR.B/A563 GR.A

FILE: M-57M.DWG

|                                                            |          |  |       |      |  |                            |           |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------------|-----------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD       |           |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001         |           |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | NON-FERROUS<br>PIPE SADDLE | REV.<br>1 |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                            |           |

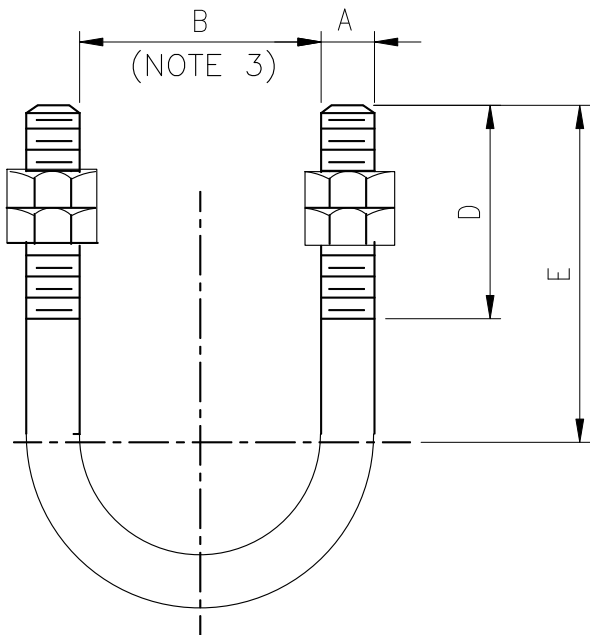

DIMENSIONS (mm)


| TYPE         | LINE SIZE | ROD SIZE A | D  | E   |
|--------------|-----------|------------|----|-----|
| UB-A-1B      | 1"        | 1/4"       | 40 | 55  |
| UB-A-1 1/2 B | 1 1/2"    | 1/4"       | 40 | 65  |
| UB-A-2B      | 2"        | 1/4"       | 40 | 70  |
| UB-A-2 1/2 B | 2 1/2"    | 3/8"       | 60 | 85  |
| UB-A-3B      | 3"        | 3/8"       | 60 | 90  |
| UB-A-4B      | 4"        | 3/8"       | 60 | 100 |
| UB-A-6B      | 6"        | 1/2"       | 70 | 135 |
| UB-A-8B      | 8"        | 1/2"       | 70 | 165 |

NOTES :

1. MATERIAL : CARBON STEEL U-BOLT AND FOUR FINISHED HEX. NUTS.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :


UB-A-1/2B-75

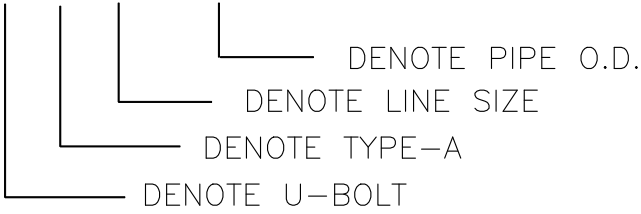

3. B=PIPE O.D. + 18  
O.D.: OUTSIDE DIA. OF NON-FERROUS PIPE

FILE: M-58M.DWG


|                                                            |          |  |       |      |  |                      |      |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-58                 | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      | 1    |

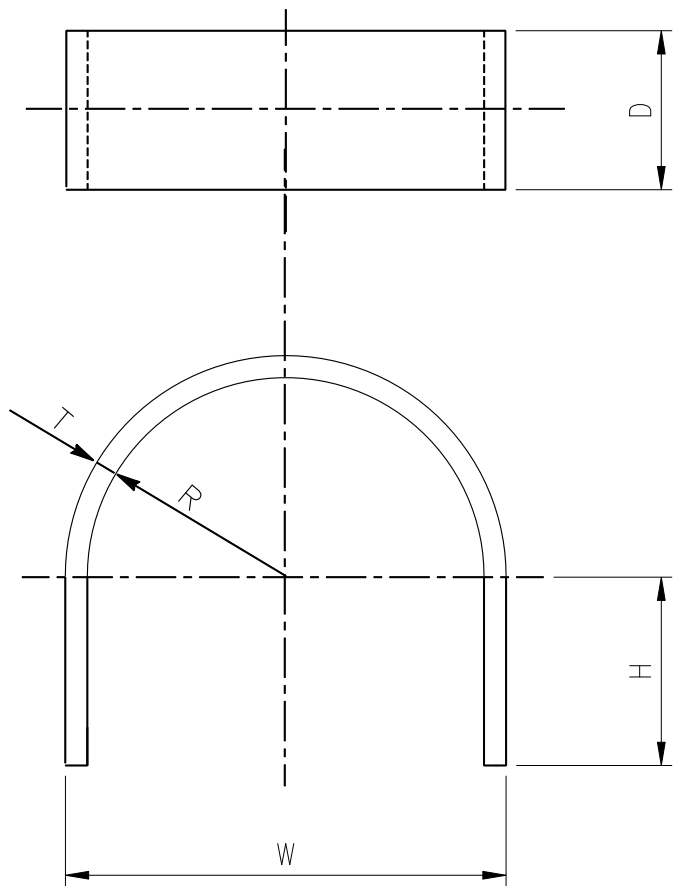

| TYPE     | LINE SIZE | D   | T | G  |
|----------|-----------|-----|---|----|
| BU-A-10B | 10"       | 100 | 6 | 9  |
| BU-A-12B | 12"       | 100 | 6 | 9  |
| BU-A-14B | 14"       | 100 | 6 | 9  |
| BU-A-16B | 16"       | 100 | 6 | 9  |
| BU-A-18B | 18"       | 100 | 6 | 12 |
| BU-A-20B | 20"       | 100 | 6 | 12 |
| BU-A-24B | 24"       | 150 | 9 | 12 |
| BU-A-26B | 26"       | 150 | 9 | 15 |
| BU-A-28B | 28"       | 150 | 9 | 15 |
| BU-A-30B | 30"       | 150 | 9 | 15 |
| BU-A-32B | 32"       | 150 | 9 | 15 |

NOTES:

1. DESIGNATION NUMBER DENOTE AS FOLLOW:

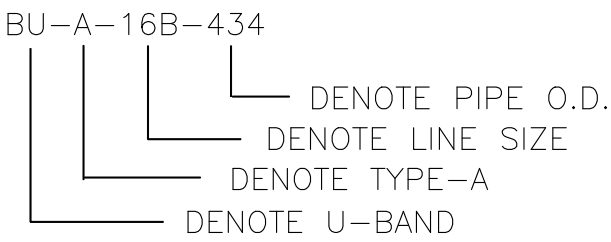

2. MATERIAL:CARBON STEEL GALVANIZED.

3.  $R = \frac{\text{PIPE O.D.}}{2} + G + 3$


$H = R - 3 \text{ mm}$

$W = 2 ( R + T )$

PIPE O.D. : NON-FERROUS PIPE O.D. SHOULD BE REFERRED TO THE MANUFACTURER’S DIMENSIONS.

FILE: M-59M.DWG

|                                                            |          |  |       |      |  |                      |  |
|------------------------------------------------------------|----------|--|-------|------|--|----------------------|--|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD |  |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001   |  |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | M-59                 |  |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                      |  |
| U-BAND<br>TYPE-A                                           |          |  |       |      |  | REV.<br>1            |  |
|                                                            |          |  |       |      |  |                      |  |

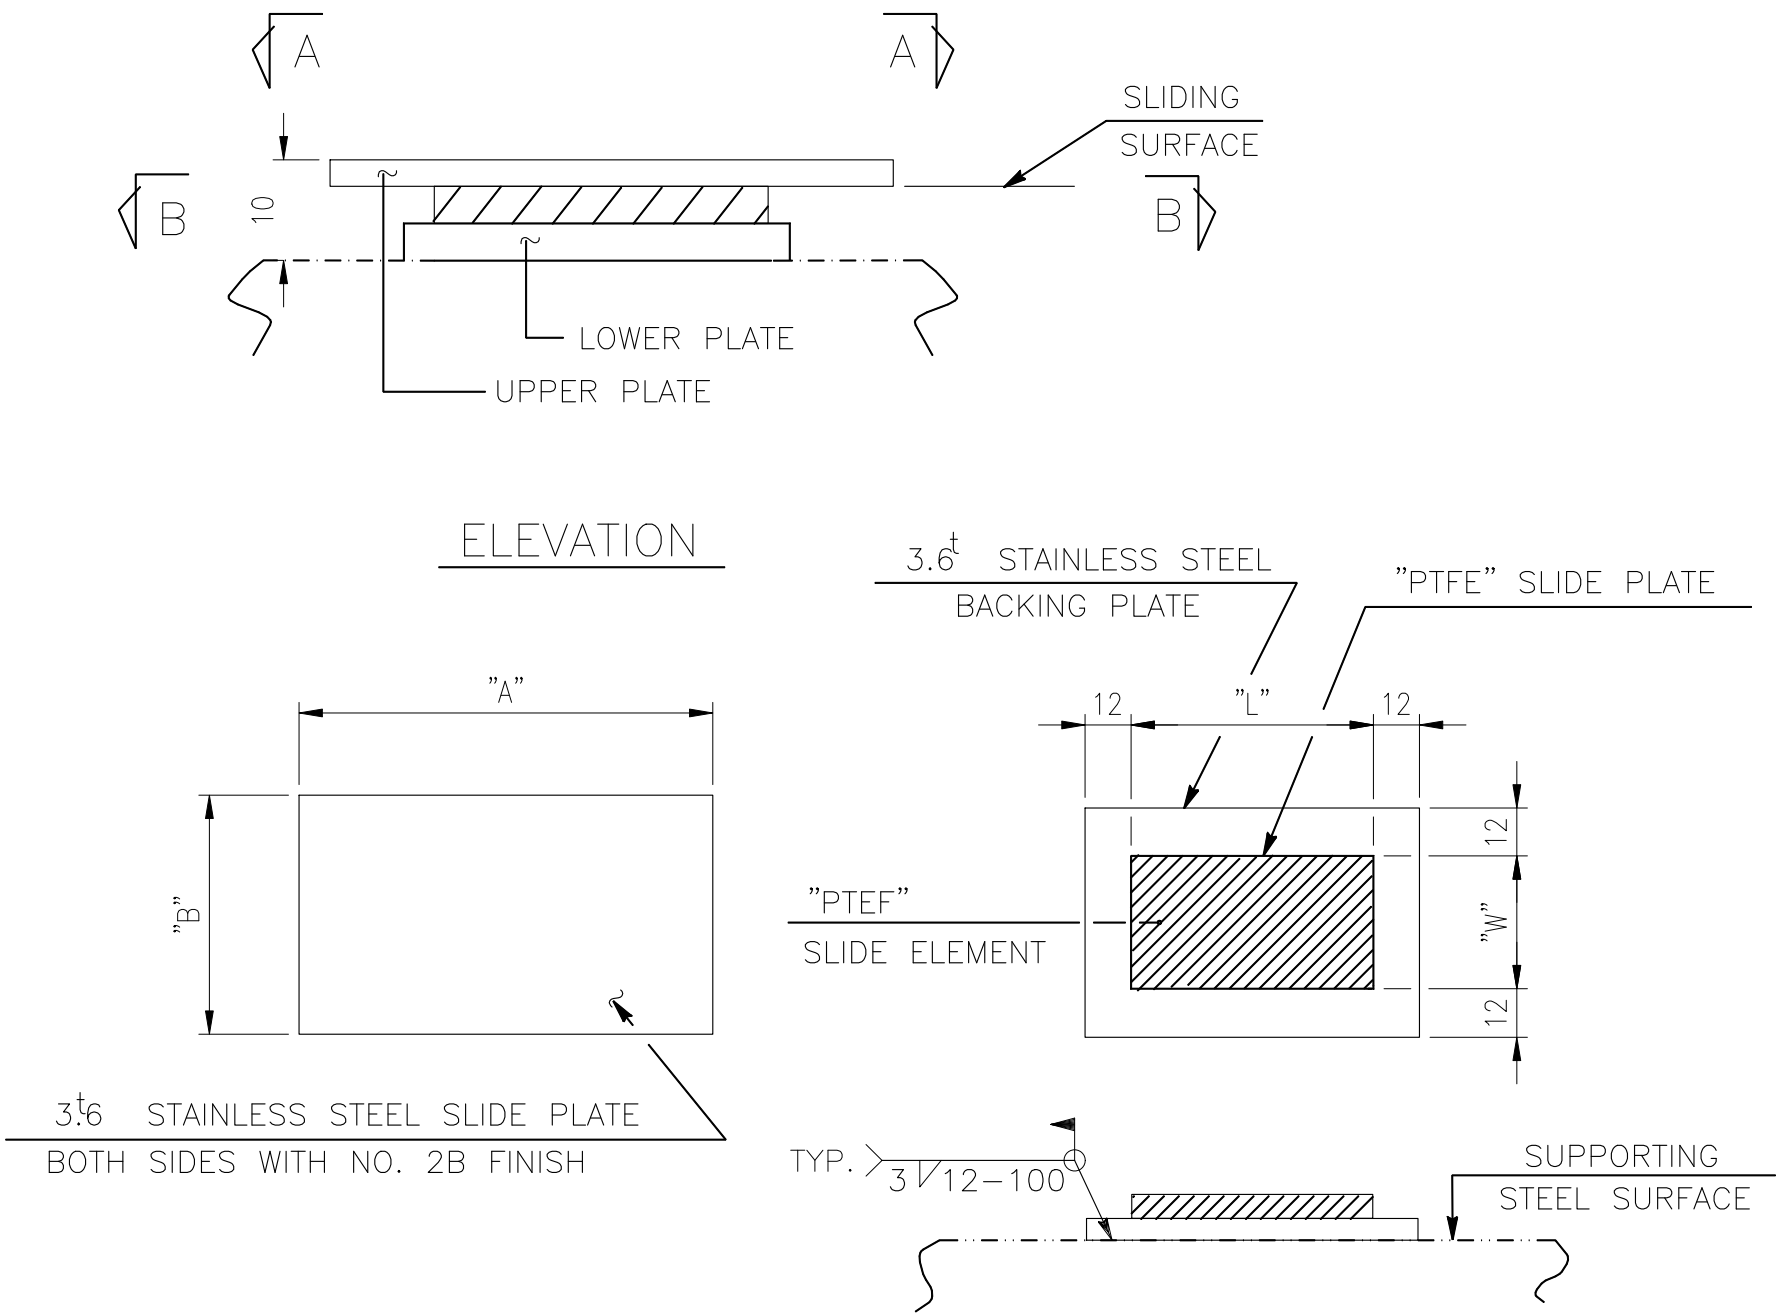

NOTE :

DESIGNATION NUMBER DENOTE AS FOLLOW:

SLP-A-5347-4715

- DENOTE SLIDE PLATES
- DENOTE TYPE-A
- DENOTE UPPER PLATE DIMENSION "A" (IN 10 MM)
- DENOTE UPPER PLATE DIMENSION "B" (IN 10 MM)
- DENOTE LOWER PLATE DIMENSION "L" (IN 10 MM)
- DENOTE LOWER PLATE DIMENSION "W" (IN 10 MM)

FILE: M-60M.DWG

|                                                            |          |  |       |      |  |                       |      |
|------------------------------------------------------------|----------|--|-------|------|--|-----------------------|------|
| 中威工程顧問股份有限公司<br>CHUNG WEI ENGINEERING CONSULTING CO., LTD. |          |  |       |      |  | ENGINEERING STANDARD  |      |
|                                                            |          |  |       |      |  | HP6-DSD-A4-500-001    |      |
| BY                                                         | SHIH     |  | CHK.  | YANG |  | SLIDE PLATE<br>TYPE-A | REV. |
| DATE                                                       | 7/15/'24 |  | APPR. | CHEN |  |                       | 1    |